

WINDERMERE COMMUNITY CENTRE KITCHEN VENTILATION SYSTEM UPGRADES

TOWNSHIP OF MUSKOKA LAKES
2416 WINDERMERE ROAD, WINDERMERE



INDEX

| DRAWING | DESCRIPTION |
|---------|--|
| TP.1 | TITLE PAGE |
| M.1 | MECHANICAL SCHEDULES, LEGEND, SPECIFICATIONS AND DETAILS |
| M.2 | MECHANICAL DEMOLITION AND INSTALLATION LAYOUTS |
| E.1 | ELECTRICAL LEGEND AND DETAILS |
| E.2 | ELECTRICAL BUILDING LAYOUTS |
| E.3 | ELECTRICAL SPECIFICATIONS |

| MECHANICAL LEGEND | |
|--|-----------------|
| DOMESTIC COLD WATER PIPING | ----- |
| DOMESTIC HOT WATER PIPING | ----- |
| DOMESTIC HOT WATER RE--CIRCULATION PIPING | ----- |
| NATURAL GAS PIPING PIPING | ----- |
| SANITARY WASTE PIPING (ABOVE GRADE) | ----- |
| SANITARY WASTE PIPING (BELOW GRADE) | ----- |
| SANITARY VENT | ----- |
| STORM WASTE PIPING (ABOVE GRADE) | ----- |
| STORM WASTE PIPING (BELOW GRADE) | ----- |
| HEATING WATER SUPPLY PIPING | ----- |
| HEATING WATER RETURN PIPING | ----- |
| REFRIGERANT LIQUID PIPING | ----- |
| REFRIGERANT SUCTION PIPING | ----- |
| FUEL OIL SUPPLY | ----- FOS ----- |
| FUEL OIL RETURN | ----- FOR ----- |
| FUEL OIL FILL | ----- FOF ----- |
| FUEL OIL VENT | ----- FOV ----- |
| PIPE UP | ----- O ----- |
| PIPED DOWN | ----- C ----- |
| CONNECT TO EXISTING | ----- C ----- |
| AIR FLOW DIRECTION | ←----- |
| FLEXIBLE DUCT CONNECTOR | ----- ■ ----- |
| EXISTING SERVICES OR EQUIPMENT | ----- [] ----- |
| EXISTING SERVICES OR EQUIPMENT TO BE REMOVED | ----- [] ----- |
| CIRCULATOR | ----- () ----- |
| FLOOR DRAIN C/W TRAP | ----- () ----- |
| SUPPLY DUCT UP/DOWN | ----- [X] ----- |
| RETURN DUCT UP/DOWN | ----- [] ----- |
| EXHAUST DUCT UP/DOWN | ----- [X] ----- |
| ROUND DUCT UP/DOWN | ----- () ----- |
| FIRE DAMPER | FD ----- |
| BALANCING DAMPER | BD ----- |
| MOTORIZED DAMPER | MD ----- |
| FIRE EXTINGUISHER (FE-1), 6--LITER A/K | FE ----- |
| MANUAL PULL STATION | MS ----- |
| THERMOSTAT | TH ----- |
| THERMOSTAT HEATING (DIV. 16) | TH ----- |
| THERMOSTAT VENTILATION (DIV. 16) | TH ----- |
| HUMIDISTAT (DIV. 16) | HI ----- |
| CARBON DIOXIDE SENSOR | CO2 ----- |
| CARBON MONOXIDE SENSOR | CO-1 ----- |
| NITROGEN DIOXIDE SENSOR | NO2-1 ----- |
| CONTROL WIRE (LOW VOLTAGE) | ----- |
| DRAWING REVISION | ----- |
| SYMBOL INDICATES A REVISION, (# DENOTES REVISION NUMBER) | ----- |
| SYMBOL INDICATES MODIFICATION OR NEW WORK | ----- |
| SYMBOL INDICATES NOTE DEMOLITION/ REMOVAL WORK | ----- |
| DETAIL NUMBER | 2 ----- |
| SHEET NUMBER/ DETAIL LOCATION | M.2 ----- |
| TYPE OF DIFFUSER/GRILLE OR (SEE SCHEDULE) | ----- |
| SIZE- IMPERIAL: IN. METRIC: MM | X ----- |
| AIR FLOW- IMPERIAL: CFM, METRIC: L/S | ----- |

| MASTER MECHANICAL LEGEND |
|--|
| ALL SYMBOLS/DEVICES LISTED MAY NOT APPLY |

- GENERAL SPECIFICATIONS:
- REVIEW WORK AREA AND READ DRAWINGS IN CONJUNCTION WITH ALL DISCIPLINES BEFORE COMMENCING WORK. NOTIFY ENGINEER OF ANY DISCREPANCIES BETWEEN PLANS AND POTENTIAL ISSUES ON WORK-SITE. NO ADDITIONAL PAYMENTS WILL BE MADE RELATED TO CLAIMS FOR ITEMS THAT WOULD HAVE BEEN APPARENT IF THE WORK AREA AND ALL PLANS WERE REVIEWED PRIOR TO PRICING THE WORKS.
 - THE GENERAL CONTRACTOR SHALL OBTAIN AND PAY FOR NECESSARY PERMITS PERTAINING TO THE INSTALLATION OF THEIR WORK AND PROVIDE ANY CERTIFICATES AND SIGN-OFFS AS CIRCUMSTANCES REQUIRE.
 - WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST EDITION OF THE ONTARIO BUILDING CODE, ONTARIO FIRE CODE, OCCUPATIONAL HEALTH AND SAFETY ACT, AND AUTHORITIES HAVING JURISDICTION. MATERIALS SHALL CONFORM TO THE LATEST EDITION OF THE CANADIAN STANDARDS ASSOCIATION, AND AUTHORITIES HAVING JURISDICTION. STANDARDS SET OUT IN DESIGN DRAWINGS SHALL NOT BE REDUCED BY CONFORMANCE TO APPLICABLE CODES AND STANDARDS. MAKE ALL MINOR MODIFICATIONS AS REQUIRED BY AUTHORITIES HAVING JURISDICTION AT NO COST TO THE OWNER.
 - SUBMIT ELECTRONIC SHOP DRAWINGS FOR EQUIPMENT LISTED ON THE SCHEDULES FOR REVIEW PRIOR TO ORDERING. REVIEW OF SHOP DRAWINGS DOES NOT RELIEVE THE CONTRACTOR OF THEIR RESPONSIBILITIES TO PROVIDE A COMPLETE WORKING SYSTEM CONSISTENT WITH THE INTENT OF THE DESIGN DRAWINGS. CONTRACTOR SHALL REVIEW DESIGN DRAWINGS, EQUIPMENT SCHEDULES AND SHOP DRAWINGS FOR ERRORS AND OMISSIONS AND ELEMENTS RELATING TO WORKS/ASSEMBLY ON-SITE.
 - AT THE COMPLETION OF THE PROJECT THE CONTRACTOR SHALL PROVIDE MARKED UP RECORD DRAWINGS AND OPERATION AND MAINTENANCE MANUALS. THE FIRST PAGE OF THE OPERATION AND MAINTENANCE MANUAL SHALL BE A TYPE WRITTEN DOCUMENT EXPLAINING THE DETAILED MAINTENANCE REQUIREMENTS AND SCHEDULE FOR THE SYSTEM AND ANY OTHER INFORMATION THAT IS SPECIFIC TO THIS PROJECT. GENERIC OPERATIONS AND MAINTENANCE MANUALS WITH NO PROJECT SPECIFIC INFORMATION WILL NOT BE ACCEPTED.
 - PROVIDE TRAINING FOR THE OPERATOR OR OWNER'S REPRESENTATIVE. PROVIDE COMMISSIONING SERVICES AS REQUIRED.
 - LABEL ALL EQUIPMENT, PIPING, CONDUIT ETC.
 - THE CONTRACTOR IS RESPONSIBLE FOR STORAGE AND SECURITY OF MATERIALS AND EQUIPMENT ON THE JOB SITE.
 - THE OWNER'S PROPERTY MUST BE KEPT IN TIDY CONDITION, PROMPTLY REMOVE GARBAGE FROM THE SITE. CLEAN WORK AREA PRIOR TO ALL INSPECTIONS AND KEEP SITE IN A SAFE CONDITION.
 - DESIGN DRAWINGS ILLUSTRATE THE GENERAL LAYOUT OF THE WORK ONLY. COORDINATE THE INSTALLATION OF WORK WITH OTHER TRADES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROPER LAYOUT OF EQUIPMENT AND MATERIALS AND ENSURING THERE ARE NO INTERFERENCES WITH OTHER SYSTEMS.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR CUTTING AND PATCHING REQUIRED FOR THE INSTALLATION OF THEIR WORK.
 - EQUIPMENT SHALL BE INSTALLED, STARTED, TESTED, AND ADJUSTED AS PER THE MANUFACTURERS' INSTRUCTIONS, AND AS NECESSARY TO ENSURE OPTIMUM PERFORMANCE. EQUIPMENT SHALL BE INSTALLED TO ALLOW FOR EASY ACCESS AND MAINTENANCE.
 - THE CONTRACTOR SHALL GUARANTEE WORK PERFORMED UNDER THIS CONTRACT FOR A PERIOD OF ONE (1) YEAR FROM THE DATE OF SUBSTANTIAL COMPLETION. ENSURE THAT ALL EQUIPMENT IS WARRANTED BY THE MANUFACTURER FOR A MINIMUM OF ONE (1) YEAR FROM THE DATE OF SUBSTANTIAL COMPLETION.
 - MATERIALS AND EQUIPMENT SHALL BE NEW, TOP QUALITY AND SPECIFICATION GRADE, EXCEPT WHERE NOTED OTHERWISE. THIS SPECIFICATION SHALL BE CONSIDERED TO BE THE BASE BID SPECIFICATION AND CONTRACTORS MUST CARRY THE BASE BID MANUFACTURERS IN THEIR QUOTATION, ALTERNATE MANUFACTURERS OF EQUIPMENT CAN ONLY BE OFFERED AS PROPOSED ALTERNATES WITH THE CORRESPONDING PRICE REDUCTIONS PASSED ON TO OWNER.
 - THE CONTRACTOR SHALL NOT WELD TO OR MAKE A HOLE IN A STRUCTURAL MEMBER WITHOUT REVIEW FROM THE STRUCTURAL ENGINEER. ATTACHMENTS TO STRUCTURAL MEMBERS SHALL BE MADE WITH SUITABLE CLAMPS OR CLIPS.
 - THE GENERAL CONTRACTOR SHALL PROVIDE ALL OPENINGS AND REINFORCEMENT FRAMING AS REQUIRED.
 - ALL MATERIALS IN CEILING SPACE USED FOR RETURN AIR PLENUM MUST BE PLENUM RATED.
 - CONFIRM FIRE SEPARATIONS WITH ARCHITECTURAL DRAWINGS AND GENERAL CONTRACTOR. ALL PENETRATIONS THROUGH FIRE SEPARATIONS SHALL BE FITTED WITH EXPANSION SLEEVES AND ULC CERTIFIED FIRE STOPPING. ACCEPTABLE MATERIAL: HILTI OR APPROVED EQUIVALENT.
 - THE OWNER RESERVES THE RIGHT TO MAKE MINOR ALTERATIONS TO THE LOCATION OF EQUIPMENT ETC AT NO ADDITION TO THE CONTRACT AMOUNT.
 - THESE DRAWINGS ARE SCHEMATIC IN NATURE AND INTENDED TO SERVE AS A GUIDE SHOWING QUANTITIES AND GENERAL ARRANGEMENTS AND ARE NOT NECESSARILY WORKING DRAWINGS FROM WHICH MEASUREMENTS CAN BE TAKEN, EXCEPT WHERE DIMENSION FIGURES ARE SPECIFICALLY SHOWN. INFORMATION INVOLVING ACCURATE MEASUREMENTS OF BUILDING SHALL BE TAKEN FROM ARCHITECTURAL BUILDING DRAWINGS OR FROM THE SITE.
 - MAINTAIN ADEQUATE LIABILITY INSURANCE TO PROTECT OWNER AND ALL CONTRACTORS.
 - TEMPORARY LIGHTING AND POWER FOR CONSTRUCTION BY GENERAL CONTRACTOR.
 - ALL EQUIPMENT, PIPING, CONDUIT, WIRING, JUNCTION BOXES, HARDWARE, ETC. INSTALLED IN OPEN CEILING SPACES SHALL BE INSTALLED IN AN INCONSPICUOUS AND AESTHETICALLY PLEASING MANNER UP TO THE SOLE DISCRETION OF THE OWNER AND ENGINEER. ALL EQUIPMENT, PIPING, CONDUIT, WIRING, JUNCTION BOXES, HARDWARE SHALL BE INSTALLED IN CHASES, ABOVE ADJACENT CEILINGS WHERE POSSIBLE.
 - SUITABLE ACCESS DOORS MUST BE PROVIDED WHERE NECESSARY TO ACCESS VALVES, JUNCTION BOXES, CLEAN OUTS, FIRE DAMPERS, AND OTHER EQUIPMENT AND APPURTENANCES. ALL ITEMS REQUIRING ACCESS PANELS ARE NOT NECESSARILY SHOWN, CARRY A REASONABLE COST ALLOWANCE. COORDINATE EXACT LOCATION OF COMPONENTS REQUIRING ACCESS AND SELECT SIZES WHICH ARE SUITABLE FOR MAINTENANCE.
 - FOR GYPSUM WALLS AND CEILINGS IN OCCUPIED AREAS, PROVIDE CONCEALED DOORS WITH 5/8" RECESS TO RECEIVE DRYWALL, ACCEPTABLE MATERIAL: FOR STANDARD CEILINGS AND WALLS ACUDOR DW-5015 OR EQUIVALENT, FOR 90 MINUTE FIRE RATING ACUDOR FW(C)-5015 OR EQUIVALENT; FOR GREATER RATING, CONTACT ENGINEER AND ARCHITECT.
 - FOR GYPSUM, PLASTER, MASONRY OR TILE WALLS AND CEILINGS IN UTILITY AND STORAGE AREAS, PROVIDE UNIVERSAL FLUSH ACCESS DOOR, ACCEPTABLE MATERIAL: FOR STANDARD CEILINGS AND WALLS ACUDOR UF-5000 OR EQUIVALENT, FOR 90 MINUTE FIRE RATING ACUDOR FW-5050, FOR GREATER RATING, CONTACT ENGINEER AND ARCHITECT.
 - PAY FOR AND COORDINATE ALL UTILITY LOCATES AS REQUIRED.
 - PROVIDE WATER--PROOFING OF BUILDING OPENINGS RELATED TO THE WORK OF ALL TRADES.

| HVAC GRILLES SCHEDULE | | | | | |
|-----------------------|--------------|-------------|-------------|-------|--|
| TAG | SERVICE | DESCRIPTION | MAKE | MODEL | ACCESSORIES/REMARKS |
| DG-1 | TRANSFER AIR | DOOR GRILLE | E. H. PRICE | ATG1 | ALUMINUM, SIGHT PROOF, 24"W X 20"H (PROVIDES LOW NOISE LEVELS AT 300CFM) |

| FIRE SUPPRESSION SYSTEM SCHEDULE | | | | |
|---|---------|-----|--|--|
| DESCRIPTION | MODEL | QTY | ACCESSORIES/REMARKS | |
| RESTAURANT COOKING AREA FIRE SUPPRESSION SYSTEM | BUCKEYE | 1 | BFR-10 FIRE SUPPRESSION AGENT CYLINDER, MB-2 CYLINDER MOUNTING BRACKET, BFR-VLV VALVE, BFR-DAK DISCHARGE ADAPTER KIT, BFR-CAP VALVE CAP, SRW2-E-120 SYSTEM RELEASING MODULE (TWO MS-DPDT MICROSWITCHES INCLUDED), SM-120 SOLENOID MONITOR, RPS-M REMOTE MECHANICAL PULL STATION, FLB-1 FUSIBLE LINK BRACKET, BFR-SC-100 SHIELDED CABLE INTERFACE, 2x N-1HP NOZZLE, 2x N-SA SWIVEL NOZZLE ADAPTOR | |

| RANGE HOOD SCHEDULE | | | | | | | | | |
|---------------------|-------|-----------|---------------------------------|---------------------------------|--------|--------------|----------------|------------------|---|
| TAG | MAKE | MODEL | DIMENSIONS (IN) | | | EXHAUST | | | ACCESSORIES/REMARKS |
| | | | LENGTH | WIDTH | HEIGHT | VOLUME (CFM) | E.S.P. (IN WC) | COLLAR SIZE (IN) | |
| RH-1 | BROAN | BCS330WWC | 19- ³ / ₈ | 29- ³ / ₈ | 6 | 240 | 0.12 | 7 | COLOUR: WHITE, C/W GOOSENECK EXHAUST EXCLUDING INTEGRAL BACK DRAFT DAMPER, INSULATED DUCT TO EXTERIOR |
| RH-2 | BROAN | BCS330WWC | 19- ³ / ₈ | 29- ³ / ₈ | 6 | 240 | 0.12 | 7 | COLOUR: WHITE, C/W GOOSENECK EXHAUST EXCLUDING INTEGRAL BACK DRAFT DAMPER, INSULATED DUCT TO EXTERIOR |


- KITCHEN VENTILATION SYSTEM SPECIFICATIONS:
- THE PROPOSED KITCHEN EXHAUST HOOD LAYOUT SHOWN ON THESE DRAWINGS ARE TO ILLUSTRATE THE GENERAL LOCATIONS OF EQUIPMENT; A KITCHEN EXHAUST HOOD AIRFLOW RATE OF 100 CFM MINIMUM, 300 CFM MAXIMUM WAS USED TO ESTABLISH THE EXHAUST FAN AND MAKE-UP AIR SIZING; THIS AIRFLOW RATE SHALL BE CONFIRMED WITH THE FINAL KITCHEN LAYOUT PROVIDED BY THE OWNER. THE CONTRACTOR SHALL PROVIDE A COMPLETE SET OF SHOP DRAWINGS FOR SYSTEM INSTALLATION INCLUDING HOOD, EXHAUST DUCT, APPLIANCES, FIRE DETECTORS, PIPING, NOZZLES, APPLIANCE SHUTOFF DEVICES, FIRE SUPPRESSION AGENT STORAGE CONTAINERS AS WELL AS CONTROLLER, AND MANUAL ACTIVATION DEVICES. SHOP DRAWINGS AND CERTIFICATION THAT INSTALLATION IS IN COMPLIANCE WITH THE TERMS OF THE LISTING AND MANUFACTURER'S INSTRUCTIONS SHALL BE SUBMITTED TO OWNER'S ENGINEER AND AHJ FOR REVIEW. SHOP DRAWINGS TO BE IDENTIFIED AS PRE-ENGINEERED AND UL300 LISTED, OR BE STAMPED BY A PROFESSIONAL ENGINEER.
 - WORK MUST BE PERFORMED IN ACCORDANCE WITH THE LATEST EDITION OF THE ONTARIO ELECTRICAL SAFETY CODE, ONTARIO BUILDING CODE, ONTARIO FIRE CODE, OCCUPATIONAL HEALTH AND SAFETY ACT, AND LOCAL CODES.
 - HOODS SHALL BE SIZED TO MATCH THE WIDTH OF THE KITCHEN RANGE.
 - PROVIDE MESH FILTER IN HOOD.
 - PROVIDE DUCTWORK WITH SLOPE BACK TO THE KITCHEN HOOD, DO NOT INSTALL WITH DIPS OR TRAPS, DO NOT TIE IN WITH ANY OTHER DUCTWORK SYSTEMS.
 - PROVIDE ALL DUCT SUPPORT HARDWARE, JOINTS (TELESCOPING AND BELL JOINTS) ETC.
 - PROVIDE SUITABLE WEATHER PROTECTIVE COATING ON ALL DUCTWORK ON EXTERIOR OF BUILDING.
 - LIGHTING UNITS IN HOODS SHALL BE LISTED FOR USE IN COOKING APPLICATIONS AND SHALL BE WIRED THROUGH KITCHEN HOOD CONTROL PANEL.
 - PROVIDE READILY ACCESSIBLE MEANS OF MANUAL ACTIVATION LOCATED AT 48" (1.2m) AFF. DEVICE SHALL BE INDEPENDENT OF AUTOMATIC ACTIVATION AND SHALL BE FULLY MECHANICAL. POST INSTRUCTIONS FOR MANUAL OPERATION OF FIRE EXTINGUISHING SYSTEM IN CONSPICUOUS LOCATION IN KITCHEN.
 - PROVIDE K-CLASS PORTABLE FIRE EXTINGUISHER IN COOKING AREAS TO NFPA 10.
 - AUTOMATIC FIRE EXTINGUISHING SYSTEMS SHALL COMPLY WITH UL300 AND NFPA 12, NFPA 13, NFPA 17, NFPA 17A.
 - INSTALLATION AND CLEARANCES OF ALL KITCHEN COOKING APPLIANCES SHALL BE TO MANUFACTURER'S RECOMMENDATIONS.
 - PROVIDE SHUNT TRIP BREAKERS FOR ALL ELECTRICAL COOKING APPLIANCES.
 - WHERE OCCUPANCY IS PROTECTED BY FIRE ALARM SYSTEM, PROVIDE SUPERVISORY EQUIPMENT/SIGNAL TO FIRE ALARM SYSTEM WHERE ELECTRICAL POWER IS REQUIRED TO OPERATE AUTOMATIC FIRE EXTINGUISHING SYSTEM.
 - VENTILATION NORMAL OPERATION.
 - UPON VENTILATION SYSTEM START SIGNAL FROM THE KITCHEN HOOD MANUFACTURER SUPPLIED SWITCH, THE INTERNAL EXHAUST FAN SHALL TURN ON.
 - UPON VENTILATION SYSTEM STOP SIGNAL FROM THE KITCHEN HOOD MANUFACTURER SUPPLIED SWITCH, THE INTERNAL EXHAUST FAN SHALL TURN OFF.
 - UPON ACTIVATION OF FIRE EXTINGUISHING SYSTEM THE FOLLOWING SEQUENCE OF OPERATION SHALL OCCUR:
 - ALL SOURCES OF FUEL AND POWER SHALL BE AUTOMATICALLY SHUT OFF TO THE RANGE. ALL SHUTOFF DEVICES SHALL REQUIRE A MANUAL RESET.
 - AUDIBLE AND/OR VISUAL ALARM SHALL BE ACTIVATED.
 - WHERE OCCUPANCY IS PROTECTED BY FIRE ALARM SYSTEM, ACTIVATION SHALL TRIGGER FIRE ALARM SYSTEM BY MEANS OF MICRO-SWITCH.
 - EF-1 SHALL STAY RUNNING AFTER EXTINGUISHING SYSTEM HAS BEEN ACTIVATED UNLESS FAN SHUTDOWN IS REQUIRED BY A LISTED COMPONENT IN THE AUTOMATIC FIRE EXTINGUISHING SYSTEM.
 - ELECTRICAL POWER TO BOTH ELECTRICAL COOKING APPLIANCES SHALL BE TURNED OFF VIA A SHUNT TRIPPER FROM THE FIRE SUPPRESSION CONTROLLER.

HVAC SPECIFICATIONS


- DUCTS SHALL BE FABRICATED AND INSTALLED IN ACCORDANCE WITH THE LATEST EDITION OF THE ONTARIO BUILDING CODE, ONTARIO FIRE CODE, AND THE ASHRAE AND SMACNA STANDARDS.
- AIR DISTRIBUTION SYSTEMS MUST BE BALANCED TO WITHIN 5% OF THE SPECIFIED VALUES SHOWN ON THE DRAWINGS. BALANCE AIR HANDLING UNITS PROVIDING VENTILATION TO THE VENTILATION LEVELS SHOWN. THE BALANCING MUST BE PERFORMED BY AN INDEPENDENT, NEBB CERTIFIED FIRM, SPECIALIZING IN THIS WORK. THE MECHANICAL CONTRACTOR SHALL TURN OVER THE BALANCING REPORT PRIOR TO SUBSTANTIAL COMPLETION BEING AWARDED.
- VOLUME DAMPERS MUST BE INSTALLED IN THE AIR DISTRIBUTION SYSTEMS AS SHOWN ON THE DRAWINGS AND AS NECESSARY TO ALLOW PROPER BALANCING.
- DUCTS MUST BE SEALED TO PREVENT AIR LEAKAGE. SEAL TO SMACNA AND ASHRAE 90.1 STANDARDS. FOR UNPAINTED DUCTS INSTALLED IN VISIBLE SPACES, THE DUCT MASTIC IS TO BE APPLIED TO THE INTERIOR OF DUCT JOINTS AND PENETRATIONS AND SHALL NOT BE VISIBLE FROM THE EXTERIOR. MASTIC MAY BE APPLIED TO THE EXTERIOR OF DUCTS ONLY IN AREAS WHERE IT IS NOT VISIBLE TO OCCUPANTS. EXPOSED MASTIC SHALL BE PAINTABLE AND IS TO BE APPLIED NEATLY WITH THE EXCESS REMOVED. REFER TO ARCHITECT'S DRAWINGS TO CONFIRM WHETHER OR NOT DUCTS ARE TO BE PAINTED.
- FIRE DAMPERS MUST HAVE A FIRE PROTECTION RATING IN ACCORDANCE WITH THE NFPA AND MUST BEAR THE ULC LABEL. USE DYNAMIC AND TYPE 'B' FIRE DAMPERS ONLY.
- INSTALL FOIL BACKED VAPOUR RETARDANT FIBERGLASS INSULATION WITH JOINTS AND SEAMS SEALED WITH 3" FOIL TAPE ON DUCTS ACCORDING TO THE INSTALLED LOCATION:
 - R-8 INSULATION ON THE NEW EXHAUST DUCT LOCATED IN THE ATTIC SPACE.
- DUCT SIZES ARE SHOWN IN INCHES AND DO NOT INCLUDE FOR INTERNAL INSULATION.
- PIPES AND EQUIPMENT MUST BE INSTALLED SO AS TO MINIMIZE THE TRANSFER OF VIBRATION TO THE BUILDING AND ALSO TO ALLOW FOR EXPANSION AND CONTRACTION AS NECESSARY.
- EQUIPMENT SHALL BE ASHRAE 90.1 COMPLIANT.
- LINE VOLTAGE STARTERS, CONTROLS AND EQUIPMENT SAFETY SWITCHES SHALL BE SUPPLIED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR UNLESS OTHERWISE NOTED ON THE ELECTRICAL DESIGN DRAWINGS. LOW VOLTAGE STARTERS AND CONTROLS SHALL BE SUPPLIED AND INSTALLED BY MECHANICAL CONTRACTOR.
- ELECTRICAL WIRING, CONDUIT, JUNCTION BOXES, BACK BOXES, MOUNTING HARDWARE ETC. ABOVE 24V TO BE SUPPLIED AND INSTALLED BY ELECTRICAL CONTRACTOR. CONTROLS WIRING, CONDUIT, JUNCTION BOXES, BACK BOXES, MOUNTING HARDWARE ETC. 24V AND BELOW TO BE INSTALLED BY MECHANICAL CONTRACTOR (MECHANICAL CONTRACTOR MAY SUB-CONTRACT THIS WORK TO ELECTRICAL CONTRACTOR).
- THERMOSTATS AND CONTROLLERS INTENDED TO BE OPERATED BY THE OCCUPANT AND LOCATED IN A BARRIER-FREE PATH OF TRAVEL. SHALL BE MOUNTED 4FT (1200MM) ABOVE THE FINISHED FLOOR.
- THE MECHANICAL CONTRACTOR SHALL INSTALL PIPE WITH SLEEVES IN ORDER TO PREVENT CONTACT WITH CONCRETE, MASONRY OR SIMILAR MATERIALS.
- ROOF CURBS AND FLASHINGS ARE TO BE SUPPLIED BY THE MECHANICAL CONTRACTOR, INSTALLED BY THE GENERAL CONTRACTOR/ROOFER.
- ALL EQUIPMENT SHALL BE INSTALLED IN SUCH A MANNER THAT MANUFACTURER'S RECOMMENDED CLEARANCES ARE MAINTAINED. THE CONTRACTOR SHALL LAY OUT THE WORK BASED ON THE MANUFACTURER'S RECOMMENDED CLEARANCES AND ADVISE ENGINEER IMMEDIATELY IF ANY SITE CONDITIONS NEGATIVELY AFFECT THE PROPER INSTALLATION OF ALL EQUIPMENT.
- ALL DOOR UNDERCUTS INDICATED SHALL BE MIN 3/4". COORDINATE WITH GENERAL CONTRACTOR.
- THIS CONTRACTOR SHALL REVIEW AND CONFIRM ALL EXISTING INDOOR METALLIC PIPING SYSTEMS ARE BONDED. PROVIDE BONDING FOR ALL NEW INDOOR METALLIC PIPING SYSTEMS AND EXISTING SYSTEMS WITHOUT PROPER BOND. BONDING SHALL BE INSTALLED TO THE REQUIREMENTS OF DESC 10-406. THE GENERAL CONTRACTOR SHALL DETERMINE IF BONDING IS BY MECHANICAL OR ELECTRICAL.
- CLEAN ALL EXISTING GRILLES AND DIFFUSERS WHICH ARE SHOWN TO REMAIN.
- DUCTWORK CONNECTIONS TO OUTDOOR AIR HANDLING UNITS WITH HORIZONTAL DISCHARGE SHALL BE EQUIPPED WITH WEATHER-TIGHT GASKETS AND FLASHING SHALL BE PROVIDED.

KITCHEN VENTILATION SYSTEM FIRE SUPPRESSION SCHEMATIC NOTES:

- REFER TO SPECIFICATIONS ON DRAWING M1 FOR SEQUENCE OF OPERATIONS.
- DETAILED DESIGN BY SUPPLIER/CONTRACTOR. SUBMIT SHOP DRAWINGS FOR REVIEW BY ENGINEER PER SPECIFICATION DRAWING M1.
- SCHEMATIC IS GENERAL ONLY. REFER TO MANUFACTURER'S INSTALLATION MANUAL FOR DETAILED WIRING INFORMATION.
- PROVIDE FACTORY PRE-PIPED NOZZLES FOR WET CHEMICAL FIRE SUPPRESSION SYSTEM CONFORMING TO NFPA 96, NFPA 17A, ULC 1254 AND AHJ REQUIREMENTS.

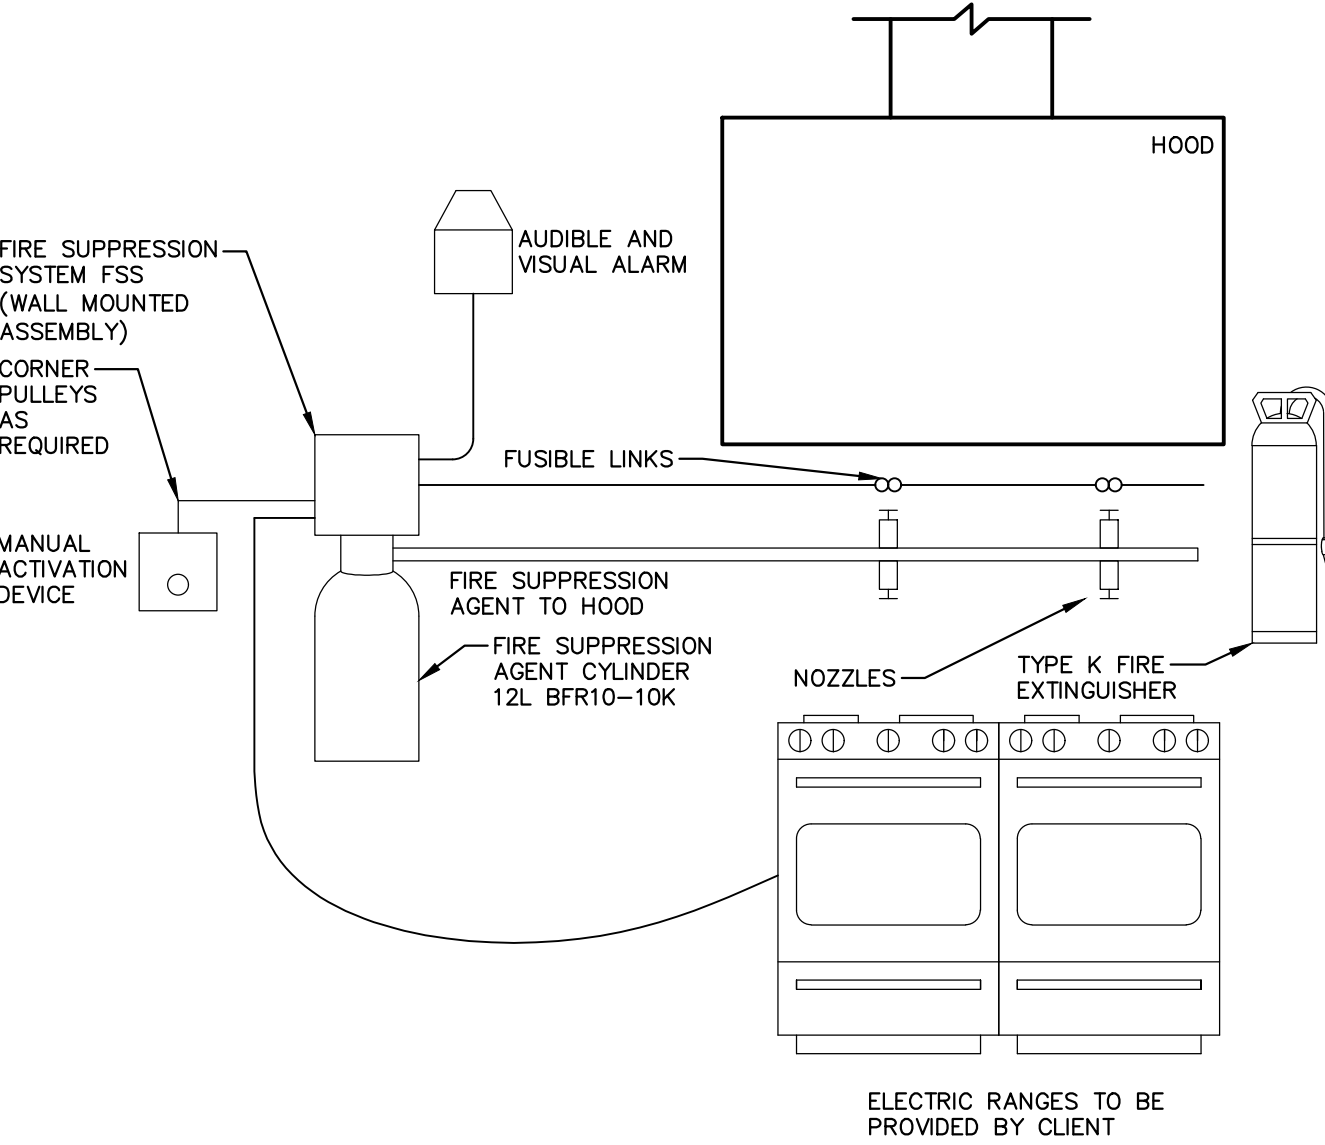


KITCHEN VENTILATION FIRE SUPPRESSION SCHEMATIC
1/4" = 1'-0" NTS

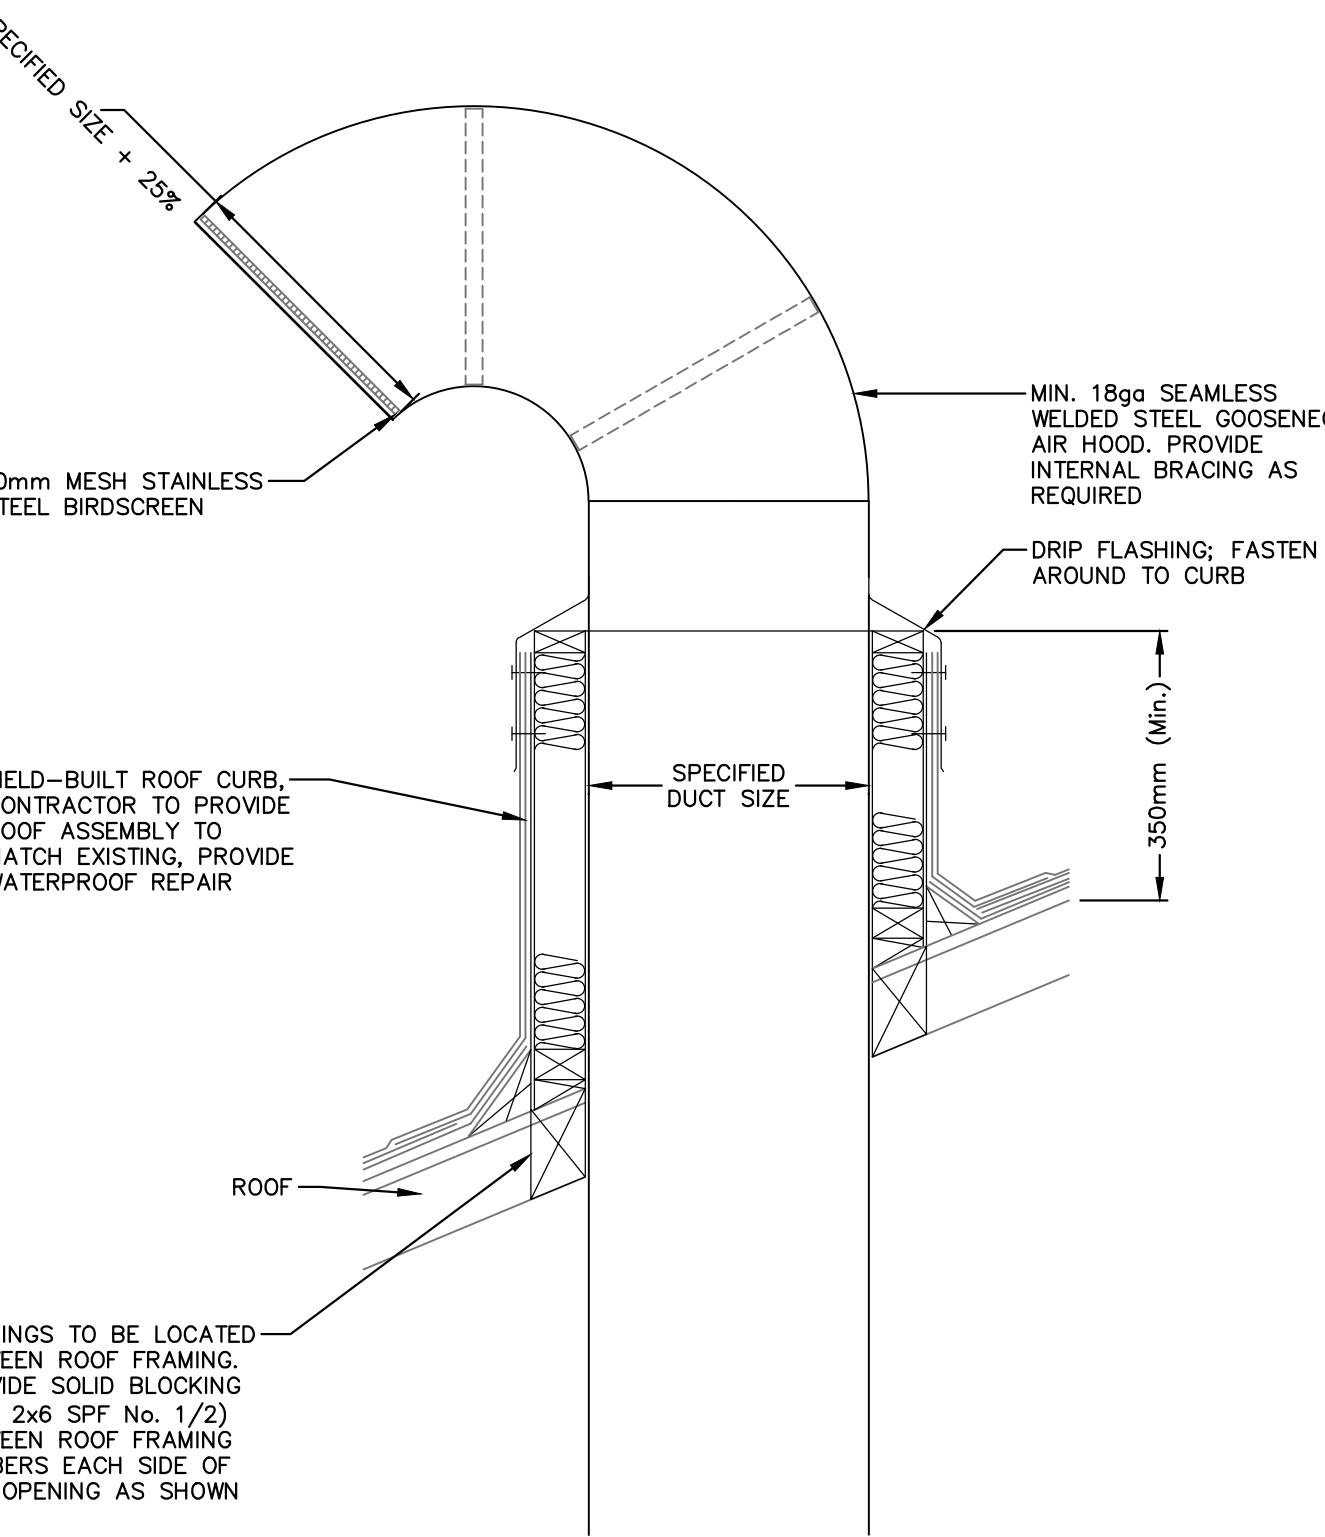


GOOSENECK EXHAUST SCHEMATIC
1/4" = 1'-0" NTS


| DISCLAIMER AND COPYRIGHT | BENCHMARKS | NOTES | No. | REVISION DESCRIPTION | DATE | ENGINEER STAMP | WINDERMERE COMMUNITY CENTRE TOWNSHIP OF MUSKOKA LAKES | TATHAM ENGINEERING | | |
|---|------------|-------|-----|----------------------|--------------------------|----------------|--|--------------------|-----------------|----------|
| | | | | 1. | ISSUED FOR CLIENT REVIEW | JUNE/2025 | | | | |
| | | | | 2. | ISSUED FOR TENDER | JULY/2025 | | | | |
| | | | | | | | | | | |
| TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED. | | | | | | | MECHANICAL SCHEDULES, LEGEND, SPECIFICATIONS, AND DETAILS | DESIGN: AB/MCG/JT | FILE: 225023 | DWG: M.1 |
| | | | | | | | | DRAWN: AB/MCG | DATE: MAY 2025 | |
| | | | | | | | | CHECK: JT | SCALE: AS SHOWN | |
| | | | | | | | | | | |

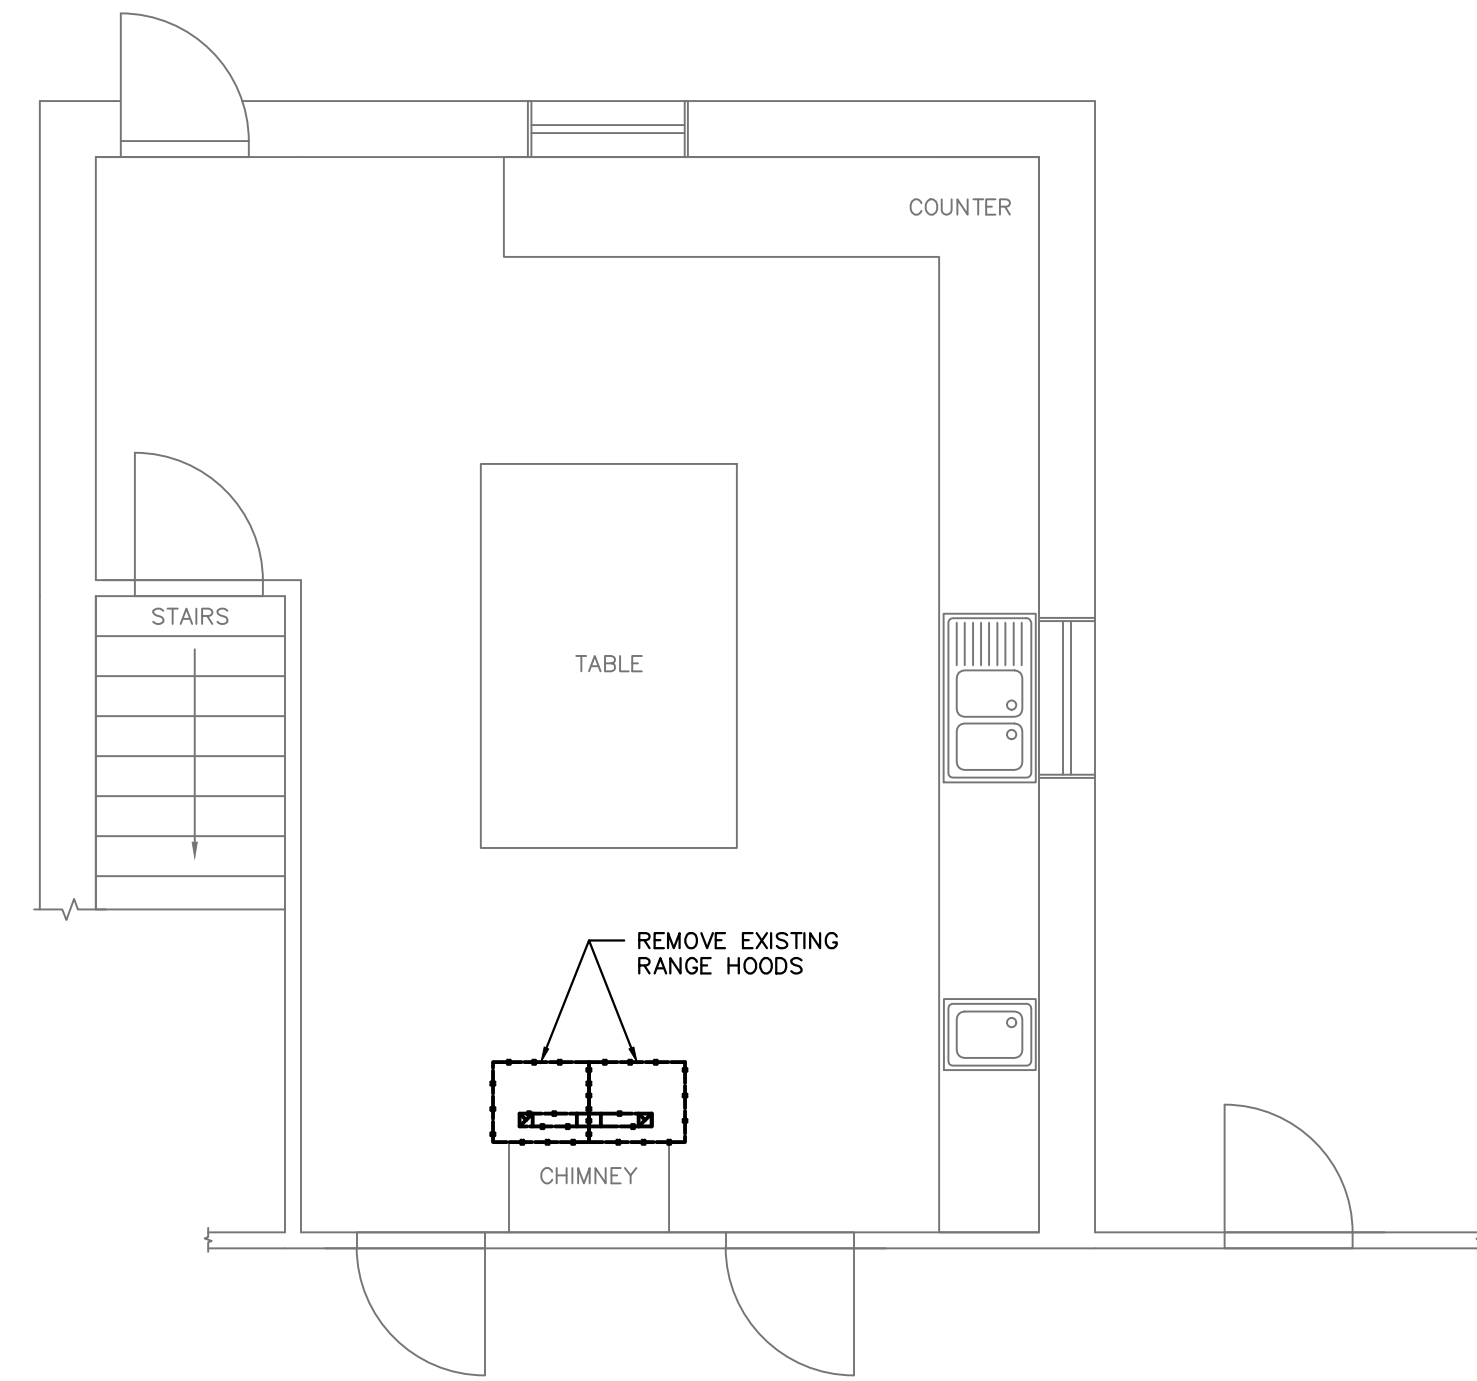


1
M.2
KITCHEN DEMOLITION FLOOR PLAN LAYOUT
— SCALE: 1/4"=1'-0"

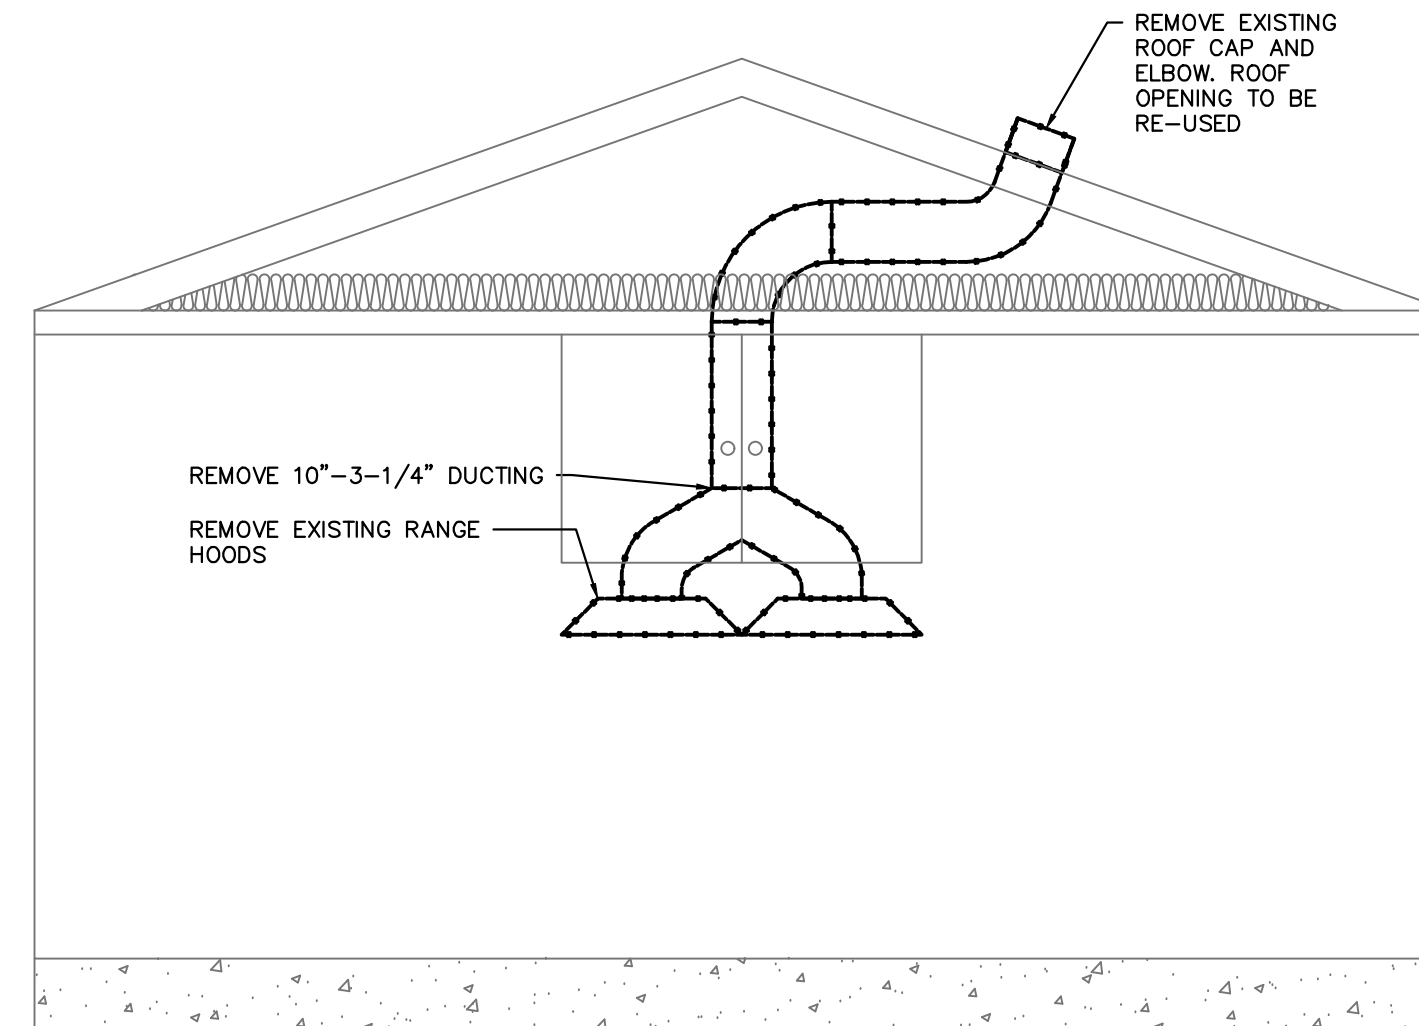

2
M.2
KITCHEN DEMOLITION ELEVATION DETAIL
— SCALE: 3/8"=1'-0"

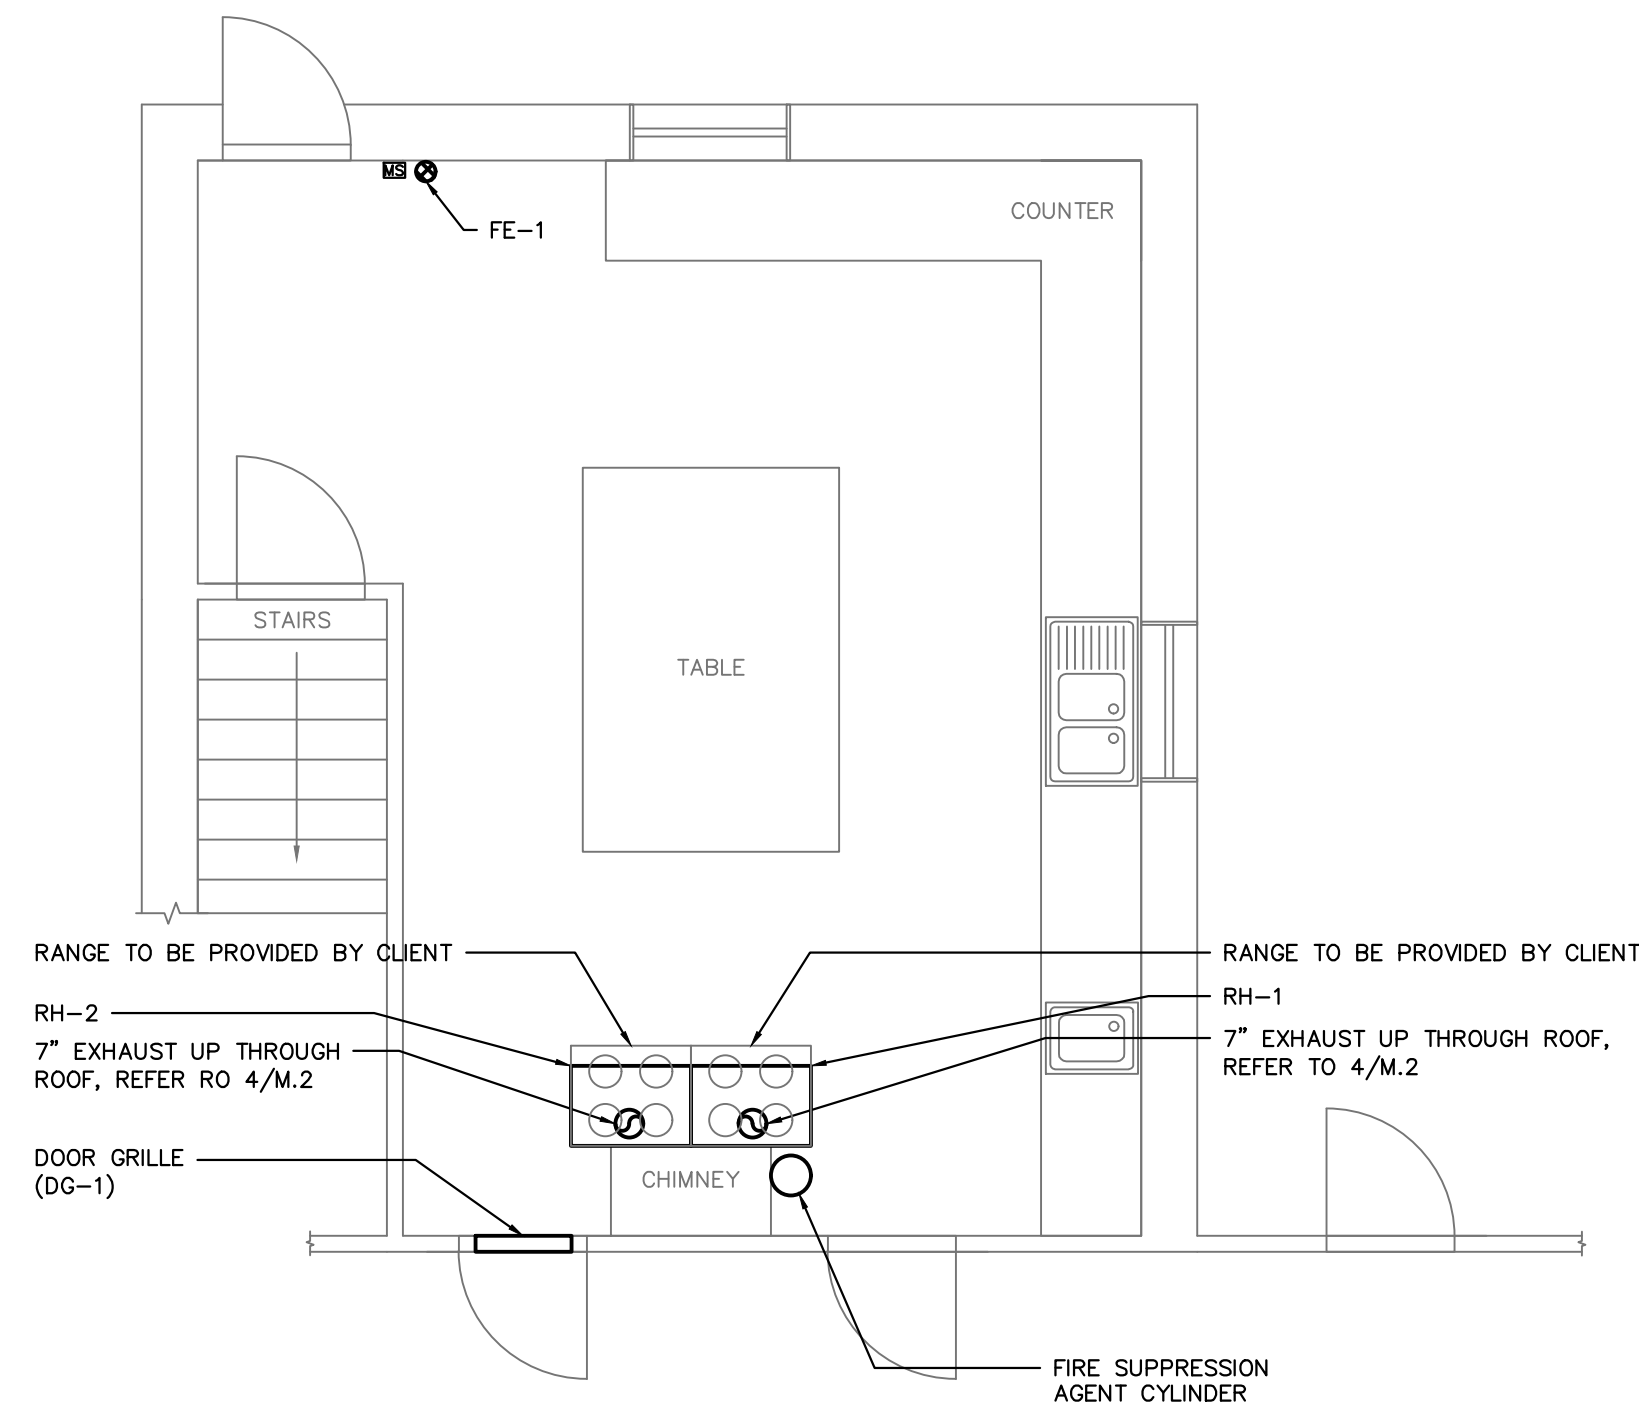

3
M.2
KITCHEN INSTALLATION FLOOR PLAN LAYOUT
— SCALE: 1/4"=1'-0"

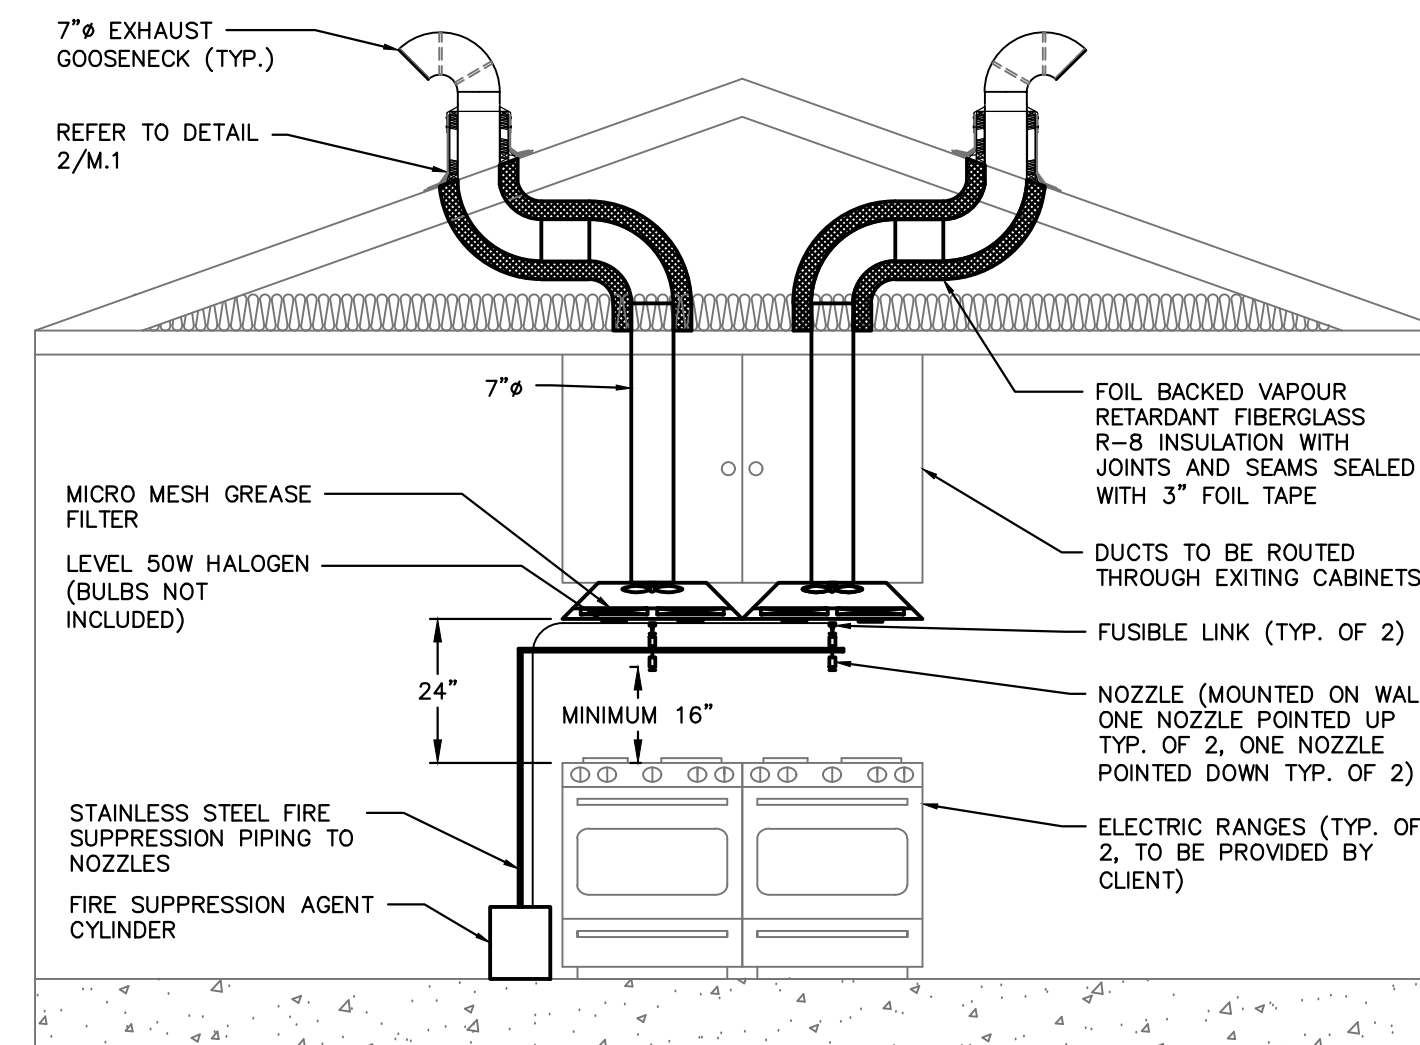

4
M.2
KITCHEN INSTALLATION ELEVATION DETAIL
— SCALE: 3/8"=1'-0"

DISCLAIMER AND COPYRIGHT

CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED.

TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.

BENCHMARKS

NOTES

| No. | REVISION DESCRIPTION | DATE |
|-----|--------------------------|-----------|
| 1. | ISSUED FOR CLIENT REVIEW | JUNE/2025 |
| 2. | ISSUED FOR TENDER | JULY/2025 |
| | | |
| | | |
| | | |

ENGINEER STAMP



WINDERMERE COMMUNITY CENTRE TOWNSHIP OF MUSKOKA LAKES

MECHANICAL DEMOLITION AND INSTALLATION LAYOUTS




| | | |
|-------------------|-----------------|----------|
| DESIGN: AB/MCG/JT | FILE: 225023 | DWG: M.2 |
| DRAWN: AB/MCG | DATE: MAY 2025 | |
| CHECK: JT | SCALE: AS SHOWN | |

| SINGLE LINE SYMBOLS AND CONTROL DIAGRAMS | |
|--|--|
| SYMBOL | DESCRIPTION |
| | CIRCUIT BREAKER, MOULDED CASE WITH THERMAL & MAGNETIC TRIPS |
| | MOTOR CIRCUIT PROTECTOR (MCP) STYLE BREAKER, WITH MAGNETIC TRIPS ONLY |
| | NEMA SIZE 1 STARTER WITH THERMAL OVERLOAD TRIP |
| | VARIABLE FREQUENCY DRIVE, C/W BYPASS MOTOR STARTER/CONTACTOR AND CONTROL TRANSFORMER |
| | CURRENT TRANSFORMER |
| | CAPACITOR |
| | CONTROL POWER TRANSFORMER (CPT) |
| | FUSE |
| | FUSIBLE DISCONNECT SWITCH |
| | NON-FUSIBLE DISCONNECT SWITCH |
| | DRY-TYPE POWER TRANSFORMER (INDOOR) |
| | OIL-FILLED POWER TRANSFORMER (OUTDOOR) |
| | SEAL (EYS) FITTING C/W CHICO POWDER |
| | MOTOR STARTER (MS) COIL, WITH COIL SUPPRESSOR |
| | PILOT LIGHT, WHERE "X" INDICATES LENS COLOR: R=RED, W=WHITE, G=GREEN |
| | PUSH TO TEST STYLE PILOT LIGHT |
| | ELAPSE TIME METER, IN HOURS |
| | CONTROL RELAY (# DENOTES RELAY NUMBER) |
| | TERMINAL BLOCK |
| | SOLENOID VALVE |
| | CONTACT, N.O. AND N.C. |
| | TEMPERATURE SWITCH, N.O AND N.C. |
| | LIMIT OR POSITION SWITCH, N.O AND N.C. |
| | PRESSURE SWITCH, N.O AND N.C. |
| | LEVEL OR FLOAT SWITCH, N.O AND N.C. |
| | TORQUE SWITCH, N.O AND N.C. |
| | PUSHBUTTON DEVICE, N.O AND N.C. |
| | SELECTOR SWITCH, 2-POSITION & 3-POSITION |

| LIGHTING AND POWER ELECTRICAL SYMBOLS | |
|---------------------------------------|---|
| SYMBOL | DESCRIPTION |
| | 1'x4' FLUORESCENT LUMINAIRE. "X" DENOTES LUMINAIRE TYPE (REFER TO LUMINAIRE SCHEDULE). |
| | DENOTES SWITCH LEG |
| | DENOTES BRANCH CIRCUIT NUMBER |
| | DENOTES PANEL DESIGNATION |
| | 2'x4' FLUORESCENT LUMINAIRE. "X" DENOTES LUMINAIRE TYPE (REFER TO LUMINAIRE SCHEDULE) |
| | CEILING MOUNTED LUMINAIRE - "x" DENOTES TYPE |
| | WALL MOUNTED LUMINAIRE - "x" DENOTES TYPE |
| | EXIT LIGHT - "x" DENOTES TYPE |
| | LIGHT SWITCH C/W BACK BOX: - "S" INDICATES 2-WIRE SWITCH - "S3" INDICATES 3-WIRE SWITCH - "S4" INDICATES 4-WIRE SWITCH - "D" INDICATES DIMMER (SIZE TO SUIT) - "T" INDICATES MANUAL TIMER - "M" INDICATES MOTION DETECTOR |
| | EMERGENCY REMOTE HEADS |
| | EMERGENCY BATTERY UNIT WITH REMOTE HEADS AND CHARGER (BU#) |
| | EXPLOSION PROOF - CLASS 1 DIV. 1&2 |
| | ELECTRICAL PANEL/ENCLOSURE |
| | DUPLEX RECEPTACLE |
| | SINGLE RECEPTACLE |
| | GFI TYPE DUPLEX RECEPTACLE |
| | SPLIT DUPLEX RECEPTACLE |
| | DRYER RECEPTACLE |
| | HARD WIRED CONNECTION |
| | SINGLE PHASE MOTOR |
| | THREE PHASE MOTOR |
| | SINGLE PHASE MANUAL STARTER SWITCH WITH LOCK-OFF AND PILOT LIGHT |
| | MANUAL STARTER SWITCH C/W PILOT LIGHT AND HAND/OFF/AUTO SELECTOR SWITCH |
| | CONTROL STATION OR PANEL |
| | DISCONNECT SWITCH, UN-FUSED, # DENOTES NUMBER OF POLES |
| | UNAUTHORIZED ENTRY KEYPAD UNIT |
| | MAGNETIC REED DOOR SWITCH |
| | MOTION SENSOR |
| | SMOKE DETECTOR |
| | TELEPHONE OUTLET |
| | DATA OUTLET |
| | JUNCTION BOX |
| | THERMOSTAT (VENTILATION) |
| | THERMOSTAT |

| GENERAL SYMBOLS | |
|-----------------|---|
| | DETAIL SYMBOL: X = DETAIL NUMBER YZ = DRAWING NUMBER |
| | EQUIPMENT SUPPLIED BY ANOTHER DIVISION, INSTALLATION, WIRING AND CONDUIT BY DIVISION 16 |
| | EXISTING OR RELOCATED EQUIPMENT, NEW WIRING AND CONDUIT BY DIVISION 16 |
| | SYMBOL INDICATES A REVISION, (# DENOTES REVISION NUMBER) |
| | SYMBOL INDICATES MODIFICATION OR NEW WORK NOTE (# DENOTES NOTE NUMBER) |
| | SYMBOL INDICATES A REMOVAL NOTE (# DENOTES NOTE NUMBER) |

| STANDARD ABBREVIATIONS - ELECTRICAL | |
|-------------------------------------|---|
| ABBREVIATION | DESCRIPTION |
| A | AMPERES (CONTINUOUS) |
| AC | ALTERNATING CURRENT |
| ASYM | ASYMMETRICAL |
| ATS | AUTOMATIC TRANSFER SWITCH |
| AUTO | AUTOMATIC |
| AWG | AMERICAN WIRE GAUGE |
| BU | BATTERY UNIT (EMERGENCY) |
| °C | DEGREE CELSIUS |
| C | CONDUCTOR |
| CCT | CIRCUIT |
| CL | CENTERLINE |
| C/W | COMPLETE WITH |
| CPT | CONTROL POWER TRANSFORMER |
| CSA | CANADIAN STANDARDS ASSOCIATION |
| CT | CURRENT TRANSFORMER |
| Cu | COPPER |
| DC | DIRECT CURRENT |
| DISC | DISCONNECT |
| DPDT | DOUBLE POLE DOUBLE THROW |
| DPST | DOUBLE POLE SINGLE THROW |
| EEMAC | ELECTRICAL AND ELECTRONIC MANUFACTURERS ASSOCIATION OF CANADA |
| EP | EXPLOSION PROOF (SEE "CLASSIFICATION SUMMARY") |
| ETM | ELAPSED TIME METER |
| ESA | ELECTRICAL SAFETY AUTHORITY |
| GFI | GROUND FAULT INTERRUPTER |
| GND | GROUND |
| HOA | HAND-OFF-AUTOMATIC |
| HP | HORSEPOWER |
| Hz | HERTZ |
| IEEE | INSTITUTE OF ELECTRICAL & ELECTRONIC ENGINEERS |
| INST | INSTANTANEOUS |
| I/O | INPUT/OUTPUT |
| ISB | INTRINSIC SAFETY BARRIER |
| JB | JUNCTION BOX |
| KAIC | KILO-AMP INTERRUPTING CAPACITY |
| kVA | KILOVOLTAMPERE |
| kW | KILOWATT |
| kWh | KILOWATT HOUR |
| kV | KILOVOLT |
| LA | LIGHTNING ARRESTOR |
| LOR | LOCAL-OFF-REMOTE |
| LUC | LOCAL UTILITY COMPANY |
| MAN | MANUAL |
| MCC | MOTOR CONTROL CENTRE |
| MH | MANHOLE |
| mm | MILLIMETER |
| MOT | MOTOR |
| N | NEUTRAL |
| NEMA | NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION |
| N/A | NON AUTOMATIC |
| N.O. | NORMALLY OPEN |
| N.C. | NORMALLY CLOSED |
| NP | NAMEPLATE |
| NTS | NOT TO SCALE |
| OESC | ONTARIO ELECTRICAL SAFETY CODE |
| O/H | OVERHEAD |
| O/L | OVERLOAD |
| OO | ON-OFF |
| PB | PUSHBUTTON |
| PDC | POWER DISTRIBUTION CENTRE |
| PH. OR Ø | PHASE OR DIAMETER |
| PLC | PROGRAMMABLE LOGIC CONTROLLER |
| REM | REMOTE |
| RGS | RIGID GALVANIZED STEEL |
| RPVC | RIGID PVC CONDUIT |
| SN | SOLID NEUTRAL |
| SPDT | SINGLE POLE DOUBLE THROW |
| SPMDD | STANDARD PROCTOR MAXIMUM DRY DENSITY |
| SPST | SINGLE POLE SINGLE THROW |
| SS | STAINLESS STEEL |
| SW | SWITCH |
| SYM | SYMMETRICAL |
| TDC | TIME DELAY ON CLOSING |
| TDDO | TIME DELAY ON DROP-OUT (OR OFF TIMER) |
| TDO | TIME DELAY ON OPENING |
| TDPU | TIME DELAY ON PICK-UP |
| TYP. | TYPICAL |
| U/G | UNDERGROUND |
| VA | VOLT-AMPERE |
| VFD | VARIABLE FREQUENCY DRIVE |
| WP | WEATHERPROOF |
| 316SS | 316 STAINLESS STEEL |

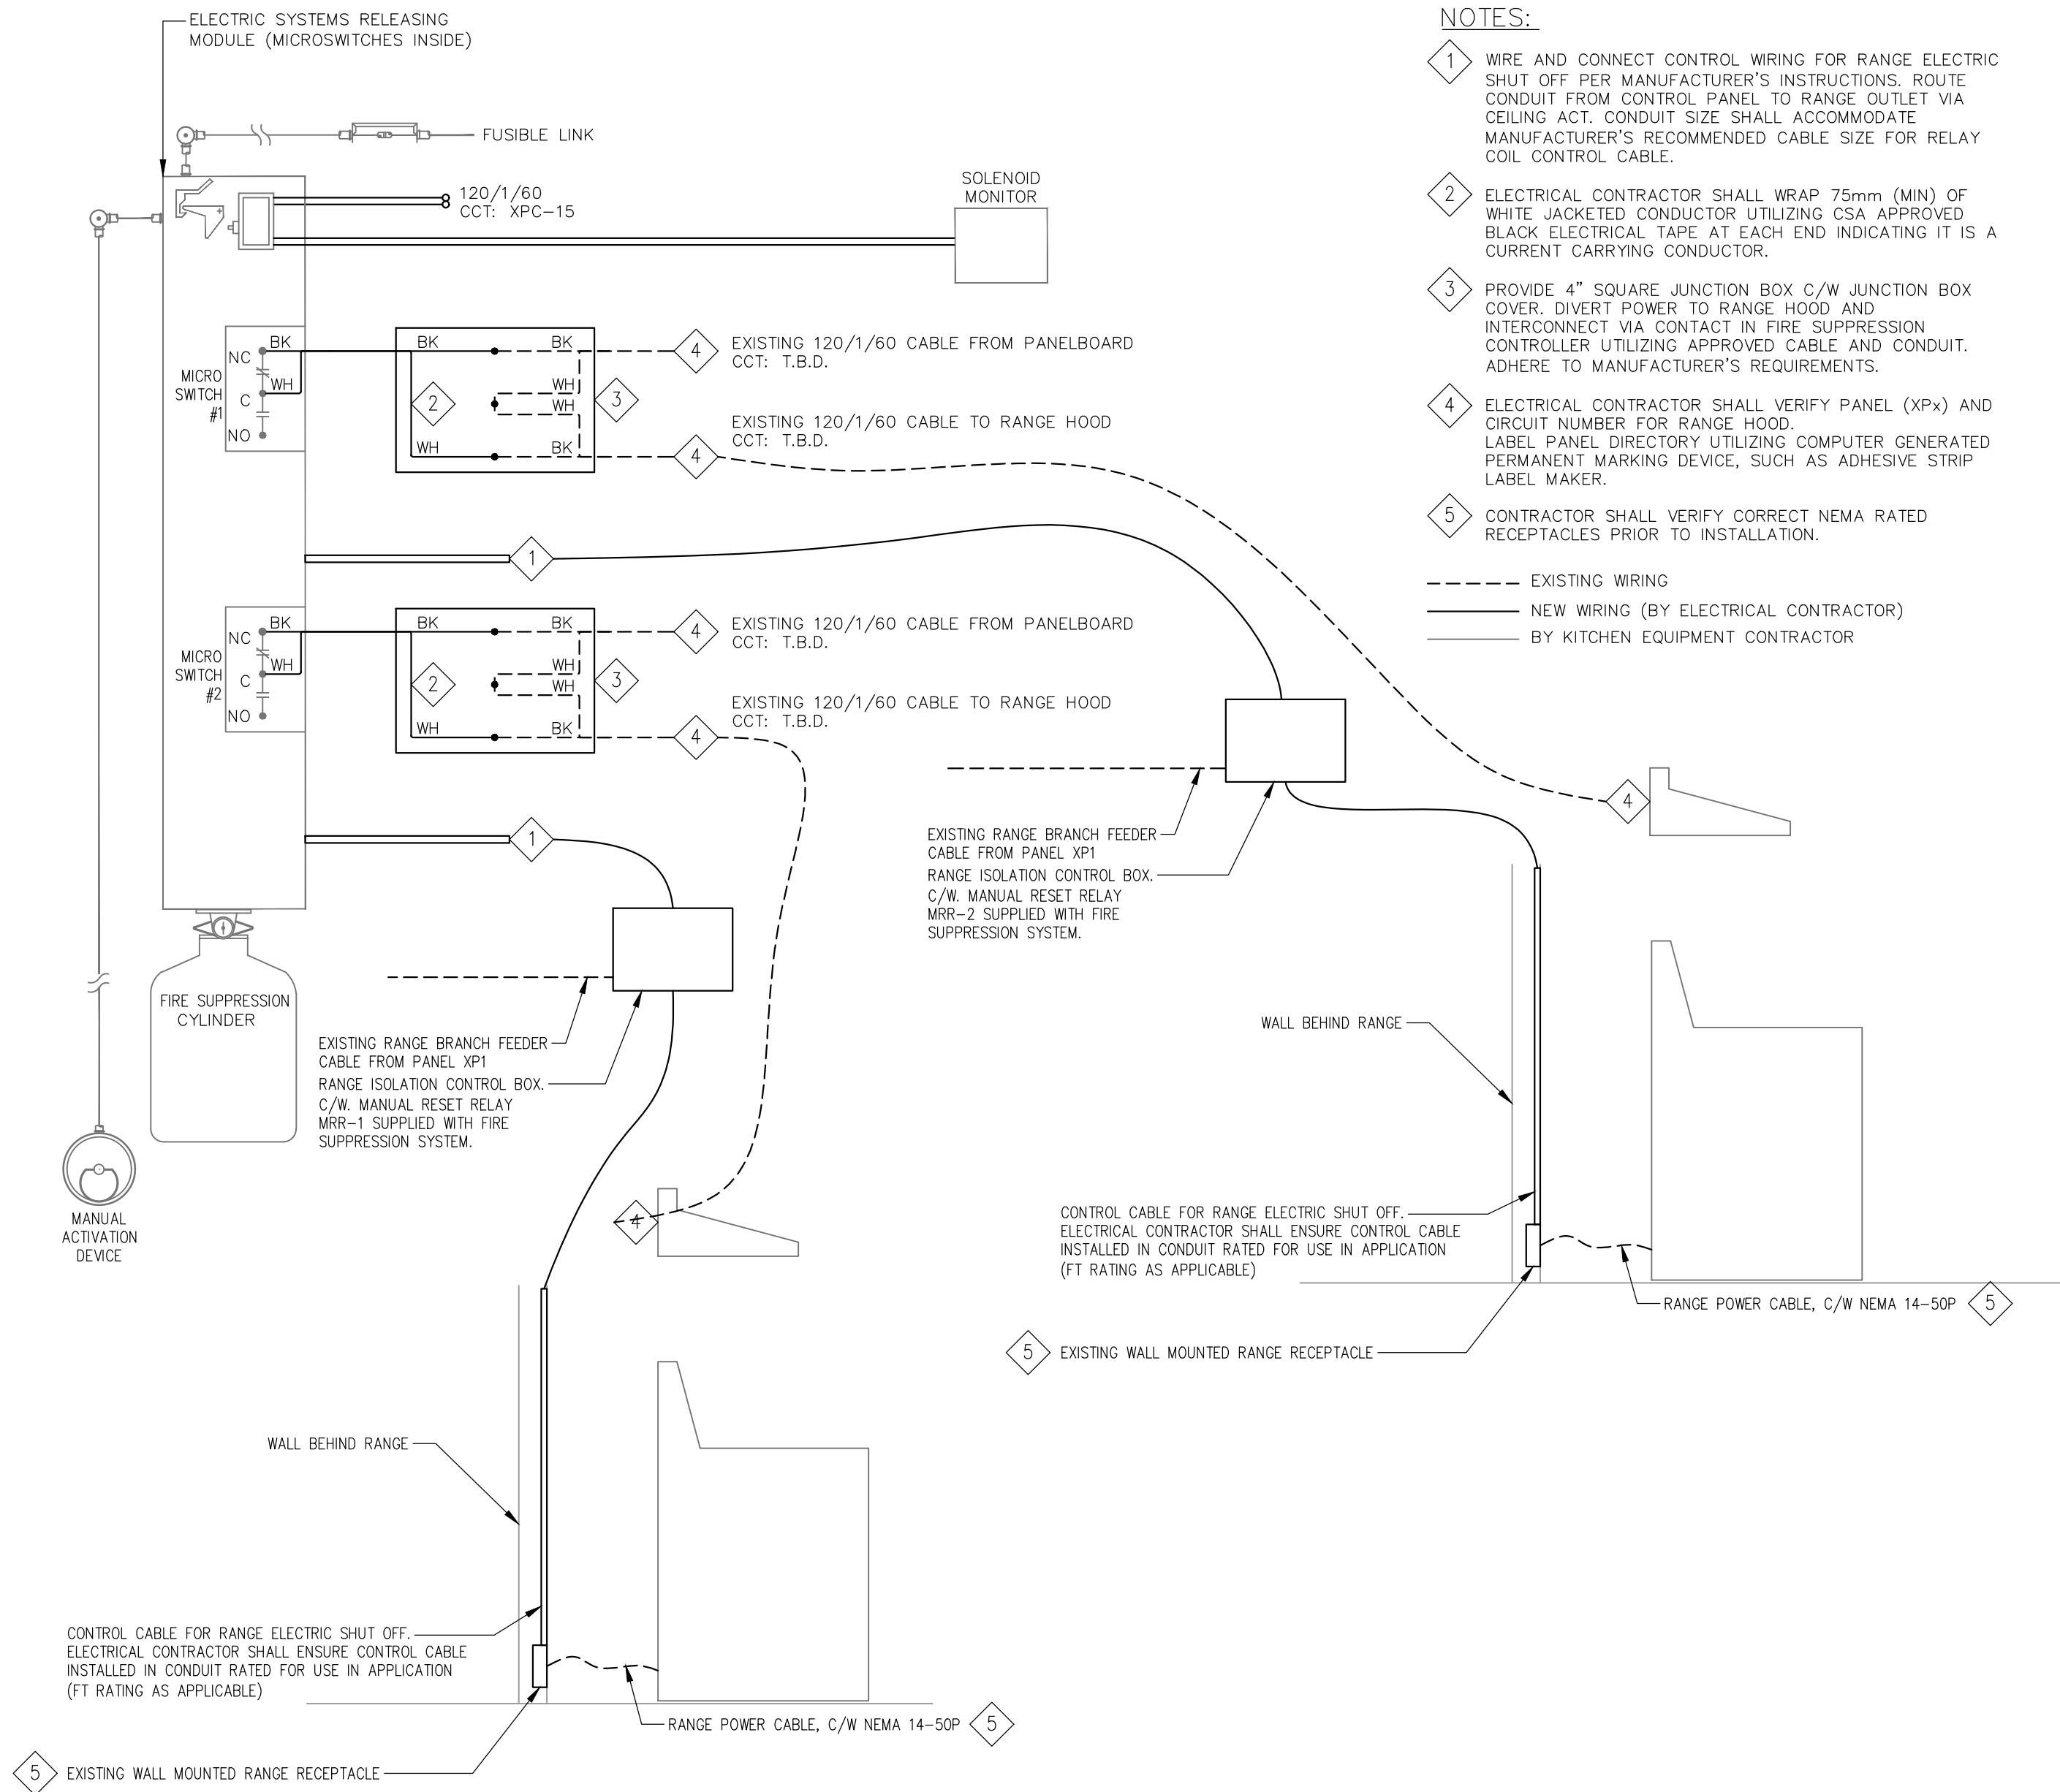

1 FIRE SUPPRESSION SYSTEM WIRING DIAGRAM
E.1 • SCALE: NTS

DISCLAIMER AND COPYRIGHT

CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED.

TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED.

BENCHMARKS

NOTES

No.

REVISION DESCRIPTION

DATE

ENGINEER STAMP



WINDERMERE COMMUNITY CENTRE
TOWNSHIP OF MUSKOKA LAKES

ELECTRICAL
LEGEND AND DETAILS



DESIGN: MCG / PP

FILE: 225023

DWG:


DRAWN: MCG

DATE: MAY 2025

E.1

CHECK: SRT

SCALE: AS SHOWN

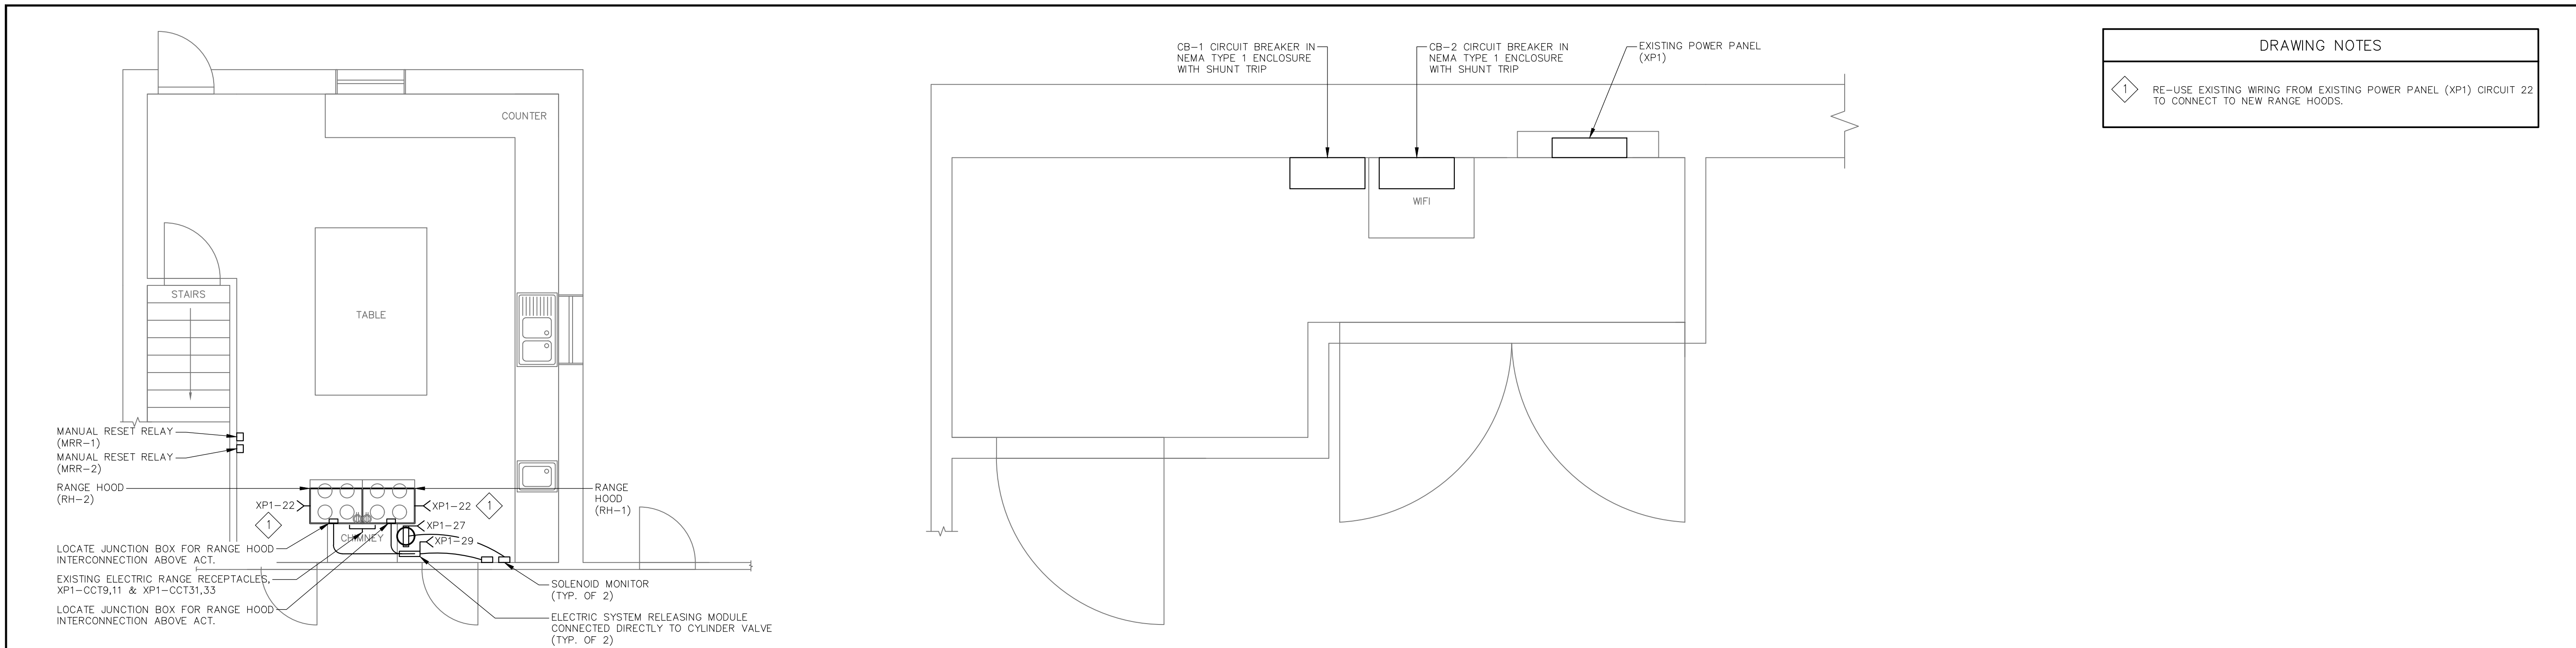


1
E.2 KITCHEN LAYOUT
• SCALE: 1/4" = 1'-0"

2
E.2 ELECTRICAL ROOM LAYOUT
• SCALE: 3/4" = 1'-0"



3
E.2 EXISTING POWER PANEL (XP1) MODIFICATIONS
• SCALE: NTS

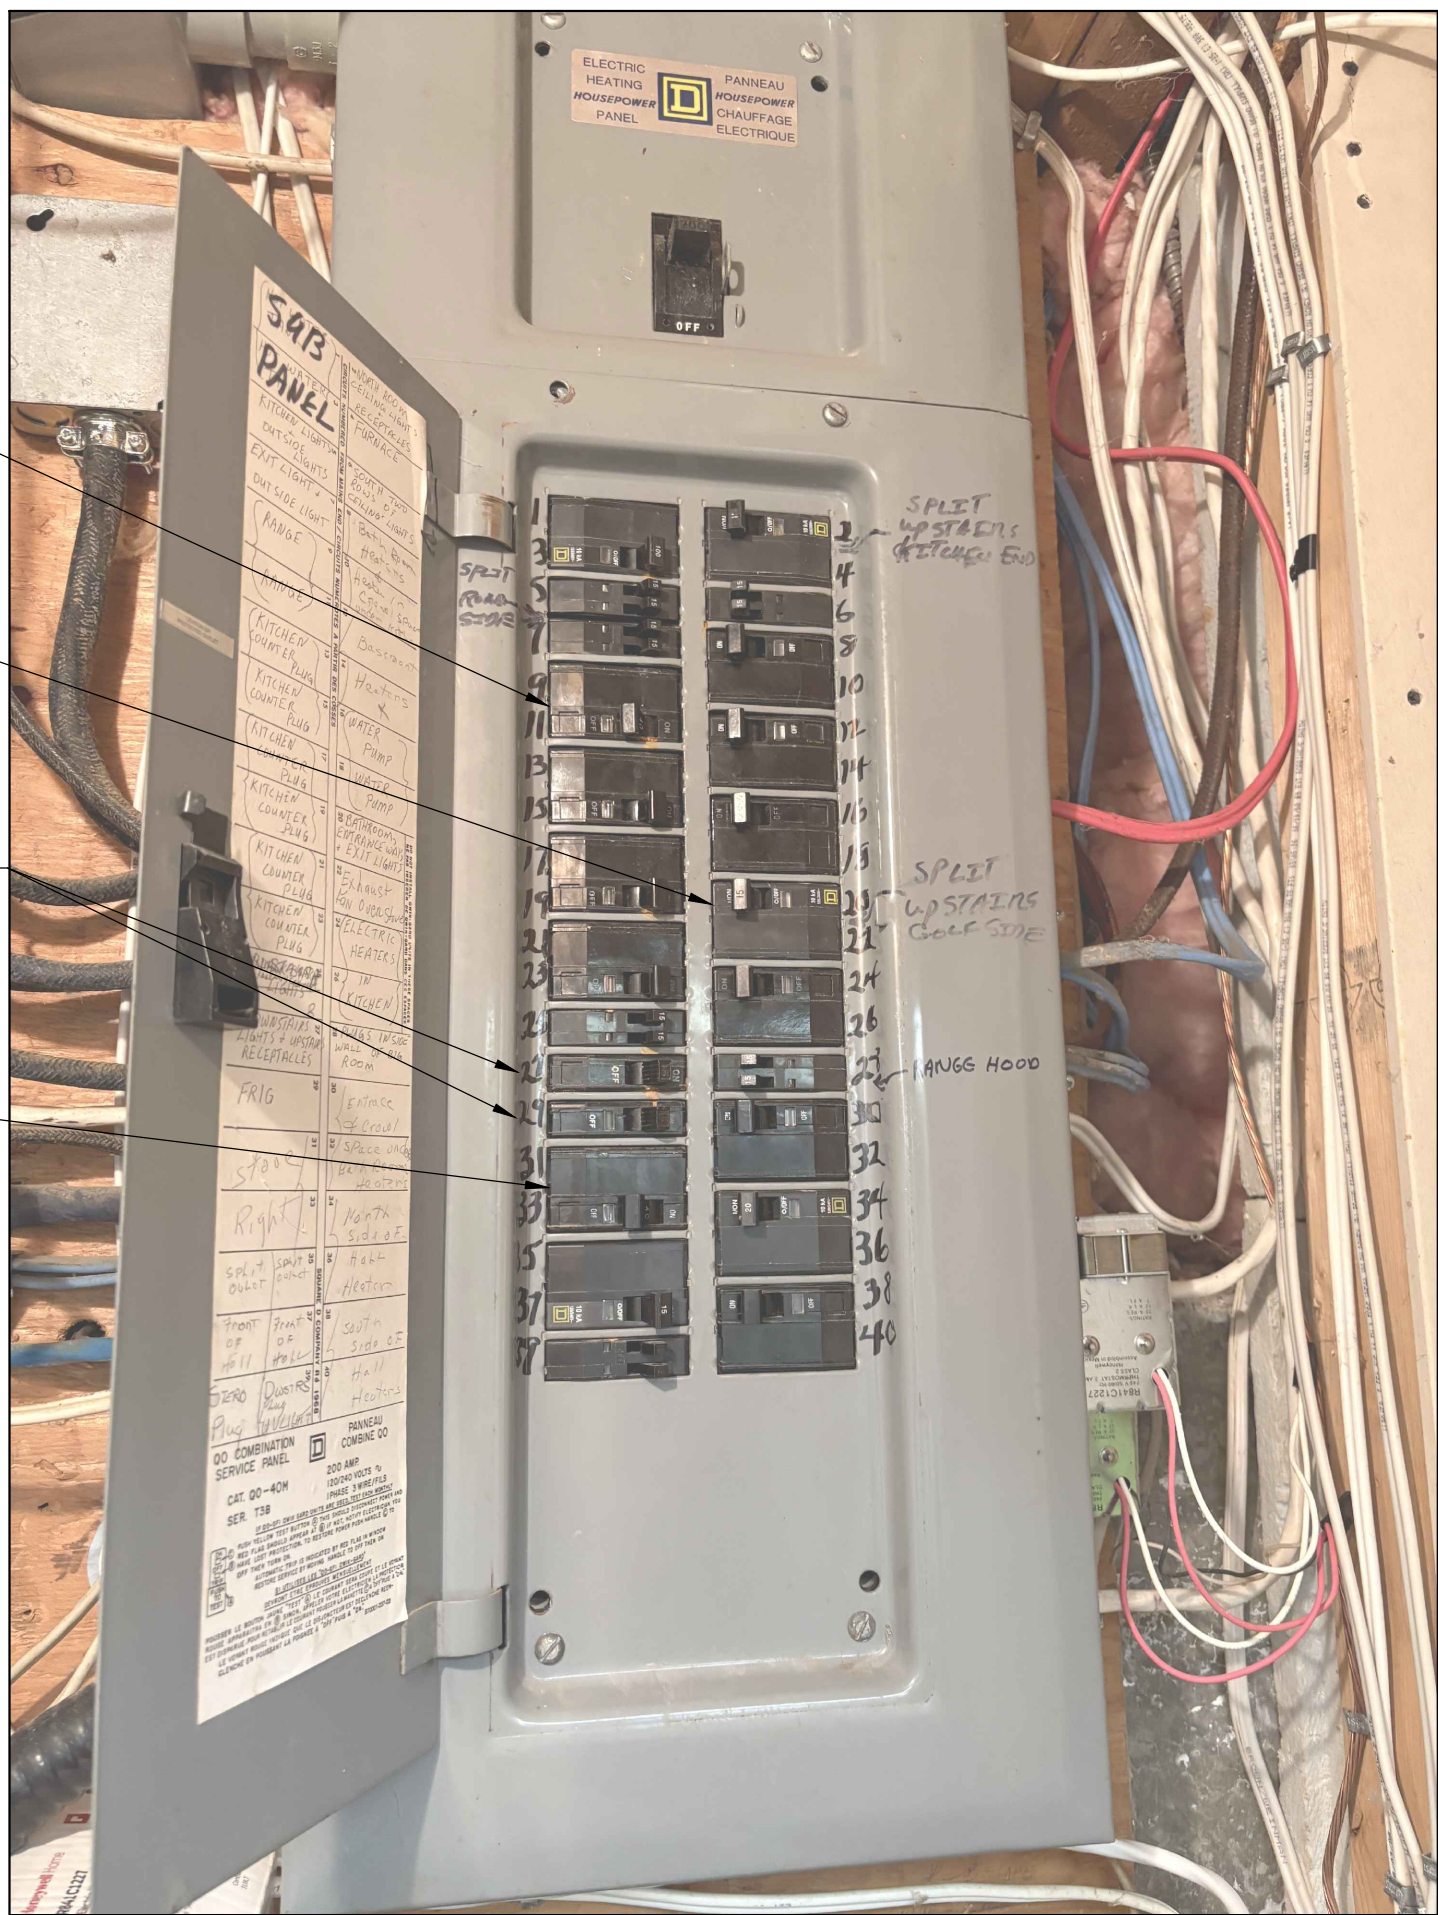

4
E.2 ELECTRICAL ROOM
• SCALE: NTS



| | | | | | | | | | | |
|--|-------------------|--------------|------------|-----------------------------|-------------|---------------------------|--|---|--|--|
| DISCLAIMER AND COPYRIGHT CONTRACTOR MUST VERIFY ALL DIMENSIONS AND BE RESPONSIBLE FOR SAME. ANY DISCREPANCIES MUST BE REPORTED TO THE ENGINEER BEFORE COMMENCING WORK. DRAWINGS ARE NOT TO BE SCALED. TATHAM ENGINEERING LIMITED CLAIMS COPYRIGHT TO THIS DRAWING WHICH MAY NOT BE USED FOR ANY PURPOSE OTHER THAN THAT PROVIDED IN THE CONTRACT BETWEEN THE OWNER/CLIENT AND THE ENGINEER WITHOUT THE EXPRESS CONSENT OF TATHAM ENGINEERING LIMITED. | BENCHMARKS | NOTES | No. | REVISION DESCRIPTION | DATE | ENGINEER STAMP | WINDERMERE COMMUNITY CENTRE TOWNSHIP OF MUSKOKA LAKES | DESIGN: MCG / PP FILE: 225023 DWG: E.2 DRAWN: MCG DATE: MAY 2025 CHECK: SRT SCALE: AS SHOWN | | |
| | | | 1. | ISSUED FOR CLIENT REVIEW | JUNE/2025 | | | | | |
| | | | 2. | ISSUED FOR TENDER | JULY/2025 | | | | | |
| | | | | | | | | | | |
| | | | | | | | | | | |

| | |
|---|--|
| <div><div>Electrical SpecificationsPage 1 of 5</div><div><div>PART 1 – GENERAL</div><div><div>1.1General</div><div><div><div>1</div><div>In case of a discrepancy between statement(s) or value(s) in this section or contract drawing(s), the higher statement or value takes precedence and shall govern.</div></div><div><div>2</div><div>"Local Inspector, Inspection Department or Authority" mean agents of any authority having jurisdiction over construction and safety standards associated with any part of electrical work on site, such as ESA for Ontario.</div></div><div><div>3</div><div>"Power Supply Authority" or "LUC" means electrical local utility company responsible for delivery of electrical power to project site.</div></div><div><div>4</div><div>"Electrical Code" or "OESC" means Ontario Electrical Safety Code C22.1 or code in force at project location, latest edition.</div></div><div><div>5</div><div>"Indicated" means as shown on contract drawings or noted in contract documents.</div></div><div><div>6</div><div>"Provide" means fabricate, supply, install, test and commission the electrical system and/or equipment.</div></div><div><div>7</div><div>"Remove" or "Removed" means to disconnect, remove, and dispose of equipment, material or item.</div></div></div><div><div>1.2Scope of Work</div><div><div>1</div><div>Provide new circuit breakers for new electric ranges as per contract drawings.</div></div><div><div>2</div><div>Provide control wiring for fire suppression system as per contract drawings.</div></div><div><div>3</div><div>Site Acceptance Testing (SAT) Assistance: When system is ready for service, provide assistance with operating instructions and start-up procedures during scheduled commissioning. Provide all necessary assistance to place the equipment into normal operating modes and train the Township operators.</div></div><div><div>4</div><div>Coordinate construction schedule with the Township prior to commencing work.</div></div><div><div>5</div><div>Conduit systems, as indicated, complete with wiring and terminations.</div></div><div><div>6</div><div>All conduit, fittings, outlets, field terminations, field wiring and cable as required, to provide a complete operating system.</div></div><div><div>7</div><div>Include all necessary mounting hardware, channel supports and fasteners to provide a complete operating system.</div></div><div><div>8</div><div>ESA Inspections throughout project construction stages as required. Final inspection certificate will be required for Substantial Performance.</div></div></div><div><div>1.3Standards</div><div><div>1</div><div>Provide all products and services in accordance with the latest addition of the following codes and standards:<div><div>1</div><div>Ontario Electrical Safety Code, latest edition applicable.</div></div><div><div>2</div><div>Canadian Standards Association.</div></div><div><div>3</div><div>Ontario Building Code, Latest Edition.</div></div></div></div></div></div></div><div><div>Electrical SpecificationsPage 2 of 5</div><div><div>1.4Permits, Fees and Inspection</div><div><div>1</div><div>Provide all licenses, permits and certificates required by the LUC at no additional expense.</div></div><div><div>2</div><div>Arrange and pay for all required inspection(s), including but not limited to the Electrical Safety Authority.</div></div><div><div>3</div><div>Upon completion of the Work, provide the Township with final, unconditional certificates of approval by the local inspection authorities.</div></div></div><div><div>1.5Examination of the Site and Contract Documents</div><div><div>1</div><div>Examine Drawings and Specifications of the complete Project and become familiar with all local site conditions.</div></div><div><div>2</div><div>Submission of Tender confirms the Contractor accepts the Contract and site conditions without qualifications.</div></div><div><div>3</div><div>Failure to determine the existing conditions or the nature of the construction shall not be a basis for granting compensation.</div></div></div><div><div>1.6Construction Drawings</div><div><div>1</div><div>The electrical drawings are diagrammatic, intended to convey the scope of work and indicate general arrangements of equipment. Do not scale drawings unless a scale is identified.</div></div><div><div>2</div><div>Have the location all equipment shown in the drawings reviewed by the Township before proceeding with the installation. Inform the Township of significant changes in location of equipment to meet field conditions and receive their authorization before proceeding. Obtain from the Township the location of equipment not definitely located in the drawings.</div></div><div><div>3</div><div>Locations of all material equipment indicated in the drawings are approximate and may be subject to revision found necessary or desirable by the Consultant at the time the work is installed. The Township may at their discretion request the relocation of electrical equipment within three metres of that shown prior to roughing in. This relocation shall be at no additional cost.</div></div><div><div>4</div><div>Drawings do not generally indicate the number of wires within conduits for control wiring. Provide the correct wire size and quantity as required by the indicated circuitry and control diagrams.</div></div></div><div><div>1.7Submissions</div><div><div>1</div><div>Submit shop drawings in accordance with general Contract Conditions and include arrangement drawings, bill of materials, diagrams, nameplate drawings and product data as applicable for the following equipment:<div><div>1</div><div>Circuit breaker.</div></div><div><div>2</div><div>Tandem breakers.</div></div><div><div>3</div><div>Fire suppression system range isolation device c/w manual reset.</div></div></div></div><div><div>2</div><div>Product data sheets shall include the name of the manufacturer and be clearly marked to show which items, features and options are offered.</div></div><div><div>3</div><div>Shop drawings that are not presented as required will be returned for revision and resubmission.</div></div><div><div>4</div><div>Submittal Procedure:<div><div>1</div><div>The Contractor shall submit digital copies in PDF format to the Owner and Engineer via email. All drawings are to be submitted electronically in pdf format. The drawings will be returned to the Contractor stamped and marked "Conforms with Intended Design", "Conforms with Intended Design with Revisions Noted", or "Non-Conforming – Revise and Resubmit".</div></div><div><div>3</div><div>When drawings are returned "Non-Conforming – Revise and Resubmit", make the necessary alterations and resubmit.</div></div><div><div>4</div><div>When drawings are returned "Conforms with Intended Design with Revisions Noted", the drawings may be used to execute the work in compliance with the Contract Documents. No other alterations are to be made to the drawings by the Contractor subsequent to receipt of drawings stamped and marked as above. If further changes are made in addition to the Engineer's notations, then the drawings must be resubmitted for further review.</div></div></div></div></div></div></div> <div><div>Electrical SpecificationsPage 3 of 5</div><div><div>5</div><div>When drawings are returned "Conforms with Intended Design", the Contractor shall be responsible for distribution of additional copies of Shop Drawings as necessary and as requested by the Engineer..</div></div><div><div>5</div><div>The review of shop drawings by the Township or Engineer does not relieve the Contractor of their responsibilities for compliance with the Contract Documents.</div></div><div><div>6</div><div>At end of project, provide PDF copy of the Operating and Maintenance Manuals of all equipment, including copies of shop drawings and all test results.</div></div></div> <div><div>1.8Construction Record Drawings</div><div><div>1</div><div>Keep one set of all applicable contract (including updates) and shop drawings at the site.</div></div><div><div>2</div><div>Ensure that the latest issue drawings are marked up to reflect the work as installed and have these available for the Township's review at site.</div></div><div><div>3</div><div>Upon completion of the work, transfer all revisions to a clean set of prints and submit to Consultant for "As-Built" record as part of the final job documentation.</div></div></div> <div><div>1.9Finishes</div><div><div>1</div><div>Shop-finish metal enclosures by application of rust resistant primer inside and out, and at least two coats of finishing enamel.</div></div><div><div>2</div><div>Clean and touch up any surfaces on shop-painted surfaces marred during shipment or installation with paint selected to match the original.</div></div><div><div>3</div><div>Wire brush and prime using a zinc-rich coating on any non-coated steel hangers, racks and fasteners to prevent rusting.</div></div></div> <div><div>1.10Warranty</div><div><div>1</div><div>All material to warrantied for material and labour for one (1) year upon substantial completion.</div></div></div> <div><div>PART 2 – PRODUCTS</div><div><div>2.1Basic Materials</div><div><div>1</div><div>Provide all necessary mounting brackets, hangars, etc., as required for installation.</div></div><div><div>2</div><div>Upon delivery of equipment on site and quantities accounted for, the contractor will assume liability for damaged, lost, stolen, etc..</div></div><div><div>3</div><div>Contractor is responsible for all labour and material costs for equipment failures during the warranty period.</div></div></div><div><div>2.2Circuit Breaker</div><div><div>1</div><div>Coordinate breaker requirements with existing panelboard manufacturer.</div></div></div><div><div>2.3Tandem Circuit Breaker</div><div><div>1</div><div>TBD</div></div></div><div><div>2.4Low Voltage Wire (1000V and Below)</div><div><div>1</div><div>Conductors: stranded Copper conductors, with minimum power conductor size: No. 12 AWG, minimum control conductor size: No. 14 AWG.</div></div><div><div>2</div><div>Power conductors: size as indicated, with cross linked polyethylene (XLPE) insulation rated 1000 V – RW90 or RWU90, as indicated.</div></div><div><div>3</div><div>Provide Sunlight Resistant ("SR" type) insulated conductors where exposed to weather.</div></div><div><div>4</div><div>Control conductors: RW90, XLPE insulation rated 600V – RW90.</div></div><div><div>5</div><div>Control wiring: copper with thermoplastic insulation type TEW rated at 600V.</div></div></div><div><div>2.5Conduits and Ducts</div></div></div> | |
|---|--|

Electrical SpecificationsPage 4 of 5

1

Minimum above grade conduit size: 21mm (3/4"), and minimum below grade conduit size: 27mm (1").

2

Rigid PVC conduit, manufactured to schedule 40 wall thickness. Solvent weld compound for all PVC joints. Complies with CSA C22.2 No. 211.2-06. All conduit to be UV rated.

3

Fittings: manufactured for use with conduit specified. Coating and UV rating: same as conduit. Fittings to incorporate nylon insulated throat or bushing.

4

Factory "ells" where 90° bends. Use "large or utility" sweeping bends to reduce pulling cable tensions.

2.6Miscellaneous Equipment

1

Wire markers: computer printed, black letters on white background, self-laminating – vinyl markers, number of markers as required.

2

Cable markers for cables or conductors greater than 13 mm diameter: strap-on type, rigid PVC, black letters on white background, with PVC covered aluminium straps.

3

Terminal blocks: minimum 600 V rated, modular, sized to accommodate conductor size used.

4

Where screw-type terminals are provided on equipment field wiring: terminate with pressure-type insulated copper fork tongue terminals.

5

Splice connectors for wire sizes Nos. 12-10 AWG inclusive: compression spring type.

6

Splice connectors for wire sizes No. 8 AWG and larger: split-bolt type, sized to suit number and size of conductors, c/w flame retardant foot-type insulator.

7

Cable ties shall be nylon, one-piece, self-locking type.

PART 3 – EXECUTION

3.1Installation Requirements

1

Install circuit breaker (s) as indicated.

2

Make power and control connections as indicated.

3

Make grounding connections between equipment ground busses and system grounding system.

4

Connect loads to circuits. Perform a "load balance" check after all loads are connected.

5

Breaker sizes listed in the panelboard schedule(s) are provided as a general guide. Prior to installation, contractor to confirm all breaker sizes with final equipment loads

6

Contractor to size all panelboard feeder wiring and conduit based on Ontario Electrical Safety Code - latest edition. Include insulated ground conductor in all conduit raceways.

7

Provide an updated typed directory for the panelboard.

8

Check all factory-made connections for mechanical security, electrical continuity and current phasing.

9

Provide a Lamicoïd nameplate on new circuit breaker and new power panelboard. Lamicoïd: 3mm thick plastic engraving sheet, black face, white core, with double-sided adhesive tape.

3.2Conduits and Wiring

1

Install all wire and cable according to the drawings, with a minimum power conductor size of No. 12 AWG and minimum control conductor size of No. 14 AWG.

2

No splices shall be permitted in cable or wiring runs, and shall only be permitted in junction boxes.

3

Identify each conductor by plastic slip-on markers at each termination with circuit or wire number.

4

Use CSA approved lubricants of type compatible with cable jacket to reduce pulling tension.

3.3Testing and Commissioning

1

Provide testing and commissioning of all electrical work and control systems.

2

Notify the Township at least three working days before the testing and commissioning is scheduled to start. The Township may request repetition of any test for which due notification was not received.

Electrical SpecificationsPage 5 of 5

3

Provide insulation test using 500V megger on all new power cables.

END OF SPECIFICATIONS