



REVISED
Hazardous Building
Materials Assessment
(Pre-construction)

Eastside Secondary School
275 Farley Avenue, Belleville,
Ontario

Prepared for:

Hastings and Prince Edward
District School Board

224 Palmer Road
Belleville, ON K7P 4E1

July 12, 2023

Pinchin File: 200584.061



Issued to: Hastings and Prince Edward District School Board
Issued on: July 12, 2023
Pinchin File: 200584.061
Issuing Office: Kingston, ON

Author: _____
Halie MacKillican
Project Coordinator
613.483.0691
hmackillican@pinchin.com

Reviewer: _____
Sarah Young, C. Tech.
Operations Manager
613.541.1013 ext. 1609
syoung@pinchin.com



EXECUTIVE SUMMARY

Hastings and Prince Edward District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct a hazardous building materials assessment at Eastside Secondary School located at 275 Farley Avenue, Belleville, Ontario. Pinchin performed the assessment on August 31 and September 1, 2021.

The objective of the assessment was to identify specified hazardous building materials in preparation for building renovation activities. The proposed work as identified by the Client includes various interior and exterior renovations, including but not limited to the removal/replacement of windows and radiators throughout the building.

The results of this assessment are intended for use with a properly developed scope of work or performance specifications and safe work procedures.

The assessed area consisted of the entire building, excluding the roof.

SUMMARY OF FINDINGS

The following is a summary of significant findings; refer to the body of the report for detailed findings:

Asbestos:

- Texture finish on plaster ceilings and bulkheads.
- Parging cement insulation on pipe fittings.
- Aircell insulation on straight sections of pipes.
- Sweatwrap insulation on straight sections of pipes.
- Drywall joint compound on wall and ceiling finishes.
- Transite board present on underside of exterior canopies, and as ceiling panels, countertops, drying racks and gardening tables.
- Transite pipe present as rain water leaders.
- Various styles of 9"x9" and 12"x12" vinyl floor tiles and mastic.
- Beige, grey and brown caulking on interior and exterior window and door frames.
- Black and grey butyl sealant on exterior windows.
- Paper heat shield in incandescent light fixtures.
- Various colours of flat paint on concrete block, poured concrete and brick walls.
- Thinsert behind ceramic tiles on walls and floors (presumed).



- The following asbestos-containing materials were observed to be damaged:
 - Parging cement insulation on one pipe elbow in Gym 142, Classroom 149, and Autoshop 153.
 - Paint on concrete block walls in Storage Room 139, Classroom 187, and Corridor 191.
 - Drywall joint compound on walls in Classroom 212 and Classroom 215.
 - Drywall joint compound on bulkhead in Washroom 128.

Lead:

- Lead in paints is present as follows:
 - Red paint on the steel structure (High).
 - Grey paint on concrete floors (Low).
 - Yellow paint on textured plaster ceilings (Low).
 - Off-white paint on smooth plaster walls and ceilings (Low).
 - Yellow paint on concrete block walls (Low).
 - Pink paint on concrete block walls (Low).
 - Off-white paint on metal radiators (Low).
- Lead within batteries of emergency lights and fire alarm control panels.
- Lead caulking on cast iron pipe joints (bell and spigot).
- Lead sheeting.

Silica: Crystalline silica is present in concrete, mortar, masonry, ceramic tiles, grout, drywall, ceiling tiles, terrazzo and plaster.

Mercury: Mercury vapour is present in lamp tubes and liquid mercury is present in thermostat ampules and boiler instrumentation equipment.

Polychlorinated Biphenyls (PCBs): Grey caulking at exterior expansion joints is presumed to contain PCBs.

Mould and Water Damage: Visible mould growth was not observed; however, water staining was observed on ceiling tiles in various locations throughout the building.



SUMMARY OF RECOMMENDATIONS

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations:

1. Remediate the following materials.

| Material, Quantity & Condition | Current Room Number | Recommended Procedure |
|--|----------------------------|--|
| Drywall joint compound on bulkhead, five square feet, poor condition | Room 128 | Remove/repair in accordance with Type 1 asbestos abatement procedures |
| Paint on concrete block wall, 300 square feet, poor condition | Room 139 | Remove in accordance with Type 1 asbestos abatement procedures |
| Parging cement insulation, one fitting, poor condition | Room 142 | Remove in accordance with Type 2 or Glove Bag asbestos abatement procedures |
| Parging cement insulation, one fitting fair condition and one fitting poor condition | Room 149 | Remove/repair in accordance with Type 2 or Glove Bag asbestos abatement procedures |
| Parging cement insulation, one fitting, fair condition | Room 153 | Remove/repair in accordance with Type 2 or Glove Bag asbestos abatement procedures |
| Paint on concrete block wall, five square feet, poor condition | Room 187 | Remove in accordance with Type 1 asbestos abatement procedures |
| Paint on concrete block wall, 15 square feet, poor condition | Room 191 | Remove in accordance with Type 1 asbestos abatement procedures |
| Drywall joint compound on wall, five square feet, poor condition | Room 212 | Remove/repair in accordance with Type 1 asbestos abatement procedures |
| Drywall joint compound on wall, five square feet, poor condition | Room 215 | Remove/repair in accordance with Type 1 asbestos abatement procedures |

2. Conduct further investigation of the following items, which was not completed during this assessment:
 - a. Sample thinset behind ceramic tiles for asbestos analysis prior to disturbance.
 - b. Sample caulking in exterior expansion joints for PCB analysis prior to disturbance.
 - c. Materials listed as exclusions in this report.



3. Prepare a scope of work or specifications and safe work procedures for the hazardous materials removal required for the planned work.
4. Do not disturb suspected hazardous building materials discovered during the planned work, which have not been identified in this report and arrange for further evaluation and testing.
5. Remove and properly dispose of asbestos-containing materials prior to renovation activities.
6. Remove PCB caulking prior to renovation activities.
7. Recycle mercury-containing lamp tubes and thermostats when removed from service.
8. Follow appropriate safe work procedures when handling or disturbing asbestos, lead and silica.

This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.



TABLE OF CONTENTS

| | | |
|-----|---------------------------------|----|
| 1.0 | INTRODUCTION AND SCOPE | 1 |
| 1.1 | Scope of Assessment | 1 |
| 2.0 | METHODOLOGY | 2 |
| 3.0 | BACKGROUND INFORMATION | 2 |
| 3.1 | Building Description | 2 |
| 3.2 | Existing Reports | 3 |
| 4.0 | FINDINGS | 3 |
| 4.1 | Asbestos | 3 |
| 4.2 | Lead | 20 |
| 4.3 | Silica | 22 |
| 4.4 | Mercury | 22 |
| 4.5 | Polychlorinated Biphenyls | 23 |
| 4.6 | Mould and Water Damage | 24 |
| 5.0 | RECOMMENDATIONS | 26 |
| 5.1 | General | 26 |
| 5.2 | Remedial Work | 27 |
| 5.3 | Building Renovation Work | 27 |
| 6.0 | TERMS AND LIMITATIONS | 29 |
| 7.0 | REFERENCES | 29 |

APPENDICES

| | |
|---------------|---|
| APPENDIX I | Drawings |
| APPENDIX II-A | Asbestos Analytical Certificates |
| APPENDIX II-B | Lead Analytical Certificates |
| APPENDIX II-C | PCB Analytical Certificates |
| APPENDIX III | Methodology |
| APPENDIX IV | Location Summary Report |
| APPENDIX V | Hazardous Materials Summary Report / Sample Log |
| APPENDIX VI | HMIS All Data Report |



1.0 INTRODUCTION AND SCOPE

Hastings and Prince Edward District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct a hazardous building materials assessment at Eastside Secondary School located at 275 Farley Avenue, Belleville, Ontario.

Pinchin performed the assessment on August 31 and September 1, 2021. The surveyors were unaccompanied during the assessment. The assessed area was occupied at the time of the assessment.

The objective of the assessment was to identify specified hazardous building materials in preparation for building renovation activities.

The proposed renovations, as identified by the Client include various interior and exterior renovations, including but not limited to the removal/replacement of windows and radiators throughout the building.

The results of this assessment are intended for use with a properly developed scope of work or performance specification.

1.1 Scope of Assessment

The **assessed area** consisted of all parts of the building, excluding the roof.

The assessment was performed to establish the type of specified hazardous building materials, locations and approximate quantities incorporated in the structure(s) and its finishes.

For the purpose of the assessment and this report, hazardous building materials are defined as follows:

- Asbestos
- Lead
- Silica
- Mercury
- Polychlorinated Biphenyls (PCBs)
- Mould

The following Designated Substances are not typically found in building materials in a composition/state that is hazardous and were not included in this assessment:

- Arsenic
- Acrylonitrile
- Benzene
- Coke oven emissions



- Ethylene oxide
- Isocyanates
- Vinyl chloride monomer

2.0 METHODOLOGY

Pinchin conducted a room-by-room assessment (rooms, corridors, service areas, exterior, etc.) to identify the hazardous building materials as defined in the scope.

The assessment included limited demolition of wall and ceiling finishes (drywall or plaster) to view concealed conditions at representative areas as permitted by the current building use. Limited destructive testing of flooring was conducted where possible (under ceramic tiles, carpets or multiple layers of flooring). Demolition of exterior building finishes, masonry walls (chases, shafts etc.), and structural surrounds was not conducted.

Limited demolition of masonry block walls (core holes) was conducted to investigate for loose fill vermiculite insulation. Sampling of roofing materials was not conducted.

For further details on the methodology including test methods, refer to Appendix III.

3.0 BACKGROUND INFORMATION

3.1 Building Description

| Description Item | Details |
|----------------------|--|
| Use | Institutional |
| Number of Floors | Two storeys with a partial basement |
| Total Area | 130,000 square feet |
| Year of Construction | 1959 with additions completed in 1961 and 1975 |
| Structure | Structural steel and concrete |
| Exterior Cladding | Brick |
| HVAC | Rooftop AC, boiler with hot water heating to radiators and suspended unit heaters |
| Roof | Flat (not assessed) |
| Flooring | Vinyl floor tiles, vinyl sheet flooring, wood, ceramic tiles, carpet and poured concrete |
| Interior Walls | Drywall, plaster, concrete block and ceramic tiles |
| Ceilings | Drywall, plaster, texture finish and acoustic ceiling tiles |



3.2 Existing Reports

Pinchin previously prepared the following reports, which have been reviewed as part of this assessment:

- *"Asbestos Assessment, Moira Secondary School, 275 Farley Avenue, Belleville, Ontario"* dated August 31, 2017, Pinchin Project Number 200584.107.
- *"Asbestos Reassessment, Eastside Secondary School, 275 Farley Avenue, Belleville, Ontario"* dated November 25, 2022, Pinchin Project Number 200584.074.
- *"Asbestos Test Results, Eastside Secondary School, 275 Farley Avenue, Belleville, Ontario"* dated June 20, 2023, Pinchin Project Number 200584.061.

4.0 FINDINGS

The following section summarizes the findings of the assessment and provides a general description of the hazardous materials identified and their locations. For details on approximate quantities, condition, friability, accessibility and locations of hazardous materials; refer to the Hazardous Material Summary / Sample Log and All Data Report in Appendices V and VI.

Any quantities listed in this report or data tables are estimated based on visual approximations only and are subject to variation.

4.1 Asbestos

4.1.1 Texture Finishes (Decorative)

Texture finish, containing chrysotile asbestos, is present on the plaster ceiling in the assessed area (previous samples 0012A-C).

Texture finish, containing chrysotile asbestos, is present on the bulkhead in Theatre 214 (previous samples 0030A-C).

Texture finish present on the southwest exterior canopy does not contain asbestos (previous samples 0034A-C).



Asbestos-containing texture finish on plaster ceiling.



Asbestos-containing texture finish on bulkhead.



Non-asbestos texture finish on underside of exterior canopy.

4.1.2 Pipe Insulation

Parging cement, containing chrysotile asbestos, is present on pipe fittings (elbows, valves, tees, hangers etc.), jacketed with canvas, on rain water leader, hot water heating and domestic water system pipes (previous samples 0006A-C, 0008A-C and 0025A-C).

A white corrugated paper insulation (trade name Aircell), containing chrysotile asbestos, is present on straight sections of hot water heating system pipes, jacketed with canvas (previous samples 0001A-C and 0014A-C).

Sweatwrap insulation, containing chrysotile asbestos in the tar paper layer and brown paper layer, is present on straight sections of hot water heating system pipes, jacketed with canvas (previous samples 0002A-C and 0035A-C).

Remaining pipes are insulated with non-asbestos fibreglass, or other non-asbestos insulation such as elastomeric foam insulation.

Pipes insulated with asbestos-containing insulations may be present in inaccessible spaces such as above solid ceilings, in chases, in column enclosures and within shafts.




Asbestos-containing paring cement insulation on pipe elbows.



Damaged asbestos-containing paring cement insulation present on pipe elbow in Automotive Shop 153.



Asbestos-containing Aircell insulation on straight sections of pipes.

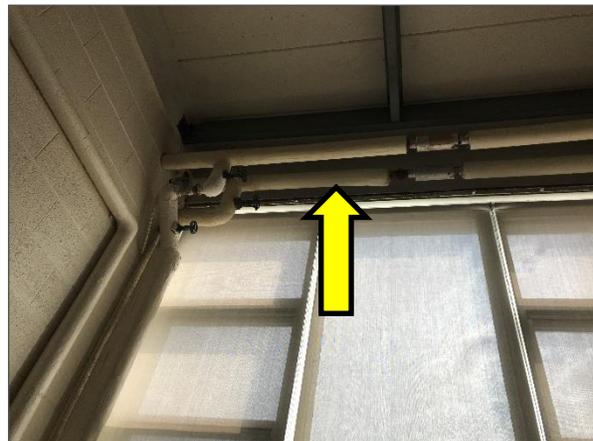


Asbestos-containing sweat wrap insulation on straight sections of pipes.

4.1.3 Duct Insulation and Mastic

Ducts are either uninsulated or insulated with non-asbestos fibreglass (foil-faced or canvas jacketing).

Brown mastic, present on seams of the sawdust collection system ducts within the Wood Shop 152 does not contain asbestos (previous samples 0007A-C).

Light grey mastic present on seams/joints of ducts throughout the assessed area does not contain asbestos (samples S0046A-C).

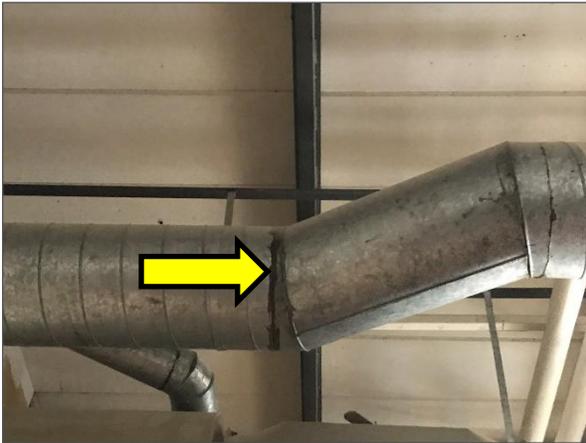

Non-asbestos brown duct mastic.



Non-asbestos light grey duct mastic.

4.1.4 Mechanical Equipment Insulation

Mechanical equipment (e.g. furnace, hot water tanks, boilers) is either uninsulated or insulated with non-asbestos fibreglass.



Non-asbestos fibreglass insulated hot water tank with metal jacketing.



Non-asbestos fibreglass insulated boiler with metal jacketing.

4.1.5 Vermiculite

Destructive testing was conducted of a representative selection of masonry block walls, including creating penetrations at various locations. The locations of destructive testing have been indicated on the drawings in Appendix I.

Loose fill vermiculite was not observed within the cavities.



4.1.6 Acoustic Ceiling Tiles

Acoustic ceiling tiles are present in the assessed area, as follows.


| Size, Type, Pattern | Sample Locations | Sample Number or Date Code | Asbestos Type |
|---|--|----------------------------|---------------|
| 2'x4' lay-in, dense small and medium pinholes | Classroom 154A | Previous samples 0010A-C | None Detected |
| 1'x1' glued-on, medium and large uniform pinholes | Classroom 156 and Classroom 157 | Previous samples 0011A-C | None Detected |
| 2'x4' lay-in, thick widthwise fissures and pinholes | Not sampled | 2007 | None |
| 2'x4' lay-in, dense short widthwise fissures | Not sampled | 01/25/2008 | None |
| 2'x4' lay-in, textured | Not sampled | Fibreglass | None |
| 2'x2' lay-in, textured with pinholes | Not sampled | 12/14/2005 | None |
| 1'x1' glued-on, large and small random pinholes | Office 123, Office 124 and Classroom 225 | Previous samples 0019A-C | None Detected |
| 2'x4' lay-in, smooth | Not sampled | Gypsum | None |
| 2'x4' lay-in, wicker | Not sampled | Wicker | None |
| 2'x4' lay-in, flecks and pinholes | Not sampled | 05/09/2014 | None |
| 1'x1' glued-on, random pinholes | Computer Lab 156C and Radio Room 156D | S0047A-C | None Detected |
| 1'x1' glued-on, medium and large pinholes with flecks | Classroom 102, Classroom 223 and Classroom 224 | S0048A-C | None Detected |

Adhesive present on the backside of 1'x1' acoustic ceiling tiles does not contain asbestos (previous samples 0019B-C; phase B and samples S0036A-C).

Ceiling tiles presumed to be non-asbestos are based on the date of manufacture determined from the date stamp applied to the top of the tiles or the non-asbestos composition of the tiles (i.e. fibreglass, gypsum or wicker). The tiles were manufactured after asbestos stopped being used in acoustic ceiling tiles.



Non-asbestos 2'x4' acoustic ceiling tiles with dense small and medium pinholes.

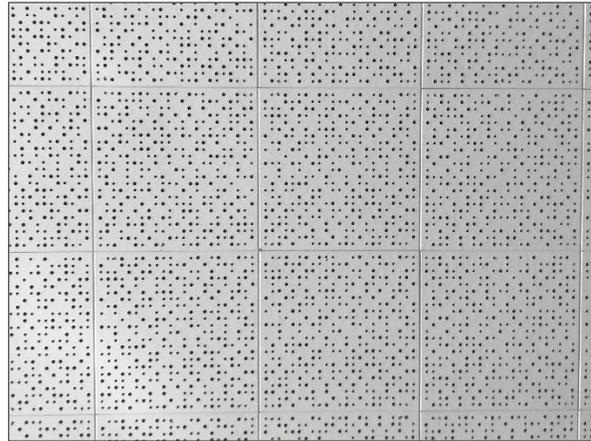


Non-asbestos 1'x1' acoustic ceiling tiles with medium and large uniform pinholes.



Non-asbestos 2'x4' acoustic ceiling tiles with thick widthwise fissures and pinholes.




Non-asbestos 2'x4' acoustic ceiling tiles with dense short widthwise fissures.

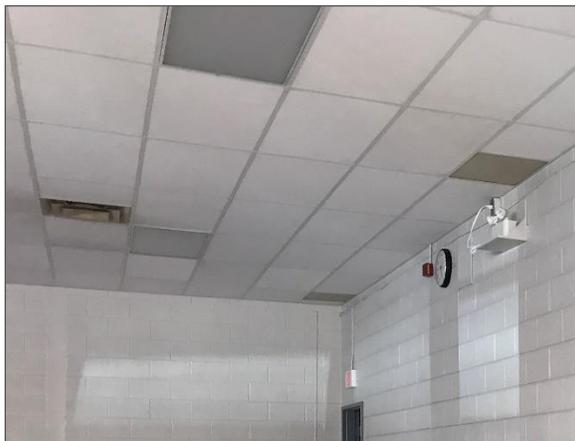


Non-asbestos 2'x4' textured acoustic ceiling tiles.




Non-asbestos 2'x2' textured acoustic ceiling tiles with pinholes.

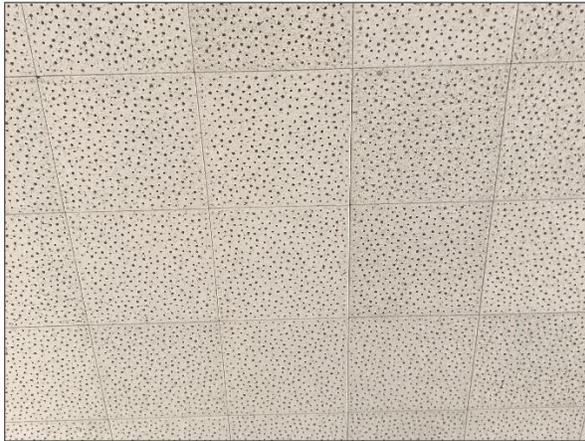

Non-asbestos 1'x1' acoustic ceiling tiles with small and large random pinholes.

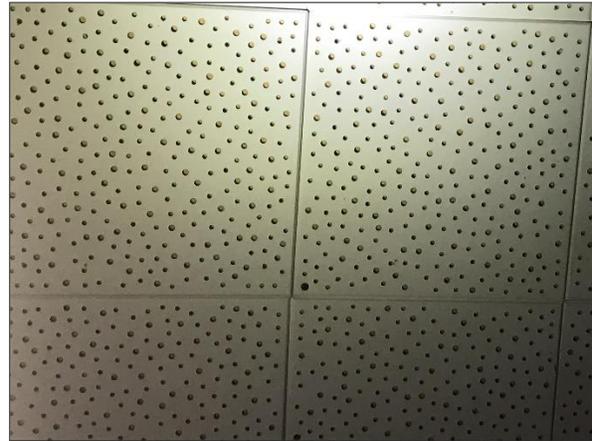

Non-asbestos 1'x1' acoustic ceiling tiles with random pinholes.

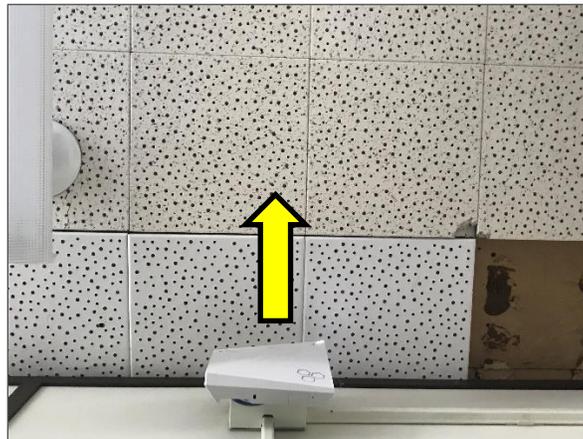

Non-asbestos 1'x1' acoustic ceiling tiles with medium and large pinholes with flecks.

4.1.7 Plaster and Stucco

Smooth plaster present on walls and ceilings throughout the building does not contain asbestos (previous samples 0009A-G and 0016A-E and samples S0056A-E and S0057A-E).

Textured plaster present on walls and ceilings in isolated locations throughout the assessed area does not contain asbestos (samples S0037A-C and S0038A-C). Sample S0037A contains <0.5% chrysotile asbestos. As per O.Reg.278/05, materials containing <0.5% asbestos by dry weight are not defined as asbestos-containing.

Scratch coat plaster present on a steel beam in Corridor 192 does not contain asbestos (samples S0039A-C).



Non-asbestos smooth plaster on wall.



Non-asbestos textured plaster on wall.

4.1.8 *Drywall Joint Compound*

Drywall joint compound, containing chrysotile asbestos, is present on wall and ceiling finishes throughout the 1975 addition and a portion of the original building (previous samples 0005D-G and 0027A-C and samples S0053A-G and S0054A,D,G).

Drywall joint compound present on wall and ceiling finishes throughout the remainder of the building does not contain asbestos (samples S0055A-E and S0058A-G).

4.1.9 *Asbestos Cement Products (Transite)*

Transite board, presumed to contain asbestos based on visual observation, is present on the underside of exterior canopies, and as ceiling panels, as countertops, as drying racks and as gardening tables in isolated locations throughout the building.

Transite pipe, presumed to contain asbestos based on visual observation, is present as rainwater leaders in the assessed area. Additional transite pipe is presumed to be concealed above solid ceilings and in vertical chases, walls and columns.



Presumed asbestos-containing Transite board present on underside of exterior canopy.



Presumed asbestos-containing Transite board present as ceiling panels.



Presumed asbestos-containing Transite board present as countertops.



Presumed asbestos-containing Transite board present as a drying rack.



Presumed asbestos-containing Transite board present as gardening table.



Presumed asbestos-containing Transite pipe.

4.1.10 Vinyl Sheet Flooring

Beige/grey vinyl sheet flooring with a pebbled pattern present in Change Room 131 does not contain asbestos (previous samples 0028A-C).



Non-asbestos beige/grey vinyl sheet flooring with a pebbled pattern.

4.1.11 Vinyl Floor Tiles, Baseboard, and Stair Flooring

Vinyl floor products are present as follows.

| Description | Sample Locations | Sample Number | Asbestos Type (tile) | Asbestos Type (mastic) |
|--|---|---------------------------|----------------------|------------------------|
| 9"x9" various colours and patterns | Classroom 115, IT Room 126A, Classroom 150, Classroom 157 and Mechanical Room 161 | Previous samples S0003A-E | Chrysotile | Chrysotile |
| 12"x12" beige | Classroom 151 | Previous samples 0004A-C | None Detected | None Detected |
| 12"x12" red and black, checkered pattern | Custodial Room 160 | Previous samples 0013A-C | None Detected | None Detected* |
| 12"x12" beige with brown streaks | Mechanical Room 163 | Previous samples 0015A-C | Chrysotile | None Detected |
| 12"x12" off-white with grey flecks | Classroom 125 | Previous samples 0018A-C | None Detected | None Detected |



| Description | Sample Locations | Sample Number | Asbestos Type (tile) | Asbestos Type (mastic) |
|---|--|---------------------------------|-----------------------------|-------------------------------|
| 12"x12" red | Office 124 | Previous samples 0020A-C | None Detected | None Detected |
| 12"x12" grey with white and grey flecks | Resource Centre 129 | Previous samples 0021A-C | None Detected | None Detected |
| 12"x12" beige with white and beige blotches | Classroom 111, Classroom 114 and Classroom 207 | Previous samples 0022A-C | None Detected | None Detected |
| 12"x12" turquoise with white flecks | Custodial Room 116 and Classroom 228 | Previous samples 0023A-C | None Detected | None Detected |
| 12"x12" beige with sparse white and brown flecks | Storage 139 and Weight Room 182 | Previous samples 0024A-C | Chrysotile | None Detected |
| 12"x12" off-white with black and grey streaks | Change Room 135 and Classroom 187 | Previous samples 0026A-C | Chrysotile | None Detected |
| 12"x12" white with grey flecks | Classroom 219 | Previous samples 0029A-C | None Detected | None Detected |

*Mastic present on samples S0013C does not contain asbestos; however, mastic was not present on sample S0013A-B. Ten other varieties of vinyl floor tiles were sampled in the building, with a total of 31 mastic samples analyzed, and all mastic was determined to be non-asbestos. The total number of non-asbestos mastic samples collected exceeds the regulatory sample frequency requirements and the mastic present beneath the 12"x12" red and black checkered vinyl floor tiles can be treated as non-asbestos.



Asbestos-containing 9"x9" vinyl floor tiles of various colours.



Asbestos-containing 9"x9" vinyl floor tiles of various colours.



Non-asbestos 12"x12" red and black vinyl floor tiles in a checkered pattern.



Non-asbestos 12"x12" beige vinyl floor tiles with white and beige blotches.



Asbestos-containing 12"x12" beige vinyl floor tiles with brown streaks.



Non-asbestos 12"x12" off-white vinyl floor tiles with grey flecks.



Non-asbestos 12"x12" grey vinyl floor tiles with white and grey flecks.



Non-asbestos 12:x12" turquoise vinyl floor tiles with white flecks.



Non-asbestos 12"x12" beige vinyl floor tiles with sparse white and brown flecks.



Non-asbestos 12:x12" off-white vinyl floor tiles with black and grey streaks.

4.1.12 *Levelling Compound*

Levelling compound associated with the asbestos-containing 12"x12" beige vinyl floor tiles with brown streaks and 12"x12" red vinyl floor tiles does not contain asbestos (previous samples 0015A-C; phase B and 0020A-C; phase B).

4.1.13 *Sealants, Caulking, and Putty*

The following table presents a summary of caulking, sealants and putties present.

| Material, Colour | Application | Sample Locations | Sample Number | Asbestos Type |
|--------------------------|--|---|--------------------------|---------------|
| Caulking, beige | Exterior window and door frames | Exterior | Previous samples 0031A-C | Chrysotile |
| Caulking, brown and grey | Exterior window and door frames | Exterior | Previous samples 0033A-C | Chrysotile |
| Caulking, grey | Exterior expansion joints | Exterior | Previous samples 0032A-C | None Detected |
| Caulking, firm grey | Interior window frames | Throughout 1975 addition | S0040A-C | None Detected |
| Caulking, soft grey | Interior window frames | Throughout building, excluding 1975 addition | S0041A-C | Chrysotile |
| Butyl sealant, black | Exterior windows | Exterior of 1975 addition | S0049A-C | Chrysotile |
| Butyl sealant, grey | Exterior windows | Exterior of building, excluding 1975 addition | S0050A-C | Chrysotile |
| Caulking, grey | Joints of metal panels on front façade | Exterior | S0051A-C | None Detected |



Asbestos-containing beige caulking on exterior window frame.



Asbestos-containing brown/grey caulking on exterior door frame.




Non-asbestos grey caulking at exterior expansion joint.




Non-asbestos firm grey caulking on interior window frame.




Asbestos-containing soft grey caulking on interior window frame.

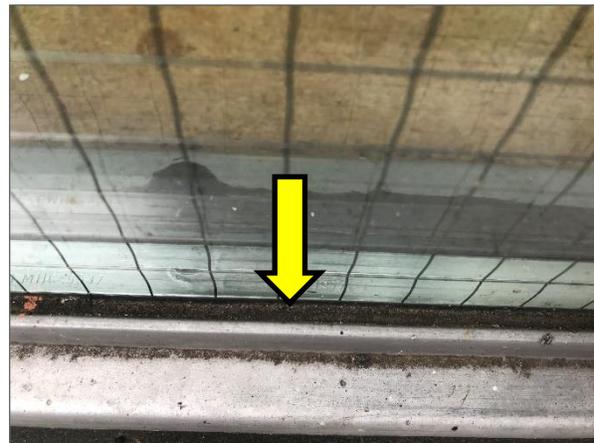

Asbestos-containing black butyl sealant on interior window.

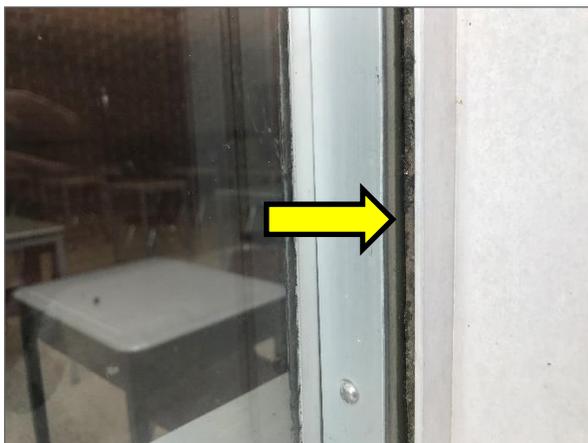

Asbestos-containing grey butyl sealant on exterior window.

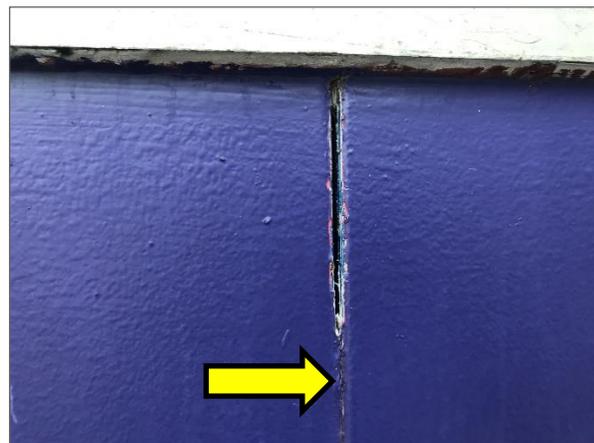

Non-asbestos grey caulking between metal panels.

4.1.14 Paper and Textile Products

A paper heat shield, containing chrysotile asbestos, is present within an incandescent light fixture in Basement Room 002 (previous samples 0017A-C).



Asbestos-containing heat shield.

4.1.15 Other Building Materials

Various colours of paint, containing chrysotile asbestos, is present on poured and precast concrete and brick walls throughout the building (samples S0042A-G S0059A-E, S0060A-D, S0061A-G, S0062A-F, S0063A-F, S0064A-F, S0065A-E, S0066A-G, S0067A-F and S0068A-D).

Adhesive present behind rubber baseboards throughout the building do not contain asbestos (samples S0043A-G).

Terrazzo floors present throughout the assessed area do not contain asbestos (samples S0044A-G).

Off-white paint present on the concrete structure in various locations throughout the assessed area does not contain asbestos (samples S0045A-E).

Mortar present between joints of exterior brick cladding does not contain asbestos (samples S0052A-G).

Thinset, presumed to contain asbestos, is present under various styles of ceramic tiles in isolated locations throughout the building. Due to the destructive nature of sampling, sampling of thinsets was not performed. Ceramic tiles and thinset are not anticipated to be disturbed as part of the planned renovations.



Asbestos-containing paint present on concrete block wall.



Damaged asbestos-containing paint on concrete block wall in Storage Room 139.



Non-asbestos adhesive present behind rubber baseboard.



Non-asbestos terrazzo floor.



Non-asbestos off-white paint on concrete structure.



Non-asbestos mortar present between joints of exterior brick cladding.



Presumed asbestos-containing thinset present behind ceramic tiles on floor.



Presumed asbestos-containing thinset present behind ceramic tiles on floor.

4.1.16 Excluded Materials

The following is a list of materials which may contain asbestos and was excluded from the assessment. These materials are presumed to contain asbestos until otherwise proven by sampling and analysis:

- Roofing felts and tar, mastics.
- Mechanical packing, ropes and gaskets.
- Fire resistant doors.
- Vibration dampers on HVAC equipment.
- Ropes and gaskets in cast-iron bell and spigot joints.
- Sealants on pipe threads.
- Materials concealed or outside of the assessed area.

4.2 Lead

4.2.1 Paints and Surface Coatings

The following table summarizes the analytical results of paints sampled.

| Sample Number | Colour, Substrate Description | Sample Location | Lead (%) |
|---------------|-------------------------------|---|----------|
| L0001 | Red on steel structure | Composite sample | 0.393 |
| L0002 | Grey on concrete floors | Composite sample | 0.0958 |
| L0003 | Yellow on textured plaster | Mechanical Room 161 and Resource Centre 129 | 0.0194 |
| L0004 | Off-white on plaster | Composite sample | 0.0568 |

| Sample Number | Colour, Substrate Description | Sample Location | Lead (%) |
|---------------|-------------------------------------|-------------------------|---------------|
| L0005 | Off-white on drywall | Composite sample | 0.0055 |
| L0006 | Green/pink on drywall | Composite sample | 0.0027 |
| L0007 | Yellow on concrete block | Composite sample | 0.0945 |
| L0008 | Pink on concrete block | Music Room 188 | 0.0144 |
| L0009 | Black on concrete block | Stage 140 | 0.0043 |
| L0010 | Off-white on concrete structure | Custodial Room 146 | 0.0011 |
| L0011 | Off-white on metal radiators | Composite sample | 0.0828 |

Results above 0.1% (1,000 mg/kg) are considered lead-containing.

Results less than or equal to 0.1% (1,000 mg/kg), but equal to or greater than 0.009% (90 mg/kg), are considered low-level lead paints or surface coatings in accordance with the EACC guideline.

Paints containing less than 0.009% (90 mg/kg) lead is assumed to be insignificant.

4.2.2 Lead Products and Applications

Lead-containing batteries are present in emergency lighting and fire control panels.

Lead caulking is present in bell and spigot fittings on cast iron pipes.

Lead sheeting is present on a wall in Basement Room 002.



Lead-acid batteries are present in emergency lights.



Lead-acid batteries are present in fire alarm control panels.



Lead caulking is present in fittings of bell and spigot fittings of cast iron pipes.



Lead sheeting present on wall.

4.2.3 Excluded Lead Materials

Lead is known to be present in a number of materials which were not assessed or sampled. The following materials, where found, should be presumed to contain lead:

- Electrical components, including wiring connectors, grounding conductors, and solder.
- Solder on pipe connections.
- Glazing on ceramic tiles.

4.3 Silica

Crystalline silica is known to be a component of the following materials:

- Poured or pre-cast concrete
- Masonry and mortar
- Ceramic tiles and grout
- Plaster
- Drywall
- Ceiling tiles
- Terrazzo

4.4 Mercury

4.4.1 Lamps

Mercury vapour is present in fluorescent lamp tubes and other lighting that is known to contain mercury such as metal halide lamps.

4.4.2 Mercury-Containing Devices

Mercury is present as a liquid in thermostats ampules.

Mercury is present as a liquid in instrumentation in boiler and mechanical rooms.



Liquid mercury is present in thermostat ampules.

4.5 Polychlorinated Biphenyls

4.5.1 Caulking and Sealants

The following table presents a summary of caulking sampled.

| Material, Colour | Sample Location | Sample Number | PCB concentration mg/kg |
|-------------------------------|--------------------------------------|--------------------------|--|
| Butyl sealant, black and grey | Exterior windows | P0001 (composite sample) | <5 |
| Caulking, various colours | Interior and exterior window frames | P0002 (composite sample) | <5 |
| Caulking, grey | Between metal panels on front façade | P0003 | <5 |
| Caulking, grey | Exterior expansion joints | - | Presumed (not anticipated to be disturbed as part of planned renovations) |

Caulking highlighted in the table above is presumed to be a PCB solid based on the threshold (50 mg/kg).

4.5.2 Lighting Ballasts

Based on observations (evidence of T-8 fixtures) the building has been comprehensively re-lamped and will not contain PCB ballasts.

4.5.3 Transformers

All transformers in the building are dry type transformers and do not contain PCB-containing dielectric fluids; however, may contain capacitors, which could not be assessed for PCBs as the equipment was in service.

4.6 Mould and Water Damage

Visible mould growth was not observed; however, water staining was observed on various non-asbestos lay-in ceiling tiles throughout the assessed area, as follows:

- Classroom 110 – 1 tile
- Classroom 112 – 9 tiles
- Classroom 125 – 4 tiles
- Washroom 128 – 3 tiles
- Resource Centre 129 – 10 tiles
- Office 129A – 4 tiles
- Classroom 212 – 3 tiles
- Classroom 217 – 3 tiles
- Storage 227 – 5 tiles



Water stained lay-in acoustic ceiling tiles in Classroom 112.



Water stained lay-in acoustic ceiling tiles in Classroom 225.



Water stained lay-in acoustic ceiling tiles in Classroom 225.



Water stained lay-in acoustic ceiling tiles in Washroom 128.



Water stained lay-in acoustic ceiling tiles in Office 129A.



Water stained lay-in acoustic ceiling tiles in Classroom 212.



Water stained lay-in acoustic ceiling tiles in Classroom 217.



Water stained lay-in acoustic ceiling tiles in Classroom 217.



Water stained lay-in acoustic ceiling tiles in Storage 227.



Water stained lay-in acoustic ceiling tiles in Storage 227.

5.0 RECOMMENDATIONS

5.1 General

1. Prepare scope of work or performance specifications for hazardous material removal required for the planned work. The specifications should include safe work practices, personal protective equipment, respiratory protection, and disposal of waste materials.
2. If suspected hazardous building materials are discovered during the planned work, which are not identified in this report, do not disturb and arrange for further testing and evaluation.
3. Conduct further investigation of the following items, areas or locations, which were not completed during this assessment:
 - a. Sample thinset behind ceramic tiles for asbestos analysis prior to disturbance.
 - b. Sample caulking in exterior expansion joints for PCB analysis prior to disturbance.
 - c. Materials listed as exclusions in this report.
4. Provide this report and the detailed plans and specifications to the contractor prior to bidding or commencing work.
5. Retain a qualified consultant to specify, observe and document the successful removal of hazardous materials.
6. Update the asbestos inventory upon completion of the abatement and removal of asbestos-containing materials and any other relevant findings.



5.2 Remedial Work

The following remedial work is recommended regardless of the planned construction work due to the condition and location of the material.

| Material, Quantity & Condition | Current Room Number | Recommended Procedure |
|--|----------------------------|--|
| Drywall joint compound on bulkhead, five square feet, poor condition | Room 128 | Remove/repair in accordance with Type 1 asbestos abatement procedures |
| Paint on concrete block wall, 300 square feet, poor condition | Room 139 | Remove in accordance with Type 1 asbestos abatement procedures |
| Parging cement insulation, one fitting, poor condition | Room 142 | Remove in accordance with Type 2 or Glove Bag asbestos abatement procedures |
| Parging cement insulation, one fitting fair condition and one fitting poor condition | Room 149 | Remove/repair in accordance with Type 2 or Glove Bag asbestos abatement procedures |
| Parging cement insulation, one fitting, fair condition | Room 153 | Remove/repair in accordance with Type 2 or Glove Bag asbestos abatement procedures |
| Paint on concrete block wall, five square feet, poor condition | Room 187 | Remove in accordance with Type 1 asbestos abatement procedures |
| Paint on concrete block wall, 15 square feet, poor condition | Room 191 | Remove in accordance with Type 1 asbestos abatement procedures |
| Drywall joint compound on wall, five square feet, poor condition | Room 212 | Remove/repair in accordance with Type 1 asbestos abatement procedures |
| Drywall joint compound on wall, five square feet, poor condition | Room 215 | Remove/repair in accordance with Type 1 asbestos abatement procedures |

5.3 Building Renovation Work

The following recommendations are made regarding renovation involving the hazardous materials identified.

5.3.1 Asbestos

Remove asbestos-containing materials (ACM) prior to renovation, alteration, or maintenance if ACM may be disturbed by the work.



If the identified ACM will not be removed prior to commencement of the work, any potential disturbance of ACM must follow asbestos precautions appropriate for the type of work being performed.

Asbestos-containing materials must be disposed of at a landfill approved to accept asbestos waste.

5.3.2 *Lead*

For lead-containing or lead-based paints (i.e., greater than the EACC guideline of 0.1% (1,000 mg/kg) for lead-containing paints, and 0.5% (5,000 mg/kg) for lead-based), construction disturbance may result in over-exposure to lead dust or fumes. The need for work procedures, engineering controls and personal protective equipment should be assessed on a site-specific basis to comply with Ministry of Labour, Training and Skills Development regulations and guidelines.

For paints identified as having low levels of lead (i.e., less than the EACC guideline of 0.1% (1,000 mg/kg) for lead-containing paints but equal to or above 0.009% (90 mg/kg)) special precautions are not recommended unless aggressive disturbance (grinding, blasting, torching) is planned. Exposure from construction disturbance of paints containing lead less than 0.009% (90 mg/kg) is assumed to be insignificant.

Lead-containing items should be recycled when taken out of service.

5.3.3 *Silica*

Construction disturbance of silica-containing products may result in excessive exposures to airborne silica, especially if performed indoors and dry. Cutting, grinding, drilling or demolition of materials containing silica should be completed only with proper respiratory protection and other worker safety precautions that comply with per applicable regulations and guidelines.

5.3.4 *Mercury*

Do not break lamps or separate liquid mercury from components. Recycle and reclaim mercury from fluorescent lamps and thermostats when taken out of service. Mercury is classified as a hazardous waste and must be disposed of in accordance with applicable regulations.

5.3.5 *PCBs*

PCB light ballasts must be removed from service and properly disposed of by December 31, 2025.

Remove PCB caulking if affected by the renovation work. PCB caulking is a hazardous waste; package and ship for destruction at a federally permitted facility.



6.0 TERMS AND LIMITATIONS

This work was performed subject to the Terms and Limitations presented or referenced in the proposal for this project.

Information provided by Pinchin is intended for Client use only. Pinchin will not provide results or information to any party unless disclosure by Pinchin is required by law. Any use by a third party of reports or documents authored by Pinchin or any reliance by a third party on or decisions made by a third party based on the findings described in said documents, is the sole responsibility of such third parties. Pinchin accepts no responsibility for damages suffered by any third party as a result of decisions made or actions conducted. No other warranties are implied or expressed.

7.0 REFERENCES


The following legislation and documents were referenced in completing the assessment and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.
3. Lead on Construction Projects, Ministry of Labour Guidance Document.
4. The Environmental Abatement Council of Canada (EACC) Lead Guideline for Construction, Renovation, Maintenance or Repair.
5. Ministry of the Environment Regulation, R.R.O. 1990 Reg. 347 as amended.
6. Ministry of the Environment Regulation, R.R.O. 1990 Reg. 362 as amended.
7. Silica on Construction Projects, Ministry of Labour Guidance Document.
8. Alert – Mould in Workplace Buildings, Ontario Ministry of Labour.
9. PCB Regulations, SOR/2008-273, Canadian Environmental Protection Act.
10. Surface Coating Materials Regulations, SOR/2016-193, Canada Consumer Product Safety Act.
11. Consolidated Transportation of Dangerous Goods Regulations, including Amendment SOR/2019-101, Transportation of Dangerous Goods Act.
12. Mould Guidelines for the Canadian Construction Industry, Standard Construction Document CCA 82 – 2004 (Revised 2018), Canadian Construction Association.

\\pinchin.com\kgn\Job\200000s\0200584.000 HPEDSB, various, BellevilleON, HAZ, DSS\0200584.061 HPEDSB, MoiraEastsideSS, HAZ, DSR\Deliverables\200584.061 HBMA 275FarleyAveBellevilleON HPEDSB.docx

Template: Master Report for Hazardous Materials Assessment (Pre-Construction), HAZ, July 29, 2021

APPENDIX I
Drawings

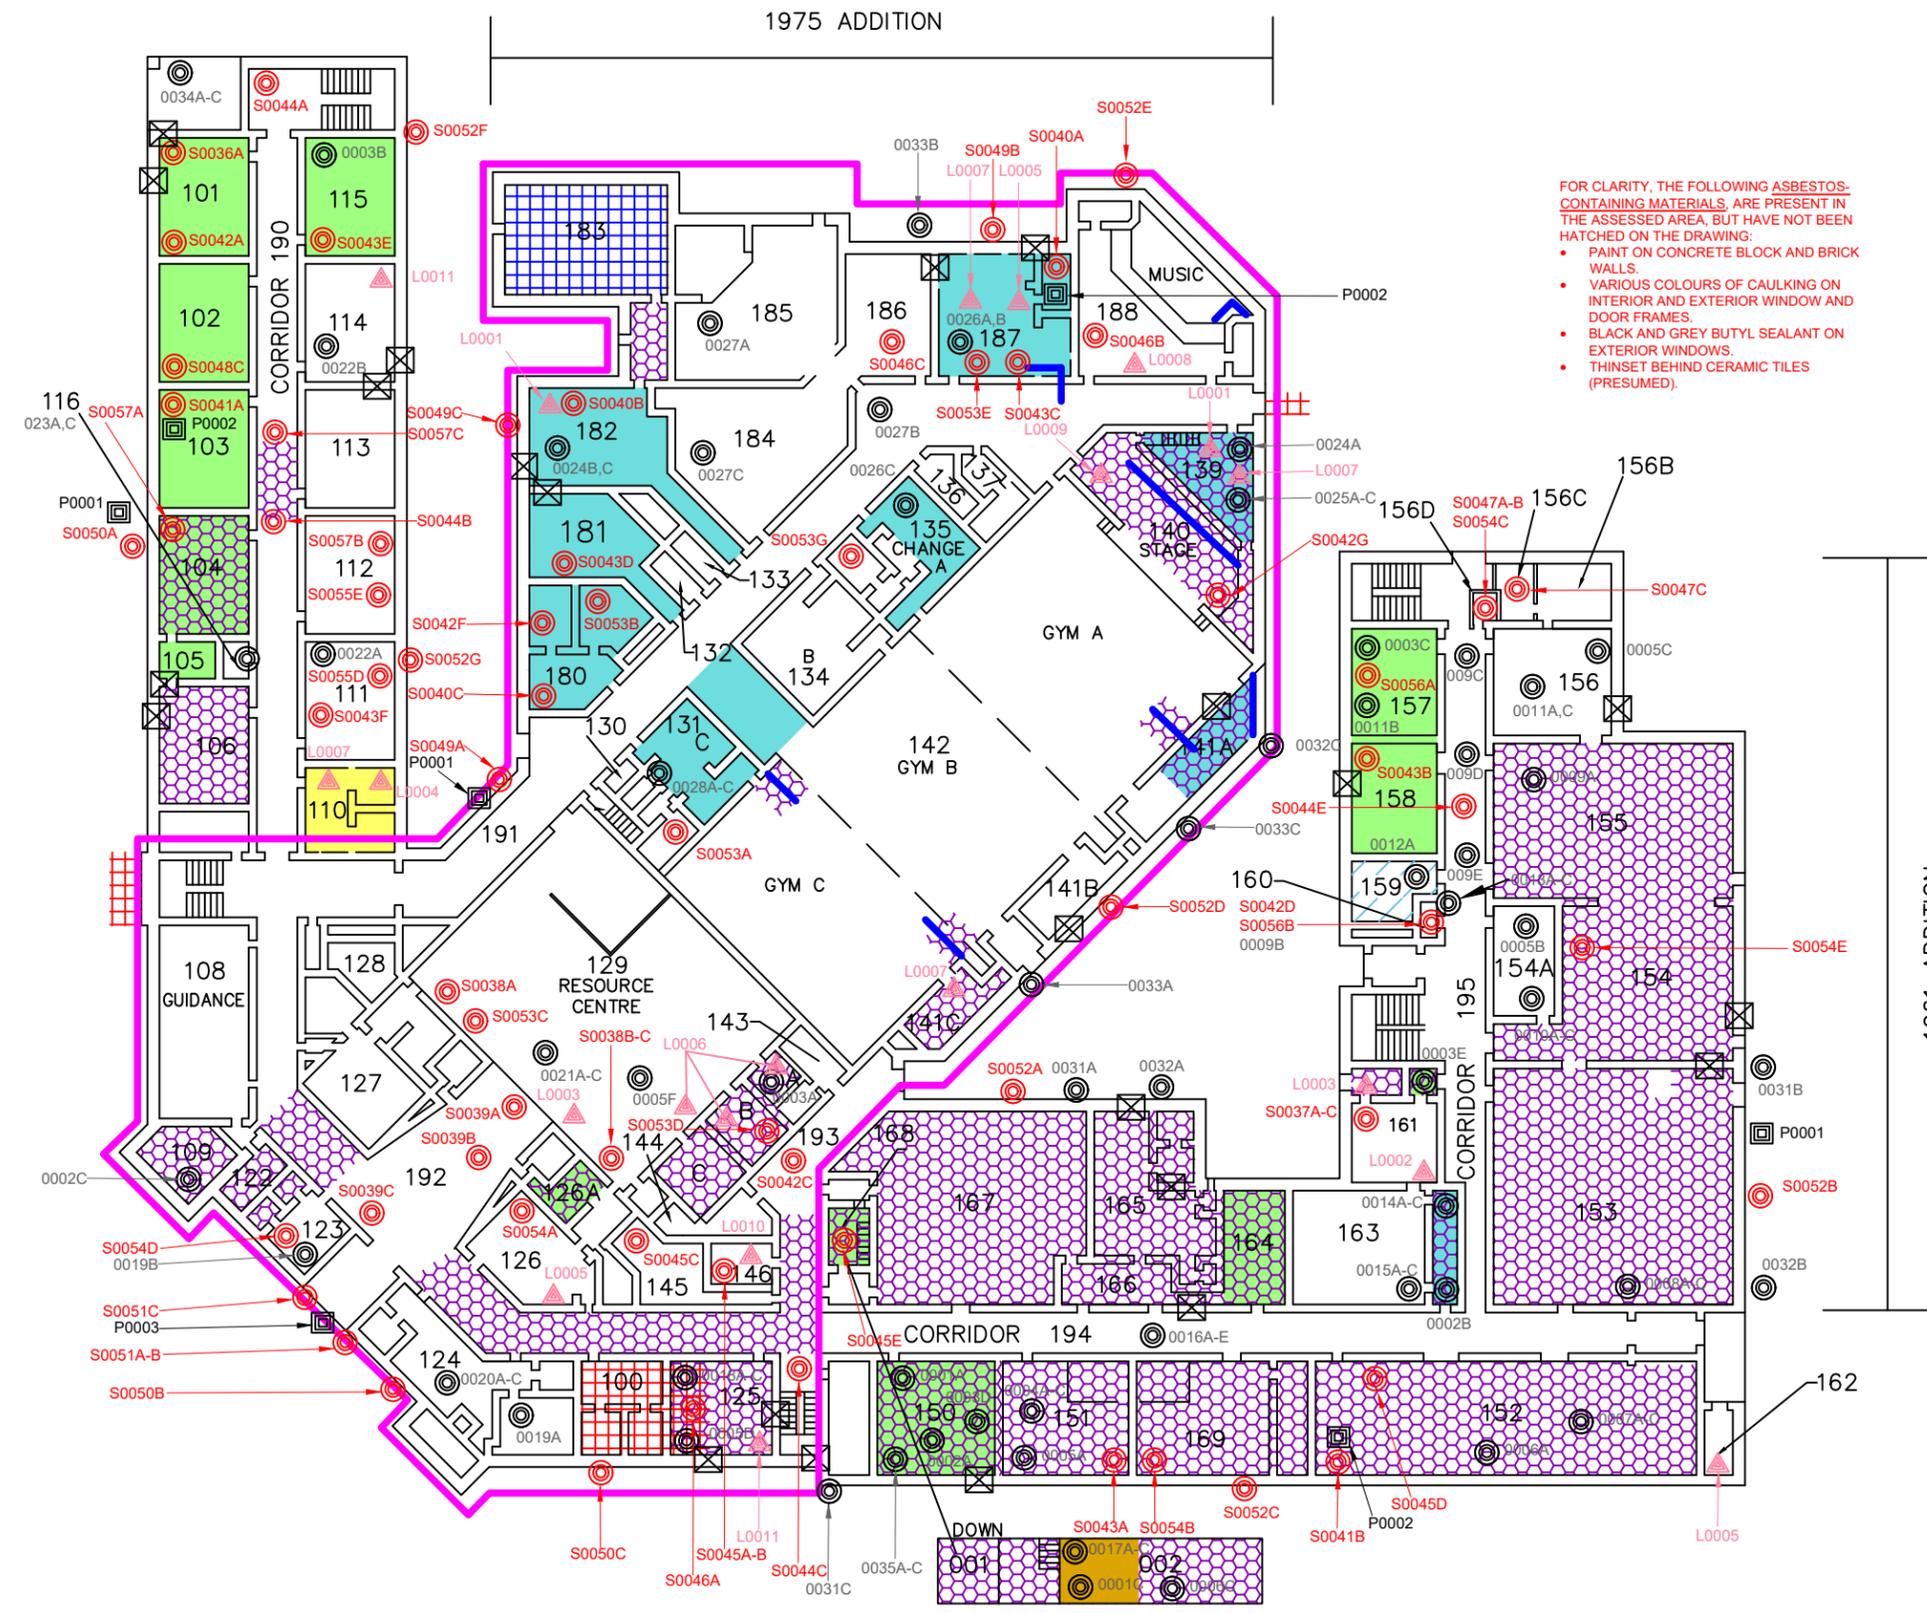

FOR CLARITY, THE FOLLOWING ASBESTOS-CONTAINING MATERIALS, ARE PRESENT IN THE ASSESSED AREA, BUT HAVE NOT BEEN HATCHED ON THE DRAWING:

- PAINT ON CONCRETE BLOCK AND BRICK WALLS.
- VARIOUS COLOURS OF CAULKING ON INTERIOR AND EXTERIOR WINDOW AND DOOR FRAMES.
- BLACK AND GREY BUTYL SEALANT ON EXTERIOR WINDOWS.
- THINSET BEHIND CERAMIC TILES (PRESUMED).

- LEGEND:**
- NEW ASBESTOS BULK SAMPLE
 - LEAD BULK SAMPLE
 - PCB BULK SAMPLE
 - PREVIOUS ASBESTOS BULK SAMPLE
 - INTRUSIVE INSPECTION LOCATION
- ASBESTOS CONTAINING MATERIALS:**
- PIPE INSULATION
 - VINYL FLOOR TILES & MASTIC
 - MASTIC UNDER VINYL FLOOR TILE
 - VINYL FLOOR TILES
 - TEXTURE FINISH
 - HEAT SHIELD
 - TRANSITE CEILING PANELS AND BOARD
 - TRANSITE COUNTERTOPS AND DRYING RACKS
 - TRANSITE PIPE
 - AREA OF DRYWALL JOINT COMPOUND

CLIENT:
HASTINGS AND PRINCE EDWARD
DISTRICT SCHOOL BOARD

LOCATION:
EASTSIDE SECONDARY SCHOOL
275 FARLEY AVENUE
BELLEVILLE, ONTARIO

TITLE:
HAZARDOUS BUILDING MATERIALS
ASSESSMENT
GROUND FLOOR AND BASEMENT

| | |
|---------------------------|---------------------------------|
| DATE: JULY 2023 | PROJECT #: 200584.061 |
|---------------------------|---------------------------------|

| | |
|----------------------------|--------------------------------------|
| DRAWN BY: J.A. | DRAWING: 1 OF 2 |
| CHECKED BY: S.Y. | |

| |
|----------------------|
| SCALE: NTS |
|----------------------|

NOTE:
NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.



1975 ADDITION

1961 ADDITION

FOR CLARITY, THE FOLLOWING ASBESTOS-CONTAINING MATERIALS, ARE PRESENT IN THE ASSESSED AREA, BUT HAVE NOT BEEN HATCHED ON THE DRAWING:

- PAINT ON CONCRETE BLOCK AND BRICK WALLS.
- VARIOUS COLOURS OF CAULKING ON INTERIOR AND EXTERIOR WINDOW AND DOOR FRAMES.
- BLACK AND GREY BUTYL SEALANT ON EXTERIOR WINDOWS.
- THINSET BEHIND CERAMIC TILES (PRESUMED).



- LEGEND:**
- NEW ASBESTOS BULK SAMPLE
 - LEAD BULK SAMPLE
 - PCB BULK SAMPLE
 - PREVIOUS ASBESTOS BULK SAMPLE
 - INTRUSIVE INSPECTION LOCATION
- ASBESTOS CONTAINING MATERIALS:**
- PIPE INSULATION
 - VINYL FLOOR TILES & MASTIC
 - MASTIC UNDER VINYL FLOOR TILE
 - VINYL FLOOR TILES
 - TEXTURE FINISH
 - HEAT SHIELD
 - TRANSITE CEILING PANELS AND BOARD
 - TRANSITE COUNTERTOPS AND DRYING RACKS
 - TRANSITE PIPE
 - AREA OF DRYWALL JOINT COMPOUND

CLIENT:
HASTINGS AND PRINCE EDWARD
DISTRICT SCHOOL BOARD

LOCATION:
EASTSIDE SECONDARY SCHOOL
275 FARLEY AVENUE
BELLEVILLE, ONTARIO

TITLE:
HAZARDOUS BUILDING MATERIALS
ASSESSMENT
SECOND FLOOR

| | |
|---------------------------|----------------------------------|
| DATE: JULY 2023 | PROJECT # : 200584.061 |
|---------------------------|----------------------------------|

| | |
|----------------------------|--------------------------------------|
| DRAWN BY: J.A. | DRAWING: 2 OF 2 |
| CHECKED BY: S.Y. | |
| SCALE: NTS | |

NOTE:
NOT ALL KNOWN OR SUSPECTED HAZARDOUS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE HAZARDOUS BUILDING MATERIALS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED HAZARDOUS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

APPENDIX II-A
Asbestos Analytical Certificates



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|--|----------------|--------------------|------------------------|---------------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 001A | Aircell pipe insulation, Location 150 | 55% Chrysotile | 30% Cellulose | 15% Other | Tan, White Fibrous Heterogeneous |
| 1717806PLM_1 | | | | | Teased |
| 001B | Aircell pipe insulation, Location 230 | Not Analyzed | | | |
| 1717806PLM_2 | | | | | |
| 001C | Aircell pipe insulation, Location 002 | Not Analyzed | | | |
| 1717806PLM_3 | | | | | |
| 002A - A | Brown pressed paper insulation, Location 150 | None Detected | 80% Cellulose | 20% Other | Black Fibrous Heterogeneous |
| 1717806PLM_4 | felt | | | | Dissolved, Teased |
| 002A - B | Brown pressed paper insulation, Location 150 | 2% Chrysotile | 90% Cellulose | 8% Other | Tan Fibrous Heterogeneous |
| 1717806PLM_173 | paper | | | | Teased |
| 002B | Brown pressed paper insulation, Custodial Office | Not Analyzed | | | |
| 1717806PLM_5 | paper only | | | | |
| 002C | Brown pressed paper insulation, Location 109 | Not Analyzed | | | |
| 1717806PLM_6 | paper only | | | | |
| 003A - A | 9" vinyl floor tiles, various patterns and colours, IT Room at Resource Centre | 4% Chrysotile | | 96% Other | Gray, White Non Fibrous Heterogeneous |
| 1717806PLM_7 | tile | | | | Dissolved |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reprinted, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|--|---------------|--------------------|------------------------|-------------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 003A - B | 9" vinyl floor tiles, various patterns and colours, IT Room at Resource Centre | 5% Chrysotile | 5% Cellulose | 90% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_119 | mastic | | | | Dissolved |
| 003B - A | 9" vinyl floor tiles, various patterns and colours, Location 115 | Not Analyzed | | | |
| 1717806PLM_8 | tile | | | | |
| 003B - B | 9" vinyl floor tiles, various patterns and colours, Location 115 | Not Analyzed | | | |
| 1717806PLM_120 | mastic | | | | |
| 003C - A | 9" vinyl floor tiles, various patterns and colours, Location 157 | Not Analyzed | | | |
| 1717806PLM_9 | tile | | | | |
| 003C - B | 9" vinyl floor tiles, various patterns and colours, Location 157 | Not Analyzed | | | |
| 1717806PLM_121 | mastic | | | | |
| 003D - A | 9" vinyl floor tiles, various patterns and colours, Location 150 | Not Analyzed | | | |
| 1717806PLM_10 | tile | | | | |
| 003D - B | 9" vinyl floor tiles, various patterns and colours, Location 150 | Not Analyzed | | | |
| 1717806PLM_122 | mastic | | | | |
| 003E - A | 9" vinyl floor tiles, various patterns and colours, Custodial at Location 161 | Not Analyzed | | | |
| 1717806PLM_11 | tile | | | | |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



NVLAP Lab Code: 200664-0



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|---------------|--------------------|------------------------|---------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 003E - B | 9" vinyl floor tiles, various patterns and colours, Custodial at Location 161 | Not Analyzed | | | |
| 1717806PLM_123 | mastic | | | | |
| 004A - A | 12" beige vinyl floor tiles, Location 151A | None Detected | | 100% Other | Beige Non Fibrous Heterogeneous |
| 1717806PLM_12 | tile | | | | Dissolved |
| 004A - B | 12" beige vinyl floor tiles, Location 151A | None Detected | 3% Cellulose | 97% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_124 | mastic | | | | Dissolved |
| 004B - A | 12" beige vinyl floor tiles, Location 151A | None Detected | | 100% Other | Beige Non Fibrous Heterogeneous |
| 1717806PLM_13 | tile | | | | Dissolved |
| 004B - B | 12" beige vinyl floor tiles, Location 151A | None Detected | 3% Cellulose | 97% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_174 | mastic | | | | Dissolved |
| 004C - A | 12" beige vinyl floor tiles, Location 151A | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_14 | tile - ashed | | | | Ashed |
| 004C - B | 12" beige vinyl floor tiles, Location 151A | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_126 | mastic | | | | Dissolved |
| 005A | Drywall joint compound, Location 151 | None Detected | | 100% Other | White Non Fibrous Homogeneous |
| 1717806PLM_15 | | | | | Crushed |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory




Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



NVLAP Lab Code: 200664-0



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|---------------|--|----------------|--------------------|------------------------|-------------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 005B | Drywall joint compound, Location 154A | None Detected | | 100% Other | White Non Fibrous Homogeneous |
| 1717806PLM_16 | | | | | Crushed |
| 005C | Drywall joint compound, Location 156C | None Detected | | 100% Other | White Non Fibrous Homogeneous |
| 1717806PLM_17 | | | | | Crushed |
| 005D | Drywall joint compound, Location 125 | None Detected | | 100% Other | White Non Fibrous Homogeneous |
| 1717806PLM_18 | | | | | Crushed |
| 005E | Drywall joint compound, Location 212 | 3% Chrysotile | | 97% Other | White Non Fibrous Homogeneous |
| 1717806PLM_19 | | | | | Crushed |
| 005F | Drywall joint compound, Location 129 | Not Analyzed | | | |
| 1717806PLM_20 | | | | | |
| 005G | Drywall joint compound, Location 215 | Not Analyzed | | | |
| 1717806PLM_21 | | | | | |
| 006A | Parging Cement, 1959 Portion, Location 152 | 30% Chrysotile | | 70% Other | Gray Fibrous Heterogeneous |
| 1717806PLM_22 | | | | | Teased |
| 006B | Parging Cement, 1959 Portion, Location 230 | Not Analyzed | | | |
| 1717806PLM_23 | | | | | |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|---------------|--|----------------|--------------------|------------------------|-----------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 006C | Parging Cement, 1959 Portion, Location 002 | Not Analyzed | | | |
| 1717806PLM_24 | | | | | |
| 007A | Brown duct mastic, Location 152 | None Detected | 10% Wollastonite | 90% Other | Brown Non Fibrous Homogeneous |
| 1717806PLM_25 | | | | | Ashed |
| 007B | Brown duct mastic, Location 152 | None Detected | 10% Wollastonite | 90% Other | Brown Non Fibrous Homogeneous |
| 1717806PLM_26 | | | | | Ashed |
| 007C | Brown duct mastic, Location 152 | None Detected | 10% Wollastonite | 90% Other | Brown Non Fibrous Homogeneous |
| 1717806PLM_27 | | | | | Ashed |
| 008A | Parging cement, 1961 portion, Location 153 | 30% Chrysotile | 10% Cellulose | 60% Other | Gray, White Fibrous Heterogeneous |
| 1717806PLM_28 | | | | | Teased |
| 008B | Parging cement, 1961 portion, Location 153 | Not Analyzed | | | |
| 1717806PLM_29 | | | | | |
| 008C | Parging cement, 1961 portion, Location 153 | Not Analyzed | | | |
| 1717806PLM_30 | | | | | |
| 009A - A | Smooth plaster, 1959 portion, Location 155 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_31 | finish | | | | Crushed |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



NVLAP Lab Code: 200664-0



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|--|---------------|--------------------|--------------------------|---------------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 009A - B | Smooth plaster, 1959 portion, Location 155 | None Detected | | 70% Other 30% Perlite | Gray Non Fibrous Heterogeneous |
| 1717806PLM_127 | base | | | | Crushed |
| 009B - A | Smooth plaster, 1959 portion, Location 160 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_32 | finish | | | | Crushed |
| 009B - B | Smooth plaster, 1959 portion, Location 160 | None Detected | | 70% Other 30% Perlite | Gray Non Fibrous Heterogeneous |
| 1717806PLM_128 | base | | | | Crushed |
| 009C - A | Smooth plaster, 1959 portion, Location 195 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_33 | finish | | | | Ashed |
| 009C - B | Smooth plaster, 1959 portion, Location 195 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_129 | base | | | | Crushed |
| 009D - A | Smooth plaster, 1959 portion, Location 196 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_34 | finish | | | | Crushed |
| 009D - B | Smooth plaster, 1959 portion, Location 196 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_130 | base | | | | Crushed |
| 009E - A | Smooth plaster, 1959 portion, Location 195 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_35 | finish | | | | Crushed |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|---------------|-----------------------------------|--------------------------|---|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 009E - B | Smooth plaster, 1959 portion, Location 195 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_131 | base | | | | Crushed |
| 009F - A | Smooth plaster, 1959 portion, Location 261 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_36 | finish | | | | Crushed |
| 009F - B | Smooth plaster, 1959 portion, Location 261 | None Detected | | 70% Other 30% Perlite | Gray Non Fibrous Heterogeneous |
| 1717806PLM_132 | base | | | | Crushed |
| 009G - A | Smooth plaster, 1959 portion, Location 261 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_37 | finish | | | | Crushed |
| 009G - B | Smooth plaster, 1959 portion, Location 261 | None Detected | | 70% Other 30% Perlite | Gray Non Fibrous Heterogeneous |
| 1717806PLM_133 | base | | | | Crushed |
| 0010A | 2 x 4 acoustic ceiling tile, dense small and medium pinhole pattern, Location 154 | None Detected | 50% Cellulose 30% Mineral Wool | 10% Perlite 10% Other | Gray, White Fibrous Heterogeneous |
| 1717806PLM_38 | | | | | Teased |
| 0010B | 2 x 4 acoustic ceiling tile, dense small and medium pinhole pattern, Location 154 | None Detected | 50% Cellulose 30% Mineral Wool | 10% Perlite 10% Other | Gray, White Fibrous Heterogeneous |
| 1717806PLM_39 | | | | | Teased |
| 0010C | 2 x 4 acoustic ceiling tile, dense small and medium pinhole pattern, Location 154 | None Detected | 50% Cellulose 30% Mineral Wool | 10% Perlite 10% Other | Gray, White Fibrous Heterogeneous |
| 1717806PLM_40 | | | | | Teased |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|---------------|---|---------------|--------------------|--------------------------|----------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0011A | 1' x 1; Acoustic ceiling tile, large and medium uniform pinhole, Location 156 | None Detected | 85% Cellulose | 15% Other | Tan, White Fibrous Heterogeneous |
| 1717806PLM_41 | | | | | Teased |
| 0011B | 1' x 1; Acoustic ceiling tile, large and medium uniform pinhole, Location 157 | None Detected | 85% Cellulose | 15% Other | Tan, White Fibrous Heterogeneous |
| 1717806PLM_42 | | | | | Teased |
| 0011C | 1' x 1; Acoustic ceiling tile, large and medium uniform pinhole, Location 156 | None Detected | 85% Cellulose | 15% Other | Tan, White Fibrous Heterogeneous |
| 1717806PLM_43 | | | | | Teased |
| 0012A | Ceiling texture, Location 159 | 5% Chrysotile | | 50% Perlite 45% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_44 | | | | | Teased |
| 0012B | Ceiling texture, Location 257 | Not Analyzed | | | |
| 1717806PLM_45 | | | | | |
| 0012C | Ceiling texture, Location 257 | Not Analyzed | | | |
| 1717806PLM_46 | | | | | |
| 0013A | 12" vinyl floor tile, red and black checkered pattern, Location 160 | None Detected | | 100% Other | Red Non Fibrous Heterogeneous |
| 1717806PLM_47 | tile only | | | | Dissolved |
| 0013B | 12" vinyl floor tile, red and black checkered pattern, Location 160 | None Detected | | 100% Other | Red Non Fibrous Heterogeneous |
| 1717806PLM_48 | tile only | | | | Dissolved |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|----------------|--------------------|------------------------|--|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0013C - A | 12" vinyl floor tile, red and black checkered pattern, Location 160 | None Detected | | 100% Other | Black Non Fibrous Heterogeneous |
| 1717806PLM_49 | tile - ashed | | | | Ashed |
| 0013C - B | 12" vinyl floor tile, red and black checkered pattern, Location 160 | None Detected | | 100% Other | Yellow Non Fibrous Homogeneous |
| 1717806PLM_134 | mastic | | | | Dissolved |
| 0014A | Aircell, 1961 portion, Custodial office | 40% Chrysotile | 50% Cellulose | 10% Other | Tan, White Fibrous Heterogeneous |
| 1717806PLM_50 | | | | | Teased |
| 0014B | Aircell, 1961 portion, Custodial office | Not Analyzed | | | |
| 1717806PLM_51 | | | | | |
| 0014C | Aircell, 1961 portion, Custodial office | Not Analyzed | | | |
| 1717806PLM_52 | | | | | |
| 0015A - A | 12" vinyl floor tile, beige with brown streaks, Location 163 | 3% Chrysotile | | 97% Other | Brown, Cream Non Fibrous Heterogeneous |
| 1717806PLM_53 | tile | | | | Dissolved |
| 0015A - B | 12" vinyl floor tile, beige with brown streaks, Location 163 | None Detected | | 100% Other | Gray, Yellow Non Fibrous Heterogeneous |
| 1717806PLM_135 | mastic/ leveling | | | | Crushed, Dissolved |
| 0015B - A | 12" vinyl floor tile, beige with brown streaks, Location 163 | Not Analyzed | | | |
| 1717806PLM_54 | tile | | | | |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|--|---------------|--------------------|------------------------|--|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0015B - B | 12" vinyl floor tile, beige with brown streaks, Location 163 | None Detected | 3% Cellulose | 97% Other | Gray, Yellow Non Fibrous Heterogeneous |
| 1717806PLM_136 | mastic/ leveling | | | | Crushed, Dissolved |
| 0015C - A | 12" vinyl floor tile, beige with brown streaks, Location 163 | Not Analyzed | | | |
| 1717806PLM_55 | tile | | | | |
| 0015C - B | 12" vinyl floor tile, beige with brown streaks, Location 163 | None Detected | 5% Cellulose | 95% Other | Gray, Yellow Non Fibrous Heterogeneous |
| 1717806PLM_137 | mastic/ leveling | | | | Crushed, Dissolved |
| 0016A - A | Plaster above lockers, Location 194 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_56 | finish | | | | Crushed |
| 0016A - B | Plaster above lockers, Location 194 | None Detected | 1% Hair | 99% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_138 | base | | | | Crushed |
| 0016B - A | Plaster above lockers, Location 194 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_57 | finish | | | | Crushed |
| 0016B - B | Plaster above lockers, Location 194 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_139 | base | | | | Crushed |
| 0016C - A | Plaster above lockers, Location 194 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_58 | finish | | | | Crushed |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|-------------------------------------|----------------|--------------------|------------------------|---|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0016C - B | Plaster above lockers, Location 194 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_140 | base | | | | Crushed |
| 0016D - A | Plaster above lockers, Location 194 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_59 | finish | | | | Crushed |
| 0016D - B | Plaster above lockers, Location 194 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_141 | base | | | | Crushed |
| 0016E - A | Plaster above lockers, Location 194 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_60 | finish | | | | Crushed |
| 0016E - B | Plaster above lockers, Location 194 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_142 | base | | | | Crushed |
| 0017A | Light heat shield, Location 002 | 70% Chrysotile | | 30% Other | White, Silver Fibrous Heterogeneous |
| 1717806PLM_61 | | | | | Teased |
| 0017B | Light heat shield, Location 002 | Not Analyzed | | | |
| 1717806PLM_62 | | | | | |
| 0017C | Light heat shield, Location 002 | Not Analyzed | | | |
| 1717806PLM_63 | | | | | |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|---------------|--------------------|------------------------|---|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0018A - A | 12" vinyl floor tile, off-white with grey fleck, Location 125 | None Detected | | 100% Other | Gray, White Non Fibrous Heterogeneous |
| 1717806PLM_64 | tile | | | | Dissolved |
| 0018A - B | 12" vinyl floor tile, off-white with grey fleck, Location 125 | None Detected | 3% Cellulose | 97% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_143 | mastic | | | | Dissolved |
| 0018B - A | 12" vinyl floor tile, off-white with grey fleck, Location 125 | None Detected | | 100% Other | Gray, White Non Fibrous Heterogeneous |
| 1717806PLM_65 | tile | | | | Dissolved |
| 0018B - B | 12" vinyl floor tile, off-white with grey fleck, Location 125 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_144 | mastic | | | | Dissolved |
| 0018C - A | 12" vinyl floor tile, off-white with grey fleck, Location 125 | None Detected | | 100% Other | Gray, White Non Fibrous Heterogeneous |
| 1717806PLM_66 | tile - ashed | | | | Dissolved |
| 0018C - B | 12" vinyl floor tile, off-white with grey fleck, Location 125 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_145 | mastic | | | | Dissolved |
| 0019A | 1' acoustic ceiling tile, random pinhole pattern, Principals Office | None Detected | 90% Mineral Wool | 10% Other | White Fibrous Heterogeneous |
| 1717806PLM_67 | ceiling tile only | | | | Teased |
| 0019B - A | 1' acoustic ceiling tile, random pinhole pattern, Location 123 | None Detected | 90% Mineral Wool | 10% Other | White Fibrous Heterogeneous |
| 1717806PLM_68 | ceiling tile | | | | Teased |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|--|---------------|--------------------|------------------------|--|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0019B - B | 1' acoustic ceiling tile, random pinhole pattern, Location 123 | None Detected | | 100% Other | Brown Non Fibrous Homogeneous |
| 1717806PLM_146 | mastic | | | | Dissolved |
| 0019C - A | 1' acoustic ceiling tile, random pinhole pattern, Location 225 | None Detected | 90% Mineral Wool | 10% Other | White Fibrous Heterogeneous |
| 1717806PLM_69 | ceiling tile | | | | Teased |
| 0019C - B | 1' acoustic ceiling tile, random pinhole pattern, Location 225 | None Detected | | 100% Other | Brown Non Fibrous Homogeneous |
| 1717806PLM_147 | mastic | | | | Dissolved |
| 0020A - A | 12" red vinyl floor tiles, Location 124 | None Detected | | 100% Other | Red Non Fibrous Heterogeneous |
| 1717806PLM_70 | tile | | | | Dissolved |
| 0020A - B | 12" red vinyl floor tiles, Location 124 | None Detected | | 100% Other | White, Black Non Fibrous Heterogeneous |
| 1717806PLM_148 | mastic/ leveling | | | | Crushed, Dissolved |
| 0020B - A | 12" red vinyl floor tiles, Location 124 | None Detected | | 100% Other | Red Non Fibrous Heterogeneous |
| 1717806PLM_71 | tile | | | | Dissolved |
| 0020B - B | 12" red vinyl floor tiles, Location 124 | None Detected | | 100% Other | White, Black Non Fibrous Heterogeneous |
| 1717806PLM_149 | mastic/ leveling | | | | Crushed, Dissolved |
| 0020C - A | 12" red vinyl floor tiles, Location 124 | None Detected | | 100% Other | Red Non Fibrous Heterogeneous |
| 1717806PLM_72 | tile - ashed | | | | Ashed |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|--|---------------|--------------------|------------------------|--|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0020C - B | 12" red vinyl floor tiles, Location 124 | None Detected | | 100% Other | White, Black Non Fibrous Heterogeneous |
| 1717806PLM_150 | mastic/ leveling | | | | Crushed, Dissolved |
| 0021A - A | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_73 | tile | | | | Dissolved |
| 0021A - B | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_151 | mastic | | | | Dissolved |
| 0021B - A | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_74 | tile | | | | Dissolved |
| 0021B - B | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_152 | mastic | | | | Dissolved |
| 0021C - A | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_75 | tile - ashed | | | | Ashed |
| 0021C - B | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_153 | mastic | | | | Dissolved |
| 0022A - A | 12" vinyl floor tiles, beige with white and beige blotches, Location 111 | None Detected | | 100% Other | Beige Non Fibrous Heterogeneous |
| 1717806PLM_76 | tile | | | | Dissolved |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|--|---------------|--------------------|------------------------|---------------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0022A - B | 12" vinyl floor tiles, beige with white and beige blotches, Location 111 | None Detected | 2% Cellulose | 98% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_154 | mastic | | | | Dissolved |
| 0022B - A | 12" vinyl floor tiles, beige with white and beige blotches, Location 114 | None Detected | | 100% Other | Beige Non Fibrous Heterogeneous |
| 1717806PLM_77 | tile | | | | Dissolved |
| 0022B - B | 12" vinyl floor tiles, beige with white and beige blotches, Location 114 | None Detected | 2% Cellulose | 98% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_155 | mastic | | | | Dissolved |
| 0022C - A | 12" vinyl floor tiles, beige with white and beige blotches, Location 207 | None Detected | | 100% Other | Beige Non Fibrous Heterogeneous |
| 1717806PLM_78 | tile - ashed | | | | Ashed |
| 0022C - B | 12" vinyl floor tiles, beige with white and beige blotches, Location 207 | None Detected | 2% Cellulose | 98% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_156 | mastic | | | | Dissolved |
| 0023A - A | 12" vinyl floor tiles, turquoise with white fleck, Location 116 | None Detected | | 100% Other | Aqua Non Fibrous Heterogeneous |
| 1717806PLM_79 | tile | | | | Dissolved |
| 0023A - B | 12" vinyl floor tiles, turquoise with white fleck, Location 116 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_157 | mastic | | | | Dissolved |
| 0023B - A | 12" vinyl floor tiles, turquoise with white fleck, Location 228 | None Detected | | 100% Other | Aqua Non Fibrous Heterogeneous |
| 1717806PLM_80 | tile | | | | Dissolved |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|---------------|--------------------|------------------------|---------------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0023B - B | 12" vinyl floor tiles, tourquise with white fleck, Location 228 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_158 | mastic | | | | Dissolved |
| 0023C - A | 12" vinyl floor tiles, tourquise with white fleck, Location 116 | None Detected | | 100% Other | Aqua Non Fibrous Heterogeneous |
| 1717806PLM_81 | tile - ashed | | | | Ashed |
| 0023C - B | 12" vinyl floor tiles, tourquise with white fleck, Location 116 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_159 | mastic | | | | Dissolved |
| 0024A - A | 12" vinyl floor ties, beige with a few white and brown flecks, Location 139 | 3% Chrysotile | | 97% Other | Beige Non Fibrous Heterogeneous |
| 1717806PLM_82 | tile | | | | Dissolved |
| 0024A - B | 12" vinyl floor ties, beige with a few white and brown flecks, Location 139 | None Detected | 2% Cellulose | 98% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_160 | mastic | | | | Dissolved |
| 0024B - A | 12" vinyl floor ties, beige with a few white and brown flecks, Location 182 | Not Analyzed | | | |
| 1717806PLM_83 | tile | | | | |
| 0024B - B | 12" vinyl floor ties, beige with a few white and brown flecks, Location 182 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_161 | mastic | | | | Dissolved |
| 0024C - A | 12" vinyl floor ties, beige with a few white and brown flecks, Location 182 | Not Analyzed | | | |
| 1717806PLM_84 | tile | | | | |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|----------------|--------------------|------------------------|--|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0024C - B | 12" vinyl floor ties, beige with a few white and brown flecks, Location 182 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_162 | mastic | | | | Dissolved |
| 0025A | Parging cement, Location 139, 1974 portion | 30% Chrysotile | 10% Cellulose | 60% Other | White Fibrous Heterogeneous |
| 1717806PLM_85 | | | | | Teased |
| 0025B | Parging cement, Location 139, 1974 portion | Not Analyzed | | | |
| 1717806PLM_86 | | | | | |
| 0025C | Parging cement, Location 139, 1974 portion | Not Analyzed | | | |
| 1717806PLM_87 | | | | | |
| 0026A - A | 12" vinyl floor tiles, off-white black and grey streaks, Location 187 | 3% Chrysotile | | 97% Other | White, Black Non Fibrous Heterogeneous |
| 1717806PLM_88 | tile | | | | Dissolved |
| 0026A - B | 12" vinyl floor tiles, off-white black and grey streaks, Location 187 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_163 | mastic | | | | Dissolved |
| 0026B - A | 12" vinyl floor tiles, off-white black and grey streaks, Location 187 | Not Analyzed | | | |
| 1717806PLM_89 | tile | | | | |
| 0026B - B | 12" vinyl floor tiles, off-white black and grey streaks, Location 187 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_164 | mastic small sample | | | | Dissolved |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|---------------|----------------------|------------------------|-----------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0026C - A | 12" vinyl floor tiles, off-white black and grey streaks, Location 135 | Not Analyzed | | | |
| 1717806PLM_90 | tile | | | | |
| 0026C - B | 12" vinyl floor tiles, off-white black and grey streaks, Location 135 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_165 | mastic | | | | Dissolved |
| 0027A | Drywall joint compound, Location 185 | None Detected | | 100% Other | White Non Fibrous Homogeneous |
| 1717806PLM_91 | | | | | Crushed |
| 0027B | Drywall joint compound, Corridor 131 | 2% Chrysotile | | 98% Other | White Non Fibrous Homogeneous |
| 1717806PLM_92 | | | | | Crushed |
| 0027C | Drywall joint compound, Corridor 184 | Not Analyzed | | | |
| 1717806PLM_93 | | | | | |
| 0028A | Vinyl sheet flooring, beige/grey pebbled pattern, Location 131 | None Detected | 60% Synthetic Fibers | 40% Other | Gray Fibrous Heterogeneous |
| 1717806PLM_94 | backing only | | | | Teased |
| 0028B | Vinyl sheet flooring, beige/grey pebbled pattern, Location 131 | None Detected | 30% Synthetic Fibers | 70% Other | Gray, Beige Fibrous Heterogeneous |
| 1717806PLM_95 | | | | | Teased, Dissolved |
| 0028C | Vinyl sheet flooring, beige/grey pebbled pattern, Location 131 | None Detected | 30% Synthetic Fibers | 70% Other | Gray, Beige Fibrous Heterogeneous |
| 1717806PLM_96 | | | | | Teased, Dissolved |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|---------------|--------------------|--------------------------|---------------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0029A - A | 12" vinyl floor tile, white with grey fleck, Location 219 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_97 | tile | | | | Dissolved |
| 0029A - B | 12" vinyl floor tile, white with grey fleck, Location 219 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_166 | mastic | | | | Dissolved |
| 0029B - A | 12" vinyl floor tile, white with grey fleck, Location 219 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_98 | tile | | | | Dissolved |
| 0029B - B | 12" vinyl floor tile, white with grey fleck, Location 219 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_167 | mastic | | | | Dissolved |
| 0029C - A | 12" vinyl floor tile, white with grey fleck, Location 219 | None Detected | | 100% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_99 | tile - ashed | | | | Ashed |
| 0029C - B | 12" vinyl floor tile, white with grey fleck, Location 219 | None Detected | | 100% Other | Black Non Fibrous Homogeneous |
| 1717806PLM_168 | mastic | | | | Dissolved |
| 0030A | Ceiling texture, Location 214 | 5% Chrysotile | | 60% Perlite 35% Other | White Non Fibrous Heterogeneous |
| 1717806PLM_100 | | | | | Teased |
| 0030B | Ceiling texture, Location 214 | Not Analyzed | | | |
| 1717806PLM_101 | | | | | |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



NVLAP Lab Code: 200664-0



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|---------------|--------------------|------------------------|-------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0030C | Ceiling texture, Location 214 | Not Analyzed | | | |
| 1717806PLM_102 | | | | | |
| 0031A | Beige caulking, central portion | 4% Chrysotile | | 96% Other | Gray Non Fibrous Homogeneous |
| 1717806PLM_103 | | | | | Dissolved |
| 0031B | Beige caulking, east elevation | Not Analyzed | | | |
| 1717806PLM_104 | | | | | |
| 0031C | Beige caulking, south elevation | Not Analyzed | | | |
| 1717806PLM_105 | | | | | |
| 0032A | Grey expansion joint sealant, central portion | None Detected | | 100% Other | Gray Non Fibrous Homogeneous |
| 1717806PLM_106 | | | | | Ashed |
| 0032B | Grey expansion joint sealant, east portion | None Detected | | 100% Other | Gray Non Fibrous Homogeneous |
| 1717806PLM_107 | | | | | Ashed |
| 0032C | Grey expansion joint sealant, south portion | None Detected | | 100% Other | Gray Non Fibrous Homogeneous |
| 1717806PLM_108 | | | | | Ashed |
| 0033A - A | Brown door caulking, central portion | None Detected | | 100% Other | Brown Non Fibrous Homogeneous |
| 1717806PLM_109 | brown layer | | | | Ashed |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|--|---------------|--------------------|------------------------|--------------------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0033A - B | Brown door caulking, central portion | None Detected | | 100% Other | Gray Non Fibrous Homogeneous |
| 1717806PLM_169 | gray layer | | | | Ashed |
| 0033B - A | Brown door caulking, north portion | None Detected | | 100% Other | Brown Non Fibrous Homogeneous |
| 1717806PLM_110 | brown layer | | | | Ashed |
| 0033B - B | Brown door caulking, north portion | 2% Chrysotile | | 98% Other | Gray Non Fibrous Homogeneous |
| 1717806PLM_170 | gray layer | | | | Crushed |
| 0033C | Brown door caulking, central portion | Not Analyzed | | | |
| 1717806PLM_111 | | | | | |
| 0034A | Grey exterior canopy texture, west portion at Location 101 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_112 | | | | | Crushed |
| 0034B | Grey exterior canopy texture, west portion at Location 101 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_113 | | | | | Crushed |
| 0034C | Grey exterior canopy texture, west portion at Location 101 | None Detected | | 100% Other | Gray Non Fibrous Heterogeneous |
| 1717806PLM_114 | | | | | Crushed |
| 0035A - A | Black paper in sweatwrap insulation, Location 150 | None Detected | 70% Cellulose | 30% Other | Black Fibrous Heterogeneous |
| 1717806PLM_115 | felt | | | | Teased |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
1456 Centennial Drive Suite 2
Kingston, ON K7L 0A5

Attn: Glenn Hendry
Sarah Young

Lab Order ID: 1717806
Analysis ID: 1717806_PLM
Date Received: 8/18/2017
Date Reported: 8/23/2017

Project: 200584.017, Farley Ave, Belleville, ON, HPEDSB, Moira SS

| Sample ID | Description | Asbestos | Fibrous Components | Non-Fibrous Components | Attributes |
|----------------|---|---------------|--------------------|------------------------|-----------------------------|
| Lab Sample ID | Lab Notes | | | | Treatment |
| 0035A - B | Black paper in sweatwrap insulation, Location 150 | 1% Chrysotile | 95% Cellulose | 4% Other | Tan Fibrous Heterogeneous |
| 1717806PLM_171 | paper | | | | Teased |
| 0035B - A | Black paper in sweatwrap insulation, Location 150 | None Detected | 70% Cellulose | 30% Other | Black Fibrous Heterogeneous |
| 1717806PLM_116 | felt | | | | Teased, Dissolved |
| 0035B - B | Black paper in sweatwrap insulation, Location 150 | Not Analyzed | | | |
| 1717806PLM_172 | paper | | | | |
| 0035C - A | Black paper in sweatwrap insulation, Location 150 | None Detected | 70% Cellulose | 30% Other | Black Fibrous Heterogeneous |
| 1717806PLM_117 | felt | | | | Teased, Dissolved |
| 0035C - B | Black paper in sweatwrap insulation, Location 150 | Not Analyzed | | | |
| 1717806PLM_118 | paper | | | | |

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Sharon Donald (173)

Analyst

Approved Signatory

1717 806

Version 1-15-2012

Client: Pinchin Ltd.
Contact: Glenn Hendry
 135 Ontario Street, Unit# 1
Address: Kingston, ON K7L 0A5
Phone: 613-541-1013
Fax:
Email: ghendry@pinchin.com
 syoung@pinchin.com
Project: 200584.017, Farley Ave, Belleville,
 ON, HPEDSB, Moira SS
Client Notes:
P.O. #. 200584.017
Date Submitted: 17 August, 2017
Analysis: PLM - Stop Positive
TurnAroundTime: 4days

***Instructions:**
 Use Column "B" for your contact info

 To See an Example Click the
 bottom Example Tab.

 Enter samples between "<<" and ">>"

 Begin Samples with a "<<" above the first sample
 and end with a ">>" below the last sample.
 Only Enter your data on the first sheet "Sheet1"

 Note: Data 1 and Data 2 are optional
 fields that do not show up on the official
 report, however they will be included
 in the electronic data returned to you
 to facilitate your reintegration of the report data.

Invoice to:
 Contact name here
 Email address here



Scientific Analytical Institute
 4604 Dundas Dr.
 Greensboro, NC 27407
 Phone: 336.292.3888
 Fax: 336.292.3313
 Email: lab@sailab.com

| Sample Number | Data 1 (Lab use only) | Sample Description | Data 2 (Lab use only) |
|---------------|-----------------------|--------------------|-----------------------|
|---------------|-----------------------|--------------------|-----------------------|

| | | | |
|-------|--|--|--|
| << | | | |
| 0001A | | Aircell pipe insulation, Location 150 | |
| 0001B | | Aircell pipe insulation, Location 230 | |
| 0001C | | Aircell pipe insulation, Location 002 | |
| 0002A | | Brown pressed paper insulation, Location 150 | |
| 0002B | | Brown pressed paper insulation, Custodial Office | |
| 0002C | | Brown pressed paper insulation, Location 109 | |
| 0003A | | 9" vinyl floor tiles, various patterns and colours, IT Room at Resource Centre | |
| 0003B | | 9" vinyl floor tiles, various patterns and colours, Location 115 | |
| 0003C | | 9" vinyl floor tiles, various patterns and colours, Location 157 | |
| 0003D | | 9" vinyl floor tiles, various patterns and colours, Location 150 | |
| 0003E | | 9" vinyl floor tiles, various patterns and colours, Custodial at Location 161 | |
| 0004A | | 12" beige vinyl floor tiles, Location 151A | |
| 0004B | | 12" beige vinyl floor tiles, Location 151A | |
| 0004C | | 12" beige vinyl floor tiles, Location 151A | |
| 0005A | | Drywall joint compound, Location 151 | |
| 0005B | | Drywall joint compound, Location 154A | |
| 0005C | | Drywall joint compound, Location 156C | |
| 0005D | | Drywall joint compound, Location 125 | |

Accepted
 Rejected

Shelton 8/18 10A

1717806

| | |
|-------|--|
| 0005E | Drywall joint compound, Location 212 |
| 0005F | Drywall joint compound, Location 129 |
| 0005G | Drywall joint compound, Location 215 |
| 0006A | Parging Cement, 1959 Portion, Location 152 |
| 0006B | Parging Cement, 1959 Portion, Location 230 |
| 0006C | Parging Cement, 1959 Portion, Location 002 |
| 0007A | Brown duct mastic, Location 152 |
| 0007B | Brown duct mastic, Location 152 |
| 0007C | Brown duct mastic, Location 152 |
| 0008A | Parging cement, 1961 portion, Location 153 |
| 0008B | Parging cement, 1961 portion, Location 153 |
| 0008C | Parging cement, 1961 portion, Location 153 |
| 0009A | Smooth plaster, 1959 portion, Location 155 |
| 0009B | Smooth plaster, 1959 portion, Location 160 |
| 0009C | Smooth plaster, 1959 portion, Location 195 |
| 0009D | Smooth plaster, 1959 portion, Location 196 |
| 0009E | Smooth plaster, 1959 portion, Location 195 |
| 0009F | Smooth plaster, 1959 portion, Location 261 |
| 0009G | Smooth plaster, 1959 portion, Location 261 |
| 0010A | 2 x 4 acoustic ceiling tile, dense small and medium pinhole pattern, Location 154A |
| 0010B | 2 x 4 acoustic ceiling tile, dense small and medium pinhole pattern, Location 154A |
| 0010C | 2 x 4 acoustic ceiling tile, dense small and medium pinhole pattern, Location 154A |
| 0011A | 1' x 1; Acoustic ceiling tile, large and medium uniform pinhole, Location 156 |
| 0011B | 1' x 1; Acoustic ceiling tile, large and medium uniform pinhole, Location 157 |
| 0011C | 1' x 1; Acoustic ceiling tile, large and medium uniform pinhole, Location 156 |
| 0012A | Ceiling texture, Location 159 |
| 0012B | Ceiling texture, Location 257 |
| 0012C | Ceiling texture, Location 257 |
| 0013A | 12" vinyl floor tile, red and black checkered pattern, Location 160 |
| 0013B | 12" vinyl floor tile, red and black checkered pattern, Location 160 |
| 0013C | 12" vinyl floor tile, red and black checkered pattern, Location 160 |
| 0014A | Aircell, 1961 portion, Custodial office |
| 0014B | Aircell, 1961 portion, Custodial office |
| 0014C | Aircell, 1961 portion, Custodial office |
| 0015A | 12" vinyl floor tile, beige with brown streaks, Location 163 |
| 0015B | 12" vinyl floor tile, beige with brown streaks, Location 163 |
| 0015C | 12" vinyl floor tile, beige with brown streaks, Location 163 |
| 0016A | Plaster above lockers, Location 194 |
| 0016B | Plaster above lockers, Location 194 |
| 0016C | Plaster above lockers, Location 194 |

1717806

| | |
|-------|--|
| 0016D | Plaster above lockers, Location 194 |
| 0016E | Plaster above lockers, Location 194 |
| 0017A | Light heat shield, Location 002 |
| 0017B | Light heat shield, Location 002 |
| 0017C | Light heat shield, Location 002 |
| 0018A | 12" vinyl floor tile, off-white with grey fleck, Location 125 |
| 0018B | 12" vinyl floor tile, off-white with grey fleck, Location 125 |
| 0018C | 12" vinyl floor tile, off-white with grey fleck, Location 125 |
| 0019A | 1' acoustic ceiling tile, random pinhole pattern, Principals Office |
| 0019B | 1' acoustic ceiling tile, random pinhole pattern, Location 123 |
| 0019C | 1' acoustic ceiling tile, random pinhole pattern, Location 225 |
| 0020A | 12" red vinyl floor tiles, Location 124 |
| 0020B | 12" red vinyl floor tiles, Location 124 |
| 0020C | 12" red vinyl floor tiles, Location 124 |
| 0021A | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 |
| 0021B | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 |
| 0021C | 12" vinyl floor tiles, grey with white and grey fleck, Location 129 |
| 0022A | 12" vinyl floor tiles, beige with white and beige blotches, Location 111 |
| 0022B | 12" vinyl floor tiles, beige with white and beige blotches, Location 114 |
| 0022C | 12" vinyl floor tiles, beige with white and beige blotches, Location 207 |
| 0023A | 12" vinyl floor tiles, turquoise with white fleck, Location 116 |
| 0023B | 12" vinyl floor tiles, turquoise with white fleck, Location 228 |
| 0023C | 12" vinyl floor tiles, turquoise with white fleck, Location 116 |
| 0024A | 12" vinyl floor tiles, beige with a few white and brown flecks, Location 139 |
| 0024B | 12" vinyl floor tiles, beige with a few white and brown flecks, Location 182 |
| 0024C | 12" vinyl floor tiles, beige with a few white and brown flecks, Location 182 |
| 0025A | Parging cement, Location 139, 1974 portion |
| 0025B | Parging cement, Location 139, 1974 portion |
| 0025C | Parging cement, Location 139, 1974 portion |
| 0026A | 12" vinyl floor tiles, off-white black and grey streaks, Location 187 |
| 0026B | 12" vinyl floor tiles, off-white black and grey streaks, Location 187 |
| 0026C | 12" vinyl floor tiles, off-white black and grey streaks, Location 135 |
| 0027A | Drywall joint compound, Location 185 |
| 0027B | Drywall joint compound, Corridor 131 |
| 0027C | Drywall joint compound, Corridor 184 |
| 0028A | Vinyl sheet flooring, beige/grey pebbled pattern, Location 131 |
| 0028B | Vinyl sheet flooring, beige/grey pebbled pattern, Location 131 |
| 0028C | Vinyl sheet flooring, beige/grey pebbled pattern, Location 131 |
| 0029A | 12" vinyl floor tile, white with grey fleck, Location 219 |
| 0029B | 12" vinyl floor tile, white with grey fleck, Location 219 |

1717806

| | |
|-------|--|
| 0029C | 12" vinyl floor tile, white with grey fleck, Location 219 |
| 0030A | Ceiling texture, Location 214 |
| 0030B | Ceiling texture, Location 214 |
| 0030C | Ceiling texture, Location 214 |
| 0031A | Beige caulking, central portion |
| 0031B | Beige caulking, east elevation |
| 0031C | Beige caulking, south elevation |
| 0032A | Grey expansion joint sealant, central portion |
| 0032B | Grey expansion joint sealant, east portion |
| 0032C | Grey expansion joint sealant, south portion |
| 0033A | Brown door caulking, central portion |
| 0033B | Brown door caulking, north portion |
| 0033C | Brown door caulking, central portion |
| 0034A | Grey exterior canopy texture, west portion at Location 101 |
| 0034B | Grey exterior canopy texture, west portion at Location 101 |
| 0034C | Grey exterior canopy texture, west portion at Location 101 |
| 0035A | Black paper in sweatwrap insulation, Location 150 |
| 0035B | Black paper in sweatwrap insulation, Location 150 |
| 0035C | Black paper in sweatwrap insulation, Location 150 |
| >> | |



Your Project #: 200584.061
 Site Location: 275 FARLEY AVENUE, BELLEVILLE
 Your C.O.C. #: n/a

Attention: Glenn Hendry

Pinchin Ltd
 1456 Centennial Drive
 Suite 2
 Kingston, ON
 CANADA K7P 0K4

Report Date: 2021/10/18
 Report #: R6857108
 Version: 2 - Revision

CERTIFICATE OF ANALYSIS – REVISED REPORT

BV LABS JOB #: C1Q2918
Received: 2021/09/13, 09:41

Sample Matrix: Solid
 # Samples Received: 98

| Analyses | Date | | Laboratory Method | Analytical Method |
|-------------------------------|----------|----------------|--------------------------|-------------------|
| | Quantity | Date Extracted | | |
| Asbestos by PLM - 0.5 RDL (1) | 55 | N/A | 2021/09/20 COR3SOP-00002 | EPA 600R-93/116 |
| Asbestos by PLM - 0.5 RDL (1) | 43 | N/A | N/A COR3SOP-00002 | EPA 600R-93/116 |

Remarks:

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, MELCC, EPA, APHA.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested. This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Bureau Veritas Laboratories' Asbestos Laboratory is accredited by NVLAP for bulk asbestos analysis by polarized light microscopy, NVLAP Code 600136-0.

This report may not be reproduced, except in full, without the written approval of Bureau Veritas Canada. This report may not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any other agency of the U.S. Government.

Bureau Veritas Laboratories' scope of accreditation includes EPA-600/M4-82-020: "Interim Method for the Determination of Asbestos in Bulk Insulation Samples" and EPA-600/R-93/116: "Method for the Determination of Asbestos in Bulk Building Materials".

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.



Your Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Your C.O.C. #: n/a

Attention: Glenn Hendry

Pinchin Ltd
1456 Centennial Drive
Suite 2
Kingston, ON
CANADA K7P 0K4

Report Date: 2021/10/18
Report #: R6857108
Version: 2 - Revision

CERTIFICATE OF ANALYSIS – REVISED REPORT

BV LABS JOB #: C1Q2918

Received: 2021/09/13, 09:41

(1) P.O.B. - Percent of Bulk

When Asbestos data is reported with other data, this report contains data that are not covered by the NVLAP accreditation.

Encryption Key

Antonella Brasil
Senior Project Manager
18 Oct 2021 10:50:12

Please direct all questions regarding this Certificate of Analysis to your Project Manager.

Antonella Brasil, Senior Project Manager
Email: Antonella.Brasil@bureauveritas.com
Phone# (905)817-5817

=====

BV Labs has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation please refer to the Validation Signature Page.



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0036 A BROWN MASTIC BEHIND 1'X1' ACOUSTIC CEILING TILE, CLASSROOM 101 | | | | | |
|--|--------------|--------------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE930 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous dark yellow mastic | Not Detected | | Non-Fibrous |
| Comment: Another layer is present but not analyzed as requested. | | | | | |

| S 0036 B BROWN MASTIC BEHIND 1'X1' ACOUSTIC CEILING TILE, CLASSROOM 223 | | | | | |
|--|--------------|--------------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE931 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous dark yellow mastic | Not Detected | | Non-Fibrous |
| Comment: Another layer is present but not analyzed as requested. | | | | | |

| S 0036 C BROWN MASTIC BEHIND 1'X1' ACOUSTIC CEILING TILE, CLASSROOM 225 | | | | | |
|--|--------------|--------------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE932 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous dark yellow mastic | Not Detected | | Non-Fibrous |
| Comment: Another layer is present but not analyzed as requested | | | | | |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0037 A TEXTURED PLASTER ON CEILING, MECHANICAL ROOM 161 | | | | | | |
|--|--------------|-----------------------------------|-------------------|--------|---------------------|--------------------|
| Bureau Veritas ID: QQE933 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey textured plaster | Chrysotile | <0.50% | | Non-Fibrous |

| S 0037 B TEXTURED PLASTER ON CEILING, MECHANICAL ROOM 161 | | | | | | |
|--|--------------|-----------------------------------|-----------------|--|---------------------|--------------------|
| Bureau Veritas ID: QQE934 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey textured plaster | Not Detected | | | Non-Fibrous |

| S 0037 C TEXTURED PLASTER ON CEILING, MECHANICAL ROOM 161 | | | | | | |
|--|--------------|-----------------------------------|-----------------|--|---------------------|--------------------|
| Bureau Veritas ID: QQE935 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey textured plaster | Not Detected | | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0038 A TEXTURED PLASTER ON WALL, RESOURCE CENTRE 129 | | | | | |
|---|--------------|-----------------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE936 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey textured plaster | Not Detected | | Non-Fibrous |

| S 0038 B TEXTURED PLASTER ON WALL, STAIRWELL TO RESOURCE CENTRE 129 | | | | | |
|--|--------------|-----------------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE937 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey textured plaster | Not Detected | | Non-Fibrous |

| S 0038 C TEXTURED PLASTER ON WALL, STAIRWELL TO RESOURCE CENTRE 129 | | | | | |
|--|--------------|-----------------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE938 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey textured plaster | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Bureau Veritas Job #: C1Q2918
 Report Date: 2021/10/18

Pinchin Ltd
 Client Project #: 200584.061
 Site Location: 275 FARLEY AVENUE, BELLEVILLE
 Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0039 A PLASTER ON STEEL BEAM, LOBBY 192 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE939 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

| S 0039 B PLASTER ON STEEL BEAM, LOBBY 192 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE940 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

| S 0039 C PLASTER ON STEEL BEAM, LOBBY 192 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE941 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0040 A FIRM GREY CAULKING ON INTERIOR WINDOW FRAME, CLASSROOM 187 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE942 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Not Detected | | Non-Fibrous |

| S 0040 B FIRM GREY CAULKING ON INTERIOR WINDOW FRAME, WEIGHT ROOM 182 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE943 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Not Detected | | Non-Fibrous |

| S 0040 C FIRM GREY CAULKING ON INTERIOR WINDOW FRAME, OFFICE 180 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE944 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | | | |
|--|--------------|---------------------------|-------------------|----|---------------------|-----|--------------------|
| S 0041 A SOFT GREY CAULKING ON INTERIOR WINDOW FRAME, CLASSROOM 103 | | | | | | | |
| Bureau Veritas ID: QQE945 | | Date Analyzed: 2021/09/20 | | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Chrysotile | 2% | Cellulose | 10% | Non-Fibrous |

| | | | | | | | |
|--|--|---------------------------|-----------------|--|---------------------|--|--------------------|
| S 0041 B SOFT GREY CAULKING ON INTERIOR WINDOW FRAME, WOOD SHOP 152 | | | | | | | |
| Bureau Veritas ID: QQE946 | | Date Analyzed: 2021/09/20 | | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | | <u>Particulate</u> |
| Layer 1 | | | N/A | | | | |
| | Comment: Not Analyzed - Positive Stop | | | | | | |

| | | | | | | | |
|--|--|---------------------------|-----------------|--|---------------------|--|--------------------|
| S 0041 C SOFT GREY CAULKING ON INTERIOR WINDOW FRAME, CLASSROOM 250 | | | | | | | |
| Bureau Veritas ID: QQE947 | | Date Analyzed: 2021/09/20 | | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | | <u>Particulate</u> |
| Layer 1 | | | N/A | | | | |
| | Comment: Not Analyzed - Positive Stop | | | | | | |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0042 A YELLOW PAINT ON CONCRETE BLOCK WALL, CLASSROOM 101 | | | | | | |
|--|--------------|--|-------------------|--------|---------------------|--------------------|
| Bureau Veritas ID: QQE948 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 90 | Non-homogeneous yellow/white paint/plaster | Chrysotile | <0.50% | | Non-Fibrous |
| Layer 2 | 10 | Homogeneous grey concrete | Not Detected | | | Non-Fibrous |

| S 0042 B YELLOW PAINT ON CONCRETE BLOCK WALL, CLASSROOM 217 | | | | | | |
|--|--------------|---|-----------------|--|---------------------|--------------------|
| Bureau Veritas ID: QQE949 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 20 | Non-homogeneous white/white paint/plaster | Not Detected | | | Non-Fibrous |
| Layer 2 | 80 | Homogeneous grey concrete | Not Detected | | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0042 C YELLOW PAINT ON BRICK WALL, CORRIDOR 193 | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE950 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 40 | Homogeneous white paint | Not Detected | | Non-Fibrous |
| Layer 2 | 60 | Homogeneous red/brown brick | Not Detected | | Non-Fibrous |

| S 0042 D YELLOW PAINT ON CONCRETE BLOCK WALL, CUSTODIAL ROOM 160 | | | | | |
|---|--------------|---|--------------------------|---------------------|--------------------|
| Bureau Veritas ID: QQE951 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous white/off-white/grey paint/plaster/concrete | Chrysotile <0.50% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0042 E YELLOW PAINT ON CONCRETE BLOCK WALL, MECHANICAL ROOM 282 | | | | | | |
|--|--------------|---|-------------------|--------|---------------------|--------------------|
| Bureau Veritas ID: QQE952 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Non-homogeneous white/off-white paint/plaster | Chrysotile | <0.50% | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey concrete | Not Detected | | | Non-Fibrous |

| S 0042 F YELLOW PAINT ON CONCRETE BLOCK WALL, OFFICE 180 | | | | | | |
|---|--------------|---|-----------------|--|---------------------|--------------------|
| Bureau Veritas ID: QQE953 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous white/off-white/grey paint/plaster/concrete | Not Detected | | | Non-Fibrous |

| S 0042 G BLACK PAINT ON CONCRETE BLOCK WALL, STAGE 140 | | | | | | |
|---|--------------|---|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: QQE954 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous black/off-white paint/plaster | Chrysotile | 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | |
|---|--------------|----------------------------|-----------------|---------------------|--------------------|
| S 0043 A ADHESIVE BEHIND BASEBOARD, OFFICE 151 | | | | | |
| Bureau Veritas ID: QQE955 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous brown adhesive | Not Detected | | Non-Fibrous |

| | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| S 0043 B ADHESIVE BEHIND BASEBOARD, CLASSROOM 158 | | | | | |
| Bureau Veritas ID: QQE956 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous yellow adhesive | Not Detected | | Non-Fibrous |

| | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| S 0043 C ADHESIVE BEHIND BASEBOARD, CLASSROOM 187 | | | | | |
| Bureau Veritas ID: QQE957 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous yellow adhesive | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | |
|---|--------------|----------------------------------|-----------------|---------------------|--------------------|
| S 0043 D ADHESIVE BEHIND BASEBOARD, OFFICE 181 | | | | | |
| Bureau Veritas ID: QQE958 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous dark yellow adhesive | Not Detected | | Non-Fibrous |

| | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| S 0043 E ADHESIVE BEHIND BASEBOARD, CLASSROOM 115 | | | | | |
| Bureau Veritas ID: QQE959 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous yellow adhesive | Not Detected | | Non-Fibrous |

| | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| S 0043 F ADHESIVE BEHIND BASEBOARD, CLASSROOM 111 | | | | | |
| Bureau Veritas ID: QQE960 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous yellow adhesive | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Bureau Veritas Job #: C1Q2918
 Report Date: 2021/10/18

Pinchin Ltd
 Client Project #: 200584.061
 Site Location: 275 FARLEY AVENUE, BELLEVILLE
 Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0043 G ADHESIVE BEHIND BASEBOARD, CLASSROOM 217 | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE961 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous yellow adhesive | Not Detected | | Non-Fibrous |

| S 0044 A TERRAZZO FLOOR, CORRIDOR 190, WEST STAIRWELL | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE962 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white terrazzo floor | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey cementitious material | Not Detected | | Non-Fibrous |

| S 0044 B TERRAZZO FLOOR, CORRIDOR 190 | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE963 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white terrazzo floor | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey cementitious material | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0044 C TERRAZZO FLOOR, CORRIDOR 194, STAIRWELL | | | | | |
|---|--------------|---|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE964 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous white/grey terrazzo floor/cementitious material | Not Detected | | Non-Fibrous |

| S 0044 D TERRAZZO FLOOR, CORRIDOR 260 | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE965 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 90 | Homogeneous white terrazzo floor | Not Detected | | Non-Fibrous |
| Layer 2 | 10 | Homogeneous grey cementitious material | Not Detected | | Non-Fibrous |

| S 0044 E TERRAZZO FLOOR, CORRIDOR 195 | | | | | |
|--|--------------|---|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE966 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous white/grey terrazzo floor/cementitious material | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0044 F TERRAZZO FLOOR, CORRIDOR 261, WEST STAIRWELL | | | | | |
|--|--------------|---|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE967 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous white/grey terrazzo floor/cementitious material | Not Detected | | Non-Fibrous |

| S 0044 G TERRAZZO FLOOR, CORRIDOR 262 | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE968 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 60 | Homogeneous white terrazzo floor | Not Detected | | Non-Fibrous |
| Layer 2 | 40 | Homogeneous grey cementitious material | Not Detected | | Non-Fibrous |

| S 0045 A OFF-WHITE PAINT ON CONCRETE STRUCTURE, CUSTODIAL ROOM 146 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE969 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0045 B OFF-WHITE PAINT ON CONCRETE STRUCTURE, CUSTODIAL ROOM 146 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE970 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S 0045 C OFF-WHITE PAINT ON CONCRETE STRUCTURE, OFFICE 145 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE971 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S 0045 D OFF-WHITE PAINT ON CONCRETE STRUCTURE, WOOD SHOP 152 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE972 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0045 E OFF-WHITE PAINT ON CONCRETE STRUCTURE, CORRIDOR 168 | | | | | |
| Bureau Veritas ID: QQE973 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0046 A LIGHT GREY DUCT MASTIC, CLASSROOM 125 | | | | | |
| Bureau Veritas ID: QQE974 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Not Detected | | Non-Fibrous |

| | | | | | |
|--|--------------|--------------------------------|-----------------|---------------------|--------------------|
| S 0046 B LIGHT GREY DUCT MASTIC, MUSIC ROOM 188 | | | | | |
| Bureau Veritas ID: QQE975 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white caulking | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--|--------------------|
| S 0046 C LIGHT GREY DUCT MASTIC, CLASSROOM 186 | | | | | | |
| Bureau Veritas ID: QQE976 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Not Detected | | | Non-Fibrous |

| | | | | | | |
|--|--------------|--------------------------------|-----------------|---------------------|-----|--------------------|
| S 0047 A 1'X1' ACOUSTIC CEILING TILE, RADIO ROOM 156D | | | | | | |
| Bureau Veritas ID: QQE977 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous brown ceiling tile | Not Detected | Cellulose | 90% | Non-Fibrous |

| | | | | | | |
|--|--------------|--------------------------------|-----------------|---------------------|-----|--------------------|
| S 0047 B 1'X1' ACOUSTIC CEILING TILE, RADIO ROOM 156D | | | | | | |
| Bureau Veritas ID: QQE978 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous brown ceiling tile | Not Detected | Cellulose | 90% | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | | |
|--|--------------|--------------------------------|-----------------|---------------------|--------------------|-------------|
| S 0047 C 1'X1' ACOUSTIC CEILING TILE, COMPUTER LAB 156C | | | | | | |
| Bureau Veritas ID: QQE979 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> | |
| Layer 1 | 100 | Homogeneous brown ceiling tile | Not Detected | Cellulose | 90% | Non-Fibrous |

| | | | | | | |
|---|--------------|-------------------------------|-----------------|---------------------|--------------------|-------------|
| S 0048 A 1'X1' ACOUSTIC CEILING TILE, MEDIUM AND LARGE PINHOLES WITH FLECKS, CLASSROOM 223 | | | | | | |
| Bureau Veritas ID: QQE980 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> | |
| Layer 1 | 100 | Homogeneous grey ceiling tile | Not Detected | Fibrous Glass | 70% | Non-Fibrous |

| | | | | | | |
|---|--------------|-------------------------------|-----------------|---------------------|--------------------|-------------|
| S 0048 B 1'X1' ACOUSTIC CEILING TILE, MEDIUM AND LARGE PINHOLES WITH FLECKS, CLASSROOM 224 | | | | | | |
| Bureau Veritas ID: QQE981 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> | |
| Layer 1 | 100 | Homogeneous grey ceiling tile | Not Detected | Fibrous Glass | 70% | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0048 C 1'X1' ACOUSTIC CEILING TILE, MEDIUM AND LARGE PINHOLES WITH FLECKS, CLASSROOM 102 | | | | | | |
|---|--------------|-------------------------------|-----------------|---------------------|--------------------|--|
| Bureau Veritas ID: QQE982 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> | |
| Layer 1 | 100 | Homogeneous grey ceiling tile | Not Detected | Fibrous Glass 70% | Non-Fibrous | |

| S 0049 A BLACK BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF CORRIDOR 191 | | | | | | |
|---|--------------|--------------------------------------|----------------------|---------------------|--------------------|--|
| Bureau Veritas ID: QQE983 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> | |
| Layer 1 | 100 | Homogeneous grey/black butyl sealant | Chrysotile 1% | | Non-Fibrous | |

| S 0049 B BLACK BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF CLASSROOM 187 | | | | | | |
|--|--|---------------------------|-----------------|---------------------|--------------------|--|
| Bureau Veritas ID: QQE984 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> | |
| Layer 1 | | | N/A | | | |
| | Comment: Not Analyzed - Positive Stop | | | | | |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0049 C BLACK BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF WEIGHT ROM 182 | | | | | |
| Bureau Veritas ID: QQE985 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | | | N/A | | |
| Comment: Not Analyzed - Positive Stop | | | | | |

| | | | | | |
|---|--------------|--------------------------------------|----------------------|---------------------|--------------------|
| S 0050 A GREY BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF CLASSROOM 104 | | | | | |
| Bureau Veritas ID: QQE986 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey/black butyl sealant | Chrysotile 3% | | Non-Fibrous |

| | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0050 B GREY BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF OFFICE 124 | | | | | |
| Bureau Veritas ID: QQE987 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | | | N/A | | |
| Comment: Not Analyzed - Positive Stop | | | | | |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Bureau Veritas Job #: C1Q2918
 Report Date: 2021/10/18

Pinchin Ltd
 Client Project #: 200584.061
 Site Location: 275 FARLEY AVENUE, BELLEVILLE
 Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0050 C GREY BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF OFFICE 124A | | | | | |
| Bureau Veritas ID: QQE988 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | | | N/A | | |
| Comment: Not Analyzed - Positive Stop | | | | | |

| | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0051 A GREY CAULKING BETWEEN METAL PANELS BELOW WINDOW, MAIN ENTRANCE | | | | | |
| Bureau Veritas ID: QQE989 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Not Detected | | Non-Fibrous |

| | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0051 B GREY CAULKING BETWEEN METAL PANELS BELOW WINDOW, MAIN ENTRANCE | | | | | |
| Bureau Veritas ID: QQE990 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0051 C GREY CAULKING BETWEEN METAL PANELS BELOW WINDOW, MAIN ENTRANCE | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE991 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey caulking | Not Detected | | Non-Fibrous |

| S 0052 A MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CAFETERIA 167 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE992 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey mortar | Not Detected | | Non-Fibrous |

| S 0052 B MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF MANUFACTURING SHOP 153 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE993 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey mortar | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0052 C MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CLASSROOM 151B | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE994 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey mortar | Not Detected | | Non-Fibrous |

| S 0052 D MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF GYM 142 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE995 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey mortar | Not Detected | | Non-Fibrous |

| S 0052 E MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF MUSIC ROOM 188 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQE996 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey mortar | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0052 F MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CLASSROOM 115 | | | | | |
| Bureau Veritas ID: QQE997 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey mortar | Not Detected | | Non-Fibrous |

| | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| S 0052 G MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CLASSROOM 111 | | | | | |
| Bureau Veritas ID: QQE998 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey mortar | Not Detected | | Non-Fibrous |

| | | | | | |
|--|--------------|--|----------------------|---------------------|--------------------|
| S 0053 A DRYWALL JOINT COMPOUND ON CEILING, CHANGE ROOM 131, SHOWER | | | | | |
| Bureau Veritas ID: QQE999 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white drywall joint compound | Chrysotile 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Bureau Veritas Job #: C1Q2918
 Report Date: 2021/10/18

Pinchin Ltd
 Client Project #: 200584.061
 Site Location: 275 FARLEY AVENUE, BELLEVILLE
 Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0053 B DRYWALL JOINT COMPOUND ON CEILING, OFFICE 180, SHOWER | | | | | | |
|---|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: QQF000 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white drywall joint compound | Chrysotile | 1% | | Non-Fibrous |

| S 0053 C DRYWALL JOINT COMPOUND ON INTERIOR WALL, RESOURCE CENTRE 129 | | | | | | |
|--|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: QQF001 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white drywall joint compound | Chrysotile | 1% | | Non-Fibrous |

| S 0053 D DRYWALL JOINT COMPOUND ON INTERIOR WALL, OFFICE 129B | | | | | | |
|--|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: QQF002 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous beige drywall joint compound | Chrysotile | 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0053 E DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 187 | | | | | | |
|--|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: QQF003 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white drywall joint compound | Chrysotile | 1% | | Non-Fibrous |

| S 0053 F DRYWALL JOINT COMPOUND ON INTERIOR WALL, MECHANICAL ROOM 280 | | | | | | |
|--|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: QQF004 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white drywall joint compound | Chrysotile | 1% | | Non-Fibrous |

| S 0053 G DRYWALL JOINT COMPOUND ON CEILING, CHANGE ROOM 135, SHOWER | | | | | | |
|--|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: QQF005 | | Date Analyzed: 2021/09/20 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white drywall joint compound | Chrysotile | 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0054 A DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 126 | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF006 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey drywall joint compound | Not Detected | | Non-Fibrous |

| S 0054 B DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 151B | | | | | |
|---|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF007 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

| S 0054 C DRYWALL JOINT COMPOUND ON INTERIOR WALL, RADIO ROOM 156D | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF008 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0054 D DRYWALL JOINT COMPOUND ON INTERIOR WALL, OFFICE 123 | | | | | |
|---|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: | | QQF009 | Date Analyzed: | | 2021/09/20 |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

| S 0054 E DRYWALL JOINT COMPOUND ON INTERIOR WALL, MANUFACTURING SHOP 154 | | | | | |
|---|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: | | QQF010 | Date Analyzed: | | 2021/09/20 |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

| S 0054 F DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 251 | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: | | QQF011 | Date Analyzed: | | 2021/09/20 |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0054 G DRYWALL JOINT COMPOUND ON INTERIOR WALL, STORAGE 216 | | | | | |
|--|--------------|--|----------------------|---------------------|--------------------|
| Bureau Veritas ID: | | QQF012 | Date Analyzed: | | 2021/09/20 |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white drywall joint compound | Chrysotile 1% | | Non-Fibrous |

| S 0055 A DRYWALL JOINT COMPOUND ON BULKHEAD, CLASSROOM 226 | | | | | |
|---|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: | | QQF013 | Date Analyzed: | | 2021/09/20 |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

| S 0055 B DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 220 | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: | | QQF014 | Date Analyzed: | | 2021/09/20 |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0055 D DRYWALL JOINT COMPOUND ON BULKHEAD, CLASSROOM 111 | | | | | |
|---|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF015 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

| S 0055 E DRYWALL JOINT COMPOUND ON BULKHEAD, CLASSROOM 112 | | | | | |
|---|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF016 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |

| S 0056 A SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 157 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF017 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Bureau Veritas Job #: C1Q2918
 Report Date: 2021/10/18

Pinchin Ltd
 Client Project #: 200584.061
 Site Location: 275 FARLEY AVENUE, BELLEVILLE
 Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0056 B SMOOTH PLASTER CEILING, STORAGE 160 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF018 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

| S 0056 C SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 251 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF019 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0056 D SMOOTH PLASTER CEILING, STORAGE 203 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF020 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

| S 0056 E SMOOTH PLASTER ON EXTERIOR WALL BELOW RADIATOR, CLASSROOM 202 | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF021 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0057 A SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 104 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF022 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

| S 0057 B SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 112 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF023 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



Bureau Veritas Job #: C1Q2918
 Report Date: 2021/10/18

Pinchin Ltd
 Client Project #: 200584.061
 Site Location: 275 FARLEY AVENUE, BELLEVILLE
 Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0057 C SMOOTH PLASTER ON BULKHEAD, ABOVE LOCKER, CORRIDOR 190 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF024 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

| S 0057 D SMOOTH PLASTER ON BULKHEAD, ABOVE LOCKER, CORRIDOR 261 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF025 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S 0057 E SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 217 | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF026 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 50 | Homogeneous white plaster | Not Detected | | Non-Fibrous |
| Layer 2 | 50 | Homogeneous grey plaster | Not Detected | | Non-Fibrous |

| S 0055 C DRYWALL JOINT COMPOUND, INTERIOR WALL, CLASSROOM 219 | | | | | |
|--|--------------|--|-----------------|---------------------|--------------------|
| Bureau Veritas ID: QQF027 | | Date Analyzed: 2021/09/20 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white drywall joint compound | Not Detected | | Non-Fibrous |
| Comment: This is sample 55C, but bag is labelled 22C | | | | | |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE930
Sample ID: S 0036 A BROWN MASTIC BEHIND 1'X1' ACOUSTIC CEILING TILE, CLASSROOM 101
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE931
Sample ID: S 0036 B BROWN MASTIC BEHIND 1'X1' ACOUSTIC CEILING TILE, CLASSROOM 223
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE932
Sample ID: S 0036 C BROWN MASTIC BEHIND 1'X1' ACOUSTIC CEILING TILE, CLASSROOM 225
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE933
Sample ID: S 0037 A TEXTURED PLASTER ON CEILING, MECHANICAL ROOM 161
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE933 Dup
Sample ID: S 0037 A TEXTURED PLASTER ON CEILING, MECHANICAL ROOM 161
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE934
Sample ID: S 0037 B TEXTURED PLASTER ON CEILING, MECHANICAL ROOM 161
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE935
Sample ID: S 0037 C TEXTURED PLASTER ON CEILING, MECHANICAL ROOM 161
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE936
Sample ID: S 0038 A TEXTURED PLASTER ON WALL, RESOURCE CENTRE 129
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE937
Sample ID: S 0038 B TEXTURED PLASTER ON WALL, STAIRWELL TO RESOURCE CENTRE 129
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE938
Sample ID: S 0038 C TEXTURED PLASTER ON WALL, STAIRWELL TO RESOURCE CENTRE 129
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE939
Sample ID: S 0039 A PLASTER ON STEEL BEAM, LOBBY 192
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE940
Sample ID: S 0039 B PLASTER ON STEEL BEAM, LOBBY 192
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE941
Sample ID: S 0039 C PLASTER ON STEEL BEAM, LOBBY 192
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE942
Sample ID: S 0040 A FIRM GREY CAULKING ON INTERIOR WINDOW FRAME, CLASSROOM 187
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE942 Dup
Sample ID: S 0040 A FIRM GREY CAULKING ON INTERIOR WINDOW FRAME, CLASSROOM 187
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE943
Sample ID: S 0040 B FIRM GREY CAULKING ON INTERIOR WINDOW FRAME, WEIGHT ROOM 182
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE944
Sample ID: S 0040 C FIRM GREY CAULKING ON INTERIOR WINDOW FRAME, OFFICE 180
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE945
Sample ID: S 0041 A SOFT GREY CAULKING ON INTERIOR WINDOW FRAME, CLASSROOM 103
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE946
Sample ID: S 0041 B SOFT GREY CAULKING ON INTERIOR WINDOW FRAME, WOOD SHOP 152
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE947
Sample ID: S 0041 C SOFT GREY CAULKING ON INTERIOR WINDOW FRAME, CLASSROOM 250
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE948
Sample ID: S 0042 A YELLOW PAINT ON CONCRETE BLOCK WALL, CLASSROOM 101
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE949
Sample ID: S 0042 B YELLOW PAINT ON CONCRETE BLOCK WALL, CLASSROOM 217
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE950
Sample ID: S 0042 C YELLOW PAINT ON BRICK WALL, CORRIDOR 193
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE951
Sample ID: S 0042 D YELLOW PAINT ON CONCRETE BLOCK WALL, CUSTODIAL ROOM 160
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE952
Sample ID: S 0042 E YELLOW PAINT ON CONCRETE BLOCK WALL, MECHANICAL ROOM 282
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE952 Dup
Sample ID: S 0042 E YELLOW PAINT ON CONCRETE BLOCK WALL, MECHANICAL ROOM 282
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE953
Sample ID: S 0042 F YELLOW PAINT ON CONCRETE BLOCK WALL, OFFICE 180
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE954
Sample ID: S 0042 G BLACK PAINT ON CONCRETE BLOCK WALL, STAGE 140
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE955
Sample ID: S 0043 A ADHESIVE BEHIND BASEBOARD, OFFICE 151
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE956
Sample ID: S 0043 B ADHESIVE BEHIND BASEBOARD, CLASSROOM 158
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE957
Sample ID: S 0043 C ADHESIVE BEHIND BASEBOARD, CLASSROOM 187
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE958
Sample ID: S 0043 D ADHESIVE BEHIND BASEBOARD, OFFICE 181
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE959
Sample ID: S 0043 E ADHESIVE BEHIND BASEBOARD, CLASSROOM 115
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE960
Sample ID: S 0043 F ADHESIVE BEHIND BASEBOARD, CLASSROOM 111
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE961
Sample ID: S 0043 G ADHESIVE BEHIND BASEBOARD, CLASSROOM 217
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE962
Sample ID: S 0044 A TERRAZZO FLOOR, CORRIDOR 190, WEST STAIRWELL
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE962 Dup
Sample ID: S 0044 A TERRAZZO FLOOR, CORRIDOR 190, WEST STAIRWELL
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE963
Sample ID: S 0044 B TERRAZZO FLOOR, CORRIDOR 190
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE964
Sample ID: S 0044 C TERRAZZO FLOOR, CORRIDOR 194, STAIRWELL
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE965
Sample ID: S 0044 D TERRAZZO FLOOR, CORRIDOR 260
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE966
Sample ID: S 0044 E TERRAZZO FLOOR, CORRIDOR 195
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE967
Sample ID: S 0044 F TERRAZZO FLOOR, CORRIDOR 261, WEST STAIRWELL
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE968
Sample ID: S 0044 G TERRAZZO FLOOR, CORRIDOR 262
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE969
Sample ID: S 0045 A OFF-WHITE PAINT ON CONCRETE STRUCTURE, CUSTODIAL ROOM 146
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE970
Sample ID: S 0045 B OFF-WHITE PAINT ON CONCRETE STRUCTURE, CUSTODIAL ROOM 146
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE971
Sample ID: S 0045 C OFF-WHITE PAINT ON CONCRETE STRUCTURE, OFFICE 145
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE972
Sample ID: S 0045 D OFF-WHITE PAINT ON CONCRETE STRUCTURE, WOOD SHOP 152
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE972 Dup
Sample ID: S 0045 D OFF-WHITE PAINT ON CONCRETE STRUCTURE, WOOD SHOP 152
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587253 | N/A | | Monika Vogt |

Bureau Veritas ID: QQE973
Sample ID: S 0045 E OFF-WHITE PAINT ON CONCRETE STRUCTURE, CORRIDOR 168
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE974
Sample ID: S 0046 A LIGHT GREY DUCT MASTIC, CLASSROOM 125
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE975
Sample ID: S 0046 B LIGHT GREY DUCT MASTIC, MUSIC ROOM 188
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE976
Sample ID: S 0046 C LIGHT GREY DUCT MASTIC, CLASSROOM 186
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE977
Sample ID: S 0047 A 1'X1' ACOUSTIC CEILING TILE, RADIO ROOM 156D
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE978
Sample ID: S 0047 B 1'X1' ACOUSTIC CEILING TILE, RADIO ROOM 156D
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE979
Sample ID: S 0047 C 1'X1' ACOUSTIC CEILING TILE, COMPUTER LAB 156C
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE980
Sample ID: S 0048 A 1'X1' ACOUSTIC CEILING TILE, MEDIUM AND LARGE PINHOLES WITH FLECKS, CLASSROOM 223
Matrix: Solid

Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE981
Sample ID: S 0048 B 1'X1' ACOUSTIC CEILING TILE, MEDIUM AND LARGE PINHOLES WITH FLECKS, CLASSROOM 224
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE982
Sample ID: S 0048 C 1'X1' ACOUSTIC CEILING TILE, MEDIUM AND LARGE PINHOLES WITH FLECKS, CLASSROOM 102
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE982 Dup
Sample ID: S 0048 C 1'X1' ACOUSTIC CEILING TILE, MEDIUM AND LARGE PINHOLES WITH FLECKS, CLASSROOM 102
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE983
Sample ID: S 0049 A BLACK BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF CORRIDOR 191
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE984
Sample ID: S 0049 B BLACK BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF CLASSROOM 187
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE985
Sample ID: S 0049 C BLACK BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF WEIGHT ROM 182
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE986
Sample ID: S 0050 A GREY BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF CLASSROOM 104
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE987
Sample ID: S 0050 B GREY BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF OFFICE 124
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE988
Sample ID: S 0050 C GREY BUTYL SEALANT ON EXTERIOR WINDOW, OUTSIDE OF OFFICE 124A
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE989
Sample ID: S 0051 A GREY CAULKING BETWEEN METAL PANELS BELOW WINDOW, MAIN ENTRANCE
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE990
Sample ID: S 0051 B GREY CAULKING BETWEEN METAL PANELS BELOW WINDOW, MAIN ENTRANCE
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE991
Sample ID: S 0051 C GREY CAULKING BETWEEN METAL PANELS BELOW WINDOW, MAIN ENTRANCE
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE992
Sample ID: S 0052 A MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CAFETERIA
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE992 Dup
Sample ID: S 0052 A MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CAFETERIA
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQE993
Sample ID: S 0052 B MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF MANUFACTURING SHOP 153
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE994
Sample ID: S 0052 C MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CLASSROOM 118
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE995
Sample ID: S 0052 D MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF GYM 115
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE996
Sample ID: S 0052 E MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF MUSIC ROOM 118
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE997
Sample ID: S 0052 F MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CLASSROOM 115
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE998
Sample ID: S 0052 G MORTAR BETWEEN JOINTS OF EXTERIOR BRICK CLADDING, OUTSIDE OF CLASSROOM 115
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQE999
Sample ID: S 0053 A DRYWALL JOINT COMPOUND ON CEILING, CHANGE ROOM 131, SHOWER
Matrix: Solid
Collected: 2021/09/09
Shipped: 2021/09/13
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQF000
Sample ID: S 0053 B DRYWALL JOINT COMPOUND ON CEILING, OFFICE 180, SHOWER
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF001
Sample ID: S 0053 C DRYWALL JOINT COMPOUND ON INTERIOR WALL, RESOURCE CENTRE 129
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF002
Sample ID: S 0053 D DRYWALL JOINT COMPOUND ON INTERIOR WALL, OFFICE 129B
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF002 Dup
Sample ID: S 0053 D DRYWALL JOINT COMPOUND ON INTERIOR WALL, OFFICE 129B
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF003
Sample ID: S 0053 E DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 187
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF004
Sample ID: S 0053 F DRYWALL JOINT COMPOUND ON INTERIOR WALL, MECHANICAL ROOM 280
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF005
Sample ID: S 0053 G DRYWALL JOINT COMPOUND ON CEILING, CHANGE ROOM 135, SHOWER
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |



TEST SUMMARY

Bureau Veritas ID: QQF006
Sample ID: S 0054 A DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 126
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF007
Sample ID: S 0054 B DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 151B
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF008
Sample ID: S 0054 C DRYWALL JOINT COMPOUND ON INTERIOR WALL, RADIO ROOM 156D
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF009
Sample ID: S 0054 D DRYWALL JOINT COMPOUND ON INTERIOR WALL, OFFICE 123
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF010
Sample ID: S 0054 E DRYWALL JOINT COMPOUND ON INTERIOR WALL, MANUFACTURING SHOP 154
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF011
Sample ID: S 0054 F DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 251
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF012
Sample ID: S 0054 G DRYWALL JOINT COMPOUND ON INTERIOR WALL, STORAGE 216
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQF012 Dup
Sample ID: S 0054 G DRYWALL JOINT COMPOUND ON INTERIOR WALL, STORAGE 216
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF013
Sample ID: S 0055 A DRYWALL JOINT COMPOUND ON BULKHEAD, CLASSROOM 226
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF014
Sample ID: S 0055 B DRYWALL JOINT COMPOUND ON INTERIOR WALL, CLASSROOM 220
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF015
Sample ID: S 0055 D DRYWALL JOINT COMPOUND ON BULKHEAD, CLASSROOM 111
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF016
Sample ID: S 0055 E DRYWALL JOINT COMPOUND ON BULKHEAD, CLASSROOM 112
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587274 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF017
Sample ID: S 0056 A SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 157
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF018
Sample ID: S 0056 B SMOOTH PLASTER CEILING, STORAGE 160
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQF019
Sample ID: S 0056 C SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 251
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF020
Sample ID: S 0056 D SMOOTH PLASTER CEILING, STORAGE 203
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF021
Sample ID: S 0056 E SMOOTH PLASTER ON EXTERIOR WALL BELOW RADIATOR, CLASSROOM 202
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF021 Dup
Sample ID: S 0056 E SMOOTH PLASTER ON EXTERIOR WALL BELOW RADIATOR, CLASSROOM 202
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF022
Sample ID: S 0057 A SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 104
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF023
Sample ID: S 0057 B SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 112
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF024
Sample ID: S 0057 C SMOOTH PLASTER ON BULKHEAD, ABOVE LOCKER, CORRIDOR 190
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

TEST SUMMARY

Bureau Veritas ID: QQF025
Sample ID: S 0057 D SMOOTH PLASTER ON BULKHEAD, ABOVE LOCKER, CORRIDOR 261
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF026
Sample ID: S 0057 E SMOOTH PLASTER ON COLUMN AT WINDOW, EXTERIOR WALL, CLASSROOM 217
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |

Bureau Veritas ID: QQF027
Sample ID: S 0055 C DRYWALL JOINT COMPOUND, INTERIOR WALL, CLASSROOM 219
Matrix: Solid
Collected: 2021/09/09
Shipped:
Received: 2021/09/13

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 7587284 | N/A | 2021/09/20 | Monika Vogt |



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

GENERAL COMMENTS

Samples can contain very fine asbestos fibres that are below the resolution limits of the PLM. Transmission Electron Microscopy (TEM) is recommended for confirmation of None Detected results.

Revised Report (2021/10/18): ID changed for S0022C to S 0055 C as per client request .

Results relate only to the items tested.



BUREAU
VERITAS

Bureau Veritas Job #: C1Q2918
Report Date: 2021/10/18

Pinchin Ltd
Client Project #: 200584.061
Site Location: 275 FARLEY AVENUE, BELLEVILLE
Sampler Initials: H.M

VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

A handwritten signature in black ink that reads 'J Santos'.

Jon Delos Santos, Laboratory Supervisor

BV Labs has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation please refer to the Validation Signature Page.



Your Project #: 200584.061
Your C.O.C. #: na

Attention: Laura Skoblenick

Pinchin Ltd
1456 Centennial Drive
Suite 2
Kingston, ON
CANADA K7P 0K4

Report Date: 2023/05/16
Report #: R7631181
Version: 1 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C3D0836

Received: 2023/05/09, 09:44

Sample Matrix: Solid
Samples Received: 56

| Analyses | Quantity | Date | Date | Laboratory Method | Analytical Method |
|-------------------------------|----------|-----------|------------|-------------------|-------------------|
| | | Extracted | Analyzed | | |
| Asbestos by PLM - 0.5 RDL (1) | 22 | N/A | 2023/05/16 | COR3SOP-00002 | EPA 600R-93/116 |
| Asbestos by PLM - 0.5 RDL (1) | 34 | N/A | N/A | COR3SOP-00002 | EPA 600R-93/116 |

Remarks:

Bureau Veritas is accredited to ISO/IEC 17025 for specific parameters on scopes of accreditation. Unless otherwise noted, procedures used by Bureau Veritas are based upon recognized Provincial, Federal or US method compendia such as CCME, MELCC, EPA, APHA.

All work recorded herein has been done in accordance with procedures and practices ordinarily exercised by professionals in Bureau Veritas' profession using accepted testing methodologies, quality assurance and quality control procedures (except where otherwise agreed by the client and Bureau Veritas in writing). All data is in statistical control and has met quality control and method performance criteria unless otherwise noted. All method blanks are reported; unless indicated otherwise, associated sample data are not blank corrected. Where applicable, unless otherwise noted, Measurement Uncertainty has not been accounted for when stating conformity to the referenced standard.

Bureau Veritas liability is limited to the actual cost of the requested analyses, unless otherwise agreed in writing. There is no other warranty expressed or implied. Bureau Veritas has been retained to provide analysis of samples provided by the Client using the testing methodology referenced in this report. Interpretation and use of test results are the sole responsibility of the Client and are not within the scope of services provided by Bureau Veritas, unless otherwise agreed in writing. Bureau Veritas is not responsible for the accuracy or any data impacts, that result from the information provided by the customer or their agent.

Solid sample results, except biota, are based on dry weight unless otherwise indicated. Organic analyses are not recovery corrected except for isotope dilution methods.

Results relate to samples tested. When sampling is not conducted by Bureau Veritas, results relate to the supplied samples tested. This Certificate shall not be reproduced except in full, without the written approval of the laboratory.

Bureau Veritas' Asbestos Laboratory is accredited by NVLAP for bulk asbestos analysis by polarized light microscopy, NVLAP Code 600136-0.

This report may not be reproduced, except in full, without the written approval of Bureau Veritas. This report may not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST or any other agency of the U.S. Government.

Bureau Veritas' scope of accreditation includes EPA -- 40 CFR Appendix E to Subpart E of Part 763, "Interim Method for the Determination of Asbestos in Bulk Insulation Samples" and EPA-600/R-93/116: "Method for the Determination of Asbestos in Bulk Building Materials".

Reference Method suffix "m" indicates test methods incorporate validated modifications from specific reference methods to improve performance.

* RPDs calculated using raw data. The rounding of final results may result in the apparent difference.



Your Project #: 200584.061
Your C.O.C. #: na

Attention: Laura Skoblenick

Pinchin Ltd
1456 Centennial Drive
Suite 2
Kingston, ON
CANADA K7P 0K4

Report Date: 2023/05/16
Report #: R7631181
Version: 1 - Final

CERTIFICATE OF ANALYSIS

BUREAU VERITAS JOB #: C3D0836

Received: 2023/05/09, 09:44

(1) P.O.B. - Percent of Bulk

When Asbestos data is reported with other data, this report contains data that are not covered by the NVLAP accreditation.

Encryption Key



Bureau Veritas
16 May 2023 15:02:10

Please direct all questions regarding this Certificate of Analysis to:
Nilushi Mahathantila, Project Manager
Email: Nilushi.Mahathantila@bureauveritas.com
Phone# (905) 817-5700

=====
This report has been generated and distributed using a secure automated process.
Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports.
For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by Rodney Major, General Manager responsible for Ontario Environmental laboratory operations.



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0059A WALL,ALL,PAINT,ON POURED CONCRETE,LOC:2,BASEMENT | | | | | |
|--|--------------|---|-------------------|----|--------------------|
| Bureau Veritas ID: VT1852 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous pink/beige paint/primer | Chrysotile | 1% | Non-Fibrous |

| S0059B WALL,ALL,PAINT,ON POURED CONCRETE,LOC:2,BASEMENT | | | | | |
|--|--------------|---------------------------|-----------------|--|--------------------|
| Bureau Veritas ID: VT1853 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey paint | Not Detected | | Non-Fibrous |

| S0059C WALL,ALL,PAINT,ON POURED CONCRETE,LOC:2,BASEMENT | | | | | |
|--|--------------|---------------------------|-----------------|--|--------------------|
| Bureau Veritas ID: VT1854 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous grey paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0059D WALL,ALL,PAINT,ON POURED CONCRETE,LOC:1,BASEMENT | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1855 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous orange paint | Not Detected | | Non-Fibrous |

| S0059E WALL,ALL,PAINT,ON POURED CONCRETE,LOC:1,BASEMENT | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1856 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous orange paint | Not Detected | | Non-Fibrous |

| S0060A WALL,ALL,PAINT,ON BRICK,LOC:193,CORRIDOR | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1857 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0060B WALL,STAIRS,PAINT,ON BRICK,LOC:190,CORRIDOR | | | | | |
|---|--------------|---------------------------|-------------------|------|--------------------|
| Bureau Veritas ID: VT1858 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Chrysotile | 0.5% | Non-Fibrous |

| S0060C WALL,STAIRS,PAINT,ON BRICK,LOC:260,CORRIDOR | | | | | |
|---|--------------|---------------------------|-----------------|--|--------------------|
| Bureau Veritas ID: VT1859 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S0060D WALL,ALL,PAINT,ON BRICK,LOC:161,MECHANICAL ROOM | | | | | |
|---|--------------|---------------------------|-----------------|--|--------------------|
| Bureau Veritas ID: VT1860 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous beige paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0061A WALL,PAINT,ON CONCRETE BLOCK,LOC:253,CLASSROOM | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1861 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S0061B WALL,PAINT,ON CONCRETE BLOCK,LOC:250,CLASSROOM | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1862 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S0061C WALL,PAINT,ON CONCRETE BLOCK,LOC:250,CLASSROOM | | | | | |
|--|--------------|-----------------------------|--------------------------|---------------------|--------------------|
| Bureau Veritas ID: VT1863 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Chrysotile <0.50% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0061D WALL,PAINT,ON CONCRETE BLOCK,LOC:255,CLASSROOM | | | | | |
|--|--------------|---------------------------|-------------------|------|--------------------|
| Bureau Veritas ID: VT1864 | | Date Analyzed: 2023/05/12 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous beige paint | Chrysotile | 0.5% | Non-Fibrous |

| S0061E WALL,PAINT,ON CONCRETE BLOCK,LOC:265,OFFICE | | | | | |
|---|--------------|-----------------------------|-------------------|--------|--------------------|
| Bureau Veritas ID: VT1865 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Chrysotile | <0.50% | Non-Fibrous |

| S0061F WALL,PAINT,ON CONCRETE BLOCK,LOC:260,CORRIDOR | | | | | |
|---|--------------|-----------------------------|-----------------|--|--------------------|
| Bureau Veritas ID: VT1866 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0061G WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:259,WASHROOM | | | | | |
|---|--------------|------------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1867 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous light grey paint | Not Detected | | Non-Fibrous |

| S0062A WALL,PAINT,ON CONCRETE BLOCK,LOC:157,CLASSROOM | | | | | |
|--|--------------|---------------------------------|----------------------|---------------------|--------------------|
| Bureau Veritas ID: VT1868 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white paint | Chrysotile 1% | | Non-Fibrous |

| S0062B WALL,PAINT,ON CONCRETE BLOCK,LOC:156,TECH AREA | | | | | |
|--|--------------|-----------------------------|------------------------|---------------------|--------------------|
| Bureau Veritas ID: VT1869 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Chrysotile 0.5% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Bureau Veritas Job #: C3D0836
 Report Date: 2023/05/16

Pinchin Ltd
 Client Project #: 200584.061
 Sampler Initials: JA

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0062C WALL,PAINT,ON CONCRETE BLOCK,LOC:155,MANUFACTURING SHOP | | | | | |
|---|--------------|-----------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1870 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Not Detected | | Non-Fibrous |

| S0062D WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:159,WASHROOM | | | | | |
|---|--------------|-----------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1871 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Not Detected | | Non-Fibrous |

| S0062E WALL,PAINT,ON CONCRETE BLOCK,LOC:161,MECHANICAL ROOM | | | | | |
|--|--------------|---------------------------|----------------------|---------------------|--------------------|
| Bureau Veritas ID: VT1872 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous beige paint | Chrysotile 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0062F WALL,PAINT,ON CONCRETE BLOCK,LOC:195,CORRIDOR | | | | | |
|---|--------------|-----------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1873 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Not Detected | | Non-Fibrous |

| S0063A WALL,PAINT,ON CONCRETE BLOCK,LOC:164,STAFF ROOM | | | | | |
|---|--------------|-----------------------------|----------------------|---------------------|--------------------|
| Bureau Veritas ID: VT1874 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Chrysotile 1% | | Non-Fibrous |

| S0063B WALL,PAINT,ON CONCRETE BLOCK,LOC:169,CLASSROOM | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1875 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0063C WALL,PAINT,ON CONCRETE | | | | | |
|--------------------------------------|--------------|---------------------------|-----------------|---------------------|--------------------|
| BLOCK,LOC:122,OFFICE | | | | | |
| Bureau Veritas ID: VT1876 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous beige paint | Not Detected | | Non-Fibrous |

| S0063D WALL,PAINT,ON CONCRETE | | | | | |
|--------------------------------------|--------------|-----------------------------|-----------------|---------------------|--------------------|
| BLOCK,LOC:194,CORRIDOR | | | | | |
| Bureau Veritas ID: VT1877 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Not Detected | | Non-Fibrous |

| S0063E WALL,PAINT,ON CONCRETE | | | | | |
|--------------------------------------|--------------|-----------------------------|--------------------------|---------------------|--------------------|
| BLOCK,LOC:111,CLASSROOM | | | | | |
| Bureau Veritas ID: VT1878 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Chrysotile <0.50% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0063F WALL,PAINT,ON CONCRETE BLOCK,LOC:103,CLASSROOM | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1879 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S0064A WALL,PAINT,ON CONCRETE BLOCK,LOC:223,CLASSROOM | | | | | |
|--|--------------|-----------------------------|------------------------|---------------------|--------------------|
| Bureau Veritas ID: VT1880 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Chrysotile 0.5% | | Non-Fibrous |

| S0064B WALL,PAINT,ON CONCRETE BLOCK,LOC:225,CLASSROOM | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1881 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0064C WALL,PAINT,ON CONCRETE BLOCK,LOC:219,CLASSROOM | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1882 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S0064D WALL,PAINT,ON CONCRETE BLOCK,LOC:262,CORRIDOR | | | | | |
|---|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1883 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S0064E WALL,PAINT,ON CONCRETE BLOCK,LOC:214,THEATRE | | | | | |
|--|--------------|-----------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1884 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous off-white paint | Not Detected | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0064F WALL,PAINT,ON CONCRETE BLOCK,LOC:211,CLASSROOM | | | | | |
|--|--------------|---------------------------|-----------------|---------------------|--------------------|
| Bureau Veritas ID: VT1885 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous white paint | Not Detected | | Non-Fibrous |

| S0065A WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE | | | | | |
|--|--------------|--|----------------------|---------------------|--------------------|
| Bureau Veritas ID: VT1886 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile 1% | | Non-Fibrous |

| S0065B WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE | | | | | |
|--|--------------|--|----------------------|---------------------|--------------------|
| Bureau Veritas ID: VT1887 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous black/white paint/primer | Chrysotile 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0065C WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE | | | | | |
|--|--------------|--|-------------------|----|--------------------|
| Bureau Veritas ID: VT1888 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous black/white paint/primer | Chrysotile | 1% | Non-Fibrous |

| S0065D WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE | | | | | |
|--|--------------|--|-------------------|----|--------------------|
| Bureau Veritas ID: VT1889 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | Non-Fibrous |

| S0065E WALL,PAINT,ON CONCRETE BLOCK,LOC:142,GYM | | | | | |
|--|--------------|--|-------------------|----|--------------------|
| Bureau Veritas ID: VT1890 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0066A WALL,PAINT,ON CONCRETE BLOCK,LOC:139,STORAGE ROOM | | | | | |
|---|--------------|--|-------------------|----|--------------------|
| Bureau Veritas ID: VT1891 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | Non-Fibrous |

| S0066B WALL,PAINT,ON CONCRETE BLOCK,LOC:139,STORAGE ROOM | | | | | |
|---|--------------|--|-------------------|----|--------------------|
| Bureau Veritas ID: VT1892 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | Non-Fibrous |

| S0066C WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:191,CORRIDOR | | | | | |
|---|--------------|--|-------------------|----|--------------------|
| Bureau Veritas ID: VT1893 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Bureau Veritas Job #: C3D0836
 Report Date: 2023/05/16

Pinchin Ltd
 Client Project #: 200584.061
 Sampler Initials: JA

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0066D WALL,PAINT,ON CONCRETE BLOCK,LOC:136,WASHROOM | | | | | |
|---|--------------|---|-------------------|----|--------------------|
| Bureau Veritas ID: VT1894 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous pink/white paint/primer | Chrysotile | 1% | Non-Fibrous |

| S0066E WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:141,EQUIPMENT STORAGE | | | | | |
|--|--------------|--|-------------------|----|--------------------|
| Bureau Veritas ID: VT1895 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | Non-Fibrous |

| S0066F WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:142,GYM | | | | | |
|--|--------------|---|-------------------|----|--------------------|
| Bureau Veritas ID: VT1896 | | Date Analyzed: 2023/05/15 | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous grey/white paint/primer | Chrysotile | 1% | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0066G WALL,ALL,PAINT,ON CONCRETE | | | | | | |
|--|--------------|---|-------------------|----|---------------------|--------------------|
| BLOCK,LOC:142,GYM | | | | | | |
| Bureau Veritas ID: VT1897 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous grey/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

| S0067A WALL,PAINT,ON CONCRETE | | | | | | |
|--------------------------------------|--------------|------------------------------|-----------------|--|---------------------|--------------------|
| BLOCK,LOC:188,MUSIC ROOM | | | | | | |
| Bureau Veritas ID: VT1898 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Homogeneous pink/green paint | Not Detected | | | Non-Fibrous |

| S0067B WALL,PAINT,ON CONCRETE | | | | | | |
|--------------------------------------|--------------|--|-------------------|----|---------------------|--------------------|
| BLOCK,LOC:191,CORRIDOR | | | | | | |
| Bureau Veritas ID: VT1899 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0067C WALL,PAINT,ON CONCRETE BLOCK,LOC:186,CLASSROOM | | | | | | |
|--|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: VT1900 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

| S0067D WALL,PAINT,ON CONCRETE BLOCK,LOC:134,CHANGE ROOM | | | | | | |
|--|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: VT1901 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

| S0067E WALL,PAINT,ON CONCRETE BLOCK,LOC:181,STAFF ROOM | | | | | | |
|---|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: VT1902 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0067F WALL,PAINT,ON CONCRETE BLOCK,LOC:141,EQUIPMENT STORAGE | | | | | | |
|--|--------------|--|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: VT1903 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

| S0068A WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE | | | | | | |
|--|--------------|--|-----------------|--|---------------------|--------------------|
| Bureau Veritas ID: VT1904 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous off-white/white paint/primer | Not Detected | | | Non-Fibrous |

| S0068B WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE | | | | | | |
|--|--------------|---|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: VT1905 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous grey/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
 Date Format : yyyy/mm/dd



BUREAU VERITAS

Bureau Veritas Job #: C3D0836
Report Date: 2023/05/16

Pinchin Ltd
Client Project #: 200584.061
Sampler Initials: JA

Asbestos Analytical Results

EPA/600R-93/116 by Polarized Light Microscopy

| S0068C WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE | | | | | | |
|--|--------------|---|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: VT1906 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous grey/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

| S0068D WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE | | | | | | |
|--|--------------|---|-------------------|----|---------------------|--------------------|
| Bureau Veritas ID: VT1907 | | Date Analyzed: 2023/05/15 | | | | |
| | <u>P.O.B</u> | <u>Sample Morphology</u> | <u>Asbestos</u> | | <u>Other Fibres</u> | <u>Particulate</u> |
| Layer 1 | 100 | Non-homogeneous grey/white paint/primer | Chrysotile | 1% | | Non-Fibrous |

The limit of quantitation is 0.50%, although asbestos may be qualitatively detected at concentrations less than 0.50%. Samples for which asbestos is detected at <0.50% are reported as trace, "<0.50%". "Not Detected" indicates that no asbestos fibres were observed.

Calibrated Visual Estimate (%)
Date Format : yyyy/mm/dd



TEST SUMMARY

Bureau Veritas ID: VT1852
Sample ID: S0059A WALL,ALL,PAINT,ON POURED CONCRETE,LOC:2,BASEMENT
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1853
Sample ID: S0059B WALL,ALL,PAINT,ON POURED CONCRETE,LOC:2,BASEMENT
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1854
Sample ID: S0059C WALL,ALL,PAINT,ON POURED CONCRETE,LOC:2,BASEMENT
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1855
Sample ID: S0059D WALL,ALL,PAINT,ON POURED CONCRETE,LOC:1,BASEMENT
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1856
Sample ID: S0059E WALL,ALL,PAINT,ON POURED CONCRETE,LOC:1,BASEMENT
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1857
Sample ID: S0060A WALL,ALL,PAINT,ON BRICK,LOC:193,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1858
Sample ID: S0060B WALL,STAIRS,PAINT,ON BRICK,LOC:190,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |



TEST SUMMARY

Bureau Veritas ID: VT1858 Dup
Sample ID: S0060B WALL,STAIRS,PAINT,ON BRICK,LOC:190,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1859
Sample ID: S0060C WALL,STAIRS,PAINT,ON BRICK,LOC:260,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1860
Sample ID: S0060D WALL,ALL,PAINT,ON BRICK,LOC:161,MECHANICAL ROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1861
Sample ID: S0061A WALL,PAINT,ON CONCRETE BLOCK,LOC:253,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1862
Sample ID: S0061B WALL,PAINT,ON CONCRETE BLOCK,LOC:250,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1863
Sample ID: S0061C WALL,PAINT,ON CONCRETE BLOCK,LOC:250,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1864
Sample ID: S0061D WALL,PAINT,ON CONCRETE BLOCK,LOC:255,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |



TEST SUMMARY

Bureau Veritas ID: VT1865
Sample ID: S0061E WALL,PAINT,ON CONCRETE BLOCK,LOC:265,OFFICE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1866
Sample ID: S0061F WALL,PAINT,ON CONCRETE BLOCK,LOC:260,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1867
Sample ID: S0061G WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:259,WASHROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1868
Sample ID: S0062A WALL,PAINT,ON CONCRETE BLOCK,LOC:157,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1868 Dup
Sample ID: S0062A WALL,PAINT,ON CONCRETE BLOCK,LOC:157,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1869
Sample ID: S0062B WALL,PAINT,ON CONCRETE BLOCK,LOC:156,TECH AREA
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1870
Sample ID: S0062C WALL,PAINT,ON CONCRETE BLOCK,LOC:155,MANUFACTURING SHOP
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |



BUREAU VERITAS

Bureau Veritas Job #: C3D0836
Report Date: 2023/05/16

Pinchin Ltd
Client Project #: 200584.061
Sampler Initials: JA

TEST SUMMARY

Bureau Veritas ID: VT1871
Sample ID: S0062D WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:159,WASHROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1872
Sample ID: S0062E WALL,PAINT,ON CONCRETE BLOCK,LOC:161,MECHANICAL ROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1873
Sample ID: S0062F WALL,PAINT,ON CONCRETE BLOCK,LOC:195,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1874
Sample ID: S0063A WALL,PAINT,ON CONCRETE BLOCK,LOC:164,STAFF ROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1875
Sample ID: S0063B WALL,PAINT,ON CONCRETE BLOCK,LOC:169,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1876
Sample ID: S0063C WALL,PAINT,ON CONCRETE BLOCK,LOC:122,OFFICE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1877
Sample ID: S0063D WALL,PAINT,ON CONCRETE BLOCK,LOC:194,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |



TEST SUMMARY

Bureau Veritas ID: VT1878
Sample ID: S0063E WALL,PAINT,ON CONCRETE BLOCK,LOC:111,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1878 Dup
Sample ID: S0063E WALL,PAINT,ON CONCRETE BLOCK,LOC:111,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1879
Sample ID: S0063F WALL,PAINT,ON CONCRETE BLOCK,LOC:103,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1880
Sample ID: S0064A WALL,PAINT,ON CONCRETE BLOCK,LOC:223,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1881
Sample ID: S0064B WALL,PAINT,ON CONCRETE BLOCK,LOC:225,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1882
Sample ID: S0064C WALL,PAINT,ON CONCRETE BLOCK,LOC:219,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1883
Sample ID: S0064D WALL,PAINT,ON CONCRETE BLOCK,LOC:262,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |



TEST SUMMARY

Bureau Veritas ID: VT1884
Sample ID: S0064E WALL,PAINT,ON CONCRETE BLOCK,LOC:214,THEATRE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1885
Sample ID: S0064F WALL,PAINT,ON CONCRETE BLOCK,LOC:211,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|----------------------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8661452 | N/A | | Rayana De Oliveira Cardoso |

Bureau Veritas ID: VT1886
Sample ID: S0065A WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1886 Dup
Sample ID: S0065A WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1887
Sample ID: S0065B WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1888
Sample ID: S0065C WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1889
Sample ID: S0065D WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:140,STAGE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |



BUREAU
VERITAS

Bureau Veritas Job #: C3D0836
Report Date: 2023/05/16

Pinchin Ltd
Client Project #: 200584.061
Sampler Initials: JA

TEST SUMMARY

Bureau Veritas ID: VT1890
Sample ID: S0065E WALL,PAINT,ON CONCRETE BLOCK,LOC:142,GYM
Matrix: Solid
Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1891
Sample ID: S0066A WALL,PAINT,ON CONCRETE BLOCK,LOC:139,STORAGE ROOM
Matrix: Solid
Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1892
Sample ID: S0066B WALL,PAINT,ON CONCRETE BLOCK,LOC:139,STORAGE ROOM
Matrix: Solid
Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1893
Sample ID: S0066C WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:191,CORRIDOR
Matrix: Solid
Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1894
Sample ID: S0066D WALL,PAINT,ON CONCRETE BLOCK,LOC:136,WASHROOM
Matrix: Solid
Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1895
Sample ID: S0066E WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:141,EQUIPMENT STORAGE
Matrix: Solid
Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1896
Sample ID: S0066F WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:142,GYM
Matrix: Solid
Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |



TEST SUMMARY

Bureau Veritas ID: VT1896 Dup
Sample ID: S0066F WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:142,GYM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1897
Sample ID: S0066G WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:142,GYM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1898
Sample ID: S0067A WALL,PAINT,ON CONCRETE BLOCK,LOC:188,MUSIC ROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1899
Sample ID: S0067B WALL,PAINT,ON CONCRETE BLOCK,LOC:191,CORRIDOR
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1900
Sample ID: S0067C WALL,PAINT,ON CONCRETE BLOCK,LOC:186,CLASSROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1901
Sample ID: S0067D WALL,PAINT,ON CONCRETE BLOCK,LOC:134,CHANGE ROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1902
Sample ID: S0067E WALL,PAINT,ON CONCRETE BLOCK,LOC:181,STAFF ROOM
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |



TEST SUMMARY

Bureau Veritas ID: VT1903
Sample ID: S0067F WALL,PAINT,ON CONCRETE BLOCK,LOC:141,EQUIPMENT STORAGE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1904
Sample ID: S0068A WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1905
Sample ID: S0068B WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1906
Sample ID: S0068C WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1906 Dup
Sample ID: S0068C WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |

Bureau Veritas ID: VT1907
Sample ID: S0068D WALL,ALL,PAINT,ON CONCRETE BLOCK,LOC:280,PENTHOUSE
Matrix: Solid

Collected: 2023/05/05
Shipped:
Received: 2023/05/09

| Test Description | Instrumentation | Batch | Extracted | Date Analyzed | Analyst |
|---------------------------|-----------------|---------|-----------|---------------|-------------|
| Asbestos by PLM - 0.5 RDL | MIC | 8665006 | N/A | 2023/05/16 | Dina Yousif |



**BUREAU
VERITAS**

Bureau Veritas Job #: C3D0836
Report Date: 2023/05/16

Pinchin Ltd
Client Project #: 200584.061
Sampler Initials: JA

GENERAL COMMENTS

Results relate only to the items tested.



BUREAU
VERITAS

Bureau Veritas Job #: C3D0836
Report Date: 2023/05/16

Pinchin Ltd
Client Project #: 200584.061
Sampler Initials: JA

VALIDATION SIGNATURE PAGE

The analytical data and all QC contained in this report were reviewed and validated by:

Jon Delos Santos, Laboratory Supervisor

Bureau Veritas has procedures in place to guard against improper use of the electronic signature and have the required "signatories", as per ISO/IEC 17025, signing the reports. For Service Group specific validation, please refer to the Validation Signatures page if included, otherwise available by request. For Department specific Analyst/Supervisor validation names, please refer to the Test Summary section if included, otherwise available by request. This report is authorized by {0}, {1} responsible for {2} {3} laboratory operations.

APPENDIX II-B
Lead Analytical Certificates

Certificate of Analysis

Pinchin Ltd. (Kingston)

1456 Centennial Drive, Suite 2
Kingston, ON K7P 0K4
Attn: Halie MacKillican

Client PO: 275 Farley Avenue, Belleville, Ontario
Project: 200584.061
Custody:

Report Date: 16-Sep-2021
Order Date: 13-Sep-2021

Order #: 2138022

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID | Client ID |
|------------|--|
| 2138022-01 | L0001 - Red on steel structure, composite sample |
| 2138022-02 | L0002 - Grey on concrete floor, composite sample |
| 2138022-03 | L0003 - Yellow on textured plaster, Mechanical 161 and Resource Centre 129 |
| 2138022-04 | L0004 - Off-white on plaster, composite sample |
| 2138022-05 | L0005 - Off-white on drywall, composite sample |
| 2138022-06 | L0006 - Green/pink on drywall, composite sample |
| 2138022-07 | L0007 - Yellow on concrete block, composite sample |
| 2138022-08 | L0008 - Pink on concrete block, Music Room 188 |
| 2138022-09 | L0009 - Black on concrete block, Stage 140 |
| 2138022-10 | L0010 - Off-white on concrete structure, Custodial 146 |
| 2138022-11 | L0011 - Off-white on metal radiators, composite sample |

Approved By:



Mark Foto, M.Sc.
Lab Supervisor

Any use of these results implies your agreement that our total liability in connection with this work, however arising shall be limited to the amount paid by you for this work, and that our employees or agents shall not under circumstances be liable to you in connection with this work

Certificate of Analysis
Client: Pinchin Ltd. (Kingston)
Client PO: 275 Farley Avenue, Belleville, Ontario

Report Date: 16-Sep-2021
Order Date: 13-Sep-2021
Project Description: 200584.061

Analysis Summary Table

| Analysis | Method Reference/Description | Extraction Date | Analysis Date |
|----------------|-------------------------------|-----------------|---------------|
| Metals, ICP-MS | EPA 6020 - Digestion - ICP-MS | 16-Sep-21 | 16-Sep-21 |

Qualifier Notes:

Sample Qualifiers :

- 1 : Complete separation of paint from substrate not possible for this sample and a small amount of substrate has been included in the paint digestion.

Sample Data Revisions

None

Work Order Revisions/Comments:

None

Other Report Notes:

- n/a: not applicable
- ND: Not Detected
- MDL: Method Detection Limit
- Source Result: Data used as source for matrix and duplicate samples
- %REC: Percent recovery.
- RPD: Relative percent difference.

Certificate of Analysis
 Client: Pinchin Ltd. (Kingston)
 Client PO: 275 Farley Avenue, Belleville, Ontario

Report Date: 16-Sep-2021
 Order Date: 13-Sep-2021
 Project Description: 200584.061

Sample Results

| Lead | | | | | Matrix: Paint |
|------------|--|-------------|----------|--------|---------------|
| Parcel ID | Client ID | Sample Date | Units | MDL | Result |
| 2138022-01 | L0001 - Red on steel structure, composite sample | 31-Aug-21 | % by Wt. | 0.0005 | 0.393 |
| 2138022-02 | L0002 - Grey on concrete floor, composite sample | 31-Aug-21 | % by Wt. | 0.0005 | 0.0958 |
| 2138022-03 | L0003 - Yellow on textured plaster, Mechanical 161 and | 31-Aug-21 | % by Wt. | 0.0005 | 0.0194 |
| 2138022-04 | L0004 - Off-white on plaster, composite sample | 31-Aug-21 | % by Wt. | 0.0005 | 0.0568 |
| 2138022-05 | L0005 - Off-white on drywall, composite sample | 31-Aug-21 | % by Wt. | 0.0005 | 0.0055 |
| 2138022-06 | L0006 - Green/pink on drywall, composite sample | 31-Aug-21 | % by Wt. | 0.0005 | 0.0027 |
| 2138022-07 | L0007 - Yellow on concrete block, composite sample | 31-Aug-21 | % by Wt. | 0.0005 | 0.0945 [1] |
| 2138022-08 | L0008 - Pink on concrete block, Music Room 188 | 31-Aug-21 | % by Wt. | 0.0005 | 0.0144 |
| 2138022-09 | L0009 - Black on concrete block, Stage 140 | 31-Aug-21 | % by Wt. | 0.0005 | 0.0043 |
| 2138022-10 | L0010 - Off-white on concrete structure, Custodial 146 | 31-Aug-21 | % by Wt. | 0.0005 | 0.0011 |
| 2138022-11 | L0011 - Off-white on metal radiators, composite sample | 31-Aug-21 | % by Wt. | 0.0005 | 0.0828 |

Laboratory Internal QA/QC

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-------------------------|---------|-----------------|----------|---------------|------|------------|------|-----------|-------|
| Matrix Blank | | | | | | | | | |
| Lead | ND | 0.0005 | % by Wt. | | | | | | |
| Matrix Duplicate | | | | | | | | | |
| Lead | 0.00268 | 0.0005 | % by Wt. | 0.00291 | | | 8.06 | 50 | |
| Matrix Spike | | | | | | | | | |
| Lead | 54.3 | 5.00 | % by Wt. | 1.2 | 106 | 70-130 | | | |



OTTAWA · KINGSTON · NIAGARA · MISSISSAUGA · SARNIA

| | | |
|---|---|--|
| Client Name: Pinchin Ltd. | Project Reference: 275 Farley Avenue, Belleville, Ontario | TAT: <input checked="" type="checkbox"/> Regular <input type="checkbox"/> 3 Day <input type="checkbox"/> 2 Day <input type="checkbox"/> 1 Day Date Required: _____ |
| Contact Name: Halle MacKilligan | Quote #: 200584.061 | |
| Address: 1456 Centennial Drive, Suite 2, Kingston, ON | PO # | |
| Telephone: 613.541.1013 | Email Address: hmackilligan@pinchin.com | |

Criteria: O. Reg. 153 (As Amended) Table RSC Filing O. Reg. 558/00 PWQO CCME SUB (Storm) SUB (Sanitary) Municipality: _____ Other: _____

Matrix Type: S (Soil/Sed.) GW (Ground Water) SW (Surface Water) SS (Storm/Sanitary Sewer) P (Paint) A (Air) O (Other) Required Analyses

| Parcel Order Number: <i>2138022</i> | | Matrix | Air Volume | # of Containers | Sample Taken | | Lead | Required Analyses | | | | | | | | | | | | |
|--|--|--------|------------|-----------------|--------------|------|-------------------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|
| Sample ID/Location Name | | | | | Date | Time | | | | | | | | | | | | | | |
| 1 | L0001 - Red on steel structure, composite sample | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2 | L0002 - Grey on concrete floor, composite sample | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3 | L0003 - Yellow on textured plaster, Mechanical 161 and Resource Centre 129 | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 4 | L0004 - Off-white on plaster, composite sample | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 5 | L0005 - Off-white on drywall, composite sample | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 6 | L0006 - Green/pink on drywall, composite sample | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 7 | L0007 - Yellow on concrete block, composite sample | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 8 | L0008 - Pink on concrete block, Music Room 188 | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 9 | L0009 - Black on concrete block, Stage 140 | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 10 | L0010 - Off-white on concrete structure, Custodial 146 | p | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |

Comments: cc ghendry@pinchin.com, jmarx@pinchin.com and jmccann@pinchin.com with results
Please report results in percent

| | | | |
|--|---------------------------|---|--------------------------------------|
| Relinquished By (Sign): <i>[Signature]</i> | Received by Driver/Depot: | Received at Lab: <i>Juneepam Dohmai</i> | Verified By: <i>[Signature]</i> |
| Relinquished By (Print): Halle MacKilligan | Date/Time: | Date/Time: <i>Sept 13, 2021 06:55</i> | Date/Time: <i>Sept 13, 2021 9:30</i> |
| Date/Time: <i>Sept 9, 2021</i> | Temperature: _____ °C | Temperature: _____ °C | pH Verified [] By: _____ |

APPENDIX II-C
PCB Analytical Certificates

Certificate of Analysis

Pinchin Ltd. (Kingston)

1456 Centennial Drive, Suite 2
Kingston, ON K7P 0K4
Attn: Halie MacKillican

Client PO: 275 Farley Avenue, Belleville, Ontario
Project: 200584.061
Custody:

Report Date: 15-Sep-2021
Order Date: 13-Sep-2021

Order #: 2138026

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Paracel ID | Client ID |
|------------|--|
| 2138026-01 | P0001 - Black and grey butyl sealant on exterior windows, composite sample |
| 2138026-02 | P0002 - Grey caulking on interior and exterior window frames, composite sample |
| 2138026-03 | P0003 - Soft grey caulking between metal panels below windows, Main entrance |

Approved By:



Mark Foto, M.Sc.
Lab Supervisor

Certificate of Analysis

Report Date: 15-Sep-2021

Client: Pinchin Ltd. (Kingston)

Order Date: 13-Sep-2021

Client PO: 275 Farley Avenue, Belleville, Ontario

Project Description: 200584.061

Analysis Summary Table

| Analysis | Method Reference/Description | Extraction Date | Analysis Date |
|-------------|------------------------------|-----------------|---------------|
| PCBs, total | SW846 8082A - GC-ECD | 14-Sep-21 | 14-Sep-21 |

Certificate of Analysis

Report Date: 15-Sep-2021

Client: Pinchin Ltd. (Kingston)

Order Date: 13-Sep-2021

Client PO: 275 Farley Avenue, Belleville, Ontario

Project Description: 200584.061

| | | | | |
|---------------------|--|--|--|---|
| Client ID: | P0001 - Black and grey butyl sealant on exterior windows, composite sample | P0002 - Grey caulking on interior and exterior window frames, composite sample | P0003 - Soft grey caulking between metal panels below windows, Main entrance | - |
| Sample Date: | 31-Aug-21 09:00 | 31-Aug-21 09:00 | 31-Aug-21 09:00 | - |
| Sample ID: | 2138026-01 | 2138026-02 | 2138026-03 | - |
| MDL/Units | Other | Other | Other | - |

PCBs

| | | | | | |
|--------------------|-----------|------|------|------|---|
| PCBs, total | 5 ppm | <5 | <5 | <5 | - |
| Decachlorobiphenyl | Surrogate | 121% | 116% | 127% | - |

Certificate of Analysis
 Client: Pinchin Ltd. (Kingston)
 Client PO: 275 Farley Avenue, Belleville, Ontario

Report Date: 15-Sep-2021
 Order Date: 13-Sep-2021
 Project Description: 200584.061

Method Quality Control: Blank

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-------------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| PCBs | | | | | | | | | |
| PCBs, total | ND | 5 | ppm | | | | | | |
| Surrogate: Decachlorobiphenyl | 2.62 | | ppm | | 131 | 60-140 | | | |

Certificate of Analysis
 Client: Pinchin Ltd. (Kingston)
 Client PO: 275 Farley Avenue, Belleville, Ontario

Report Date: 15-Sep-2021
 Order Date: 13-Sep-2021
 Project Description: 200584.061

Method Quality Control: Duplicate

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-------------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| PCBs | | | | | | | | | |
| PCBs, total | ND | 5 | ppm | ND | | | NC | 40 | |
| Surrogate: Decachlorobiphenyl | 2.29 | | ppm | | 115 | 60-140 | | | |

Certificate of Analysis
 Client: Pinchin Ltd. (Kingston)
 Client PO: 275 Farley Avenue, Belleville, Ontario

Report Date: 15-Sep-2021
 Order Date: 13-Sep-2021
 Project Description: 200584.061

Method Quality Control: Spike

| Analyte | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-------------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| PCBs | | | | | | | | | |
| PCBs, total | 8 | 5 | ppm | ND | 102 | 60-140 | | | |
| Surrogate: Decachlorobiphenyl | 2.65 | | ppm | | 133 | 60-140 | | | |

Certificate of Analysis

Report Date: 15-Sep-2021

Client: Pinchin Ltd. (Kingston)

Order Date: 13-Sep-2021

Client PO: 275 Farley Avenue, Belleville, Ontario

Project Description: 200584.061

Qualifier Notes:

None

Sample Data Revisions

None

Work Order Revisions / Comments:

None

Other Report Notes:

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated



OTTAWA • KINGSTON • NIAGARA • MISSISSAUGA • S.....

Page 1 of 1

| | | |
|---|---|---|
| Client Name: Pinchin Ltd. | Project Reference: 275 Farley Avenue, Belleville, Ontario | TAT: <input checked="" type="checkbox"/> Regular <input type="checkbox"/> 3 Day |
| Contact Name: Halle MacKillican | Quote # 200584.061 | <input type="checkbox"/> 2 Day <input type="checkbox"/> 1 Day |
| Address: 1456 Centennial Drive, Suite 2, Kingston, ON | PO # | Date Required: _____ |
| Telephone: 613-541-1013 ext 1616 | Email Address: hmackillican@pinchin.com | |

Criteria: O. Reg. 153 (As Amended) Table RSC Filing O. Reg. 558/00 PWQO CCME SUB (Storm) SUB (Sanitary) Municipality: _____ Other: _____

Matrix Type: S (Soil/Sed.) GW (Ground Water) SW (Surface Water) SS (Storm/Sanitary Sewer) P (Paint) A (Air) O (Other)

Required Analyses

| Parcel Order Number: <i>2138026</i> | | Matrix | Air Volume | # of Containers | Sample Taken | | PCB | Required Analyses | | | | | | | | | | | | |
|--|--|--------|------------|-----------------|--------------|------|-------------------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|--------------------------|
| Sample ID/Location Name | | | | | Date | Time | | | | | | | | | | | | | | |
| 1 | P0001 - Black and grey butyl sealant on exterior windows, composite sample | o | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 2 | P0002 - Grey caulking on interior and exterior window frames, composite sample | o | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 3 | P0003 - Soft grey caulking between metal panels below windows, Main Entrance | o | | 1 | Aug 31 2021 | AM | <input checked="" type="checkbox"/> | <input type="checkbox"/> |
| 4 | | | | | | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 5 | | | | | | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 6 | | | | | | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 7 | | | | | | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 8 | | | | | | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 9 | | | | | | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 10 | | | | | | | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

Comments: cc ghendry@pinchin.com jmarx@pinchin.com and jmccann@pinchin.com on results
Method of Delivery: *Purulator*

| | | | |
|--|---------------------------|---|--------------------------------------|
| Relinquished By (Sign): <i>[Signature]</i> | Received by Driver/Depot: | Received at Lab: <i>Juneepam Dekmal</i> | Verified By: <i>[Signature]</i> |
| Relinquished By (Print): Halle MacKillican | Date/Time: | Date/Time: <i>sep 13, 2021 08.50</i> | Date/Time: <i>sep 13th 2021 9.51</i> |
| Date/Time: Sept 10 2021 | Temperature: _____ °C | Temperature: _____ °C | pH Verified [] By: _____ |

APPENDIX III
Methodology



1.0 GENERAL

An inspection was conducted to identify the type of Hazardous Building Materials incorporated in the structure and its finishes.

Information regarding the location and condition of hazardous building materials encountered and visually estimated quantities were recorded. The locations of any samples collected were recorded on small-scale plans. As-built drawings and previous reports were referenced where provided.

Sample collection was conducted in accordance with our Standard Operating Procedures.

1.1 Asbestos

The inspection for asbestos included friable and non-friable asbestos-containing materials (ACM). A friable material is a material that when dry can be crumbled, pulverized or powdered by hand pressure.

A separate set of samples was collected of each type of homogenous material suspected to contain asbestos. A homogenous material is defined by the US EPA as material that is uniform in texture and appearance, was installed at one time, and is unlikely to consist of more than one type or formulation of material. The homogeneous materials were determined by visual examination and available information on the phases of construction and prior renovations.

Samples were collected at a rate that is in compliance with the requirements of local regulations and guidelines. The sampling strategy was also based on known ban dates and phase out dates of the use of asbestos; sampling of certain building materials is not conducted after specific construction dates. In addition, to be conservative, several years past these dates are added to account for some uncertainty in the exact start / finish date of construction and associated usage of ACM. In some cases, manufactured products such as asbestos cement pipe were visually identified without sample confirmation.

The asbestos analysis was completed using a stop-positive approach. Only one result meeting the regulated criteria was required to determine that a material is asbestos-containing, but all samples must be analyzed to conclusively determine that a material is non-asbestos. The laboratory stopped analyzing samples from a homogeneous material once a result equal to or greater than the regulated criteria is detected in any of the samples of that material. All samples of a homogeneous material were analyzed if no asbestos is detected. In some cases, all samples were analyzed in the sample set regardless of result.

The analysis was performed in accordance with Test Method EPA/600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials, July 1993.

Analytical results were compared to the following criteria:

| Jurisdiction | Friable | Non-Friable |
|---------------------|----------------|--------------------|
| Ontario | 0.5% | 0.5% |

Where building materials are described in the report as “non-asbestos” or “does not contain asbestos”, this means that either no asbestos was detected by the analytical method utilized in any of the multiple samples or, if detected, it is below the lower limit of an asbestos-containing material in the applicable regulation. Additionally, these terms are used for materials which historically are known to not include asbestos in their manufacturing.

1.2 Lead

Samples of distinctive paint finishes, and surface coatings present in more than a limited application, where removal of the paint is possible was collected. The samples were collected by scraping the painted finish to include base and covering applications.

Analysis for lead in paints or surface coatings was performed in accordance with EPA Method No. 3050B/Method No. 7420; flame atomic absorption, or equivalent.

Analytical results were compared to the following criteria:

| Jurisdiction | Units (%) | Units (ppm) / (mg/kg) |
|---------------------|------------------|------------------------------|
| Ontario | 0.1 | 1000 |

Other lead building products (e.g. batteries, lead sheeting, flashing) were identified by visual observation only.

1.3 Silica

Building materials known to contain crystalline silica (e.g. concrete, cement, tile, brick, masonry, mortar) were identified by visual inspection only. Pinchin did not perform sampling of these materials for laboratory analysis of crystalline silica content.

1.4 Mercury

Building materials, products or equipment (e.g. thermostats, barometers, pressure gauges, lamp tubes), suspected to contain mercury was identified by visually inspection only. Dismantling of equipment suspected of containing mercury was not performed. Sampling of these materials for laboratory analysis of mercury content was not performed.



1.5 Polychlorinated Biphenyls

The potential for light ballast and oil filled transformers to contain PCBs was based on the age of the building, a review of maintenance records and examination of labels or nameplates on equipment, where present and accessible. The information was compared to known ban dates of PCBs and Environment Canada publications.

Dry type transformers were presumed to be free of dielectric fluids and hence non-PCB.

Fluids (mineral oil, hydraulic, Aroclor or Askarel) in transformers or other equipment were not sampled for PCB content.

Caulking, sealants, or paints were sampled and submitted for PCB analysis following EPA 3550C/8082A.

Sample results are compared to the criteria of 50 mg/kg for solids as stated in the PCB Regulation, SOR/2008-273.

1.6 Visible Mould

The presence of mould or water damage was determined by visual inspection of exposed building surfaces. If any mould growth or water damage was concealed within building cavities it was not addressed in this assessment.

Template: Methodology for Hazardous Building Materials Assessment, HAZ, July 22, 2021

APPENDIX IV
Location Summary Report

Client:Hasting and Prince Edward District School Board
Building Name: Eastside Secondary School
Survey Date:
Building Phases: A:

Site: 275 Farley Avenue, Belleville, ON
Last Re-Assessment:

| Location No. | Name or Description | Area ft ² | Floor No. | Bldg. Phase | Notes |
|--------------|-----------------------------------|----------------------|-----------|-------------|--|
| 1 | Basement, room no. 001 | 150 | 0 | A | |
| 2 | Basement, room no. 002 | 500 | 0 | A | |
| 3 | Exterior | 0 | | A | |
| 100 | Offices, room no. 124 | 400 | 1 | A | Formerly Room 100, Includes Rooms 124E-F and 125A-C |
| 101 | Classroom, room no. 101 | 500 | 1 | A | |
| 102 | Classroom, room no. 102 | 500 | 1 | A | |
| 103 | Classroom, room no. 103 | 500 | 1 | A | |
| 104 | Classroom, room no. 104 | 500 | 1 | A | |
| 105 | Resource Room, room no. 104 | 500 | 1 | A | Formerly Room 105 |
| 106 | Classroom, room no. 106 | 500 | 1 | A | |
| 108 | Guidance, room no. 120 | 600 | 1 | A | Formerly Room 108, Includes Rooms 120A-E |
| 109 | Storage, room no. 121 | 200 | 1 | A | Formerly Room 109, Includes Room 121A |
| 110 | Staff Room, room no. 110 | 300 | 1 | A | Includes Rooms 110A-C |
| 111 | Classroom, room no. 111 | 500 | 1 | A | |
| 112 | Classroom, room no. 112 | 500 | 1 | A | |
| 113 | Classroom, room no. 113 | 500 | 1 | A | |
| 114 | Classroom, room no. 114 | 500 | 1 | A | |
| 115 | Classroom, room no. 115 | 500 | 1 | A | |
| 116 | Custodial Room, room no. 105 | 50 | 1 | A | Formerly Room 116 |
| 122 | Office, room no. 122 | 100 | 1 | A | |
| 123 | Office, room no. 123 | 200 | 1 | A | Includes Rooms 123A-B |
| 124 | Office, room no. 124 | 700 | 1 | A | Includes Room 124-2 and 124A-D |
| 125 | Classroom, room no. 125 | 400 | 1 | A | |
| 126 | Classroom/IT Office, room no. 126 | 500 | 1 | A | Includes Rooms 129J-K |
| 127 | Staff Room, room no. 127 | 500 | 1 | A | Includes Rooms 127A-B |
| 128 | Washroom, room no. 128 | 300 | 1 | A | |
| 129 | Resource Centre, room no. 129 | 9000 | 1 | A | Includes Rooms 129A-H and 129C-N |
| 130 | Custodial Room, room no. 130 | 25 | 1 | C | |
| 131 | Change Room, room no. 131 | 400 | 1 | C | Includes Rooms 131A-C |
| 132 | Washroom, room no. 132 | 50 | 1 | C | |
| 133 | Washroom, room no. 133 | 50 | 1 | C | |
| 134 | Change Room, room no. 134 | 400 | 1 | C | |
| 135 | Change Room, room no. 135 | 400 | 1 | C | Includes Rooms 135A-B |
| 136 | Washroom, room no. 136 | 200 | 1 | C | |
| 137 | Washroom, room no. 137 | 200 | 1 | C | Includes Room 137A |
| 139 | Storage Room, room no. 139 | 300 | 1 | C | |
| 140 | Stage, room no. 140 | 200 | 1 | C | |
| 141 | Equipment Storage, room no. 142 | 400 | 1 | C | Formerly Rooms 141 and 141A-C, Includes Rooms 142B-F |
| 142 | Gym, room no. 142 | 9000 | 1 | C | Includes Room 191A |
| 143 | Custodial Office, room no. 143 | 100 | 1 | A | Includes Rooms 143A |
| 144 | Office, room no. 144 | 150 | 1 | A | |
| 145 | Washroom, room no. 146 | 300 | 1 | A | Formerly Room 145 |
| 146 | Custodial Room, room no. 145 | 100 | 1 | A | Formerly Room 146 |
| 150 | Classroom, room no. 148 | 300 | 1 | A | Formerly Room 150 |
| 151 | Classroom, room no. 149 | 300 | 1 | A | Formerly Room 151, Includes Rooms 149A-C |
| 152 | Wood Shop, room no. 151 | 1000 | 1 | A | Formerly Room 152, Includes Room 151A |
| 153 | Autoshop, room no. 153 | 4000 | 1 | B | |
| 154 | Manufacturing Shop, room no. 154 | 1500 | 1 | B | Includes 154A |
| 155 | Manufacturing Shop, room no. 155 | 2000 | 1 | B | |
| 156 | Tech Area, room no. 156 | 500 | 1 | B | Includes rooms 156A-C |
| 157 | Classroom, room no. 157 | 400 | 1 | B | |
| 158 | Classroom, room no. 158 | 400 | 1 | B | |
| 159 | Washroom, room no. 159 | 300 | 1 | B | |
| 160 | Custodial Room, room no. 160 | 50 | 1 | B | |
| 161 | Mechanical Room, room no. 161 | 250 | 1 | B | Includes Rooms 161A-B |
| 162 | Storage, room no. 152 | 100 | 1 | A | Formerly Room 162 |
| 163 | Boiler Room, room no. 163 | 600 | 1 | A | Includes Room 162 |

| Location No. | Name or Description | Area ft ² | Floor No. | Bldg. Phase | Notes |
|--------------|--------------------------------|----------------------|-----------|-------------|--|
| 164 | Staff Room, room no. 164 | 200 | 1 | A | |
| 165 | Kitchen, room no. 165 | 600 | 1 | A | Includes Rooms 165A-D |
| 166 | Kitchen, room no. 194 | 150 | 1 | A | Formerly Room 166 |
| 167 | Cafeteria, room no. 167 | 1000 | 1 | A | |
| 168 | Corridor, room no. 168 | 200 | 1 | A | |
| 169 | Classroom, room no. 150 | 400 | 1 | A | Formerly Room 169, Includes Room 150A |
| 180 | Staff Room, room no. 180 | 400 | 1 | C | Includes Rooms 180A-B |
| 181 | Staff Room, room no. 181 | 500 | 1 | C | |
| 182 | Weight Room, room no. 182 | 500 | 1 | C | Includes Room 183A |
| 183 | Greenhouse, room no. 183 | 500 | 1 | C | |
| 184 | Classroom, room no. 184 | 300 | 1 | C | Includes Room 184A |
| 185 | Classroom, room no. 185 | 500 | 1 | C | |
| 186 | Classroom, room no. 186 | 300 | 1 | C | |
| 187 | Classroom, room no. 187 | 500 | 1 | C | Includes Room 188 |
| 188 | Music Room, room no. 189 | 500 | 1 | C | Formerly Room 188, Includes Rooms 189A-E |
| 190 | Corridor, room no. 190 | 2000 | 1 | A | Includes Room 190A |
| 191 | Corridor, room no. 191 | 3000 | 1 | C | |
| 192 | Corridor, room no. 192 | 4000 | 1 | A | |
| 193 | Corridor, room no. 193 | 200 | 1 | A | Includes Rooms 193A-B |
| 194 | Corridor, room no. 194 | 2000 | 1 | A | Includes Rooms 194A and 194C |
| 195 | Corridor, room no. 195 | 2000 | 1 | B | Includes Rooms 195A |
| 202 | Classroom, room no. 204 | 400 | 2 | A | Formerly Room 202, Includes Room 205 |
| 203 | Storage, room no. 216 | 100 | 2 | A | Formerly Room 203 |
| 204 | Custodial Room, room no. 217 | 100 | 2 | A | Formerly Room 204 |
| 205 | Washroom, room no. 217 | 200 | 2 | A | Formerly Room 205 |
| 206 | Washroom, room no. 217 | 200 | 2 | A | Formerly Room 206 |
| 207 | Classroom, room no. 201 | 500 | 2 | A | Formerly Room 207 |
| 208 | Storage, room no. 201 | 100 | 2 | A | Formerly Room 208 |
| 209 | Storage, room no. 202 | 50 | 2 | A | Formerly Room 209 |
| 210 | Staff Room, room no. 210 | 300 | 2 | A | |
| 211 | Classroom, room no. 208 | 400 | 2 | A | Formerly Room 211 |
| 212 | Classroom, room no. 212 | 400 | 2 | A | Includes Rooms 212A |
| 214 | Theatre, room no. 214 | 500 | 2 | A | |
| 215 | Classroom, room no. 215 | 400 | 2 | A | Includes Room 215A |
| 216 | Storage, room no. 213 | 200 | 2 | A | Formerly Room 216 |
| 217 | Classroom, room no. 218 | 500 | 2 | A | Formerly Room 217 |
| 218 | Resource Room, room no. 218 | 150 | 2 | A | Formerly Room 218 |
| 219 | Classroom, room no. 219 | 500 | 2 | A | |
| 220 | Classroom, room no. 220 | 500 | 2 | A | Includes Room 220A |
| 223 | Classroom, room no. 223 | 500 | 2 | A | |
| 224 | Classroom, room no. 224 | 500 | 2 | A | |
| 225 | Classroom, room no. 225 | 500 | 2 | A | |
| 226 | Classroom, room no. 226 | 500 | 2 | A | |
| 227 | Resource Room, room no. 227 | 150 | 2 | A | Includes Room 227A |
| 228 | Classroom, room no. 228 | 500 | 2 | A | |
| 229 | Storage, room no. 211 | 100 | 2 | A | Formerly Room 229 |
| 230 | Mechanical Room, room no. 207 | 400 | 2 | A | Formerly Room 230 |
| 231 | Electrical Room, room no. 209 | 200 | 2 | A | Formerly Room 231, Includes Room 209A |
| 250 | Classroom, room no. 249 | 500 | 2 | B | Formerly Room 250, Includes Rooms 249A-B |
| 251 | Classroom, room no. 251 | 400 | 2 | B | |
| 252 | Classroom, room no. 252 | 300 | 2 | B | |
| 253 | Classroom, room no. 253 | 300 | 2 | B | |
| 254 | Classroom, room no. 254 | 300 | 2 | B | |
| 255 | Classroom, room no. 258 | 300 | 2 | B | Formerly Room 255 |
| 257 | Washroom, room no. 257 | 200 | 2 | B | |
| 258 | Custodial Closet, room no. 256 | 50 | 2 | B | Formerly Room 258 |
| 259 | Washroom, room no. 255 | 200 | 2 | B | Formerly Room 259 |
| 260 | Corridor, room no. 295 | 2000 | 2 | B | Formerly Room 260 |
| 261 | Corridor, room no. 290 | 2000 | 2 | A | Formerly Room 261 |
| 262 | Corridor, room no. 292 | 2000 | 2 | A | Formerly Room 262 |
| 263 | Washroom, room no. 203 | 50 | 2 | A | Formerly Room 263 |
| 264 | Washroom, room no. 206 | 50 | 2 | A | Formerly Room 264 |
| 265 | Office, room no. 259 | 200 | 2 | B | Formerly Room 265, Includes Room 295A |
| 266 | Offices, room no. 250 | 300 | 2 | B | Formerly Room 266 |
| 280 | Penthouse, room no. 280 | 2000 | 2 | C | Includes 281 and 282 |

APPENDIX V

Hazardous Materials Summary Report / Sample Log

Client:Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Survey Date:

| HAZMAT | Sample No | System/Component/Material/Sample Description | Locations | Bldg. Phase | LF | SF | EA | % | Type | Positive | Friability |
|----------|-------------------|--|--|-------------|------|------|-----|---|------------------|----------|------------|
| Asbestos | S0001 ABC | Piping All, Hot Water Heating Aircell | 2,104,106,109,124,150,151,153,154,155,167,168 169,193,194,230 | A,B | 1158 | 0 | 0 | 0 | Chrysotile | Yes | F |
| Asbestos | S0002 ABC | Piping Rain Water Leader Sweatwrap | 109,150,152,153,163,190 | A,B | 496 | 0 | 0 | 0 | Chrysotile | Yes | F |
| Asbestos | S0003 ABCDE | Floor All Vinyl Floor Tile And Mastic 9x9 Various Colours | [209],101,102,103,104,105,110,115,124,126,150 157,158,161,164,168,210,253,254,255,265 | A,B | 0 | 6100 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0004 ABC | Floor Vinyl Floor Tile And Mastic 12x12 Beige | 151 | A | 0 | 300 | 0 | 0 | None Detected | No | |
| Asbestos | S0005 DEG | Wall All Drywall And Joint Compound | 125,212,215 | A | 0 | 2100 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0006 ABC | Piping All, Rain Water Leader Parging Cement | 1,2,109,124,140,141,142,150,151,152,161,164 167,169,182,230 | A,B,C | 0 | 0 | 142 | 0 | Chrysotile | Yes | F |
| Asbestos | S0007 ABC | Duct Mastic Brown | 152 | A | 50 | 0 | 0 | 0 | None Detected | No | |
| Asbestos | S0008 ABC | Piping All Parging Cement | 129,153,154,155,163,165,166,192 | A,B | 0 | 0 | 131 | 0 | Chrysotile | Yes | F |
| Asbestos | S0009 ABCDEFGF | Ceiling, Wall All Plaster | 155,160,195,261 | A,B | 0 | 5050 | 0 | 0 | None Detected | No | |
| Asbestos | S0010 ABC | Ceiling Ceiling Tiles (lay-in) 2x4 Small And Medium Pinholes | 154 | B | 0 | 500 | 0 | 0 | None Detected | No | |
| Asbestos | S0011 ABC | Ceiling All Ceiling Tiles (glue-on) 1x1 Medium And Large Uniform Pinholes | 156,157,158,210,253,254,255,260 | A,B | 0 | 4075 | 0 | 0 | None Detected | No | |
| Asbestos | S0012 ABC | Ceiling All Texture Coat | 159,257,259 | B | 0 | 700 | 0 | 0 | Chrysotile | Yes | F |
| Asbestos | S0013 ABC | Floor All Vinyl Floor Tile And Mastic 12x12 Red And Black Checkered | 160 | B | 0 | 50 | 0 | 0 | None Detected | No | |
| Asbestos | S0014 ABC | Piping All Aircell | 1,122,123,161,163,164 | A,B | 240 | 0 | 0 | 0 | Chrysotile | Yes | F |
| Asbestos | S0015 ABC | Floor Vinyl Floor Tile And Mastic 12x12 Beige With Brown Streaks | 163 | A | 0 | 100 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0016 ABCDE | Wall Plaster Above Lockers | 194 | A | 0 | 2000 | 0 | 0 | None Detected | No | |
| Asbestos | S0017 ABC | Structure Light Fixture Paper | 2 | A | 0 | 0 | 1 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0018 ABC | Floor All Vinyl Floor Tile And Mastic 12x12 Off-white With Grey Flecks | 100,106,125,134,190,211,225,251,252,263,264 266 | A,B,C | 0 | 3400 | 0 | 0 | None Detected | No | |
| Asbestos | S0019 ABC | Ceiling All Ceiling Tiles (glue-on) 1x1 Large And Small Random Pinholes | 122,123,124,223,224,225 | A | 0 | 1300 | 0 | 0 | None Detected | No | |
| Asbestos | S0020 ABC | Floor Vinyl Floor Tile And Mastic 12x12 Red | 124 | A | 0 | 700 | 0 | 0 | None Detected | No | |
| Asbestos | S0021 ABC | Floor Vinyl Floor Tile And Mastic 12x12 Grey With White And Grey Flecks | 129 | A | 0 | 5000 | 0 | 0 | None Detected | No | |
| Asbestos | S0022 ABC | Floor All Vinyl Floor Tile And Mastic 12x12 Beige With Beige And White Blotches | 110,111,112,113,114,126,127,143,144,169,188 202,207,208,210,223,224,265 | A,B,C | 0 | 6450 | 0 | 0 | None Detected | No | |
| Asbestos | S0023 ABC | Floor All Vinyl Floor Tile And Mastic 12x12 Turquoise With White Flecks | 116,226,227,228 | A | 0 | 1150 | 0 | 0 | None Detected | No | |
| Asbestos | S0024 ABC | Floor All Vinyl Floor Tile And Mastic 12x12 | 139,141,142,180,181,182,212,215 | A,C | 0 | 2200 | 0 | 0 | Chrysotile | Yes | NF |

| HAZMAT | Sample No | System/Component/Material/Sample Description | Locations | Bldg. Phase | LF | SF | EA | % | Type | Positive | Friability |
|----------|---------------|---|--|-------------|------|-------|-----|---|---------------|----------|------------|
| | | Beige With Sparse White And Brown Flecks | | | | | | | | | |
| Asbestos | S0025 ABC | Piping All Parging Cement | 125,126,129,139,152,192,193 | A,C | 365 | 0 | 6 | 0 | Chrysotile | Yes | F |
| Asbestos | S0026 ABC | Floor All Vinyl Floor Tile And Mastic 12x12 Off-white With Black And Grey Streaks | 131,135,187 | C | 0 | 900 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0027 ABC | Ceiling, Wall Drywall And Joint Compound | 131,184,185 | C | 0 | 400 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0028 ABC | Floor Vinyl Sheet Flooring Beige/grey With Pebbled Pattern | 131 | C | 0 | 50 | 0 | 0 | None Detected | No | |
| Asbestos | S0029 ABC | Floor All Vinyl Floor Tile And Mastic 12x12 White With Grey Flecks | 217,218,219,220,250 | A,B | 0 | 2150 | 0 | 0 | None Detected | No | |
| Asbestos | S0030 ABC | Ceiling Bulkhead Texture Coat | 214 | A | 0 | 300 | 0 | 0 | Chrysotile | Yes | F |
| Asbestos | S0031 ABC | Wall Window, Door Caulking Beige | 3 | A | 0 | 0 | 600 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0032 ABC | Wall Expansion Joint Caulking Grey | 3 | A | 0 | 0 | 15 | 0 | None Detected | No | |
| Asbestos | S0033 ABC | Wall Window, Door Caulking Brown And Grey | 3 | A | 0 | 0 | 600 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0034 ABC | Structure Canopy Texture Coat Southwest Entrance | 3 | A | 0 | 100 | 0 | 0 | None Detected | No | |
| Asbestos | S0035 ABC | Piping All Sweatwrap | 122,129,150,151,169 | A | 245 | 0 | 0 | 0 | Chrysotile | Yes | F |
| Asbestos | S0036 ABC | Ceiling Adhesive/mastic | 101,102,103,122,123,124,156,157,158,202,207 210,211,223,224,225,226,228,250,251,252,253 254,255,260,266 | A,B | 0 | 11025 | 0 | 0 | None Detected | No | |
| Asbestos | S0037 ABC | Ceiling All Plaster Textured | 161 | B | 0 | 250 | 0 | 0 | None Detected | No | |
| Asbestos | S0038 ABC | Wall Plaster Textured | 129 | A | 0 | 2000 | 0 | 0 | None Detected | No | |
| Asbestos | S0039 ABC | Structure Beam Plaster | 192 | A | 0 | 200 | 0 | 0 | None Detected | No | |
| Asbestos | S0040 ABC | Wall Window Caulking Firm Grey | 180,181,182,185,186,187 | C | 0 | 0 | 38 | 0 | None Detected | No | |
| Asbestos | S0041 ABC | Wall Window Caulking Soft Grey | 100,101,102,103,104,105,106,108,110,111,112 113,114,115,122,123,124,125,150,151,152,153 154,155,157,158,159,164,165,167,169,202,207 211,217,218,219,220,223,224,225,226,227,228 250,251,252,253,254,255,257,259,265,266 | A,B | 0 | 0 | 527 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0042 ABCDEFG | Wall All Paint On Concrete Block | 101,140,160,180,193,217,280 | A,B,C | 0 | 0 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0043 ABCDEFG | Wall Base Adhesive/mastic | 100,101,102,103,104,105,106,110,111,112,113 114,115,122,123,125,126,131,134,135,141,143 150,151,154,157,158,164,167,169,180,181,182 187,202,207,210,211,212,214,215,217,218,219 220,223,224,225,226,227,228,250,251,252,253 254,255,265,266 | A,B,C | 5440 | 0 | 0 | 0 | None Detected | No | |
| Asbestos | S0044 ABCDEFG | Floor All Terrazzo | 126,159,165,166,167,190,192,193,194,195,203 229,257,259,260,261,262 | A,B | 0 | 18800 | 0 | 0 | None Detected | No | |

| HAZMAT | Sample No | System/Component/Material/Sample Description | Locations | Bldg. Phase | LF | SF | EA | % | Type | Positive | Friability |
|----------|---------------|--|--|-------------|-----|-------|-----|---|---------------|----------|------------|
| Asbestos | S0045 ABCDE | Structure Paint Off-white | 143,144,145,146,150,151,152,168,169,193 | A | 0 | 3050 | 0 | 0 | None Detected | No | |
| Asbestos | S0046 ABC | Duct Mastic Light Grey | 125,153,154,155,180,181,184,185,186,187,188 190,192,194 | A,B,C | 0 | 270 | 0 | 0 | None Detected | No | |
| Asbestos | S0047 ABC | Ceiling All Ceiling Tiles (glue-on) 1x1 Random Pinholes | 101,103,156,202,207,211,225,226,228,250,251 252,266 | A,B | 0 | 4350 | 0 | 0 | None Detected | No | |
| Asbestos | S0048 ABC | Ceiling All Ceiling Tiles (glue-on) 1x1 Medium And Large Pinholes With Flecks | 102,223,224 | A | 0 | 1300 | 0 | 0 | None Detected | No | |
| Asbestos | S0049 ABC | Wall Window Liner Caulking Black, Butyl Sealant, 1975 Addition | 3 | A | 0 | 0 | 20 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0050 ABC | Wall Window Liner Caulking Grey, Butyl Sealant | 3 | A | 0 | 0 | 560 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0051 ABC | Wall Caulking Grey, Metal Panels Of Front Facade | 3 | A | 100 | 0 | 0 | 0 | None Detected | No | |
| Asbestos | S0052 ABCDEFG | Wall Mortar Brick Mortar | 3 | A | 0 | 60000 | 0 | 0 | None Detected | No | |
| Asbestos | S0053 ABCDEFG | Ceiling, Wall, Ceiling, Wall All Drywall And Joint Compound | 129,130,131,134,135,180,181,187,191,280 | A,C | 0 | 5655 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0054 ADG | Wall, Ceiling, Wall All, Bulkhead Drywall And Joint Compound | 100,108,123,124,126,127,128,143,145,202,214 216,263,264 | A | 0 | 6400 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0055 ABCDE | Ceiling, Wall, Ceiling, Wall Bulkhead Drywall And Joint Compound | 111,112,113,218,219,220,226,227,228 | A | 0 | 1500 | 0 | 0 | None Detected | No | |
| Asbestos | S0056 ABCDE | Ceiling, Wall, Ceiling, Wall All, Bulkhead Plaster | 100,109,122,123,126,154,157,159,160,192,202 203,204,205,206,208,209,210,229,250,251,257 258,259,260,262,263,264,265 | A,B | 0 | 14225 | 0 | 0 | None Detected | No | |
| Asbestos | S0057 ABCDE | Wall, Ceiling, Wall All Plaster | 101,102,103,104,105,106,110,111,112,113,114 115,116,158,190,195,207,211,217,218,219,220 223,224,225,226,227,228,250,252,253,254,255 260,261,262,265,266 | A,B | 0 | 9000 | 0 | 0 | None Detected | No | |
| Asbestos | S0058 ABCDEFG | Wall, Ceiling, Wall All Drywall And Joint Compound Lab Report Reference 1717806_plm (s0005a) | 151,154,156,162,165,169,251,252,265,266 | A,B | 0 | 3200 | 0 | 0 | None Detected | No | |
| Asbestos | S0059 ABCDE | Wall All Paint On Poured Concrete | 1,2 | A | 0 | 1100 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0060 ABCD | Wall All, Stairs Paint On Brick (in Addition To Sample S0042c) | 161,190,193,260 | A,B | 0 | 1650 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0061 ABCDEFG | Wall All Paint On Concrete Block, Phase B - 2nd Floor | 250,251,252,253,254,255,258,259,260,265,266 | B | 0 | 10000 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0062 ABCDEF | Wall All Paint On Concrete Block, Phase B - 1st Floor (in Addition To Sample S0042d) | 153,154,155,156,157,158,159,160,161,195 | B | 0 | 17800 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0063 ABCDEF | Wall All Paint On Concrete Block, Phase A - 1st Floor (in Addition To Sample S0042a) | 100,101,102,103,104,105,106,108,109,110,111 112,113,114,115,116,122,124,125,126,127,129 143,144,146,150,151,152,163,164,165,166,167 168,169,190,192,194 | A | 0 | 35900 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0064 ABCDEF | Wall Paint On Concrete Block, Phase A - | 203,204,207,208,209,211,212,214,215,217,218 | A | 0 | 15700 | 0 | 0 | Chrysotile | Yes | NF |

| HAZMAT | Sample No | System/Component/Material/Sample Description | Locations | Bldg. Phase | LF | SF | EA | % | Type | Positive | Friability |
|----------|---------------|--|---|-------------|-----|-------|----|---|-------------------|----------|------------|
| | | 2nd Floor (in Addition To Sample S0042b) | 219,220,223,224,225,226,227,228,229,261,262 | | | | | | | | |
| Asbestos | S0065 ABCDE | Wall All Paint On Concrete Block, Phase C - Stage Area | 140,142 | C | 0 | 1500 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0066 ABCDEFG | Wall All Paint On Concrete Block, Phase C - Area Adjacent To Stage | 136,137,139,141,142,191 | C | 0 | 8800 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0067 ABCDEF | Wall All Paint On Concrete Block, Phase C - 1st Floor (in Addition To Sample S0042f) | 130,131,132,133,134,135,141,180,181,182,184,185,186,187,188,191 | C | 0 | 13710 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | S0068 ABCD | Wall All Paint On Concrete Block, Phase C - 2nd Floor (in Addition To Sample S0042e) | 280 | C | 0 | 4000 | 0 | 0 | Chrysotile | Yes | NF |
| Asbestos | V9500 | Ceiling All Cement Product Transite Panels | 100,125 | A | 0 | 500 | 0 | 0 | Presumed Asbestos | Yes | NF |
| Asbestos | V9500 | Floor All Mortar 1"x1" Grey Tiles, 12x12 Brown And Beige Tiles, 4"x8" Red Quarry Tile | 128,130,131,132,133,134,135,136,137,145,180,191,205,206 | A,C | 0 | 3325 | 0 | 0 | Presumed Asbestos | Yes | NF |
| Asbestos | V9500 | Other Countertop Cement Product Transite, Transite Drying Rack, Transite Garden Tables | 183,217,218,219,220,226,228 | A,C | 0 | 1960 | 0 | 0 | Presumed Asbestos | Yes | NF |
| Asbestos | V9500 | Piping Rain Water Leader, All Cement Product Transite | 140,141,142,187,188,191,280 | C | 177 | 0 | 0 | 0 | Presumed Asbestos | Yes | NF |
| Asbestos | V9500 | Structure Canopy Cement Product Transite Panels | 3 | A | 0 | 200 | 0 | 0 | Presumed Asbestos | Yes | NF |
| Asbestos | V9500 | Wall Cement Product Transite Panels | 125 | A | 0 | 8 | 0 | 0 | Presumed Asbestos | Yes | NF |
| Asbestos | V9500 | Wall All Mortar 12x12 Brown And Beige Tiles | 128,145,205,206 | A | 0 | 4000 | 0 | 0 | Presumed Asbestos | Yes | NF |
| Asbestos | V9500 | Wall Door Thermal Insulation | 163 | A | 0 | 0 | 1 | 0 | Presumed Asbestos | Yes | F |
| Asbestos | V0000 | Ceiling All Adhesive/mastic 2x4 Thick Widthwise Fissures And Pinholes, 2007 | 191 | C | 0 | 3000 | 0 | 0 | Non Asbestos | No | |
| Asbestos | V0000 | Ceiling All Ceiling Tiles (lay-in) 2x2 Textured With Pinholes, 12/14/2005 | 192 | A | 0 | 2000 | 0 | 0 | Non Asbestos | No | |
| Asbestos | V0000 | Ceiling All Ceiling Tiles (lay-in) 2x2 Textured With Small Pinholes | 128,145,205,206 | A | 0 | 1000 | 0 | 0 | Non Asbestos | No | |
| Asbestos | V0000 | Ceiling All Ceiling Tiles (lay-in) 2x2 Textured With Small Pinholes, 12/14/2005 | 136,137 | C | 0 | 400 | 0 | 0 | Non Asbestos | No | |
| Asbestos | V0000 | Ceiling All Ceiling Tiles (lay-in) 2x4 Dense Short Widthwise Fissures, 01/25/2008 | 180,181,182,184,185,186,187,190,192,194,195,217,218,219,220,227 | A,B,C | 0 | 12600 | 0 | 0 | Non Asbestos | No | |
| Asbestos | V0000 | Ceiling All Ceiling Tiles (lay-in) 2x4 Smooth, Gypsum | 131,134,135 | C | 0 | 600 | 0 | 0 | Non Asbestos | No | |
| Asbestos | V0000 | Ceiling All Ceiling Tiles (lay-in) 2x4 Textured, Fibreglass | 167 | A | 0 | 1000 | 0 | 0 | Non Asbestos | No | |
| Asbestos | V0000 | Ceiling All Ceiling Tiles (lay-in) 2x4 Thick Widthwise Fissures And Pinholes, 2007 | 100,104,106,108,110,111,112,113,114,115,122,124,125,126,127,129,132,133,143,156,164,165,166,188,212,214,215,250,251,252,261,262,266 | A,B,C | 0 | 18550 | 0 | 0 | Non Asbestos | No | |

| HAZMAT | Sample No | System/Component/Material/Sample Description | Locations | Bldg. Phase | LF | SF | EA | % | Type | Positive | Friability |
|----------|-----------|--|---|-------------|----|-------|----|---|--------------|----------|------------|
| Asbestos | V0000 | Ceiling All Ceiling Tiles (lay-in) 2x4, Wicker | 140,142 | C | 0 | 9200 | 0 | 0 | Non Asbestos | No | |
| Asbestos | V0000 | Duct Not Found N/a | 210 | A | 0 | 0 | 0 | 0 | Non Asbestos | No | |
| Paint | L0001 | Structure Metal Red | 104,106,108,110,111,112,113,114,115,124,125,126,127,128,129,130,131,132,133,134,135,136,137,139,140,141,142,180,181,182,184,185,186,187,188,190,191,192,194,205,206,207,212,215,217,218,219,220,223,224,225,226,228,230,231,250,251,252,262,266,280 | A,B,C | 0 | 53875 | 0 | 0 | Lead (High) | Yes | - |
| Paint | L0002 | Floor Concrete (poured) Grey | 1,109,141,146,150,151,154,155,161,163,169,203,204,229,230,258,280 | A,B,C | 0 | 7500 | 0 | 0 | Lead (Low) | Yes | - |
| Paint | L0003 | Ceiling Plaster Yellow | 129,161 | A,B | 0 | 2250 | 0 | 0 | Lead (Low) | Yes | - |
| Paint | L0004 | Wall Plaster Off-white | 100,101,102,103,104,105,106,109,110,111,112,113,114,115,116,122,123,126,154,155,157,158,159,160,190,192,194,195,202,203,204,205,206,207,208,209,210,211,214,217,218,219,220,223,224,225,226,227,228,229,250,251,252,253,254,255,257,258,259,260,261,262,263,264,265,266 | A,B | 0 | 29675 | 0 | 0 | Lead (Low) | Yes | - |
| Paint | L0005 | Structure Drywall And Joint Compound Off-white | 123,124,126,127,128,130,131,134,135,143,145,151,154,156,162,165,169,180,181,184,185,187,191,202,212,214,215,218,219,220,226,227,228,251,252,263,264,265,266,280 | A,B,C | 0 | 13205 | 0 | 0 | | No | - |
| Paint | L0006 | Wall Drywall And Joint Compound Green/pink | 100,108,125,129 | A | 0 | 5000 | 0 | 0 | | No | - |
| Paint | L0007 | Wall Concrete (precast) Yellow | 101,102,103,104,105,106,109,110,111,112,113,114,115,116,122,124,126,127,130,131,132,133,134,135,139,141,142,143,144,146,150,151,152,153,154,155,156,157,158,160,161,163,165,166,167,169,180,181,182,184,185,186 | A,B,C | 0 | 97500 | 0 | 0 | Lead (Low) | Yes | - |

| HAZMAT | Sample No | System/Component/Material/Sample Description | Locations | Bldg. Phase | LF | SF | EA | % | Type | Positive | Friability |
|--------------|-----------|--|--|-------------|-----|------|------|-----|--------------|----------|------------|
| | | | 187,190,191,192,193,194,195,203,204,207,208,209,210 211,212,214,215,217,218,219,220,223,224,225,226,227 228,229,250,251,252,253,254,255,258,260,261,262,265 266,280 | | | | | | | | |
| Paint | L0008 | Wall Concrete (precast) Pink | 100,108,125,129,136,137,168,188 | A,C | 0 | 7600 | 0 | 0 | Lead (Low) | Yes | - |
| Paint | L0009 | Wall Concrete (precast) Black | 140 | C | 0 | 1000 | 0 | 0 | | No | - |
| Paint | L0010 | Structure Concrete (precast) Off-white | 143,144,146,150,151,152,168,169,193 | A | 0 | 2750 | 0 | 0 | | No | - |
| Paint | L0011 | Other Metal Off-white, Radiator | 100,101,102,103,104,105,106,108,109,110,111,112,113 114,115,123,124,125,139,140,141,150,151,152,153,154 155,156,157,158,159,161,163,164,165,167,169,180,181 182,185,186,187,188,191,202,205,206,207,208,210,211 212,214,215,217,218,219,220,223,224,225,226,227,228 230 | A,B,C | 0 | 6600 | 0 | 0 | Lead (Low) | Yes | - |
| Lead Product | V9000 | Batteries (other) | 192 | A | 0 | 0 | 0 | 100 | Lead Product | Yes | - |
| Lead Product | V9000 | Batteries In Emer. Lights | 2,129,140,141,142,163,167,168,190,191,192,194,195 230,260,261,262 | A,B,C | 0 | 0 | 0 | 100 | Lead Product | Yes | - |
| Lead Product | V9000 | Bell And Spigot Fittings | 116,203,204 | A | 0 | 0 | 0 | 100 | Lead Product | Yes | - |
| Lead Product | V9000 | Lead Sheeting | 2 | A | 0 | 150 | 0 | 0 | Lead Product | Yes | - |
| PCB | P0001 | Caulking Black/grey Butyl Sealant, Windows | 3 | A | 0 | 0 | 580 | 0 | - | No | - |
| PCB | P0002 | Caulking Various Colours, Window/door Frames | 3,100,101,102,103,104,105,106,108,110,111,112,113 114,115,122,123,124,125,150,151,152,153,154,155,157 158,159,164,165,167,169,180,181,182,185,186,187,202 207,211,217,218,219,220,223,224,225,226,227,228,250 251,252,253,254,255,257,259,265,266 | A,B,C | 0 | 0 | 1165 | 0 | - | No | - |
| PCB | P0003 | Caulking Grey, Front Facade, Metal Panels | 3 | A | 100 | 0 | 0 | 0 | - | No | - |
| PCB | V9500 | Caulking | 3 | A | 0 | 0 | 15 | 0 | Presumed PCB | Yes | - |
| PCB | V0000 | Light Ballasts | 100,101,102,103,104,105,106,108,109,110,111,112,113 | A,B,C | 0 | 0 | 0 | 0 | - | No | - |

| HAZMAT | Sample No | System/Component/Material/Sample Description | Locations | Bldg. Phase | LF | SF | EA | % | Type | Positive | Friability |
|--------|-----------|--|---|-------------|----|----|----|-----|-------------|----------|------------|
| | | | 114,115,116,122,123,124,125,126,127,128,129,130,132 133,136,137,139,140,141,142,143,144,145,146,150,151 152,153,154,155,156,157,158,159,160,161,162,164,165 166,167,168,169,180,181,182,184,185,186,187,188,190 191,192,193,194,195,202,203,204,205,206,207,208,209 210,211,212,214,215,216,217,218,219,220,223,224,225 226,227,228,229,230,231,250,251,252,253,254,255,257 258,259,260,261,262,263,264,265,266,280 | | | | | | | | |
| PCB | V0000 | Transformer | 231 | A | 0 | 0 | 0 | 0 | - | No | - |
| Hg | V9000 | Fluorescent Light Tube | 100,101,102,103,104,105,106,108,109,110,111,112,113 114,115,116,122,123,124,125,126,127,128,129,130,132 133,136,137,139,140,141,142,143,144,145,146,150,151 152,153,154,155,156,157,158,159,160,161,162,164,165 166,167,168,169,180,181,182,184,185,186,187,188,190 191,192,193,194,195,202,203,204,205,206,207,208,209 210,211,212,214,215,216,217,218,219,220,223,224,225 226,227,228,229,230,231,250,251,252,253,254,255,257 258,259,260,261,262,263,264,265,266,280 | A,B,C | 0 | 0 | 0 | 97 | Hg | Yes | - |
| Hg | V9000 | Mercury Vapour Lamp | 230 | A | 0 | 0 | 0 | 1 | Hg | Yes | - |
| Hg | V9000 | Thermostat | 143,230,280 | A,C | 0 | 0 | 0 | 3 | Hg | Yes | - |
| Hg | V9500 | Boiler Control | 163,280 | A,C | 0 | 0 | 0 | 100 | Presumed Hg | Yes | - |

Legend:

| Sample number | | Units | | |
|---------------|--|-------|-------------|---------------------------------|
| S#### | Asbestos sample collected | SF | Square feet | NF Non Friable material. |
| L#### | Paint sample collected | LF | Linear feet | F Friable material |
| P#### | PCB sample collected | EA | Each | PF Potentially Friable material |
| M#### | Mould sample collected | % | Percentage | |
| V#### | Material visually similar to numbered sample collected | | | |
| V0000 | Known non Hazardous Material | | | |
| V9000 | Material is visually identified as Hazardous Material | | | |
| V9500 | Material is presumed to be Hazardous Material | | | |
| [Loc. No.] | Abated Material | | | |

APPENDIX VI
HMIS All Data Report

Client: Hasting and Prince Edward District School Board
Location: #1 : Basement
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 0

Building Name: Eastside Secondary School
Room #: 001
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---------------------------|------|----------|----|----|-----|--------|------|------|------|---------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 150 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | A | Y | | 80(5) | | | LF | V0014 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | A | Y | | 15(5) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Concrete (poured) | | | C | N | | 150 | | | SF | | | | | |
| Wall | All | Concrete (poured) | | Paint | A | Y | | | | | | | | | | |
| Wall | All | Paint, On poured concrete | | | A | Y | | 100(7) | | | SF | S0059DE | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #1 : Basement
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 0

Building Name: Eastside Secondary School
Room #: 001
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PAINT | | | | | | | | | |
|--------|-------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Floor | Concrete (poured) | 150 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #2 : Basement
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 0

Building Name: Eastside Secondary School
Room #: 002
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|---------------|---------------------------|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 500 | | | SF | | | | | |
| Mechanical Equipment | Unit Heater | Not Insulated | | | A | Y | | | | | | | | | | |
| Piping | | Parging Cement | | | A | Y | | 5(5) | | | EA | S0006C | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | All | Aircell | | | A | Y | | 50(5) | | | LF | S0001C | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Structure | All | | | | C | N | | 500 | | | SF | | | | | |
| Structure | Light Fixture | Paper | | | A | Y | | 1(7) | | | EA | S0017ABC | Chrysotile | 50-75% | Confirmed Asbestos | NF |
| Wall | All | Concrete (poured) | | Paint | A | Y | | | | | | | | | | |
| Wall | All | Paint, On poured concrete | | | B | Y | | 1000(7) | | | SF | S0059ABC | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #2 : Basement
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 0

Building Name: Eastside Secondary School
Room #: 002
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |
| Lead Sheeting | 150 | SF | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #3 : Exterior
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: Basement (0)

Building Name: Eastside Secondary School
Room #:
Last Re-Assessment: 0000-00-00

Area (sqft): 0

| ASBESTOS | | | | | | | | | | | | | | | | |
|-----------|-----------------|---|------|----------|----|----|-----|--------|------|------|------|------------------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Structure | Canopy | Cement Product, Transite panels | | | C | Y | | 200(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Structure | Canopy | Texture Coat, southwest entrance | | | C | Y | | 100 | | | SF | S0034ABC | None Detected | N.D. | None | |
| Wall | | Concrete (precast), Front entrance | | | A | Y | | | | | | | | | | |
| Wall | | Masonry | | | A | Y | | | | | | | | | | |
| Wall | | Metal, Front entrance | | | A | Y | | | | | | | | | | |
| Wall | | Mortar, Brick mortar | | | A | Y | | 60000 | | | SF | S0052ABC DEFG | None Detected | N.D. | None | |
| Wall | | Mortar, Brick mortar | | | A | Y | | | | | | V0052 | None Detected | N.D. | None | |
| Wall | | Mortar, Brick mortar | | | A | Y | | | | | | V0052 | None Detected | N.D. | None | |
| Wall | | Caulking, Grey, metal panels of front facade | | | A | Y | | 100 | | | LF | S0051ABC | None Detected | N.D. | None | |
| Wall | Door | Caulking, Brown and grey | | | A | Y | | 20(7) | | | EA | S0033B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Door | Caulking, Beige | | | A | Y | | 20(7) | | | EA | S0031B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Expansion Joint | Caulking, Grey | | | A | Y | | 15 | | | EA | S0032ABC | None Detected | N.D. | None | |
| Wall | Window | Caulking, Brown and grey | | | A | Y | | 580(7) | | | EA | S0033AC | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Window | Caulking, Beige | | | A | Y | | 580(7) | | | EA | S0031AC | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Window Liner | Caulking, grey, butyl sealant | | | A | Y | | 560(7) | | | EA | S0050ABC | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Window Liner | Caulking, black, butyl sealant, 1975 addition | | | A | Y | | 20(7) | | | EA | S0049ABC | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #3 : Exterior
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: Basement (0)

Building Name: Eastside Secondary School
Room #:
Last Re-Assessment: 0000-00-00

Area (sqft): 0

| PCB | | | | | | |
|-----------|----------|------|--------|--------------------|----------|----------|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Caulking | 100 | LF | P0003 | | <5 mg/kg | No |
| Caulking | 600 | EA | P0002 | | <5 mg/kg | No |
| Caulking | 580 | EA | P0001 | | <5 mg/kg | No |
| Caulking | 15 | EA | V9500 | | | Presumed |

Client: Hasting and Prince Edward District School Board
Location: #100 : Offices
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 124
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Ceiling | All | Cement Product, Transite panels | | | C | N | | 400(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Ceiling | Bulkhead | Plaster | | | C | Y | | 50 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Carpet | | | A | Y | | 200 | | | SF | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 200 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 500(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Light grey | | | A | Y | | 6(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 100, Includes Rooms 124E-F and 125A-C

Client: Hasting and Prince Edward District School Board
Location: #100 : Offices
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 124
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|---------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 500 | | SF | V0006 | Pink | Pb: .0027 % | No | |
| Ceiling | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Concrete (precast) | 500 | | SF | V0008 | Pink | Pb: .0144 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 100, Includes Rooms 124E-F and 125A-C

Client: Hasting and Prince Edward District School Board
Location: #100 : Offices
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 124
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 100, Includes Rooms 124E-F and 125A-C

Client: Hasting and Prince Edward District School Board
Location: #100 : Offices
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 124
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 6 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 100, Includes Rooms 124E-F and 125A-C

Client: Hasting and Prince Edward District School Board
Location: #101 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 101
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|---------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | S0036A | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 500 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 500(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | | | | | S0042A | [None] | | [None] | |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 1200(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #101 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 101
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #101 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 101
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #101 : Classroom
2023-07-10

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 101

Area (sqft): 500

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #102 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 102
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 500 | | | SF | S0048C | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 500(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #102 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 102
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #102 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 102
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #102 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 102
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #103 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 103
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 500 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 500(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0063F | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | S0041A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #103 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 103
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #103 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 103
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #103 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 103
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | P0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #104 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 104
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 500(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | Hot Water Heating | Aircell | | | C | N | | 60(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | S0057A | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #104 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 104
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #104 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 104
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #104 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 104
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #105 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 104
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Plaster | | | C | Y | | 100 | | | SF | V0057 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 100(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 50 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 400(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 40 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 105

Client: Hasting and Prince Edward District School Board
Location: #105 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 104
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 400 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 105

Client: Hasting and Prince Edward District School Board
Location: #105 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 104
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 105

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #105 : Resource Room
Survey Date: 2023-05-03

Floor: 1

Room #: 104
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 105

Client: Hasting and Prince Edward District School Board
Location: #106 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 106
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 500 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | Hot Water Heating | Aircell | | | C | N | | 60(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #106 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 106
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #106 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 106
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #106 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 106
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #108 : Guidance
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 120
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 600 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Carpet | | | A | Y | | 600 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 600 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 500(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 12(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 108, Includes Rooms 120A-E

Client: Hasting and Prince Edward District School Board
Location: #108 : Guidance
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 120
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 500 | | SF | V0006 | Pink | Pb: .0027 % | No | |
| Wall | Concrete (precast) | 800 | | SF | V0008 | Pink | Pb: .0144 % | Lead (Low) | |
| Structure | Metal | 600 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 108, Includes Rooms 120A-E

Client: Hasting and Prince Edward District School Board
Location: #108 : Guidance
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 120
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 108, Includes Rooms 120A-E

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #108 : Guidance
Survey Date: 2023-05-03

Floor: 1

Room #: 120
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 12 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 108, Includes Rooms 120A-E

Client: Hasting and Prince Edward District School Board
Location: #109 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 121
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | | | C | Y | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 200 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | Y | | 70(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | | Sweatwrap | | | C | Y | | 30(7) | | | LF | S0002C | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | Y | | 3(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 109, Includes Room 121A

Client: Hasting and Prince Edward District School Board
Location: #109 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 121
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 500 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Floor | Concrete (poured) | 200 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 109, Includes Room 121A

Client: Hasting and Prince Edward District School Board
Location: #109 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 121
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 109, Includes Room 121A

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #109 : Storage
Survey Date: 2023-05-03

Floor: 1

Room #: 121
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 109, Includes Room 121A

Client: Hasting and Prince Edward District School Board
Location: #110 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 110
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|--------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Mastic | ALL | Vinyl Floor Tile | D | N | | 300(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Floor | All | Vinyl Floor Tile, 12x12 beige with beige and white blotches | | | A | Y | | 300 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Polyvinyl chloride (PVC) | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 100 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 50 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 6(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Rooms 110A-C

Client: Hasting and Prince Edward District School Board
Location: #110 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 110
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 100 | | SF | L0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 500 | | SF | L0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 300 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Rooms 110A-C

Client: Hasting and Prince Edward District School Board
Location: #110 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 110
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 110A-C

**Client: Hasting and Prince Edward District
School Board**
Location: #110 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 110
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 6 | EA | V0002 | | <5 mg/kg | No |

Includes Rooms 110A-C

Client: Hasting and Prince Edward District School Board
Location: #111 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 111
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|--------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Ceiling | Bulkhead | Drywall and joint compound | | | C | N | | 50 | | | SF | S0055D | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with beige and white blotches | | | A | Y | | 500 | | | SF | S0022A | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Polyvinyl chloride (PVC) | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0063E | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | S0043F | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #111 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 111
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #111 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 111
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #111 : Classroom
Survey Date: 2023-05-03

Floor: 1

Room #: 111
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #112 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 112
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|--------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Ceiling | Bulkhead | Drywall and joint compound | | | C | N | | 50 | | | SF | S0055E | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with beige and white blotches | | | A | Y | | 500 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Polyvinyl chloride (PVC) | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | S0057B | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #112 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 112
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #112 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 112
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #112 : Classroom
Survey Date: 2023-05-03

Floor: 1

Room #: 112
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #113 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 113
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|--------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Ceiling | Bulkhead | Drywall and joint compound | | | C | N | | 50 | | | SF | V0055 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with beige and white blotches | | | A | Y | | 500 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Polyvinyl chloride (PVC) | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #113 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 113
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #113 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 113
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #113 : Classroom
Survey Date: 2023-05-03

Floor: 1

Room #: 113
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #114 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 114
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with beige and white blotches | | | A | Y | | 500 | | | SF | S0022B | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #114 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 114
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | L0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #114 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 114
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #114 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 114
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #115 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 115
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 500(7) | | | SF | S0003B | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | S0043E | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #115 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 115
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #115 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 115
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #115 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 115
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #116 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 105
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|--------------------------|----|----|-----|--------|------|------|------|---------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | | | C | Y | | 50 | | | SF | V0057 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 turquoise with white flecks | | | A | Y | | 50 | | | SF | S0023AC | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Polyvinyl chloride (PVC) | A | Y | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 116

Client: Hasting and Prince Edward District School Board
Location: #116 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 105
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Formerly Room 116

Client: Hasting and Prince Edward District School Board
Location: #116 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 105
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PB PRODUCTS | | | | |
|--------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Bell And Spigot Fittings | 100 | % | V9000 | Yes |

Formerly Room 116

Client: Hasting and Prince Edward District School Board
Location: #116 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 105
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 116

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #116 : Custodial Room

Floor: 1

Room #: 105

Area (sqft): 50

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 116

Client: Hasting and Prince Edward District School Board
Location: #122 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 122
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | D | N | | 100 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 large and small random pinholes | | | C | N | | 100 | | | SF | V0019 | None Detected | N.D. | None | |
| Ceiling | Bulkhead | Plaster | | | C | Y | | 50 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Carpet | | | A | Y | | 100 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Sweatwrap | | | C | Y | | 15(7) | | | LF | V0035 | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | All | Aircell | | | C | Y | | 15(7) | | | LF | V0014 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 300(7) | | | SF | S0063C | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 40 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 6(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #122 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 122
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 400 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #122 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 122
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

School Board
Location: #122 : Office
Survey Date: 2023-05-03

Floor: 1

Room #: 122
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 6 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #123 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 123
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | D | N | | 200 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 large and small random pinholes | | | C | Y | | 200 | | | SF | S0019B | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Carpet | | | A | Y | | 200 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Aircell | | | C | Y | | 30(7) | | | LF | V0014 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 500(7) | | | SF | S0054D | [Asbestos] | 0.5-5% | [Asbestos] | NF |
| Wall | | Plaster | | | A | Y | | 500 | | | SF | V0056 | None Detected | N.D. | None | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 60 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 6(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Rooms 123A-B

Client: Hasting and Prince Edward District School Board
Location: #123 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 123
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|--------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 500 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Wall | Plaster | 500 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Rooms 123A-B

Client: Hasting and Prince Edward District School Board
Location: #123 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 123
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 123A-B

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #123 : Office
Survey Date: 2023-05-03

Floor: 1

Room #: 123
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 6 | EA | V0002 | | <5 mg/kg | No |

Includes Rooms 123A-B

Client: Hasting and Prince Edward District School Board
Location: #124 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 124
Last Re-Assessment: 0000-00-00

Area (sqft): 700

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|-------------------------|----|----|-----|--------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling tiles (glue-on), 1x1 random pinholes | ALL | Ceiling Tiles (lay-in) | C | N | | 700 | | | SF | S0019A | None Detected | N.D. | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | D | N | | 700 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 700 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 red | ALL | Carpet | D | N | | 700 | | | SF | S0020ABC | None Detected | N.D. | None | |
| Floor | All | Vinyl Floor Tile and Mastic | | | A | Y | | 200(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Floor | All | Carpet | | | A | Y | | 700 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Parging Cement | | | C | Y | | 4(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | All | Aircell | | | C | Y | | 8(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Structure | All | Metal | | | D | N | | 700 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 500(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 12(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Room 124-2 and 124A-D

Client: Hasting and Prince Edward District School Board
Location: #124 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 124
Last Re-Assessment: 0000-00-00

Area (sqft): 700

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 500 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 700 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Room 124-2 and 124A-D

Client: Hasting and Prince Edward District

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Client: Hasting and Prince Edward District School Board
Location: #125 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 125
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|----------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | | | | | V0000 | Non-Asbestos | | None | |
| Ceiling | All | Cement Product, Transite panels | | | C | N | | 100(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Duct | | Mastic, Light grey | | | C | N | | 10 | | | SF | S0046A | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 400 | | | SF | S0018ABC | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Aircell, Under radiator | | | A | Y | | 3(5) | | | LF | V0025 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Cement Product, Transite panels | | | D | N | | 8(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 500(7) | | | SF | S0005D | [Asbestos] | 0.5-5% | [Asbestos] | NF |
| Wall | All | Cement Product, Behind radiator southeast corner | | | A | Y | | 15 | | | SF | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #125 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 125
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 500 | | SF | V0006 | Pink | Pb: .0027 % | No | |
| Wall | Concrete (precast) | 500 | | SF | V0008 | Pink | Pb: .0144 % | Lead (Low) | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | L0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #125 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 125
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #125 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 125
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #126 : Classroom/IT Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 126
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Plaster | | | C | Y | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 300 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 150(7) | | | SF | S0003A | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Floor | | Terrazzo | | | A | Y | | 50 | | | SF | V0044 | None Detected | N.D. | None | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 300 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Aircell | | | A | Y | | 2(5) | | | LF | V0025 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Metal | | | D | N | | 500 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 300(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 800(7) | | | SF | S0054A | [Asbestos] | 0.5-5% | [Asbestos] | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |

Includes Rooms 129J-K

Client: Hasting and Prince Edward District School Board
Location: #126 : Classroom/IT Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 126
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Drywall and joint compound | 800 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Ceiling | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Concrete (precast) | 300 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Includes Rooms 129J-K

Client: Hasting and Prince Edward District School Board
Location: #126 : Classroom/IT Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 126
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 129J-K

Client: Hasting and Prince Edward District School Board
Location: #126 : Classroom/IT Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 126
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 129J-K

Client: Hasting and Prince Edward District School Board
Location: #127 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 127
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 500 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 500 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 800(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Rooms 127A-B

Client: Hasting and Prince Edward District School Board
Location: #127 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 127
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 500 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Wall | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Includes Rooms 127A-B

Client: Hasting and Prince Edward District School Board
Location: #127 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 127
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 127A-B

Client: Hasting and Prince Edward District School Board
Location: #127 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 127
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 127A-B

Client: Hasting and Prince Edward District School Board
Location: #128 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 128
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|---------------|----|----|-----|---------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x2 textured with small pinholes | | | C | Y | | 300 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | Bulkhead | Drywall and joint compound | | | C | Y | | 195(7) | | 5(4) | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 300(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 300 | | | SF | | | | | |
| Wall | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 1000(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #128 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 128
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Structure | Metal | 300 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Client: Hasting and Prince Edward District School Board
Location: #128 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 128
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #128 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 128
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #129 : Resource Centre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 129
Last Re-Assessment: 0000-00-00

Area (sqft): 9000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | D | Y | | 9000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | D | N | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 grey with white and grey flecks | | | A | Y | | 5000 | | | SF | S0021ABC | None Detected | N.D. | None | |
| Floor | All | Carpet | | | A | Y | | 4000 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Parging Cement | | | C | N | | 10(7) | | | EA | V0008 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | | Aircell | | | C | N | | 90(7) | | | LF | V0025 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | All | Sweatwrap | | | D | N | | 160(7) | | | LF | V0035 | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Structure | All | Metal | | | D | N | | 9000 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Plaster, Textured | | | A | Y | | 2000 | | | SF | S0038ABC | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 3000(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 3500(7) | | | SF | S0053CD | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Rooms 129A-H and 129C-N

Client: Hasting and Prince Edward District School Board
Location: #129 : Resource Centre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 129
Last Re-Assessment: 0000-00-00

Area (sqft): 9000

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 3500 | | SF | L0006 | Green/pink | Pb: .0027 % | No | |
| Structure | Metal | 9000 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Concrete (precast) | 3000 | | SF | V0008 | Pink | Pb: .0144 % | Lead (Low) | |
| Structure | Plaster | 2000 | | SF | L0003 | Yellow | Pb: .0194 % | Lead (Low) | |

Includes Rooms 129A-H and 129C-N

Client: Hasting and Prince Edward District School Board
Location: #129 : Resource Centre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 129
Last Re-Assessment: 0000-00-00

Area (sqft): 9000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Includes Rooms 129A-H and 129C-N

Client: Hasting and Prince Edward District School Board
Location: #129 : Resource Centre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 129
Last Re-Assessment: 0000-00-00

Area (sqft): 9000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 129A-H and 129C-N

Client: Hasting and Prince Edward District School Board
Location: #129 : Resource Centre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 129
Last Re-Assessment: 0000-00-00

Area (sqft): 9000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 129A-H and 129C-N

Client: Hasting and Prince Edward District School Board
Location: #130 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 130
Last Re-Assessment: 0000-00-00

Area (sqft): 25

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|----------------------------|------|---------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Drywall and joint compound | | | C | Y | | 25(7) | | | SF | V0053 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Mortar, 1"x1" grey tiles | ALL | Ceramic Tiles | D | N | | 25(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 25 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 100(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Client: Hasting and Prince Edward District School Board
Location: #130 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 130
Last Re-Assessment: 0000-00-00

Area (sqft): 25

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 100 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 25 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Ceiling | Drywall and joint compound | 25 | | SF | V0005 | Off-white | Pb: .0055 % | No | |

Client: Hasting and Prince Edward District School Board
Location: #130 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 130
Last Re-Assessment: 0000-00-00

Area (sqft): 25

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #130 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 130
Last Re-Assessment: 0000-00-00

Area (sqft): 25

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #131 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 131
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|---------------|----|----|-----|--------|------|------|------|----------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Drywall and joint compound | | | C | Y | | 200(7) | | | SF | S0027B | [Asbestos] | 0.5-5% | [Asbestos] | NF |
| Ceiling | | Drywall and joint compound | | | C | Y | | | | | | S0053A | [Asbestos] | 0.5-5% | [Asbestos] | NF |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 smooth, gypsum | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | | Vinyl Sheet Flooring, Beige/grey with pebbled pattern | | | A | Y | | 50 | | | SF | S0028ABC | None Detected | N.D. | None | |
| Floor | | Mortar, 1"x1" grey tiles | ALL | Ceramic Tiles | D | N | | 150(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with black and grey streaks | | | A | Y | | 200(7) | | | SF | V0026 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 400 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 600(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |

Includes Rooms 131A-C

Client: Hasting and Prince Edward District School Board
Location: #131 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 131
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 600 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Includes Rooms 131A-C

Client: Hasting and Prince Edward District School Board
Location: #131 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 131
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | | | | |

Includes Rooms 131A-C

Client: Hasting and Prince Edward District School Board
Location: #131 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 131
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | | | | No |

Includes Rooms 131A-C

Client: Hasting and Prince Edward District School Board
Location: #132 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 132
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|---------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 50 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Mortar, 1"x1" grey tiles | ALL | Ceramic Tiles | D | N | | 50(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 50 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #132 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 132
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 50 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #132 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 132
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #132 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 132
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #133 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 133
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|---------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 50 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Mortar, 1"x1" grey tiles | ALL | Ceramic Tiles | D | N | | 50(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 50 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #133 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 133
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 50 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #133 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 133
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #133 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 133
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #134 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 134
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|---------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Drywall and joint compound | | | C | Y | | 200(7) | | | SF | V0053 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 smooth, gypsum | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | | Mortar, 1"x1" grey tiles | ALL | Ceramic Tiles | D | N | | 200(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 200 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 400 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 600(7) | | | SF | S0067D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |

Client: Hasting and Prince Edward District School Board
Location: #134 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 134
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 600 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Client: Hasting and Prince Edward District School Board
Location: #134 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 134
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | | | | |

Client: Hasting and Prince Edward District School Board
Location: #134 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 134
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | | | | No |

Client: Hasting and Prince Edward District School Board
Location: #135 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 135
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|---------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Drywall and joint compound | | | C | Y | | 200(7) | | | SF | S0053G | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 smooth, gypsum | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | | Mortar, 1"x1" grey tiles | ALL | Ceramic Tiles | D | N | | 200(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with black and grey streaks | | | A | Y | | 200(7) | | | SF | S0026C | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 400 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |

Includes Rooms 135A-B

Client: Hasting and Prince Edward District School Board
Location: #135 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 135
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 600 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Includes Rooms 135A-B

Client: Hasting and Prince Edward District School Board
Location: #135 : Change Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 135
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | | | | |

Includes Rooms 135A-B

Client: Hasting and Prince Edward District

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

School Board
Location: #135 : Change Room **Floor: 1** **Room #: 135** **Area (sqft): 400**
Survey Date: 2023-05-03 **Last Re-Assessment: 0000-00-00**

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | | | | No |

Includes Rooms 135A-B

Client: Hasting and Prince Edward District School Board
Location: #136 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 136
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|---------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x2 textured with small pinholes, 12/14/2005 | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 200(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 200 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0066D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #136 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 136
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 200 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Concrete (precast) | 800 | | SF | V0008 | Pink | Pb: .0144 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #136 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 136
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #136 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 136
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #137 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 137
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|---------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x2 textured with small pinholes, 12/14/2005 | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 200(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 200 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0066 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Room 137A

Client: Hasting and Prince Edward District School Board
Location: #137 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 137
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 200 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Concrete (precast) | 800 | | SF | V0008 | Pink | Pb: .0144 % | Lead (Low) | |

Includes Room 137A

Client: Hasting and Prince Edward District School Board
Location: #137 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 137
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Room 137A

Client: Hasting and Prince Edward District School Board
Location: #137 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 137
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |



ALL DATA REPORT



Includes Room 137A

Client: Hasting and Prince Edward District School Board
Location: #139 : Storage Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 139
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|--------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with sparse white and brown flecks | | | A | Y | | 300(7) | | | SF | S0024A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Parging Cement | | | C | Y | | 4(7) | | | EA | S0025ABC | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Metal | | | C | N | | 300 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 400(7) | | 300(3) | SF | S0066AB | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Client: Hasting and Prince Edward District School Board
Location: #139 : Storage Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 139
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 850 | 150 | SF | L0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 300 | | SF | L0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #139 : Storage Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 139
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #139 : Storage Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 139
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #140 : Stage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 140
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|-------------------------------------|------|----------|----|----|-----|---------|------|------|------|---------------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4, wicker | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | All | Wood | | | A | Y | | 200 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | Rain Water Leader | Cement Product, Transite | | | C | Y | | 15(7) | | | LF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | Rain Water Leader | Parging Cement | | | C | Y | | 2(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Metal | | | D | Y | | 200 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | | | | | S0042G | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | S0065ABC D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #140 : Stage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 140
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 1000 | | SF | L0009 | Black | Pb: .0043 % | No | |
| Structure | Metal | 200 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #140 : Stage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 140
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #140 : Stage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 140
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #140 : Stage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 140
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #141 : Equipment Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 142
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|---|------|----------|----|----|-----|---------|------|-------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Concrete (poured) | | | A | Y | | 200 | | | SF | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with sparse white and brown flecks | | | A | Y | | 200(7) | | | SF | V0024 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Parging Cement | | | C | Y | | 30(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | Rain Water Leader | Cement Product, Transite | | | C | Y | | 40(7) | | | LF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Structure | All | Metal | | | C | Y | | 400 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | 10(3) | SF | S0067F | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | S0066E | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 50 | | | LF | V0043 | None Detected | N.D. | None | |

Formerly Rooms 141 and 141A-C, Includes Rooms 142B-F

Client: Hasting and Prince Edward District School Board
Location: #141 : Equipment Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 142
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Floor | Concrete (poured) | 200 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Floor | Concrete (precast) | 2000 | | SF | L0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Rooms 141 and 141A-C, Includes Rooms 142B-F

Client: Hasting and Prince Edward District School Board
Location: #141 : Equipment Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 142
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Formerly Rooms 141 and 141A-C, Includes Rooms 142B-F

Client: Hasting and Prince Edward District School Board
Location: #141 : Equipment Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 142
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Rooms 141 and 141A-C, Includes Rooms 142B-F

Client: Hasting and Prince Edward District School Board
Location: #141 : Equipment Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 142
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Rooms 141 and 141A-C, Includes Rooms 142B-F

Client: Hasting and Prince Edward District School Board
Location: #142 : Gym
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 142
Last Re-Assessment: 0000-00-00

Area (sqft): 9000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|---|------|----------|----|----|-----|---------|------|------|------|---------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4, wicker | | | D | Y | | 9000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | D | Y | | | | | | | | | | |
| Floor ¹ | | Vinyl Floor Tile and Mastic, 12x12 beige with sparse white and brown flecks | | | A | Y | | 200(7) | | | SF | V0024 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Floor | All | Wood | | | A | Y | | 9000 | | | SF | | | | | |
| Mechanical Equipment | Fan Unit | Not Insulated | | | D | Y | | | | | | | | | | |
| Piping | All | Cement Product, Transite | | | D | Y | | 40(7) | | | LF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | Rain Water Leader | Parging Cement | | | D | Y | | 1(7) | | 1(7) | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Metal | | | D | Y | | 9000 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | S0065E | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 5000(7) | | | SF | S0066FG | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Room 191A
1 - 191A

Client: Hasting and Prince Edward District School Board
Location: #142 : Gym
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 142
Last Re-Assessment: 0000-00-00

Area (sqft): 9000

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 9000 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Concrete (precast) | 5000 | | SF | V0007 | Yellow/purple | Pb: .0945 % | Lead (Low) | |

Includes Room 191A

Client: Hasting and Prince Edward District School Board
Location: #142 : Gym
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 142
Last Re-Assessment: 0000-00-00

Area (sqft): 9000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Includes Room 191A

Client: Hasting and Prince Edward District

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Client: Hasting and Prince Edward District School Board
Location: #143 : Custodial Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 143
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 100 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 100 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | | Paint, Off-white | | | C | N | | 100 | | | SF | V0045 | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 100 | | | SF | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 200(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 40 | | | LF | V0043 | None Detected | N.D. | None | |

Includes Rooms 143A

Client: Hasting and Prince Edward District School Board
Location: #143 : Custodial Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 143
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Concrete (precast) | 100 | | SF | V0010 | Off-white | Pb: .0011 % | No | |
| Structure | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |

Includes Rooms 143A

Client: Hasting and Prince Edward District School Board
Location: #143 : Custodial Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 143
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |
| Thermostat | 100 | % | V9000 | Yes |

Includes Rooms 143A

Client: Hasting and Prince Edward District

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

School Board
Location: #143 : Custodial Office **Floor: 1** **Room #: 143** **Area (sqft): 100**
Survey Date: 2023-05-03 **Last Re-Assessment: 0000-00-00**

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 143A

Client: Hasting and Prince Edward District School Board
Location: #144 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 144
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 150 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | | Paint, Off-white | | | C | Y | | 150 | | | SF | V0045 | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 150 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Client: Hasting and Prince Edward District School Board
Location: #144 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 144
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 400 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Concrete (precast) | 150 | | SF | V0010 | Off-white | Pb: .0011 % | No | |

Client: Hasting and Prince Edward District School Board
Location: #144 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 144
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #144 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 144
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #145 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 146
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|---------------|----|----|-----|---------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x2 textured with small pinholes | | | C | Y | | 300 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | Bulkhead | Drywall and joint compound | | | C | Y | | 200(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 300(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | | Paint, Off-white | | | C | Y | | 300 | | | SF | S0045C | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | D | N | | 300 | | | SF | | | | | |
| Wall | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 1000(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |

Formerly Room 145

Client: Hasting and Prince Edward District School Board
Location: #145 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 146
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|---------|----------------------------|------|------|------|--------|--------------------|-------------|--------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |

Formerly Room 145

Client: Hasting and Prince Edward District School Board
Location: #145 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 146
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 145

Client: Hasting and Prince Edward District School Board
Location: #145 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 146
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 145

Client: Hasting and Prince Edward District School Board
Location: #146 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 145
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|--------|------|------|------|---------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 100 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | | Paint, Off-white | | | C | Y | | 100 | | | SF | S0045AB | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 100 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 400(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 146

Client: Hasting and Prince Edward District School Board
Location: #146 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 145
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 400 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Floor | Concrete (poured) | 100 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Structure | Concrete (precast) | 100 | | SF | L0010 | Off-white | Pb: .0011 % | No | |

Formerly Room 146

Client: Hasting and Prince Edward District School Board
Location: #146 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 145
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 146

Client: Hasting and Prince Edward District School Board
Location: #146 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 145
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |



ALL DATA REPORT



Formerly Room 146

Client: Hasting and Prince Edward District School Board
Location: #150 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 148
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 300(7) | | | SF | S0003D | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | N | | 100(7) | | | LF | S0001A | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | | Sweatwrap | | | C | N | | 110(7) | | | LF | S0002A | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | | Sweatwrap | | | C | N | | | | | | S0035ABC | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | N | | 12(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | | Paint, Off-white | | | C | Y | | 300 | | | SF | V0045 | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 300 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 120 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 150

Client: Hasting and Prince Edward District School Board
Location: #150 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 148
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 1000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Floor | Concrete (poured) | 300 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Structure | Concrete (precast) | 300 | | SF | V0010 | Off-white | Pb: .0011 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 150

Client: Hasting and Prince Edward District School Board
Location: #150 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 148
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 150

Client: Hasting and Prince Edward District School Board
Location: #150 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 148
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 150

Client: Hasting and Prince Edward District School Board
Location: #151 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 149
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige | | | A | Y | | 300 | | | SF | S0004ABC | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | N | | 60(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | | Sweatwrap | | | C | N | | 60(7) | | | LF | V0035 | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | N | | 8(7) | 1(7) | 1(4) | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | | Paint, Off-white | | | C | Y | | 300 | | | SF | V0045 | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 300 | | | SF | | | | | |
| Wall | | Drywall and joint compound, Lab Report Reference 1717806_PLM (S0005A) | | | A | Y | | 200 | | | SF | S0058A | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 120 | | | LF | S0043A | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 151, Includes Rooms 149A-C

Client: Hasting and Prince Edward District School Board
Location: #151 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 149
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 1000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Floor | Concrete (poured) | 300 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Structure | Concrete (precast) | 300 | | SF | V0010 | Off-white | Pb: .0011 % | No | |
| Structure | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 151, Includes Rooms 149A-C

Client: Hasting and Prince Edward District School Board
Location: #151 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 149
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 151, Includes Rooms 149A-C

Client: Hasting and Prince Edward District School Board
Location: #151 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 149
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 151, Includes Rooms 149A-C

Client: Hasting and Prince Edward District School Board
Location: #152 : Wood Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 151
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | | Mastic, Brown | | | C | Y | | 50 | | | LF | S0007ABC | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | All | Wood | | | A | Y | | 1000 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Parging Cement | | | C | Y | | 25(7) | | | EA | S0006A | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | | Sweatwrap | | | C | Y | | 170(7) | | | LF | V0002 | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | All | Aircell | | | C | Y | | 170(7) | | | LF | V0025 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | | Paint, Off-white | | | C | Y | | 1000 | | | SF | S0045D | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 1000 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 4000(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 27(7) | | | EA | S0041B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 152, Includes Room 151A

Client: Hasting and Prince Edward District School Board
Location: #152 : Wood Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 151
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 4000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Concrete (precast) | 1000 | | SF | V0010 | Off-white | Pb: .0011 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 152, Includes Room 151A

Client: Hasting and Prince Edward District School Board
Location: #152 : Wood Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 151
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 152, Includes Room 151A

Client: Hasting and Prince Edward District School Board
Location: #152 : Wood Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 151
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 27 | EA | P0002 | | <5 mg/kg | No |

Formerly Room 152, Includes Room 151A

Client: Hasting and Prince Edward District School Board
Location: #153 : Autoshop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 153
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Duct | | Mastic, Light grey | | | C | Y | | 30 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 4000 | | | SF | | | | | |
| Mechanical Equipment | Fan Unit | Not Insulated | | | C | Y | | | | | | | | | | |
| Piping | | Aircell | | | C | Y | | 150(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | | Sweatwrap | | | C | Y | | 150(7) | | | LF | V0002 | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | Y | | 29(7) | 1(6) | | EA | S0008ABC | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Concrete (precast) | | | C | N | | 4000 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 4000(7) | | | SF | V0062 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 27(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #153 : Autoshop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 153
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 4000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #153 : Autoshop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 153
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #153 : Autoshop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 153
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 27 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #154 : Manufacturing Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 154
Last Re-Assessment: 0000-00-00

Area (sqft): 1500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 small and medium pinholes | | | C | Y | | 500 | | | SF | S0010ABC | None Detected | N.D. | None | |
| Ceiling | Bulkhead | Plaster | | | C | Y | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | | Mastic, Light grey | | | C | Y | | 20 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Concrete (poured) | | | | | | 500 | | | SF | | | | | |
| Floor | All | Wood | | | A | Y | | 1000 | | | SF | | | | | |
| Mechanical Equipment | Fan Unit | Not Insulated | | | C | Y | | | | | | | | | | |
| Piping | | Aircell | | | C | Y | | 200(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | A | Y | | 20(5) | | | EA | V0008 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Concrete (precast) | | | C | N | | 1000 | | | SF | | | | | |
| Wall | | Drywall and joint compound, Lab Report Reference 1717806_PLM (S0005B) | | | A | Y | | 700 | | | SF | S0058BF | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 3000(7) | | | SF | V0062 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 50 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 18(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes 154A

Client: Hasting and Prince Edward District School Board
Location: #154 : Manufacturing Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 154
Last Re-Assessment: 0000-00-00

Area (sqft): 1500

| PAINT | | | | | | | | | |
|---------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 3000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Wall | Drywall and joint compound | 700 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Ceiling | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Floor | Concrete (poured) | 500 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes 154A

Client: Hasting and Prince Edward District School Board
Location: #154 : Manufacturing Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 154
Last Re-Assessment: 0000-00-00

Area (sqft): 1500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes 154A

Client: Hasting and Prince Edward District School Board
Location: #154 : Manufacturing Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 154
Last Re-Assessment: 0000-00-00

Area (sqft): 1500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 18 | EA | V0002 | | <5 mg/kg | No |

Includes 154A

Client: Hasting and Prince Edward District School Board
Location: #155 : Manufacturing Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 155
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

ASBESTOS

| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|---------|------|------|------|--------|---------------|--------|--------------------|---------|
| Ceiling | All | Plaster | | | D | Y | | 1000 | | | SF | S0009A | None Detected | N.D. | None | |
| Duct | | Mastic, Light grey | | | C | Y | | 30 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 2000 | | | SF | | | | | |
| Mechanical Equipment | Fan Unit | Not Insulated | | | C | Y | | | | | | | | | | |
| Piping | | Aircell | | | C | Y | | 100(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | Y | | 15(7) | | | EA | V0008 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Concrete (precast) | | | C | N | | 2000 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 4000(7) | | | SF | S0062C | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 27(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #155 : Manufacturing Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 155
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

PAINT

| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
|---------|--------------------|------|------|------|--------|---------------------|-------------|------------|
| Floor | Concrete (poured) | 2000 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) |
| Ceiling | Plaster | 1000 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) |
| Ceiling | Concrete (precast) | 4000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) |

Client: Hasting and Prince Edward District School Board
Location: #155 : Manufacturing Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 155
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

MERCURY

| Component | Quantity | Unit | Sample | Hazard |
|------------------------|----------|------|--------|--------|
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #155 : Manufacturing Shop
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 155
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 27 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #156 : Tech Area
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 156
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|-------------------------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 100 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | D | N | | 500 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 random pinholes | | | C | Y | | 400 | | | SF | S0047ABC | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large uniform pinholes | | | C | Y | | 100 | | | SF | S0011AC | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Carpet | | | A | Y | | 500 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | | SF | S0062B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound, Lab Report Reference 1717806_PLM (S0005C) | | | A | Y | | 500 | | | SF | S0058CE | None Detected | N.D. | None | |

Includes rooms 156A-C

Client: Hasting and Prince Edward District School Board
Location: #156 : Tech Area
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 156
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|--------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 500 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Wall | Concrete (precast) | 2000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes rooms 156A-C

Client: Hasting and Prince Edward District School Board
Location: #156 : Tech Area
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 156
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes rooms 156A-C

Client: Hasting and Prince Edward District School Board
Location: #156 : Tech Area
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 156
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes rooms 156A-C

Client: Hasting and Prince Edward District School Board
Location: #157 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 157
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 400 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 large and medium uniform pinholes | | | C | Y | | 400 | | | SF | S0011B | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 400(7) | | | SF | S0003C | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | S0056A | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0062A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #157 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 157
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #157 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 157
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #157 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 157
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #158 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 158
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 400 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 large and medium uniform pinholes | | | C | Y | | 400 | | | SF | V0011 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 400(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0062 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | S0043B | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #158 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 158
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #158 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 158
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #158 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 158
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #159 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 159
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--------------------------|------|--------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | ALL | Texture Coat | D | N | | 300 | | | SF | V0056 | None Detected | N.D. | None | |
| Ceiling | All | Texture Coat | | | C | Y | | 300(7) | | | SF | S0012A | Chrysotile | 5-10% | Confirmed Asbestos | F |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 300 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 400 | | | SF | V0056 | None Detected | N.D. | None | |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | S0062D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #159 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 159
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|---------|---------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 300 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Plaster | 400 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #159 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 159
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #159 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 159
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #160 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 160
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|------|------|------|------|----------|---------------|--------|--------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | | | C | Y | | 50 | | | SF | S0009B | None Detected | N.D. | None | |
| Ceiling | All | Plaster | | | C | Y | | | | | | S0056B | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 red and black checkered | | | A | Y | | 50 | | | SF | S0013ABC | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | | | | | S0042D | [None] | | [None] | |
| Wall | | Paint, On concrete block | | | A | Y | | 200 | | | SF | V0062 | [None] | | [None] | |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Client: Hasting and Prince Edward District School Board
Location: #160 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 160
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #160 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 160
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #160 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 160
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #161 : Mechanical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 161
Last Re-Assessment: 0000-00-00

Area (sqft): 250

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|--------------------|--|------|----------|----|----|-----|--------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster, Textured | | | C | Y | | 250 | | | SF | S0037ABC | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 50(7) | | | SF | S0003E | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Floor | All | Concrete (poured) | | | A | Y | | 200 | | | SF | | | | | |
| Mechanical Equipment | Heating Water Tank | Fibreglass | ALL | Metal | A | Y | | | | | | | | | | |
| Piping | | Aircell | | | C | Y | | 25(7) | | | LF | V0014 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | Y | | 5(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | None Found | | | | | | | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | S0062E | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On brick | | | A | Y | | 100(7) | | | SF | S0060D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Rooms 161A-B

Client: Hasting and Prince Edward District School Board
Location: #161 : Mechanical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 161
Last Re-Assessment: 0000-00-00

Area (sqft): 250

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Floor | Concrete (poured) | 200 | | SF | L0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Floor | Concrete (precast) | 600 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Plaster | 250 | | SF | L0003 | Yellow | Pb: .0194 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Rooms 161A-B

Client: Hasting and Prince Edward District School Board
Location: #161 : Mechanical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 161
Last Re-Assessment: 0000-00-00

Area (sqft): 250

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 161A-B

Client: Hasting and Prince Edward District School Board
Location: #161 : Mechanical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 161
Last Re-Assessment: 0000-00-00

Area (sqft): 250

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 161A-B

Client: Hasting and Prince Edward District School Board
Location: #162 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 152
Last Re-Assessment: 0000-00-00

Area (sqft): 100

ASBESTOS

| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
|----------------------|-----------|----------------------------|------|----------|----|----|-----|------|------|------|------|--------|---------------|--------|--------|---------|
| Ceiling | All | Drywall and joint compound | | | C | Y | | 100 | | | SF | V0058 | [None] | | [None] | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 100 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 162

Client: Hasting and Prince Edward District School Board
Location: #162 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 152
Last Re-Assessment: 0000-00-00

Area (sqft): 100

PAINT

| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
|---------|----------------------------|------|------|------|--------|--------------------|-------------|--------|
| Ceiling | Drywall and joint compound | 100 | | SF | L0005 | Off-white | Pb: .0055 % | No |

Formerly Room 162

Client: Hasting and Prince Edward District School Board
Location: #162 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 152
Last Re-Assessment: 0000-00-00

Area (sqft): 100

MERCURY

| Component | Quantity | Unit | Sample | Hazard |
|------------------------|----------|------|--------|--------|
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 162

Client: Hasting and Prince Edward District School Board
Location: #162 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 152
Last Re-Assessment: 0000-00-00

Area (sqft): 100

PCB

| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
|----------------|----------|------|--------|--------------------|--------|-----|
| Light Ballasts | | | V0000 | | | No |

Formerly Room 162

Client: Hasting and Prince Edward District School Board
Location: #163 : Boiler Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 163
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|----------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with brown streaks | | | A | Y | | 100(7) | | | SF | S0015ABC | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Floor | All | Concrete (poured) | | | A | Y | | 500 | | | SF | | | | | |
| Mechanical Equipment | Boiler | Fibreglass, Post-2000 | ALL | Metal | A | Y | | | | | | | | | | |
| Piping | | Aircell | | | C | Y | | 30(7) | | | LF | S0014ABC | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | | Sweatwrap | | | C | Y | | 30(7) | | | LF | S0002B | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | Y | | 4(7) | | | EA | V0008 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Concrete (precast) | | | C | N | | 600 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 1200(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Door | Thermal Insulation | | Metal | A | Y | | 1(5) | | | EA | V9500 | Presumed Asbestos | | Presumed Asbestos | F |

Includes Room 162

Client: Hasting and Prince Edward District School Board
Location: #163 : Boiler Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 163
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Floor | Concrete (poured) | 500 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Floor | Concrete (precast) | 1200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Room 162

Client: Hasting and Prince Edward District School Board
Location: #163 : Boiler Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 163
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Includes Room 162

Client: Hasting and Prince Edward District School Board
Location: #163 : Boiler Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 163
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| MERCURY | | | | |
|------------------------|----------|------|--------|----------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | | | | |
| Boiler Control | 100 | % | V9500 | Presumed |

Includes Room 162

Client: Hasting and Prince Edward District School Board
Location: #163 : Boiler Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 163
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | | | | No |

Includes Room 162

Client: Hasting and Prince Edward District School Board
Location: #164 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 164
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 200(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | N | | 60(7) | | | LF | V0014 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | N | | 6(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Concrete (precast) | | | C | N | | 200 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0063A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #164 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 164
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|--------|-------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #164 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 164
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #164 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 164
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #165 : Kitchen
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 165
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 100 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | All | Drywall and joint compound | | | C | Y | | 500 | | | SF | V0058 | [None] | | [None] | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 600 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | N | | 120 | | | LF | | | | | |
| Piping | All | Parging Cement | | | C | N | | 25(7) | | | EA | V0008 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Rooms 165A-D

Client: Hasting and Prince Edward District School Board
Location: #165 : Kitchen
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 165
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| PAINT | | | | | | | | | |
|---------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Drywall and joint compound | 500 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Ceiling | Concrete (precast) | 1000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Rooms 165A-D

Client: Hasting and Prince Edward District School Board
Location: #165 : Kitchen
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 165
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 165A-D

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #165 : Kitchen
Survey Date: 2023-05-03

Floor: 1

Room #: 165
Last Re-Assessment: 0000-00-00

Area (sqft): 600

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Includes Rooms 165A-D

Client: Hasting and Prince Edward District School Board
Location: #166 : Kitchen
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 194
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 100 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 150 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | N | | 30 | | | LF | | | | | |
| Piping | All | Parging Cement | | | C | N | | 25(7) | | | EA | V0008 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 166

Client: Hasting and Prince Edward District School Board
Location: #166 : Kitchen
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 194
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 500 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Formerly Room 166

Client: Hasting and Prince Edward District School Board
Location: #166 : Kitchen
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 194
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 166

Client: Hasting and Prince Edward District School Board
Location: #166 : Kitchen
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 194
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |



ALL DATA REPORT



Formerly Room 166

Client: Hasting and Prince Edward District School Board
Location: #167 : Cafeteria
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 167
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|---------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 textured, fibreglass | | | D | Y | | 1000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | D | N | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 1000 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | Y | | 30(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | Y | | 2(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 2500(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 200 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 20(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #167 : Cafeteria
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 167
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 2500 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #167 : Cafeteria
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 167
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #167 : Cafeteria
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 167
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #167 : Cafeteria
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 167
Last Re-Assessment: 0000-00-00

Area (sqft): 1000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 20 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #168 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 168
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 200(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Aircell | | | C | Y | | 60(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Structure | | Paint, Off-white | | | C | Y | | 200 | | | SF | S0045E | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 200 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 400(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Client: Hasting and Prince Edward District School Board
Location: #168 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 168
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 400 | | SF | V0008 | Pink | Pb: .0144 % | Lead (Low) | |
| Structure | Concrete (precast) | 200 | | SF | V0010 | Off-white | Pb: .0011 % | No | |

Client: Hasting and Prince Edward District School Board
Location: #168 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 168
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #168 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 168
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Client: Hasting and Prince Edward District School Board
Location: #169 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 150
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|---------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 400 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | N | | 10(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | | Sweatwrap | | | C | N | | 10(7) | | | LF | V0035 | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | C | N | | 11(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | | Paint, Off-white | | | C | Y | | 400 | | | SF | V0045 | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 400 | | | SF | | | | | |
| Wall | | Drywall and joint compound, Lab Report Reference R6857108 (S0054B) | | | A | Y | | 250 | | | SF | S0058D | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | S0063B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 120 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 169, Includes Room 150A

Client: Hasting and Prince Edward District School Board
Location: #169 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 150
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 1000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Floor | Concrete (poured) | 400 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Structure | Concrete (precast) | 400 | | SF | V0010 | Off-white | Pb: .0011 % | No | |
| Structure | Drywall and joint compound | 250 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 169, Includes Room 150A

Client: Hasting and Prince Edward District School Board
Location: #169 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 150
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 169, Includes Room 150A

Client: Hasting and Prince Edward District School Board
Location: #169 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 150
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 169, Includes Room 150A

Client: Hasting and Prince Edward District School Board
Location: #180 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 180
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|---------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Drywall and joint compound | | | C | Y | | 200(7) | | | SF | S0053B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 10 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | | Mortar, 1"x1" grey tiles | ALL | Ceramic Tiles | D | N | | 200(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with sparse white and brown flecks | | | A | Y | | 200(7) | | | SF | V0024 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 400 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, Yellow | | | A | Y | | | | | | S0042F | [None] | | [None] | |
| Wall | | Paint, On concrete block | | | A | Y | | 600(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Firm grey | | | A | Y | | 6 | | | EA | S0040C | None Detected | N.D. | None | |

Includes Rooms 180A-B

Client: Hasting and Prince Edward District School Board
Location: #180 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 180
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 600 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Ceiling | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Rooms 180A-B

Client: Hasting and Prince Edward District School Board
Location: #180 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 180
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 180A-B

Client: Hasting and Prince Edward District School Board
Location: #180 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 180
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 6 | EA | V0002 | | <5 mg/kg | No |

Includes Rooms 180A-B

Client: Hasting and Prince Edward District School Board
Location: #181 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 181
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 10 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with sparse white and brown flecks | | | A | Y | | 500(7) | | | SF | V0024 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 500 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 600(7) | | | SF | S0067E | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 30(7) | | | SF | V0053 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | S0043D | None Detected | N.D. | None | |
| Wall | Window | Caulking, Firm grey | | | A | Y | | 6 | | | EA | V0040 | None Detected | N.D. | None | |

Client: Hasting and Prince Edward District School Board
Location: #181 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 181
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 30 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Wall | Concrete (precast) | 600 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #181 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 181
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #181 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 181
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 6 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #182 : Weight Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 182
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|---------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with sparse white and brown flecks | | | A | Y | | 500(7) | | | SF | S0024BC | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Parging Cement | | | C | N | | 10(7) | | | EA | V0006 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Metal | | | C | N | | 500 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Firm grey | | | A | Y | | 12 | | | EA | S0040B | None Detected | N.D. | None | |

Includes Room 183A

Client: Hasting and Prince Edward District School Board
Location: #182 : Weight Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 182
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 1000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | L0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Room 183A

Client: Hasting and Prince Edward District School Board
Location: #182 : Weight Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 182
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Room 183A

Client: Hasting and Prince Edward District School Board
Location: #182 : Weight Room

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 182

Area (sqft): 500

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 12 | EA | V0002 | | <5 mg/kg | No |

Includes Room 183A

Client: Hasting and Prince Edward District School Board
Location: #183 : Greenhouse
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 183
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|------------|--|------|--------------------------|----|----|-----|---------|------|------|------|--------|-------------------|--------|-------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plexiglass, Glass | | | C | Y | | 500 | | | SF | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 500 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Other | Countertop | Cement Product, Transite garden tables | | | A | Y | | 1000(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | All | Fibreglass | ALL | Polyvinyl chloride (PVC) | C | Y | | | | | | | | | | |
| Structure | All | Metal | | | C | Y | | 500 | | | SF | | | | | |
| Wall | All | Glass | | | A | Y | | | | | | | | | | |

Client: Hasting and Prince Edward District School Board
Location: #184 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 184
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 300 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 20 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Carpet | | | A | Y | | 300 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 300 | | | SF | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 100(7) | | | SF | S0027C | [Asbestos] | 0.5-5% | [Asbestos] | NF |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Includes Room 184A

Client: Hasting and Prince Edward District School Board
Location: #184 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 184
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 300 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

| PAINT | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|--------|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
| Structure | Drywall and joint compound | 100 | | SF | V0005 | Off-white | Pb: .0055 % | No |

Includes Room 184A

Client: Hasting and Prince Edward District School Board
Location: #184 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 184
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Room 184A

Client: Hasting and Prince Edward District School Board
Location: #184 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 184
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Room 184A

Client: Hasting and Prince Edward District School Board
Location: #185 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 185
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|---------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 30 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Carpet | | | A | Y | | 500 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 500 | | | SF | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 100(7) | | | SF | S0027A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Window | Caulking, Firm grey | | | A | Y | | 4 | | | EA | V0040 | None Detected | N.D. | None | |

Client: Hasting and Prince Edward District School Board
Location: #185 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 185
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 1000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |
| Other | Drywall and joint compound | 100 | | SF | V0005 | Off-white | Pb: .0055 % | No | |

Client: Hasting and Prince Edward District School Board
Location: #185 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 185
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #185 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 185
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 4 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #186 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 186
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 300 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 20 | | | SF | S0046C | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Carpet | | | A | Y | | 300 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 300 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0067C | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Window | Caulking, Firm grey | | | A | Y | | 4 | | | EA | V0040 | None Detected | N.D. | None | |

Client: Hasting and Prince Edward District School Board
Location: #186 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 186
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 300 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #186 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 186
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #186 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 186
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 4 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #187 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 187
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|--|------|----------|----|----|-----|--------|------|------|------|---------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 10 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with black and grey streaks | | | A | Y | | 500(7) | | | SF | S0026AB | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Piping | Rain Water Leader | Cement Product, Transite | | | C | N | | 10(7) | | | LF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Structure | All | Metal | | | C | N | | 500 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 595(7) | | 5(3) | SF | V0067 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 200(7) | | | SF | S0053E | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 80 | | | LF | S0043C | None Detected | N.D. | None | |
| Wall | Window | Caulking, Firm grey | | | A | Y | | 6 | | | EA | S0040A | None Detected | N.D. | None | |

Includes Room 188

Client: Hasting and Prince Edward District School Board
Location: #187 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 187
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Drywall and joint compound | 200 | | SF | L0005 | Off-white | Pb: .0055 % | No | |
| Wall | Concrete (precast) | 600 | | SF | L0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Room 188

Client: Hasting and Prince Edward District School Board
Location: #187 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 187
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Room 188

**Client: Hasting and Prince Edward District
School Board**
Location: #187 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 187
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 6 | EA | V0002 | | <5 mg/kg | No |

Includes Room 188

Client: Hasting and Prince Edward District School Board
Location: #188 : Music Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 189
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|---|------|----------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 20 | | | SF | S0046B | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 250 | | | SF | V0022 | None Detected | N.D. | None | |
| Floor | All | Carpet | | | A | Y | | 250 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | Rain Water Leader | Cement Product, Transite | | | A | Y | | 12(7) | | | LF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Structure | All | Metal | | | C | N | | 500 | | | SF | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0067A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 188, Includes Rooms 189A-E

Client: Hasting and Prince Edward District School Board
Location: #188 : Music Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 189
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 800 | | SF | L0008 | Pink | Pb: .0144 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 188, Includes Rooms 189A-E

Client: Hasting and Prince Edward District School Board
Location: #188 : Music Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 189
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 188, Includes Rooms 189A-E

Client: Hasting and Prince Edward District School Board
Location: #188 : Music Room

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 189

Area (sqft): 500

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 188, Includes Rooms 189A-E

Client: Hasting and Prince Edward District School Board
Location: #190 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 190
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|--|------|----------|----|----|-----|---------|------|------|------|---------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Plaster, Stairwells | | | C | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 2000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 20 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 100 | | | SF | V0018 | None Detected | N.D. | None | |
| Floor | All | Terrazzo | | | A | Y | | 2000 | | | SF | S0044AB | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | Rain Water Leader | Sweatwrap | | | C | N | | 6(7) | | | LF | V0002 | Chrysotile | 0.5-5% | Confirmed Asbestos | F |
| Structure | All | Metal | | | C | N | | 2000 | | | SF | | | | | |
| Wall | | Plaster, Above lockers | | | A | Y | | 2000 | | | SF | S0057C | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Stairs | Paint, On brick | | | A | Y | | 500(7) | | | SF | S0060B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Room 190A

Client: Hasting and Prince Edward District School Board
Location: #190 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 190
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 2000 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Plaster | 2000 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Structure | Concrete (precast) | 2000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Includes Room 190A

Client: Hasting and Prince Edward District School Board
Location: #190 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 190
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Includes Room 190A

Client: Hasting and Prince Edward District School Board
Location: #190 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 190
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Room 190A

Client: Hasting and Prince Edward District School Board
Location: #190 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 190
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Room 190A

Client: Hasting and Prince Edward District School Board
Location: #191 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 191
Last Re-Assessment: 0000-00-00

Area (sqft): 3000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-------------------|--|------|--------------------------|----|----|-----|---------|------|-------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Adhesive/mastic, 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 3000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor ¹ | | Mortar, 1"x1" grey tiles | ALL | Ceramic Tiles | A | Y | | 50(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Floor | All | Mortar, 4"x8" red quarry tile | ALL | Ceramic Tiles | D | N | | 1000(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Polyvinyl chloride (PVC) | C | N | | | | | | | | | | |
| Piping ² | Rain Water Leader | Cement Product, Transite | | | A | Y | | 10(7) | | | LF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Structure | All | Metal | | | C | N | | 3000 | | | SF | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 800(7) | | | SF | V0053 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | | Paint, On concrete block | | | A | Y | | 2985(7) | | 15(3) | SF | S0067B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | S0066C | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

1 - Custodial closet
2 - Custodial closet

Client: Hasting and Prince Edward District School Board
Location: #191 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 191
Last Re-Assessment: 0000-00-00

Area (sqft): 3000

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 4000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 3000 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Drywall and joint compound | 800 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #191 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 191
Last Re-Assessment: 0000-00-00

Area (sqft): 3000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #191 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 191
Last Re-Assessment: 0000-00-00

Area (sqft): 3000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #191 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 191
Last Re-Assessment: 0000-00-00

Area (sqft): 3000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #192 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 192
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 2000 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | | Plaster, Stairwell | | | C | Y | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling Tiles (lay-in), 2x2 textured with pinholes, 12/14/2005 | | | C | Y | | 2000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 20 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 4000 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Parging Cement | | | C | N | | 2(7) | | | EA | V0008 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | | Aircell | | | C | N | | 100(7) | | | LF | V0025 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Metal | | | C | N | | 4000 | | | SF | | | | | |
| Structure | Beam | Plaster | | | C | N | | 200 | | | SF | S0039ABC | None Detected | N.D. | None | |
| Wall | | Plaster | | | A | Y | | 4000 | | | SF | V0056 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 1000(7) | | | SF | V0063 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Client: Hasting and Prince Edward District School Board
Location: #192 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 192
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 4000 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Plaster | 4000 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Structure | Concrete (precast) | 2000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #192 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 192
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| PB PRODUCTS | | | | |
|--------------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |
| Batteries (other) ¹ | 100 | % | V9000 | Yes |

1 - Fire alarm control panel

Client: Hasting and Prince Edward District School Board
Location: #192 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 192
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #192 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 192
Last Re-Assessment: 0000-00-00

Area (sqft): 4000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #193 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 193
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--------------------|-------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Terrazzo | | | A | Y | | 200 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Parging Cement | Elbow | | C | N | | 2(7) | | | EA | V0025 | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Piping | All | Aircell | | | C | Y | | 50(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Structure | | Paint, Off-white | | | C | Y | | 200 | | | SF | V0045 | None Detected | N.D. | None | |
| Structure | All | Concrete (precast) | | | C | N | | 200 | | | SF | | | | | |
| Wall | | Paint, On brick | | | A | Y | | | | | | S0042C | [None] | | [None] | |
| Wall | All | Masonry | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On brick | | | A | Y | | 800(7) | | | SF | S0060A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Rooms 193A-B

Client: Hasting and Prince Edward District School Board
Location: #193 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 193
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 400 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Concrete (precast) | 200 | | SF | V0010 | Off-white | Pb: .0011 % | No | |

Includes Rooms 193A-B

Client: Hasting and Prince Edward District School Board
Location: #193 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 193
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 193A-B

Client: Hasting and Prince Edward District School Board
Location: #193 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 193
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 193A-B

Client: Hasting and Prince Edward District School Board
Location: #194 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 194
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|---------|------|------|------|----------------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 2000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | | Mastic, Light grey | | | C | N | | 20 | | | SF | V0046 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 2000 | | | SF | S0044C | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Aircell | | | C | N | | 50(7) | | | LF | V0001 | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Structure | All | Metal | | | C | N | | 2000 | | | SF | | | | | |
| Wall | | Plaster, Above lockers | | | A | Y | | 2000 | | | SF | S0016ABC DE | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | | SF | S0063D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Includes Rooms 194A and 194C

Client: Hasting and Prince Edward District School Board
Location: #194 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 194
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 2000 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Plaster | 2000 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Structure | Concrete (precast) | 2000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Includes Rooms 194A and 194C

Client: Hasting and Prince Edward District School Board
Location: #194 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 194
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Includes Rooms 194A and 194C

Client: Hasting and Prince Edward District School Board
Location: #194 : Corridor

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 194

Area (sqft): 2000

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 194A and 194C

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #194 : Corridor

Floor: 1

Room #: 194

Area (sqft): 2000

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 194A and 194C

Client: Hasting and Prince Edward District School Board
Location: #195 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 195
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Plaster, Stairwells | | | C | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 2000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 2000 | | | SF | S0044E | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Concrete (precast) | | | C | N | | 2000 | | | SF | | | | | |
| Wall | | Plaster, Above lockers | | | A | Y | | 2000 | | | SF | S0009CDE | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | | SF | S0062F | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Includes Rooms 195A

Client: Hasting and Prince Edward District School Board
Location: #195 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 195
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 2000 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 2000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Includes Rooms 195A

Client: Hasting and Prince Edward District School Board
Location: #195 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 195
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Includes Rooms 195A

Client: Hasting and Prince Edward District School Board
Location: #195 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 195
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 195A

Client: Hasting and Prince Edward District School Board
Location: #195 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 1

Building Name: Eastside Secondary School
Room #: 195
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 195A

Client: Hasting and Prince Edward District School Board
Location: #202 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 204
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 400 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 400 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 400 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Drywall and joint compound | | | B | Y | | 400(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | | Plaster | | | A | Y | | 1000 | | | SF | S0056E | None Detected | N.D. | None | |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 150 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 18(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 202, Includes Room 205

Client: Hasting and Prince Edward District School Board
Location: #202 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 204
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|--------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 1000 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Drywall and joint compound | 400 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 202, Includes Room 205

Client: Hasting and Prince Edward District School Board
Location: #202 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 204
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 202, Includes Room 205

Client: Hasting and Prince Edward District School Board
Location: #202 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 204
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 18 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 202, Includes Room 205

Client: Hasting and Prince Edward District School Board
Location: #203 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 216
Last Re-Assessment: 0000-00-00

Area (sqft): 100

ASBESTOS

| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| Ceiling | All | Plaster | | | C | Y | | 100 | | | SF | S0056D | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Concrete (poured) | | | A | Y | | 50 | | | SF | | | | | |
| Floor | | Terrazzo | | | A | Y | | 50 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | A | Y | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 203

Client: Hasting and Prince Edward District School Board
Location: #203 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 216
Last Re-Assessment: 0000-00-00

Area (sqft): 100

PAINT

| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
|---------|--------------------|------|------|------|--------|--------------------|-------------|------------|
| Ceiling | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) |
| Ceiling | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) |
| Floor | Concrete (poured) | 50 | | SF | L0002 | Grey | Pb: .0958 % | Lead (Low) |

Formerly Room 203

Client: Hasting and Prince Edward District School Board
Location: #203 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 216
Last Re-Assessment: 0000-00-00

Area (sqft): 100

PB PRODUCTS

| Component | Quantity | Unit | Sample | Hazard |
|--------------------------|----------|------|--------|--------|
| Bell And Spigot Fittings | 100 | % | V9000 | Yes |

Formerly Room 203

Client: Hasting and Prince Edward District School Board
Location: #203 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 216
Last Re-Assessment: 0000-00-00

Area (sqft): 100

MERCURY

| Component | Quantity | Unit | Sample | Hazard |
|------------------------|----------|------|--------|--------|
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 203

**Client: Hasting and Prince Edward District
School Board**
Location: #203 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 216
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 203

Client: Hasting and Prince Edward District School Board
Location: #204 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 100

ASBESTOS

| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| Ceiling | All | Plaster | | | C | Y | | 100 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Concrete (poured) | | | A | Y | | 100 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | A | Y | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 204

Client: Hasting and Prince Edward District School Board
Location: #204 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 100

PAINT

| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
|---------|--------------------|------|------|------|--------|--------------------|-------------|------------|
| Ceiling | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) |
| Ceiling | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) |
| Floor | Concrete (poured) | 100 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) |

Formerly Room 204

Client: Hasting and Prince Edward District School Board
Location: #204 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 100

PB PRODUCTS

| Component | Quantity | Unit | Sample | Hazard |
|--------------------------|----------|------|--------|--------|
| Bell And Spigot Fittings | 100 | % | V9000 | Yes |

Formerly Room 204

Client: Hasting and Prince Edward District School Board
Location: #204 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 100

MERCURY

| Component | Quantity | Unit | Sample | Hazard |
|------------------------|----------|------|--------|--------|
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 204

2023-07-10

Client: Hasting and Prince Edward District School Board
Location: #204 : Custodial Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 204

Client: Hasting and Prince Edward District School Board
Location: #205 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|---------------|----|----|-----|---------|------|------|------|--------|-------------------|--------|-------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x2 textured with small pinholes | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | Bulkhead | Plaster | | | C | Y | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 200(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 200 | | | SF | | | | | |
| Wall | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 1000(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |

Formerly Room 205

Client: Hasting and Prince Edward District School Board
Location: #205 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|-----------|---------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Structure | Metal | 200 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 205

Client: Hasting and Prince Edward District School Board
Location: #205 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 205

Client: Hasting and Prince Edward District School Board
Location: #205 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 205

Client: Hasting and Prince Edward District School Board
Location: #206 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|---------------|----|----|-----|---------|------|------|------|--------|-------------------|--------|-------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x2 textured with small pinholes | | | C | Y | | 200 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | Bulkhead | Plaster | | | C | Y | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 200(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 200 | | | SF | | | | | |
| Wall | All | Mortar, 12x12 brown and beige tiles | ALL | Ceramic Tiles | D | N | | 1000(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |

Formerly Room 206

Client: Hasting and Prince Edward District School Board
Location: #206 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|-----------|---------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Structure | Metal | 200 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 206

Client: Hasting and Prince Edward District School Board
Location: #206 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 206

Client: Hasting and Prince Edward District School Board
Location: #206 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 217
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 206

Client: Hasting and Prince Edward District School Board
Location: #207 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 201
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 500 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 500 | | | SF | S0022C | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 12(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 207

Client: Hasting and Prince Edward District School Board
Location: #207 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 201
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 207

Client: Hasting and Prince Edward District School Board
Location: #207 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 201
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 207

Client: Hasting and Prince Edward District School Board
Location: #207 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 201
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 12 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 207

Client: Hasting and Prince Edward District School Board
Location: #208 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 201
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | | | C | Y | | 100 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 100 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 400(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 208

Client: Hasting and Prince Edward District School Board
Location: #208 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 201
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Concrete (precast) | 400 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 208

Client: Hasting and Prince Edward District School Board
Location: #208 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 201
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 208

Client: Hasting and Prince Edward District School Board
Location: #208 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 201
Last Re-Assessment: 0000-00-00

Area (sqft): 100

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |



ALL DATA REPORT



Formerly Room 208

Client: Hasting and Prince Edward District School Board
Location: #209 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 202
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | | | C | Y | | 50 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 50 | | | SF | V0003 | [None] | 5-10% | [Abated] | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 209

Client: Hasting and Prince Edward District School Board
Location: #209 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 202
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Formerly Room 209

Client: Hasting and Prince Edward District School Board
Location: #209 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 202
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 209

Client: Hasting and Prince Edward District School Board
Location: #209 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 202
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 209

2023-07-10

Client: Hasting and Prince Edward District School Board
Location: #210 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 210
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|----------------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Plaster | | | C | Y | | 25 | | | SF | V0056 | None Detected | N.D. | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 275 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 large and medium uniform pinholes | | | C | Y | | 275 | | | SF | V0011 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Duct | Not Found | N/A | Not Applicable | N/A | | | | | | | % | V0000 | Non-Asbestos | | None | |
| Floor | | Mastic | ALL | Vinyl Floor Tile | D | N | | 300(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Floor | All | Vinyl Floor Tile, 12x12 beige with white and beige blotches | | | A | Y | | 300 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |

Client: Hasting and Prince Edward District School Board
Location: #210 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 210
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|---------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 25 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Concrete (precast) | 1000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #210 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 210
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #210 : Staff Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 210
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #211 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 208
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 400 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 400 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 400 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0064F | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 12(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 211

Client: Hasting and Prince Edward District School Board
Location: #211 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 208
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 211

Client: Hasting and Prince Edward District School Board
Location: #211 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 208
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 211

Client: Hasting and Prince Edward District School Board
Location: #211 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 208
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 12 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 211

Client: Hasting and Prince Edward District School Board
Location: #212 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 212
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 300 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with sparse white and brown flecks | | | A | Y | | 150(7) | | | SF | V0024 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 400 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 795(7) | | 5(3) | SF | S0005E | [Asbestos] | 0.5-5% | [Asbestos] | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |

Includes Rooms 212A

Client: Hasting and Prince Edward District School Board
Location: #212 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 212
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Drywall and joint compound | 800 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Structure | Concrete (precast) | 500 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Rooms 212A

Client: Hasting and Prince Edward District School Board
Location: #212 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 212
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Rooms 212A

Client: Hasting and Prince Edward District School Board
Location: #212 : Classroom

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 212

Area (sqft): 400

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Rooms 212A

Client: Hasting and Prince Edward District School Board
Location: #214 : Theatre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 214
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|----------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | D | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | Bulkhead | Texture Coat | | | C | Y | | 300(7) | | | SF | S0030ABC | Chrysotile | 5-10% | Confirmed Asbestos | F |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Carpet | | | A | Y | | 500 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 600(7) | | | SF | S0064E | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 1000(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 150 | | | LF | V0043 | None Detected | N.D. | None | |

Client: Hasting and Prince Edward District School Board
Location: #214 : Theatre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 214
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | |
|---------|----------------------------|------|------|------|--------|-------------------------|-------------|------------|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
| Wall | Concrete (precast) | 600 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) |
| Wall | Drywall and joint compound | 1000 | | SF | V0005 | Off-white | Pb: .0055 % | No |
| Ceiling | Plaster | 300 | | SF | V0004 | Off-white, texture coat | Pb: .0568 % | Lead (Low) |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) |

Client: Hasting and Prince Edward District School Board
Location: #214 : Theatre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 214
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #214 : Theatre
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 214
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Client: Hasting and Prince Edward District School Board
Location: #215 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 215
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 300 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with sparse white and brown flecks | | | A | Y | | 150(7) | | | SF | V0024 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | 400 | | | SF | | | | | |
| Wall | | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Drywall and joint compound | | | A | Y | | 795(7) | | 5(3) | SF | S0005G | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |

Includes Room 215A

Client: Hasting and Prince Edward District School Board
Location: #215 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 215
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Drywall and joint compound | 800 | | SF | L0005 | Off-white | Pb: .0055 % | No | |
| Structure | Concrete (precast) | 500 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Room 215A

Client: Hasting and Prince Edward District School Board
Location: #215 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 215
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Room 215A

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #215 : Classroom
Survey Date: 2023-05-03

Floor: 2

Room #: 215
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes Room 215A

Client: Hasting and Prince Edward District School Board
Location: #216 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 213
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|----------------------------|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | A | Y | | 200 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Concrete (poured) | | | A | Y | | 200 | | | SF | | | | | |
| Wall | All | Drywall and joint compound | | | A | Y | | 600(7) | | | SF | S0054G | [Asbestos] | 0.5-5% | [Asbestos] | NF |

Formerly Room 216

Client: Hasting and Prince Edward District School Board
Location: #216 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 213
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 216

Client: Hasting and Prince Edward District School Board
Location: #216 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 213
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 216

Client: Hasting and Prince Edward District School Board
Location: #217 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 218
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|------------|--|------|----------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 white with grey flecks | | | A | Y | | 500 | | | SF | V0029 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Other | | Cement Product, Transite drying rack | | | A | Y | | 10(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Other | Countertop | Cement Product, Transite | | | A | Y | | 160(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | S0057E | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | | | | | S0042B | [None] | | [None] | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | S0043G | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 217

Client: Hasting and Prince Edward District School Board
Location: #217 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 218
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | L0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 217

Client: Hasting and Prince Edward District School Board
Location: #217 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 218
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 217

Client: Hasting and Prince Edward District School Board
Location: #217 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 218
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 217

Client: Hasting and Prince Edward District School Board
Location: #218 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 218
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|------------|--|------|----------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 150 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 white with grey flecks | | | A | Y | | 150 | | | SF | V0029 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Other | | Cement Product, Transite drying rack | | | A | Y | | 10(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Other | Countertop | Cement Product, Transite | | | A | Y | | 100(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 200 | | | SF | V0055 | None Detected | N.D. | None | |
| Wall | | Plaster | | | A | Y | | 100 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 500(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 50 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 218

Client: Hasting and Prince Edward District School Board
Location: #218 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 218
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 500 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 150 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 218

Client: Hasting and Prince Edward District School Board
Location: #218 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 218
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 218

Client: Hasting and Prince Edward District School Board
Location: #218 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 218
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 218

Client: Hasting and Prince Edward District School Board
Location: #219 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 219
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|------------|--|------|----------|----|----|-----|--------|------|------|------|----------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 white with grey flecks | | | A | Y | | 500 | | | SF | S0029ABC | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Other | | Cement Product, Transite drying rack | | | A | Y | | 10(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Other | Countertop | Cement Product, Transite | | | A | Y | | 160(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 200 | | | SF | S0055C | None Detected | N.D. | None | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0064C | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #219 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 219
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #219 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 219
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

**Client: Hasting and Prince Edward District
School Board**
Location: #219 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 219
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #220 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 220
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|------------|--|------|----------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 500 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 white with grey flecks | | | A | Y | | 500 | | | SF | V0029 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Other | | Cement Product, Transite drying rack | | | A | Y | | 10(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Other | Countertop | Cement Product, Transite | | | A | Y | | 160(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 400 | | | SF | S0055B | None Detected | N.D. | None | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Room 220A

Client: Hasting and Prince Edward District School Board
Location: #220 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 220
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Structure | Drywall and joint compound | 400 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Room 220A

Client: Hasting and Prince Edward District School Board
Location: #220 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 220
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Room 220A

Client: Hasting and Prince Edward District School Board
Location: #220 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 220
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Includes Room 220A

Client: Hasting and Prince Edward District School Board
Location: #223 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 223
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling tiles (glue-on), 1x1 large and small random pinhole | | | C | Y | | 100 | | | SF | V0019 | None Detected | N.D. | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | S0036B | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 400 | | | SF | S0048A | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 500 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0064A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #223 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 223
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #223 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 223
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #224 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 224
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling tiles (glue-on), 1x1 large and small random pinhole | | | C | Y | | 100 | | | SF | V0019 | None Detected | N.D. | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 400 | | | SF | S0048B | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 500 | | | SF | V0022 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #224 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 224
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #224 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 224
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

School Board
Location: #224 : Classroom
Survey Date: 2023-05-03

Floor: 2

Room #: 224
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #225 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 225
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling tiles (glue-on), 1x1 large and small random pinhole | | | C | Y | | 100 | | | SF | S0019C | None Detected | N.D. | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | S0036C | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 400 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 500 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0064B | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #225 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 225
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #225 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 225
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

School Board
Location: #225 : Classroom
Survey Date: 2023-05-03

Floor: 2

Room #: 225
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #226 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 226
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|------------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 500 | | | SF | V0047 | None Detected | N.D. | None | |
| Ceiling | Bulkhead | Drywall and joint compound | | | C | Y | | 175 | | | SF | S0055A | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 turquoise with white flecks | | | A | Y | | 500 | | | SF | V0023 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Other | | Cement Product, Transite drying rack | | | A | Y | | 10(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Other | Countertop | Cement Product, Transite | | | A | Y | | 160(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #226 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 226
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Ceiling | Drywall and joint compound | 175 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | L0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #226 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 226
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #226 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 226
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #227 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 227
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 dense short widthwise fissures, 01/25/2008 | | | C | Y | | 150 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | | Plaster | | | C | N | | 150 | | | SF | V0057 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 turquoise with white flecks | | | A | Y | | 100 | | | SF | V0023 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 200 | | | SF | V0055 | None Detected | N.D. | None | |
| Wall | | Plaster | | | A | Y | | 50 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 400(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 40 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes Room 227A

Client: Hasting and Prince Edward District School Board
Location: #227 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 227
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PAINT | | | | | | | | | |
|---------|----------------------------|------|------|------|--------|---------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 400 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Plaster | 150 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Drywall and joint compound | 200 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Includes Room 227A

Client: Hasting and Prince Edward District School Board
Location: #227 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 227
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Includes Room 227A

Client: Hasting and Prince Edward District School Board
Location: #227 : Resource Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 227
Last Re-Assessment: 0000-00-00

Area (sqft): 150

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Includes Room 227A

Client: Hasting and Prince Edward District School Board
Location: #228 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 228
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|------------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 500 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 medium and large pinholes with flecks | | | C | Y | | 500 | | | SF | V0047 | None Detected | N.D. | None | |
| Ceiling | Bulkhead | Drywall and joint compound | | | C | Y | | 175 | | | SF | V0055 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 turquoise with white flecks | | | A | Y | | 500 | | | SF | S0023B | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Other | | Cement Product, Transite drying rack | | | A | Y | | 10(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Other | Countertop | Cement Product, Transite | | | A | Y | | 160(7) | | | SF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #228 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 228
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | L0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Ceiling | Drywall and joint compound | 175 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #228 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 228
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #228 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 228
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #229 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 211
Last Re-Assessment: 0000-00-00

Area (sqft): 100

ASBESTOS

| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| Ceiling | All | Plaster | | | C | Y | | 100 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Concrete (poured) | | | A | Y | | 50 | | | SF | | | | | |
| Floor | | Terrazzo | | | A | Y | | 50 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 229

Client: Hasting and Prince Edward District School Board
Location: #229 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 211
Last Re-Assessment: 0000-00-00

Area (sqft): 100

PAINT

| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
|---------|--------------------|------|------|------|--------|--------------------|-------------|------------|
| Ceiling | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) |
| Ceiling | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) |
| Floor | Concrete (poured) | 50 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) |

Formerly Room 229

Client: Hasting and Prince Edward District School Board
Location: #229 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 211
Last Re-Assessment: 0000-00-00

Area (sqft): 100

MERCURY

| Component | Quantity | Unit | Sample | Hazard |
|------------------------|----------|------|--------|--------|
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 229

Client: Hasting and Prince Edward District School Board
Location: #229 : Storage
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 211
Last Re-Assessment: 0000-00-00

Area (sqft): 100

PCB

| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
|----------------|----------|------|--------|--------------------|--------|-----|
| Light Ballasts | | | V0000 | | | No |



ALL DATA REPORT



Formerly Room 229

Client: Hasting and Prince Edward District School Board
Location: #230 : Mechanical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 207
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|--------------------|--------------------|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | Not Insulated | | | B | Y | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | B | Y | | 400 | | | SF | | | | | |
| Mechanical Equipment | Heating Water Tank | Fibreglass | ALL | Metal | B | Y | | | | | | | | | | |
| Piping | | Aircell | | | B | Y | | 100(7) | | | LF | S0001B | Chrysotile | 50-75% | Confirmed Asbestos | F |
| Piping | All | Parging Cement | | | B | Y | | 15(7) | | | | S0006B | Chrysotile | 25-50% | Confirmed Asbestos | F |
| Structure | All | Metal | | | C | N | | 400 | | | SF | | | | | |
| Wall | All | Concrete (precast) | | | B | Y | | | | | | | | | | |

Formerly Room 230

Client: Hasting and Prince Edward District School Board
Location: #230 : Mechanical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 207
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|-------------------|------|------|------|--------|---------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Floor | Concrete (poured) | 400 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Other | Metal | 100 | | SF | V0011 | Off-white, radiator | Pb: .0828 % | Lead (Low) | |

Formerly Room 230

Client: Hasting and Prince Edward District School Board
Location: #230 : Mechanical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 207
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Formerly Room 230

Client: Hasting and Prince Edward District School Board
Location: #230 : Mechanical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 207
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|---------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Mercury Vapour Lamp | 100 | % | V9000 | Yes |

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |
| Thermostat | 100 | % | V9000 | Yes |

Formerly Room 230

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #230 : Mechanical Room

Floor: 2

Room #: 207

Area (sqft): 400

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 230

Client: Hasting and Prince Edward District School Board
Location: #231 : Electrical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 209
Last Re-Assessment: 0000-00-00

Area (sqft): 200

ASBESTOS

| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
|----------------------|-----------|--------------------|------|----------|----|----|-----|------|------|------|------|--------|---------------|--------|--------|---------|
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | B | Y | | 200 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 200 | | | SF | | | | | |
| Wall | All | Concrete (precast) | | | B | Y | | | | | | | | | | |

Formerly Room 231, Includes Room 209A

Client: Hasting and Prince Edward District School Board
Location: #231 : Electrical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 209
Last Re-Assessment: 0000-00-00

Area (sqft): 200

PAINT

| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
|-----------|-------|------|------|------|--------|--------------------|------------|-------------|
| Structure | Metal | 200 | | SF | V0001 | Red | Pb: .393 % | Lead (High) |

Formerly Room 231, Includes Room 209A

Client: Hasting and Prince Edward District School Board
Location: #231 : Electrical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 209
Last Re-Assessment: 0000-00-00

Area (sqft): 200

MERCURY

| Component | Quantity | Unit | Sample | Hazard |
|------------------------|----------|------|--------|--------|
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 231, Includes Room 209A

Client: Hasting and Prince Edward District School Board
Location: #231 : Electrical Room
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 209
Last Re-Assessment: 0000-00-00

Area (sqft): 200

PCB

| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
|----------------|----------|------|--------|--------------------|--------|-----|
| Light Ballasts | | | V0000 | | | No |
| Transformer | | | V0000 | | | No |

Formerly Room 231, Includes Room 209A

Client: Hasting and Prince Edward District School Board
Location: #250 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 249
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|-------------------------|----|----|-----|---------|------|------|------|---------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 300 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | | Plaster, Closets | | | C | Y | | 100 | | | SF | V0056 | None Detected | N.D. | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 100 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 random pinholes | | | C | Y | | 100 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 white with grey flecks | | | A | Y | | 500 | | | SF | V0029 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 300 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | | SF | S0061BC | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 120 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 18(7) | | | EA | S0041C | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 250, Includes Rooms 249A-B

Client: Hasting and Prince Edward District School Board
Location: #250 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 249
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 300 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 1200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 500 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Ceiling | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |

Formerly Room 250, Includes Rooms 249A-B

Client: Hasting and Prince Edward District School Board
Location: #250 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 249
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 250, Includes Rooms 249A-B

Client: Hasting and Prince Edward District School Board
Location: #250 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 249
Last Re-Assessment: 0000-00-00

Area (sqft): 500

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 18 | EA | P0002 | | <5 mg/kg | No |

Formerly Room 250, Includes Rooms 249A-B

Client: Hasting and Prince Edward District School Board
Location: #251 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 251
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 350 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 50 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 random pinholes | | | C | Y | | 50 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 400 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | S0056C | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0061 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Drywall and joint compound, Lab Report Reference R6857108 (S0054F) | | | A | Y | | 300 | | | SF | S0058G | None Detected | N.D. | None | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 12(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #251 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 251
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Wall | Drywall and joint compound | 300 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Structure | Metal | 400 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Client: Hasting and Prince Edward District School Board
Location: #251 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 251
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #251 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 251
Last Re-Assessment: 0000-00-00

Area (sqft): 400

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 12 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #252 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 252
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 250 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 50 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 random pinholes | | | C | Y | | 50 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 300 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0061 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Drywall and joint compound | | | A | Y | | 100 | | | SF | V0058 | [None] | | [None] | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #252 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 252
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Wall | Drywall and joint compound | 100 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Structure | Metal | 300 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Client: Hasting and Prince Edward District School Board
Location: #252 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 252
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #252 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 252
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #253 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 253
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 300 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 large and medium uniform pinholes | | | C | Y | | 300 | | | SF | V0011 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 300(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0061A | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #253 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 253
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #253 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 253
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #253 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 253
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #254 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 254
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 300 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 large and medium uniform pinholes | | | C | Y | | 300 | | | SF | V0011 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 300(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0061 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #254 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 254
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #254 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 254
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #254 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 254
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #255 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 258
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 300 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 large and medium uniform pinholes | | | C | Y | | 300 | | | SF | V0011 | None Detected | N.D. | None | |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | | A | Y | | 300(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | S0061D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 255

Client: Hasting and Prince Edward District School Board
Location: #255 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 258
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Formerly Room 255

Client: Hasting and Prince Edward District School Board
Location: #255 : Classroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 258
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 255

Client: Hasting and Prince Edward District

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Client: Hasting and Prince Edward District School Board
Location: #257 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 257
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---------------------|------|--------------|----|----|-----|--------|------|------|------|---------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | ALL | Texture Coat | D | N | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Ceiling | All | Texture Coat | | | C | Y | | 200(7) | | | SF | S0012BC | Chrysotile | 5-10% | Confirmed Asbestos | F |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 200 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 400 | | | SF | V0056 | None Detected | N.D. | None | |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Client: Hasting and Prince Edward District School Board
Location: #257 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 257
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|---------|---------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Plaster | 400 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |

Client: Hasting and Prince Edward District School Board
Location: #257 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 257
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Client: Hasting and Prince Edward District School Board
Location: #257 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 257
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Client: Hasting and Prince Edward District School Board
Location: #258 : Custodial Closet
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 256
Last Re-Assessment: 0000-00-00

Area (sqft): 50

ASBESTOS

| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
|----------------------|-----------|--------------------------|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| Ceiling | All | Plaster | | | C | Y | | 50 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Concrete (poured) | | | A | Y | | 50 | | | SF | | | | | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Paint, On concrete block | | | A | Y | | 200(7) | | | SF | V0061 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 258

Client: Hasting and Prince Edward District School Board
Location: #258 : Custodial Closet
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 256
Last Re-Assessment: 0000-00-00

Area (sqft): 50

PAINT

| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard |
|---------|--------------------|------|------|------|--------|--------------------|-------------|------------|
| Ceiling | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) |
| Ceiling | Concrete (precast) | 200 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) |
| Floor | Concrete (poured) | 50 | | SF | V0002 | Grey | Pb: .0958 % | Lead (Low) |

Formerly Room 258

Client: Hasting and Prince Edward District School Board
Location: #258 : Custodial Closet
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 256
Last Re-Assessment: 0000-00-00

Area (sqft): 50

MERCURY

| Component | Quantity | Unit | Sample | Hazard |
|------------------------|----------|------|--------|--------|
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 258

Client: Hasting and Prince Edward District School Board
Location: #258 : Custodial Closet
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 256
Last Re-Assessment: 0000-00-00

Area (sqft): 50

PCB

| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
|----------------|----------|------|--------|--------------------|--------|-----|
| Light Ballasts | | | V0000 | | | No |

Formerly Room 258
2023-07-10

Client: Hasting and Prince Edward District School Board
Location: #259 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 255
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--------------------------|------|--------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | ALL | Texture Coat | D | N | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Ceiling | All | Texture Coat | | | C | Y | | 200(7) | | | SF | V0012 | Chrysotile | 5-10% | Confirmed Asbestos | F |
| Duct | All | None Found | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 200 | | | SF | V0044 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 400 | | | SF | V0056 | None Detected | N.D. | None | |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Paint, On concrete block | | | A | Y | | 400(7) | | | SF | S0061G | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 259

Client: Hasting and Prince Edward District School Board
Location: #259 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 255
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|---------|---------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Plaster | 400 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |

Formerly Room 259

Client: Hasting and Prince Edward District School Board
Location: #259 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 255
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 259

Client: Hasting and Prince Edward District School Board
Location: #259 : Washroom

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 255

Area (sqft): 200

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 259

Client: Hasting and Prince Edward District School Board
Location: #260 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 295
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|-------------------------|----|----|-----|---------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Plaster, Stairwells | | | C | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | D | N | | 2000 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1medium and large uniform pinholes | | | C | Y | | 2000 | | | SF | V0011 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 2000 | | | SF | S0044D | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Concrete (precast) | | | C | N | | 2000 | | | SF | | | | | |
| Wall | | Plaster, Above lockers | | | A | Y | | 2000 | | | SF | V0056 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | | SF | S0061F | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | Stairs | Masonry | | Paint | A | Y | | | | | | | | | | |
| Wall | Stairs | Paint, On brick | | | A | Y | | 250(7) | | | SF | S0060C | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 260

Client: Hasting and Prince Edward District School Board
Location: #260 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 295
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 2000 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 2000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Formerly Room 260

Client: Hasting and Prince Edward District School Board
Location: #260 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 295
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Formerly Room 260

Client: Hasting and Prince Edward District

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Client: Hasting and Prince Edward District School Board
Location: #261 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 290
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|---------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 2000 | | | SF | V0000 | Non-Asbestos | | None | |
| Duct | All | Not Insulated | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 2000 | | | SF | S0044F | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | Fibreglass | ALL | Paper | C | N | | | | | | | | | | |
| Structure | All | Concrete (precast) | | | C | N | | 2000 | | | SF | | | | | |
| Wall | | Plaster, Above lockers | | | A | Y | | 2000 | | | SF | S0009FG | None Detected | N.D. | None | |
| Wall | | Plaster, Above lockers | | | A | Y | | | | | | S0057D | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | | SF | V0064 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 261

Client: Hasting and Prince Edward District School Board
Location: #261 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 290
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PAINT | | | | | | | | | |
|--------|--------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 2000 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 2000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |

Formerly Room 261

Client: Hasting and Prince Edward District School Board
Location: #261 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 290
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Formerly Room 261

Client: Hasting and Prince Edward District School Board
Location: #261 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 290
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 261

Client: Hasting and Prince Edward District School Board
Location: #261 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 290
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 261

Client: Hasting and Prince Edward District School Board
Location: #262 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 292
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|---------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 2000 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | | Plaster, Stairwells | | | C | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | | | | | | | | | | | | |
| Floor | All | Terrazzo | | | A | Y | | 2000 | | | SF | S0044G | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | C | N | | 2000 | | | SF | | | | | |
| Wall | | Plaster, Above lockers | | | A | Y | | 2000 | | | SF | V0056 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 2000(7) | | | SF | S0064D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |

Formerly Room 262

Client: Hasting and Prince Edward District School Board
Location: #262 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 292
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PAINT | | | | | | | | | |
|-----------|--------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 2000 | | SF | L0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 2000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 2000 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Formerly Room 262

Client: Hasting and Prince Edward District School Board
Location: #262 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 292
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PB PRODUCTS | | | | |
|---------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Batteries In Emer. Lights | 100 | % | V9000 | Yes |

Formerly Room 262

Client: Hasting and Prince Edward District School Board
Location: #262 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 292
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 262

Client: Hasting and Prince Edward District School Board
Location: #262 : Corridor
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 292
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Formerly Room 262

Client: Hasting and Prince Edward District School Board
Location: #263 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 203
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | | | C | Y | | 50 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, Off-white with grey flecks | | | A | Y | | 50 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 100(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | | Plaster | | | A | Y | | 100 | | | SF | V0056 | None Detected | N.D. | None | |

Formerly Room 263

Client: Hasting and Prince Edward District School Board
Location: #263 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 203
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PAINT | | | | | | | | | |
|---------|----------------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Drywall and joint compound | 100 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Ceiling | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |

Formerly Room 263

Client: Hasting and Prince Edward District School Board
Location: #263 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 203
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 263

Client: Hasting and Prince Edward District School Board
Location: #263 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 203
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |



ALL DATA REPORT



Formerly Room 263

Client: Hasting and Prince Edward District School Board
Location: #264 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 206
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | | | C | Y | | 50 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, Off-white with grey flecks | | | A | Y | | 50 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Drywall and joint compound | | | A | Y | | 100(7) | | | SF | V0054 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | | Plaster | | | A | Y | | 100 | | | SF | V0056 | None Detected | N.D. | None | |

Formerly Room 264

Client: Hasting and Prince Edward District School Board
Location: #264 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 206
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PAINT | | | | | | | | | |
|---------|----------------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Ceiling | Plaster | 50 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Drywall and joint compound | 100 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Ceiling | Plaster | 100 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |

Formerly Room 264

Client: Hasting and Prince Edward District School Board
Location: #264 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 206
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 264

Client: Hasting and Prince Edward District School Board
Location: #264 : Washroom
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 206
Last Re-Assessment: 0000-00-00

Area (sqft): 50

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |



ALL DATA REPORT



Formerly Room 264

Client: Hasting and Prince Edward District School Board
Location: #265 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 259
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|--|------|----------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | Plaster | | | C | Y | | 200 | | | SF | V0056 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | Y | | | | | | | | | | |
| Floor | | Vinyl Floor Tile and Mastic, 12x12 beige with white and beige blotches | | | A | Y | | 150 | | | SF | V0022 | None Detected | N.D. | None | |
| Floor ¹ | All | Vinyl Floor Tile and Mastic, 9x9 various colours | | Paint | A | Y | | 50(7) | | | SF | V0003 | Chrysotile | 5-10% | Confirmed Asbestos | NF |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | None Found | | | | | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 100 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 600(7) | | | SF | S0061E | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Drywall and joint compound | | | A | Y | | 250 | | | SF | V0058 | [None] | | [None] | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 60 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 3(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 265, Includes Room 295A
1 - Vestibule

Client: Hasting and Prince Edward District School Board
Location: #265 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 259
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PAINT | | | | | | | | | |
|---------|----------------------------|------|------|------|--------|--------------------|-------------|------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 600 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Ceiling | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Ceiling | Drywall and joint compound | 250 | | SF | V0005 | Off-white | Pb: .0055 % | No | |

Formerly Room 265, Includes Room 295A

Client: Hasting and Prince Edward District School Board
Location: #265 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 259
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 265, Includes Room 295A

Client: Hasting and Prince Edward District School Board
Location: #265 : Office
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 259
Last Re-Assessment: 0000-00-00

Area (sqft): 200

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 3 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 265, Includes Room 295A

Client: Hasting and Prince Edward District School Board
Location: #266 : Offices
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 250
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|-----------|---|------|-------------------------|----|----|-----|--------|------|------|------|--------|---------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | | Ceiling Tiles (lay-in), 2x4 thick widthwise fissures and pinholes, 2007 | | | C | Y | | 250 | | | SF | V0000 | Non-Asbestos | | None | |
| Ceiling | | Adhesive/mastic | ALL | Ceiling tiles (glue-on) | C | Y | | 50 | | | SF | V0036 | None Detected | N.D. | None | |
| Ceiling | All | Ceiling tiles (glue-on), 1x1 random pinholes | | | C | Y | | 50 | | | SF | V0047 | None Detected | N.D. | None | |
| Duct | All | Not Insulated | | | C | N | | | | | | | | | | |
| Floor | All | Vinyl Floor Tile and Mastic, 12x12 off-white with grey flecks | | | A | Y | | 300 | | | SF | V0018 | None Detected | N.D. | None | |
| Mechanical Equipment | All | None Found | | | | | | | | | | | | | | |
| Piping | All | None Found | | | | | | | | | | | | | | |
| Structure | All | Metal | | | D | N | | | | | | | | | | |
| Wall | | Plaster | | | A | Y | | 200 | | | SF | V0057 | None Detected | N.D. | None | |
| Wall | | Paint, On concrete block | | | A | Y | | 800(7) | | | SF | V0061 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Concrete (precast) | | | A | Y | | | | | | | | | | |
| Wall | All | Drywall and joint compound | | | A | Y | | 300 | | | SF | V0058 | [None] | | [None] | |
| Wall | Base | Adhesive/mastic | ALL | Rubber | D | N | | 100 | | | LF | V0043 | None Detected | N.D. | None | |
| Wall | Window | Caulking, Soft grey | | | A | Y | | 9(7) | | | EA | V0041 | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Formerly Room 266

Client: Hasting and Prince Edward District School Board
Location: #266 : Offices
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 250
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Plaster | 200 | | SF | V0004 | Off-white | Pb: .0568 % | Lead (Low) | |
| Wall | Concrete (precast) | 800 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Wall | Drywall and joint compound | 300 | | SF | V0005 | Off-white | Pb: .0055 % | No | |
| Structure | Metal | 300 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |

Formerly Room 266

Client: Hasting and Prince Edward District School Board
Location: #266 : Offices
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 250
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| MERCURY | | | | |
|------------------------|----------|------|--------|--------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |

Formerly Room 266

Client: Hasting and Prince Edward District School Board
Location: #266 : Offices
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 250
Last Re-Assessment: 0000-00-00

Area (sqft): 300

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|----------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |
| Caulking | 9 | EA | V0002 | | <5 mg/kg | No |

Formerly Room 266

Client: Hasting and Prince Edward District School Board
Location: #280 : Penthouse
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 280
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| ASBESTOS | | | | | | | | | | | | | | | | |
|----------------------|--------------------|----------------------------|------|--------------------------|----|----|-----|---------|------|------|------|---------------|-------------------|--------|--------------------|---------|
| System | Component | Material | Item | Covering | A* | V* | AP* | Good | Fair | Poor | Unit | Sample | Asbestos Type | Amount | Hazard | Friable |
| Ceiling | All | None Found | | | | | | | | | | | | | | |
| Duct | All | Fibreglass | ALL | Canvas | B | Y | | | | | | | | | | |
| Floor | All | Concrete (poured) | | | B | Y | | 2000 | | | SF | | | | | |
| Mechanical Equipment | Air Handling Unit | Fibreglass | ALL | Canvas | B | Y | | | | | | | | | | |
| Mechanical Equipment | Boiler | Fibreglass, Post-2000 | ALL | Metal | B | Y | | | | | | | | | | |
| Mechanical Equipment | Heating Water Tank | Fibreglass | ALL | Metal | B | Y | | | | | | | | | | |
| Mechanical Equipment | Unit Heater | Not Insulated | | | B | Y | | | | | | | | | | |
| Piping | All | Fibreglass | ALL | Polyvinyl chloride (PVC) | B | Y | | | | | | | | | | |
| Piping | Rain Water Leader | Cement Product, Transite | | | C | Y | | 50(7) | | | LF | V9500 | Presumed Asbestos | | Presumed Asbestos | NF |
| Structure | All | Metal | | | C | N | | 2000 | | | SF | | | | | |
| Wall | | Drywall and joint compound | | | B | Y | | 500(7) | | | SF | S0053F | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |
| Wall | All | Paint, On concrete block | | | B | Y | | | | | | S0042E | [None] | | [None] | |
| Wall | All | Paint, On concrete block | | | B | Y | | 4000(7) | | | SF | S0068ABC D | Chrysotile | 0.5-5% | Confirmed Asbestos | NF |

Includes 281 and 282

Client: Hasting and Prince Edward District School Board
Location: #280 : Penthouse
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 280
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| PAINT | | | | | | | | | |
|-----------|----------------------------|------|------|------|--------|--------------------|-------------|-------------|--|
| System | Item | Good | Poor | Unit | Sample | Sample Description | Amount | Hazard | |
| Wall | Concrete (precast) | 4000 | | SF | V0007 | Yellow | Pb: .0945 % | Lead (Low) | |
| Structure | Metal | 2000 | | SF | V0001 | Red | Pb: .393 % | Lead (High) | |
| Floor | Concrete (poured) | 2000 | | SF | L0002 | Grey | Pb: .0958 % | Lead (Low) | |
| Floor | Drywall and joint compound | 500 | | SF | V0005 | Off-white | Pb: .0055 % | No | |

Includes 281 and 282

Client: Hasting and Prince Edward District School Board
Location: #280 : Penthouse
Survey Date: 2023-05-03

Site: 275 Farley Avenue, Belleville, ON
Floor: 2

Building Name: Eastside Secondary School
Room #: 280
Last Re-Assessment: 0000-00-00

Area (sqft): 2000

| MERCURY | | | | |
|------------------------|----------|------|--------|----------|
| Component | Quantity | Unit | Sample | Hazard |
| Fluorescent Light Tube | 100 | % | V9000 | Yes |
| Thermostat | 100 | % | V9000 | Yes |
| Boiler Control | 100 | % | V9500 | Presumed |

Includes 281 and 282

Client: Hasting and Prince Edward District School Board

Site: 275 Farley Avenue, Belleville, ON

Building Name: Eastside Secondary School

Location: #280 : Penthouse

Floor: 2

Room #: 280

Area (sqft): 2000

Survey Date: 2023-05-03

Last Re-Assessment: 0000-00-00

| PCB | | | | | | |
|----------------|----------|------|--------|--------------------|--------|-----|
| Component | Quantity | Unit | Sample | Sample Description | Amount | PCB |
| Light Ballasts | | | V0000 | | | No |

Includes 281 and 282

Legend:

| Sample number | | Units | | Other | |
|---------------|--|-------|-------------|-------|------------------------------|
| S#### | Asbestos sample collected | SF | Square feet | A | Access |
| L#### | Paint sample collected | LF | Linear feet | V | Visible |
| P#### | PCB sample collected | EA | Each | AP | Air Plenum |
| M#### | Mould sample collected | % | Percentage | F | Friable material |
| V#### | Material is visually identified to be identical to S#### | LF | Linear feet | NF | Non Friable material |
| V0000 | Known non hazardous material | | | PF | Potentially Friable material |
| V9000 | Material visually identified as a Hazardous Material | | | Pb | Lead |
| V9500 | Material is presumed to be a hazardous material | | | Hg | Mercury |
| | | | | As | Arsenic |
| | | | | Cr | Chromium |

| Access | |
|--------|---|
| A | Accessible to all building occupants |
| B | Accessible to maintenance and operations staff without a ladder |
| C | Accessible to maintenance and operations staff with a ladder. Also rarely entered, locked areas |
| D | Not normally accessible |

| Condition | |
|-----------|---|
| Good | No visible damage or deterioration |
| Fair | Minor, repairable damage, cracking, delamination or deterioration |
| Poor | Irreparable damage or deterioration with exposed and missing material |

| Visible | |
|---------|---|
| Y | The material is visible when standing on the floor of the room, without the removal or opening of other building components (e.g. ceiling tiles or access panels). |
| N | The material is not visible to view when standing on the floor of the room and requires the removal of a building component (e.g. ceilings tiles or access panels) to view and access. Includes rarely entered crawlspaces, attic spaces, etc. Observations will be limited to the extent visible from the access points. |

| Air Plenum | |
|------------|---|
| Yes or No | The material is in a return air plenum or in a direct airstream or there is evidence of air erosion (e.g. duct for heating or cooling blowing directly on or across an ACM). This field is only completed where Air Plenum consideration is required by regulation. |

| Colour Coding | |
|--|---|
|  | The material is known to contain regulated concentrations of asbestos; either by analytical results or visible identification (use of the V9000 code). |
|  | The material is presumed to contain asbestos; based on visual appearances; typically a material known to historically contain asbestos; however, not sampled due to limited access or the destructive nature of the sampling. |

| Action | | | | | |
|--------|--|-----|--|-----|-------------|
| (1) | Clean up of ACM Debris | (2) | Precautions for Access Which may Disturb ACM Debris | (3) | ACM removal |
| (4) | Precautions for Work Which may Disturb ACM in Poor Condition | (5) | Proactive ACM removal (Minimum repair required for fair condition) | (6) | ACM repair |
| (7) | Management program and surveillance | | | | |