







PHOTO-P3



PHOTO-P2



PHOTO-P1

**DEMOLITION NOTES**

- PATCH, REPAIR AND MAKE GOOD AT ALL AFFECTED SURFACES AND FINISHES AFFECTED BY DEMOLITION AND NEW CONSTRUCTION.**
1. EXISTING MECHANICAL DUST COLLECTOR AND DUCT WORK TO BE REMOVED IN ITS ENTIRETY. REFER TO MECHANICAL & ELECTRICAL. ALL FINISHES BY THE REMOVAL SHALL BE RESTORED TO EXISTING CONDITIONS.
  2. REMOVE AND DISPOSE OF EXISTING WALL ASSEMBLY IN ITS ENTIRETY, INCLUDING STRUCTURE AND VENEER. PATCH, REPAIR, AND MAKE GOOD ALL AFFECTED SURFACES AS REQUIRED FOR NEW WORK. MATCH BRICK VENEER TO EXISTING. REMOVE EXISTING CONCRETE FOUNDATION WALLS - 400mm BELOW FINISHED GRADE.
  3. REMOVE AND DISPOSE OF EXISTING ROOF AND CEILING ASSEMBLY IN ITS ENTIRETY. PATCH, REPAIR, AND MAKE GOOD ALL AFFECTED SURFACES AS REQUIRED FOR NEW WORK.
  4. REMOVE AND DISPOSE OF EXISTING CONCRETE SLAB AND GRADE BEAM FOUNDATION. BACKFILL SITE WITH CLEAN FILL AND COMPACT IN ACCORDANCE WITH LOCAL REQUIREMENTS TO MATCH EXISTING GRADE.
  5. EXISTING CONCRETE PAD TO BE REMOVED IN ITS ENTIRETY. PATHWAY AND SOG TO BE PATCHED, REPAIRED AND MAKE GOOD ALL AFFECTED SURFACES FOR NEW WORK. REMOVE 200mm OVER EXISTING FOUNDATION WALLS TO SEAT NEW BASE PLATE FOR COLUMN.
  6. EXISTING EXTERIOR WALL TO BE PROTECTED DURING NEW WORK. PATCH, REPAIR AND MAKE GOOD ALL AFFECTED SURFACES. MATCH EXISTING BRICK VENEER.
  7. EXISTING DOOR AND FRAME TO BE PROTECTED DURING NEW WORK. PATCH, REPAIR AND MAKE GOOD ALL AFFECTED SURFACES.
  8. EXISTING OVERHEAD CANOPY AND COLUMNS TO BE PROTECTED AND SUPPORTED DURING NEW WORK. PATCH, REPAIR AND MAKE GOOD ALL AFFECTED SURFACES.
  9. DETACH AND REINSTATE EXISTING SECURITY CAMERAS AFTER COMPLETION OF WORK (COORDINATE WITH OWNER).
  10. REMOVE AND DISPOSE OF EXISTING DOOR AND FRAME. PATCH, REPAIR AND MAKE GOOD AFFECTED SURFACES AS REQUIRED FOR NEW WORK.

**TYPICAL DEMOLITION NOTES**

1. SITE VERIFY ALL DIMENSIONS AND CONDITIONS.
2. ALL WORK TO BE IN ACCORDANCE WITH THE ONTARIO BUILDING CODE.
3. COMPLY WITH THE OCCUPATIONAL HEALTH AND SAFETY ACT REGULATIONS FOR CONSTRUCTION PROJECTS.
4. PROVIDE PROTECTION IN LOCATIONS APPROVED BY THE OWNER AND CONSULTANT SO AS NOT TO DAMAGE EXISTING STRUCTURE, LANDSCAPE OR PART THEREOF.
5. COMPLETE ALL DEMOLITION WORK NECESSARY TO COMPLETE THE RENOVATIONS AS SHOWN AND AS REQUIRED. DEMOLITION OF BUILDING ELEMENTS INCLUDES BUT NOT LIMITED TO COMPLETE REMOVAL OF ALL ASSOCIATED FIXTURES, FITTINGS, HARDWARE, FASTENERS, EQUIPMENT AND ACCESSORIES UNLESS NOTED OTHERWISE.
6. ARCHITECTURAL, STRUCTURAL, MECHANICAL AND ELECTRICAL DEMOLITION DRAWINGS ARE COMPLEMENTARY AND SHALL BE READ TOGETHER.
7. PROVIDE ALL SHORING AS REQUIRED. SHORING SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER.
8. NOTIFY CONSULTANT OF LOAD BEARING MEMBERS OR ASSEMBLIES IDENTIFIED OR DISCOVERED DURING WORK AND NOT INDICATED ON DRAWINGS DO NOT PROCEED WITH REMOVALS WITHOUT PRIOR REVIEW BY THE CONSULTANT.
9. PROVIDE TEMPORARY SUPPORT OF PIPES, DUCTS AND ELECTRICAL CHASES AS REQUIRED FOR SAFE REMOVAL. EXISTING AND PROPOSED SUPPORTS ARE TO BE REVIEWED BY THE CONSULTANT PRIOR TO THE REMOVAL OF ANY COMPONENTS WHICH MAY FALL OR CAUSE OTHERS TO FALL.
10. MAINTAIN ALL WORK AREAS AND ALL STORAGE AREAS CLEAN AND ORDERLY AT ALL TIMES INCLUDING EXISTING AREAS THAT REMAIN IN OPERATION DURING CONSTRUCTION. DUST CONTROL MEASURES ARE TO BE IN PLACE AT ALL TIMES AND NOisy WORK SHALL BE COORDINATED AROUND PROGRAM EVENTS.
11. DISCONNECT AND CAP OFF ALL REQUIRED SERVICES PRIOR TO DEMOLITION.
12. DISPOSE MATERIALS OFF SITE. RECYCLE WHERE POSSIBLE (CONFIRM WITH OWNER).
13. DEMOLITION INCLUDES ALL ASSOCIATED MECHANICAL AND ELECTRICAL SERVICES, EQUIPMENT, FITTINGS, FIXTURES, HANGERS, BRACKETS, TRIM AND ACCESSORIES AS REQUIRED TO COMPLETE THE WORK.
14. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE EXISTING STRUCTURE OR FINISHES SHOWN TO REMAIN AND REPAIR/REPLACE SAME TO THE SATISFACTION OF THE OWNER AND CONSULTANT.
15. BUILDING TO BE SECURED BY THE GENERAL CONTRACTOR AT ALL TIMES.


**DEMOLITION LEGEND**

- EXISTING WALL, PARTITION OR COLUMN
- DENOTES DEMOLITION OF BUILDING ELEMENT
- WORK N.I.C.
- EXISTING DOOR, FRAME AND TRIM TO REMAIN
- EXISTING DOOR, FRAME AND TRIM TO BE CAREFULLY REMOVED AND DISPOSED OF.

DO NOT SCALE THE DRAWINGS. CHECK AND VERIFY ALL DIMENSIONS AT THE SITE. ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN. DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES	DATE	BY
1	ISSUED FOR CLIENT REVIEW		BBA
2	ISSUED FOR PERMIT & TENDER	FEB. 09, 2026	BBA

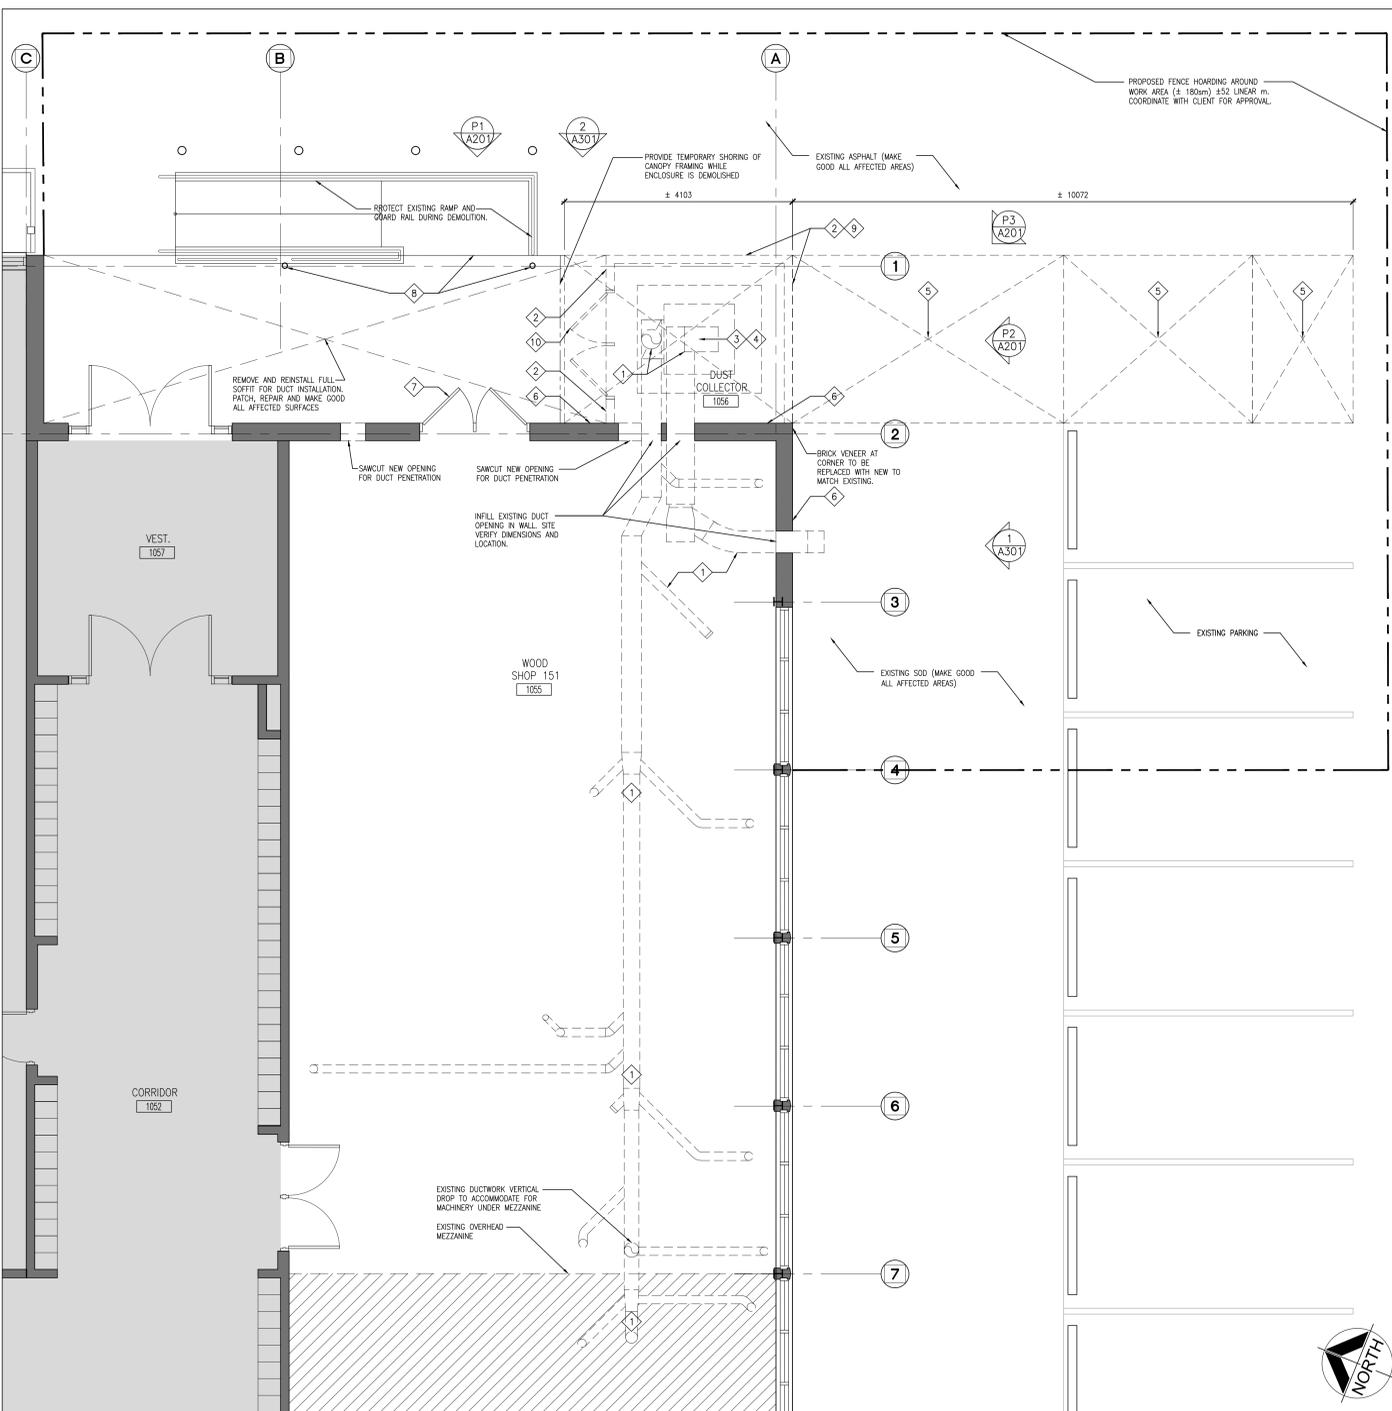

1 PART FIRST FLOOR DEMOLITION PLAN  
1:50

NO.	REVISIONS	DATE	BY

**PROJECT:**  
**EASTSIDE SECONDARY SHOP DUST COLLECTOR REPLACEMENT**

275 FARLEY AVENUE  
 BELLEVILLE, ONTARIO  
 HASTINGS & PRINCE EDWARD DISTRICT SCHOOL BOARD

**DRAWING:**  
**PART FIRST FLOOR DEMOLITION PLAN**



**BARRY BRYAN ASSOCIATES**  
 Architects  
 Engineers  
 Project Managers  
 250 Water Street  
 Suite 201  
 Windsor, Ontario  
 L9N 0G8  
 Tel: (800) 666-5252  
 Fax: (800) 666-5256  
 e-mail: bba@bba-enteng.com

DESIGN BY: BBA  
 DRAWN BY: JS  
 CHECKED BY: DM  
 DATE: FEB. 2026  
 SCALE: 1:50  
 FILE:

PROJECT NO: **25035**  
 DRAWING NO: **A202**


**FLOOR PLAN NOTATION LEGEND**

- ROOM NAME  
[ ] ROOM NAME & NUMBER
- [ 1 / A301 ] BUILDING ELEVATION REFERENCE
- [ 1 / A501 ] WALL SECTION REFERENCE

DO NOT SCALE THE DRAWINGS  
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.  
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE  
COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED  
UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE  
WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.  
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED  
AND SEALED BY THE CONSULTANT.



NO.	ISSUES	DATE	BY
1	ISSUED FOR CLIENT REVIEW		BBA
2	ISSUED FOR PERMIT & TENDER	FEB. 09, 2026	BBA

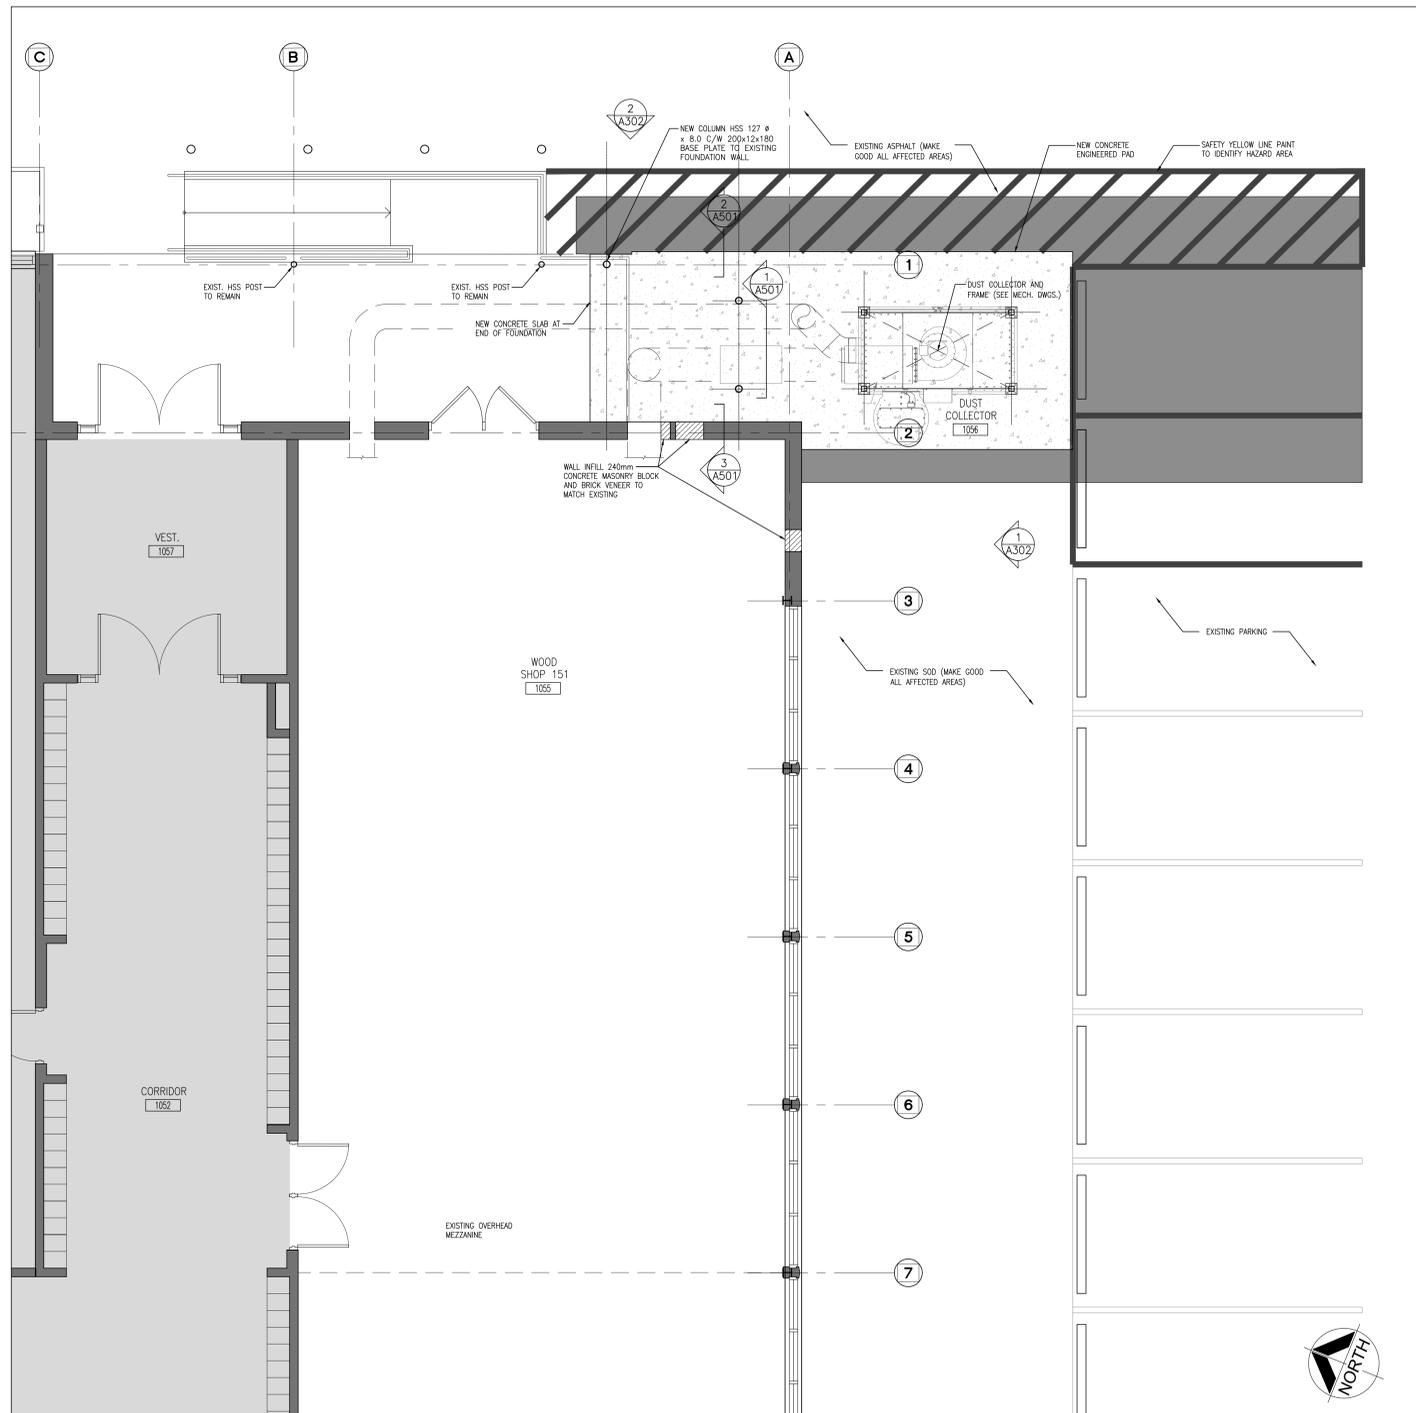

**1 A203 PART FIRST FLOOR PLAN**  
1:50


NO.	REVISIONS	DATE	BY

NO.	REVISIONS	DATE	BY

**PROJECT:**  
**EASTSIDE SECONDARY SHOP DUST COLLECTOR REPLACEMENT**

275 FARLEY AVENUE  
BELLEVILLE, ONTARIO  
HASTINGS & PRINCE EDWARD DISTRICT SCHOOL BOARD

**DRAWING:**  
**PART FIRST FLOOR PLAN**



**BARRY BRYAN ASSOCIATES**  
Architects  
Engineers  
Project Managers  
250 Water Street  
Suite 201  
Windsor, Ontario  
Tel: (508) 666-5252  
Fax: (508) 666-5256  
e-mail: bba@bba-ontario.com

DESIGN BY: BBA  
DRAWN BY: JS  
CHECKED BY: DM  
DATE: FEB. 2026  
SCALE: 1:50  
FILE:

DESIGN CONTROL: BBA  
% COMPLETE: JS  
DATE: FEB. 2026  
SCALE: 1:50  
FILE:

PROJECT NO: **25035**  
DRAWING NO: **A203**














Giallonardo —  
Engineering Inc.  
228-4558 Highway 7  
Woodbridge, ON  
L4L 4Y7  
(905) 265-1052  
info@gi.alionardoeng.com  
www.gialionardoeng.com

This drawing is the property of  
GIALLONARDO ENGINEERING INC.

This drawing shall be read in conjunction with the architectural,  
structural, electrical and all other consultant's drawings prior to  
proceeding with the work. Do not scale the drawings.

The contractor is to verify and accept responsibility for all  
dimensions and conditions on site and must notify  
GIALLONARDO ENGINEERING INC. of any variations from the  
drawings.




NO.	ISSUES	DATE	BY
1	ISSUED FOR REVIEW	JUN. 23 2025	SW
2	ISSUED FOR PERMIT AND TENDER	JUN. 30 2026	SW

# ESS DUST COLLECTOR REPLACEMENT

275 FARLEY AVENUE  
BELLEVILLE, ON

## MECHANICAL DRAWINGS

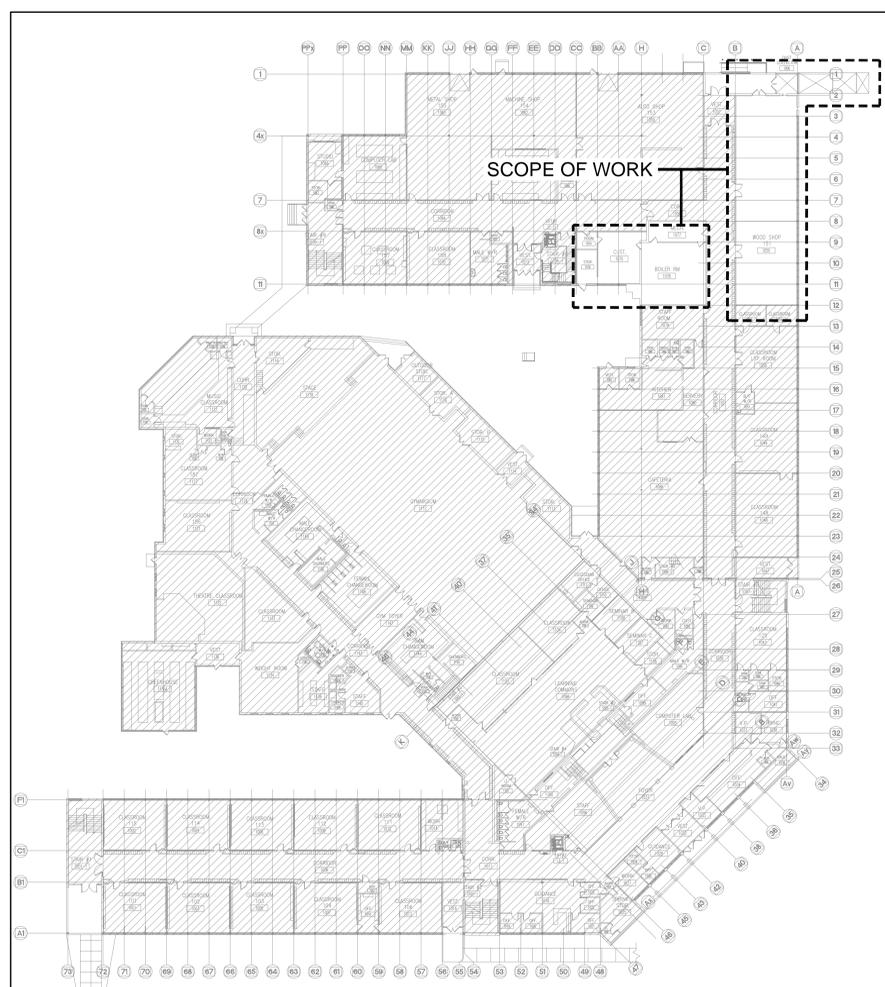

1 KEYPLAN  
M-0 NTS

### DRAWING LIST

DWG. NO.	DRAWING NAME
M-0	TITLE SHEET
M-1.1	MECHANICAL LEGEND & SCHEDULES
M-1.2	MECHANICAL DETAILS
M-2.1	DUST COLLECTION SYSTEM – DEMOLITION
M-2.2	DUST COLLECTION SYSTEM – NEW
M-2.3	BOILER ROOM DEMOLITION & NEW – PLUMBING

NO.	REVISIONS	DATE	BY
-----	-----------	------	----


PROJECT:  
**EASTSIDE SECONDARY  
SHOP DUST COLLECTOR  
REPLACEMENT**

275 FARLEY AVENUE  
BELLEVILLE, ONTARIO  
HASTINGS & PRINCE EDWARD DISTRICT SCHOOL BOARD

DRAWING:  
**TITLE SHEET**



BARRY BRYAN  
ASSOCIATES  
Architects  
Engineers  
Project Managers  
250 Water Street  
Suite 201  
Whitby, Ontario  
L1N 9G5  
Tel: (905) 866-5252  
Fax: (905) 866-5258  
email: info@barrybryan.com




DESIGN BY: SW  
DRAWN BY: RC  
CHECKED BY: JH  
DATE: APR. 2025  
SCALE: AS NOTED  
FILE:

PROJECT NO:  
**25-110**

DRAWING NO:  
**M-0**





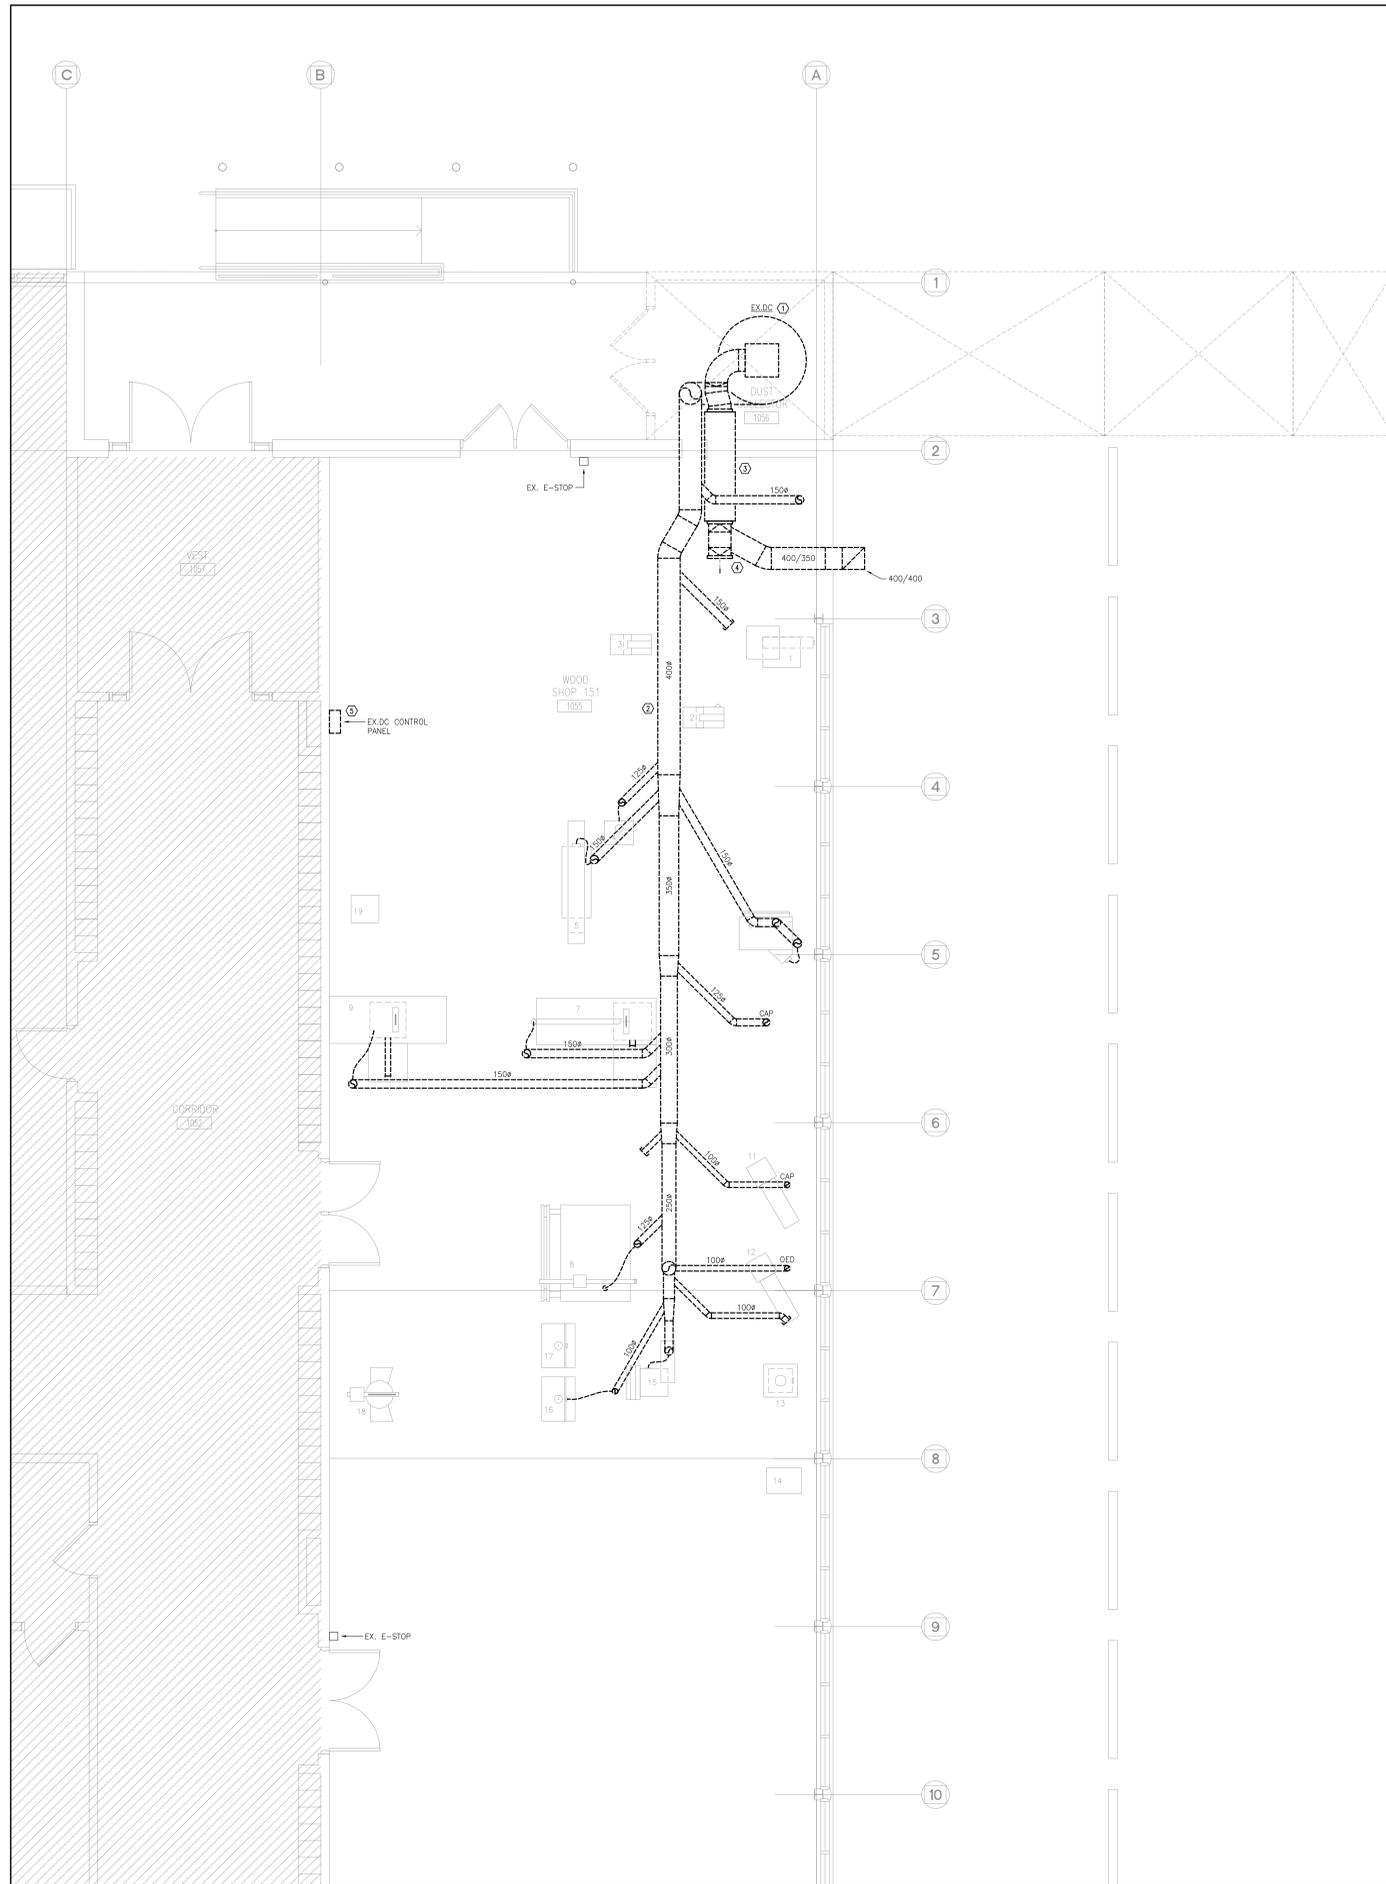

1 DUST COLLECTION SYSTEM - DEMOLITION  
M-2.1  
150

- MECHANICAL DRAWING NOTES**
- ① EXISTING DUST COLLECTOR AND ALL ASSOCIATED CONTROLS, SUPPORTS, ETC. TO BE REMOVED AND DISPOSED OF.
  - ② EXISTING EXHAUST DUCTWORK AND ALL ASSOCIATED HANGERS, SUPPORTS, DROPS, ETC. TO BE REMOVED AND DISPOSED OF. RETAIN ALL EQUIPMENT FLEX CONNECTIONS FOR REINSTALLATION (TYPICAL).
  - ③ EXISTING SUPPLY DUCTWORK AND ALL ASSOCIATED HANGERS, SUPPORTS, ETC. TO BE REMOVED AND DISPOSED OF.
  - ④ EXISTING ABORT DAMPER, ASSOCIATED EXHAUST DUCTWORK, AND ALL CONTROLS TO BE REMOVED AND DISPOSED OF. MAKE GOOD WALL PENETRATION TO BASE BUILDING STANDARDS.
  - ⑤ EXISTING MAIN CONTROL PANEL AND ALL ASSOCIATED CONTROLS, WIRING, CONDUIT, ETC. TO BE REMOVED AND DISPOSED OF.

- GENERAL NOTES**
1. THE MECHANICAL DRAWINGS DISPLAY A GENERAL DESIGN AND INSTALLATION. THEREFORE, IF REQUIRED, THE CONTRACTOR SHALL OBTAIN CLARIFICATION FROM THE CONSULTANT PRIOR TO INSTALLATION.
  2. THESE DRAWINGS HAVE BEEN PREPARED FOR DIV.23 AND DO NOT ACCURATELY DISPLAY ALL ELECTRICAL, STRUCTURAL AND ARCHITECTURAL ELEMENTS. REFER TO OTHER DIVISION'S DRAWINGS FOR CLARIFICATION.
  3. THIS CONTRACTOR SHALL VISIT THE SITE AND COMPLETELY INVESTIGATE AND UNDERSTAND THE EXISTING CONDITIONS AND THEIR RELATION TO THE DESIGN DRAWINGS/DOCUMENTS. NO CONSIDERATION WILL BE GIVEN TO THE CONTRACTOR FOR ANY HINDRANCES TO THE MECHANICAL INSTALLATION FROM SITE CONDITIONS WHICH EXISTED PRIOR TO TENDER SUBMISSION. AS SUCH AND WHERE REQUIRED, THE CONTRACTOR SHALL PROVIDE INTERFERENCE DRAWINGS AND SHALL SUBMIT THEM TO THE CONSULTANT FOR REVIEW.

This drawing is the property of  
**GIALLONARDO ENGINEERING INC.**

This drawing shall be read in conjunction with the architectural, structural, electrical and all other consultant's drawings prior to proceeding with the work. Do not scale the drawings.

The contractor is to verify and accept responsibility for all dimensions and conditions on site and must notify **GIALLONARDO ENGINEERING INC.** of any variations from the drawing.




NO.	ISSUES	DATE	BY
1	ISSUED FOR REVIEW	JUN. 23 2025	SW
2	ISSUED FOR PERMIT AND TENDER	JAN. 30 2026	SW

NO.	REVISIONS	DATE	BY
-----	-----------	------	----

**PROJECT:**  
**EASTSIDE SECONDARY  
SHOP DUST COLLECTOR  
REPLACEMENT**

275 FARLEY AVENUE  
BELLEVILLE, ONTARIO  
HASTINGS & PRINCE EDWARD DISTRICT SCHOOL BOARD

**DRAWING:**  
**DUST COLLECTION  
SYSTEM - DEMOLITION**

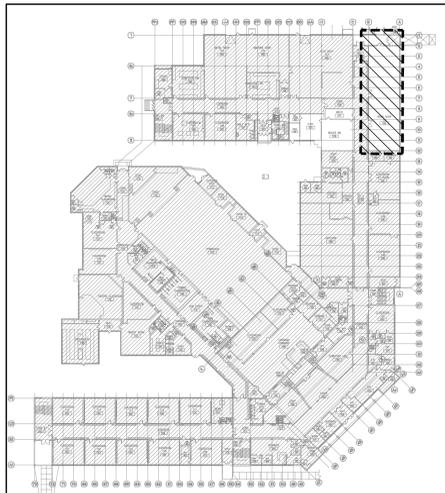

**BARRY BRYAN  
ASSOCIATES**  
Architects  
Engineers  
Project Managers  
250 Water Street  
Suite 201  
Whitby, Ontario  
L1N 9G5  
Tel: (905) 866-5252  
Fax: (905) 866-5258  
email: info@bba-engineering.com

DESIGN BY: SW  
DRAWN BY: PC  
CHECKED BY: JH  
DATE: APR. 2025  
SCALE: AS NOTED  
FILE:

PROJECT NO:  
**25-110**

DRAWING NO:  
**M-2.1**





**ELECTRICAL SPECIFICATION**

- EXAMINE THE EXISTING SITE CONDITION TOGETHER WITH THE PROPOSED WORK AND THE WORK OF ALL OTHER TRADES TO DETERMINE THE COMPLETE EXTENT OF RENOVATIONS TO THE EXISTING BUILDING. INCLUDE IN THE TENDER PRICE FOR THE TOTAL SCOPE OF WORK INCLUDING BUT NOT LIMITED TO CUTTING, PATCHING, REMOVING, REROUTING OF ALL EXISTING ELECTRICAL EQUIPMENT AND WIRING TO SUCCESSFULLY EXECUTE ALL WORK DESCRIBED.
- ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE LATEST EDITIONS OF THE 2024 ONTARIO BUILDING CODE, PROVINCIAL ELECTRICAL SAFETY CODE, C.S.A. STANDARD, U.L.C., N.F.P.A., O.S.H.A., AND ALL OTHER APPLICABLE CODES AS REQUIRED.
- ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH BASE BUILDING STANDARDS.
- OBTAIN AND PAY FOR ALL REQUIRED PERMITS AND INSPECTIONS. ALL REQUIRED PERMITS SHALL BE SUBMITTED TO THE LANDLORD PRIOR TO COMMENCING THE WORK.
- ALL WORK SHALL BE INSTALLED IN A CO-ORDINATED MANNER WITH ALL TRADES.
- DRAWINGS SHALL NOT BE SCALED FOR MEASUREMENTS.
- ALL INTERRUPTIONS OF SERVICES TO ANY PART OF THE BUILDING SHALL BE EXECUTED ONLY WITH PRIOR APPROVAL AND ARRANGEMENTS WITH THE BUILDING OWNER OR REPRESENTATIVE. MINIMUM 48HRS. NOTICE REQUIRED. INCLUDE FOR ALL PREMIUM TIME REQUIRED FOR INTERRUPTIONS OF SERVICES, AND REQUIRED TIE-INS TO EXISTING SERVICES.
- PROVIDE ALL MATERIALS, EQUIPMENT AND LABOUR NECESSARY TO PERFORM THE COMPLETE WORK AS INDICATED.
- DAMAGE TO ANY SYSTEM OCCURRING DURING EXECUTION OF THE WORK SHALL BE RECTIFIED AT THE CONTRACTORS EXPENSE.
- ALL NEW EQUIPMENT SHALL BE IDENTIFIED WITH LAMACOID PLATES. BLACK BACKGROUND WITH WHITE LETTERING. WORDING ON ALL LAMACOID PLATES SHALL BE APPROVED BY THE CONSULTANT AND THE BUILDING OWNER PRIOR TO ENGRAVING.
- PROVIDE A FULLY ITEMIZED BREAKDOWN OF ALL MATERIALS, EQUIPMENT AND LABOUR FOR SUBMISSIONS OF ALL CHANGES TO THE CONTRACT. CONTRACTOR SHALL UTILIZE NECA 1 LABOUR RATES, AND TRADE PRICES. WORK ASSOCIATED WITH ANY CHANGES TO THE CONTRACT SHALL NOT PROCEED WITH-OUT WRITTEN APPROVAL.
- PRIOR TO INSTALLATION OF ANY DEVICES, THE CONSULTANT AND OR INTERIOR CONSULTANT SHALL HAVE THE RIGHT TO CHANGE LOCATIONS OF OUTLETS WITHIN 3 METERS ( 10 FEET ) WITH-OUT ANY EXTRA COST TO THE OWNER.
- PERFORM ALL WORK REQUIRED TO THE FIRE ALARM SYSTEM AS INDICATED. RETAIN THE FORCES OF THE LANDLORD TO PERFORM FINAL CONNECTIONS, TESTING AND VERIFICATION OF ALL WORK. DEVICES SHALL MATCH THE EXISTING SYSTEM IN CHARACTERISTICS AND TYPES. VERIFY IN ACCORDANCE WITH ULC 524 AND LOCAL AUTHORITIES HAVING JURISDICTION VERIFY F/A BELL CIRCUITS TO ENSURE PROPER OPERATION & COVERAGE.
- SUBMIT SHOP DRAWINGS, FIVE ( 5 ) COPIES FOR ALL MAJOR EQUIPMENT. SHOP DRAWINGS SHALL BE REVIEWED AND STAMPED FOR ACCEPTANCE BY THE APPROPRIATE TRADE PRIOR TO STAMPED "REVIEWED" BY THE CONSULTANT.
- ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE APPROVED CONSTRUCTION SCHEDULE.
- LOCATIONS OF ALL FLOOR PENETRATIONS, INCLUDING CORE DRILLING AND SAW CUTTING SHALL BE APPROVED ON SITE BY THE INTERIOR DESIGNER, BUILDING OWNER/LANDLORD, AND STRUCTURAL ENGINEER. OBTAIN ALL NECESSARY APPROVALS PRIOR TO BATT-SCAN AND DRILLING. SUBMIT BATT-SCAN RESULTS FOR LANDLORDS APPROVAL AND OBTAIN 48HRS PRIOR PERMISSION TO COMMENCE CORE DRILLING. INCLUDE FOR ALL COSTS.
- PROVIDE THE LANDLORD AND TENANT WITH A 1-YEAR WRITTEN WARRANTY FOR ALL LABOUR, MATERIALS AND EQUIPMENT SUPPLIED IN THIS CONTRACT. WARRANTY SHALL COMMENCE AT SUCH TIME THAT THE CONSULTANT DEEMS THE WORK IS ACCEPTABLE.
- ALL POWER WIRING AND SUPPLY OF STARTERS FOR MECHANICAL EQUIPMENT SHALL BE PROVIDED BY ELECTRICAL CONTRACTOR, UNLESS OTHERWISE NOTED. ALL CONTROL WIRING AND CONTROL DEVICES SHALL BE PROVIDED BY MECHANICAL CONTRACTOR. CONFIRM AND CO-ORDINATE ALL POWER CHARACTERISTICS WITH MECHANICAL CONTRACTOR PRIOR TO PROCESSING SHOP DRAWINGS AND EQUIPMENT ORDERING.
- PROVIDE ALL ACCESS DOORS WHERE REQUIRED TO SERVICE ALL NEW AND EXISTING EQUIPMENT. ACCESS PANELS SHALL BE EQUAL TO LEHAGE AND SHALL BE COMPATIBLE WITH CEILING/WALL. TYPE AND FINISH. ACCESS DOORS SHALL BE RECESSED TYPE WITH A DRYWALL INFILL. ELECTRICAL SERVICES ARE TO BE CO-ORDINATED TO MINIMIZE THE NUMBER OF ACCESS LOCATIONS. CO-ORDINATE LOCATION AND SIZES WITH THE CONSULTANT. SUBMIT DRAWING(S) TO THE CONSULTANT FOR REVIEW INDICATING SIZE AND LOCATION OF ALL ACCESS LOCATIONS PRIOR TO PROCEEDING WITH THE INSTALLATION.
- ALL LUMINAIRES SHALL BE CLEANED AT THE COMPLETION OF THE PROJECT.
- OBTAIN AND PAY FOR A CAD DISK DRAWING FILES AND ONE SET OF WHITE PRINTS. MARK WHITE PRINTS TO CLEARLY INDICATE THE INSTALLED WORK. AFTER THE WHITE PRINTS HAVE BEEN REVIEWED BY THE CONSULTANT, TRANSFER ALL INFORMATION, COMMENTS AND REVISIONS ONTO THE AS-BUILT CAD FILES. SUBMIT THE COMPLETED RECORD DRAWINGS AND THE CAD FILES TO THE CONSULTANT, WITH ONE SET OF PRINTS TO THE LANDLORD.
- UPON COMPLETION OF THE WORK, PROVIDE A COPY OF THE LOCAL HYDRO CERTIFICATE, AND FIRE ALARM VERIFICATION. SUBMIT RECORDS TO GENERAL CONTRACTOR AND LANDLORD.
- PROVIDE TYPE WRITTEN PANELBOARD DIRECTORIES FOR ALL NEW PANELS AND ALL EXISTING PANELS AFFECTED BY THIS RENOVATION.
- ALL EQUIPMENT AND MATERIALS SHALL BE NEW, UN-USED AND C.S.A. APPROVED.
- ALL WIRING SHALL BE INSTALLED IN CONDUIT. ARMoured "BX" CABLE MAY BE USED TO A MAXIMUM OF 3 METERS ( 10 FEET ) FOR FLEXIBLE LIGHTING, SWITCHED LEGS, EMERGENCY REMOTE HEADS AND EXIT SIGNS.
- ALL WIRING SHALL BE COPPER, MINIMUM # 12 AWG RW90.
- MINIMUM SIZE OF CONDUIT SHALL BE 20# ( 3/4" ) EMT UNLESS OTHERWISE NOTED. INSTALLATION OF CONDUITS SHALL BE PARALLEL TO BUILDING STRUCTURE. RUN CONDUITS CONCEALED IN ALL FINISHED AREAS.
- PROVIDE COPPER GROUND WIRE IN ALL CONDUIT FOR BRANCH AND FEEDER CIRCUITS.
- PROVIDE NYLON PULLSTRINGS IN ALL EMPT CONDUIT.
- PROVIDE FLEXIBLE METAL CONDUIT FOR ALL CONNECTIONS TO MOTORS, TRANSFORMERS AND GENERATORS.
- INDEPENDENTLY SUPPORT FROM BUILDING STRUCTURE WITH APPROVED CHAINS ALL NEW SURFACE AND RECESSED LUMINAIRES.
- PROVIDE A SEPARATE NEUTRAL CONDUCTOR FOR EACH CIRCUIT DO NOT SHARE NEUTRALS.
- ALL PENETRATIONS THROUGH FLOORS AND FIRE RATED WALLS SHALL BE PACKED AND SEALED WITH APPROVED FIRE MATERIAL AND SILICON SEALANT.
- WHERE A MANUFACTURER IS NOT SPECIFIED, THE PRODUCTS SHALL BE OF SAME MANUFACTURER AS BASE BUILDING.
- PROVIDE DIMMERS AS INDICATED. DIMMERS SHALL SUIT THE TYPE AND SIZE OF LOAD. PROVIDE DE-BUZZING COILS FOR ALL NEW DIMMERS.
- DIMMERS SHALL BE " LUTRON NOVA T " SERIES UNLESS OTHERWISE NOTED.
- ALL DEVICES AND COVERPLATES SHALL BE PASS & SEYMOUR MODULAR DECORA TYPE. SPECIFICATION GRADE COLOUR TO INTERIOR CONSULTANTS SELECTION. SUBMIT COLOUR SAMPLES.
- ALL SURFACE FLOOR OUTLETS SHALL BE CANADIAN ELECTRICAL RACEWAYS INC. SERIES 4000 OR WELLMARK EQUAL. COLOUR SHALL BE BLACK.
- WHERE SWITCHES, DIMMERS, AND RECEPTACLES ARE SHOWN SIDE BY SIDE, PROVIDE GANGED COVERPLATES. GANGED DIMMERS SHALL BE DE-RATED AND INSTALLED AS PER MANUFACTURERS INSTRUCTIONS.
- ENSURE THAT ALL NEUTRALS OF ALL TRANSFORMERS ARE GROUNDED TO THE BUILDING GROUND SYSTEM IN ACCORDANCE WITH TABLE 16A/16B OF THE O.H.E.S.C.
- ALL TRANSFORMERS, DISTRIBUTION PANELS, AND PANELBOARDS SHALL BE COMPLETE WITH COPPER BUS ( OR WINDINGS ), AND 200 % RATED NEUTRALS.
- ALL FUSES SHALL BE HRC TYPE " J " WITH TIME DELAY.
- CIRCUITING SHOWN FOR GROUPING PURPOSES ONLY. VERIFY EXACT CIRCUITS AVAILABLE AND PROVIDE NEW CIRCUITS AND BREAKERS AS REQUIRED. BALANCE LOADS WITH-IN 10# ACROSS PHASES, SUBMIT TEST REPORT FOR REVIEW BY THE CONSULTANT.
- CO-ORDINATE ALL EQUIPMENT SUPPLIED BY OTHER TRADES TO ENSURE VOLTAGE AND AMPERAGE COMPATIBILITY WITH DESIGN DOCUMENTS PRIOR TO EQUIPMENT BEING ORDERED.
- PROVIDE TEMPORARY ELECTRICAL POWER AND LIGHTING AS REQUIRED BY THE GENERAL CONTRACTOR OR CONSTRUCTION MANAGER. CO-ORDINATE REQUIREMENTS FOR PHASING OF WORK.

**1 ELECTRICAL SPECIFICATION**  
E-1 SCALE: N.T.S.

**LEGEND**


SYMBOL	DESCRIPTION
	NEW LUMINAIRE. TYPE AS NOTED.
	EXISTING LUMINAIRE TO BE REMOVED.
	TRACK LIGHTING C/W NUMBER OF FIXTURES INDICATED.
	FLUORESCENT STRIP LIGHT.
	CEILING MOUNTED (RECESSED OR SURFACE) LUMINAIRE.
	WALL MOUNTED (RECESSED OR SURFACE) LUMINAIRE.
	COMBINATION CEILING MOUNTED EXIT SIGN C/W FACES, ARROWS AND ADJUSTABLE EMERGENCY HEADS.
	WALL MOUNTED EXIT SIGN C/W FACES AND ARROWS AS INDICATED.
	SINGLE POLE LINE VOLTAGE SWITCH.
	3 WAY LIGHT LINE VOLTAGE SWITCH.
	EXHAUST FAN SWITCH C/W PILOT LIGHT.
	LIGHTING OCCUPANCY SENSOR. PASSIVE INFRARED C/W OVERRIDE SWITCH. WALL MOUNTED.
	LIGHTING OCCUPANCY SENSOR. PASSIVE INFRARED C/W OVERRIDE SWITCH. CEILING OR WALL MOUNTED AS SHOWN ON PLAN.
	DIMMER SWITCH. (RATING AND TYPE TO SUIT LOAD). N LIGHT OR EQUAL.
	WALL MOUNTED DUPLEX RECEPTACLE.
	WALL MOUNTED SPLIT RECEPTACLE.
	WALL MOUNTED DUPLEX RECEPTACLE WITH GROUND FAULT INTERRUPTER.
	WALL MOUNTED SINGLE RECEPTACLE VOLTAGE AND AMP AS INDICATED.
	WALL MOUNTED QUAD RECEPTACLE.
	WALL MOUNTED CABLE T.V OUTLET. PROVIDE CABLE T.V. JACK, AND COAXIAL CABLE BACK TO I.T. SERVER ROOM.
	WALL MOUNTED TELEPHONE OUTLET.
	FURNITURE MOUNTED DATA OUTLET.
	WALL MOUNTED DATA OUTLET.
	WALL MOUNTED COMBINATION TELEPHONE/DATA OUTLET.
	CEILING MOUNTED WI-FI UNIT.
	POWER POLE WITH DEVICES AS SHOWN.
	DIRECT CONNECTION TO EQUIPMENT AS INDICATED.
	MOTOR CONNECTION.
	UNFUSED DISCONNECT SWITCH.
	PANEL (RECESSED OR SURFACE).
	TRANSFORMER.
	FIRE ALARM SMOKE DETECTOR.
	FIRE ALARM HEAT DETECTOR.
	FIRE ALARM PULL STATION.
	SURFACE FIRE ALARM HORN.
	SURFACE FIRE ALARM HORN/STROBE.
	SURFACE EMERGENCY LIGHTING BATTERY UNIT C/W LUMINAIRE(S).
	EMERGENCY LIGHTING REMOTE HEADS DOUBLE, AND SINGLE AS NOTED.
	RECESSED SINGLE GANG BACKBOX 1-DENOTES SINGLE GANG, 2-DENOTES DOUBLE GANG. PROVIDE REQUIRED COVERPLATE TO SUIT DEVICE.
	BUZZER/CHIME.
	SECURITY KEYPAD.
	SECURITY KEY SWITCH.
	SECURITY MOTION SENSOR.
	SECURITY CARD READER.
	SECURITY DOOR CONTACT.
	SECURITY ELECTRIC STRIKE.
	SECURITY MOTION SENSOR
	SECURITY CAMERA.
	PUSH BUTTON DOOR RELEASE.
	DENOTES REFER TO NOTE N-1.
	DENOTES OVER COUNTER
	DENOTES EXISTING TO REMAIN.
	DENOTES REFER TO DETAIL#6 ON DRAWING #E-1.

**2 ELECTRICAL LEGEND**  
E-1 SCALE: N.T.S.


**DRAWING LIST**

DWG. No.	DESCRIPTION
E-1	ELECTRICAL SPEC., LEGEND, DRAWING LIST, AND DETAILS
E-2	ELECTRICAL RISERS, DETAILS, AND SCHEDULES
E-3	ELECTRICAL VICINITY PLANS
E-4	PART GROUND FLOOR WOOD SHOP ELECTRICAL PLAN
E-5	PART GROUND FLOOR WOOD SHOP DEMOLITION PLAN ELECTRICAL
E-6	PART GROUND FLOOR BOILER ROOM ELECTRICAL PLAN

**3 DRAWING LIST**  
E-1 SCALE: N.T.S.

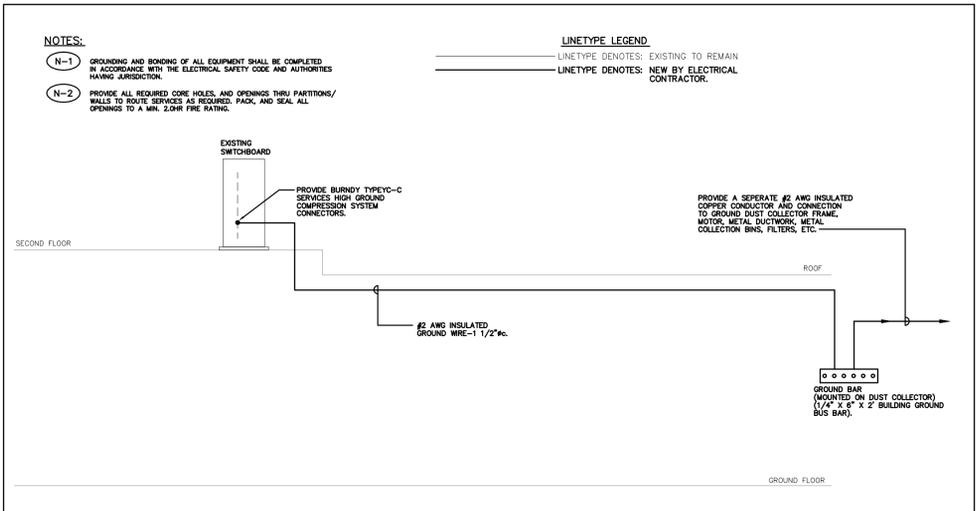

**4 GROUNDING SYSTEM RISER DIAGRAM**  
E-1 SCALE: N.T.S.

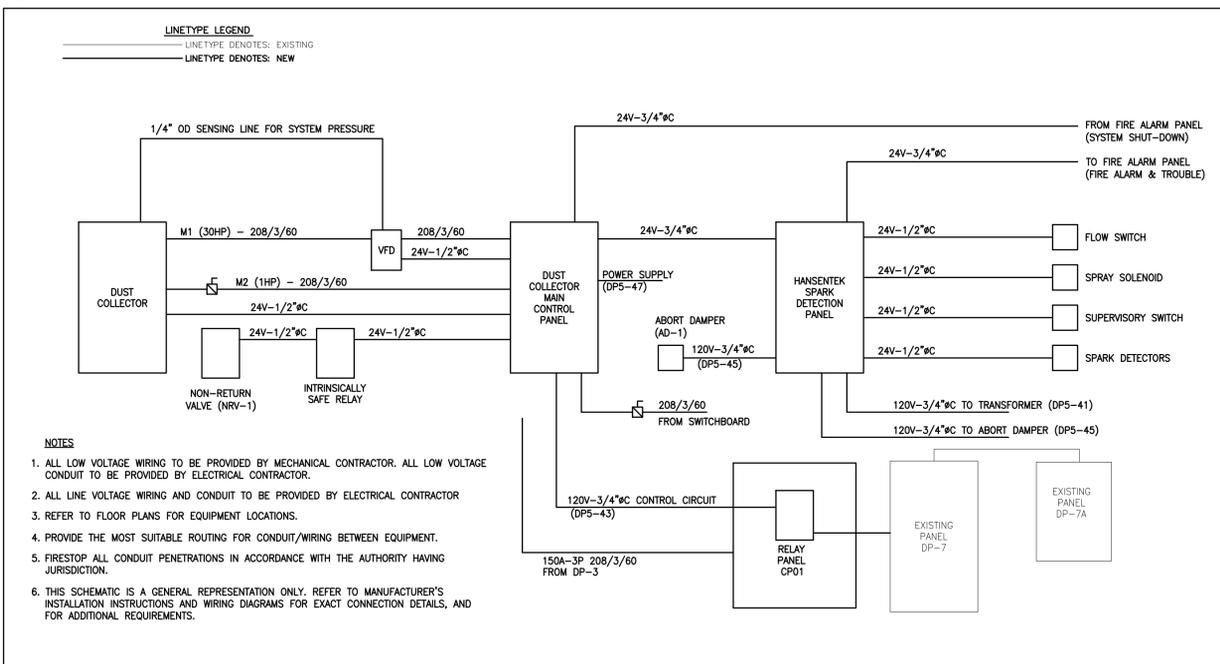

**5 DUST COLLECTOR SYSTEM SCHEMATIC/RISER DIAGRAM**  
E-1 SCALE: N.T.S.

DO NOT SCALE THE DRAWINGS CHECK AND VERIFY ALL DIMENSIONS AT THE SITE. ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN. DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.




NO.	ISSUES	DATE	BY
1	ISSUED FOR REVIEW	JUN 05 2025	TM
2	RE-ISSUED FOR REVIEW	JAN 27 2026	TM
3	ISSUED FOR PERMIT AND TENDER	JAN 30 2026	TM

NO.	REVISIONS	DATE	BY

DYNAMIC DESIGNS AND ENGINEERING INC.  
111 Hodgson Ave. Kettleby, Ontario L7B 0C7  
Tel. (905) 841-7278  
dyneng@rogers.com

PROJECT:  
**EASTSIDE SECONDARY SHOP DUST COLLECTOR REPLACEMENT**  
275 FARLEY AVENUE  
BELLEVILLE, ONTARIO  
HASTING & PRINCE EDWARD DISTRICT SCHOOL BOARD


DRAWING:  
**ELECTRICAL SPEC; LEGEND, DRAWING LIST, AND DETAILS**

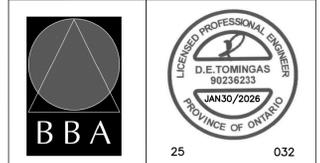


**BARRY BRYAN ASSOCIATES**  
Architects  
Engineers  
Project Managers  
250 Water Street  
Suite 201  
Whitby, Ontario  
L1N 0G5  
Tel: (905) 666-5252  
Fax: (905) 666-5258  
e-mail: bba@bba-archeng.com

DESIGN BY: TM  
DRAWN BY: STAFF  
CHECKED BY: TM  
DATE: MAY 2025  
SCALE: AS NOTED  
FILE:

PROJECT NO: **25032**  
DRAWING NO: **E-1**

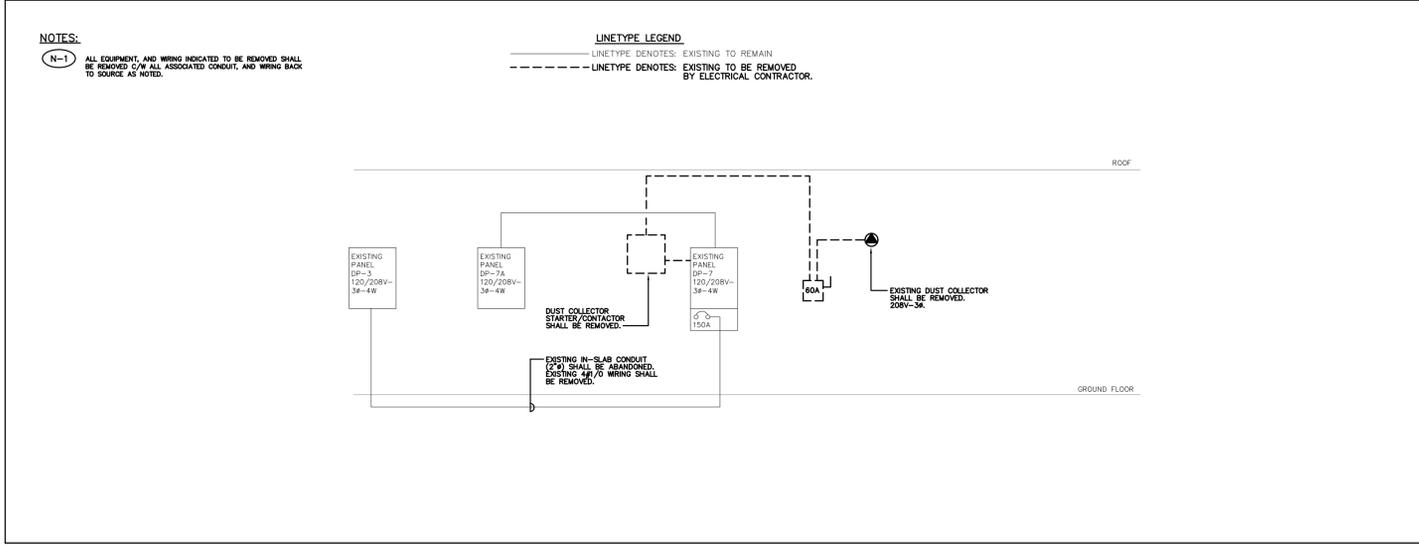

**1 DEMOLITION ELECTRICAL SINGLE LINE DIAGRAM**  
 E-2 SCALE: N.T.S.

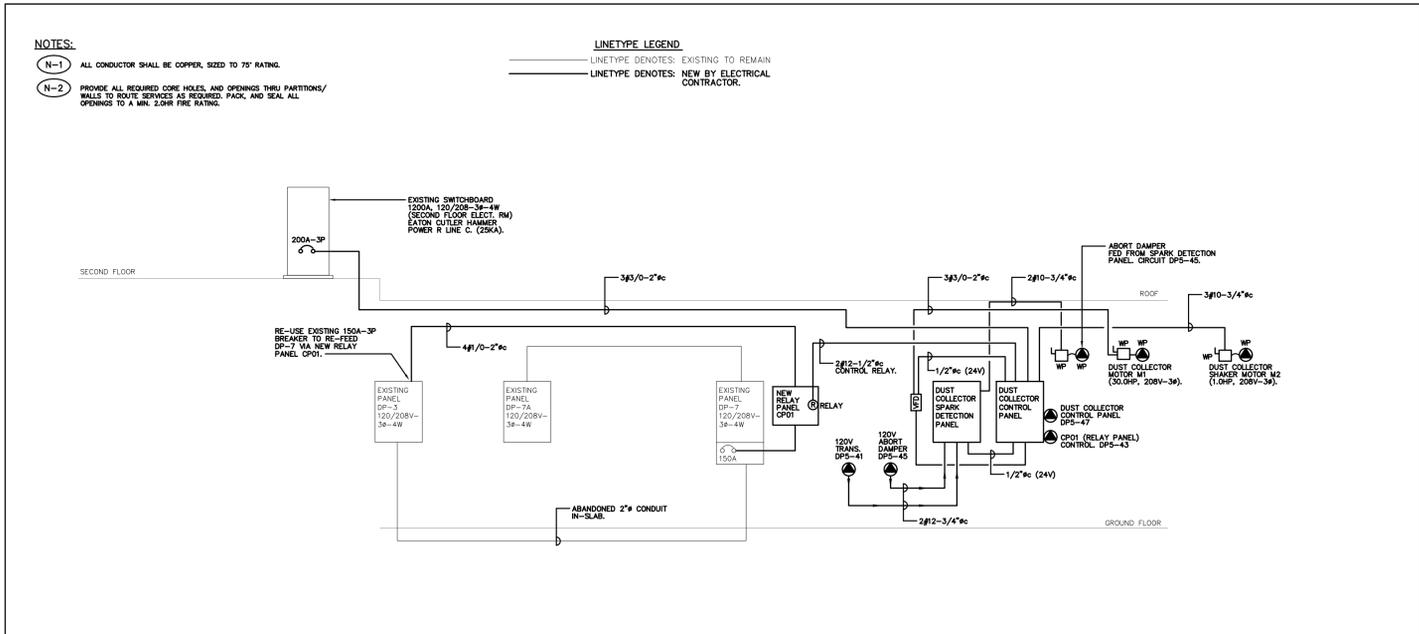

**2 PROPOSED ELECTRICAL SINGLE LINE DIAGRAM**  
 E-2 SCALE: N.T.S.

**PANEL : DP-7**

DESCRIPTION	BKBR. SIZE	CCT. NO.	PH.	CCT. NO.	BKBR. SIZE	DESCRIPTION
TO BE CONFIRMED	15A	1	A	2	15A	TO BE CONFIRMED
JOINER	40A	3	B	4	30A	CNC ROUTER
TO BE CONFIRMED	2P	5	C	6	2P	TO BE CONFIRMED
CNC ROUTER	30A	9	B	10	15A	SPINDLE SANDER
TO BE CONFIRMED	2P	11	C	12	2P	TO BE CONFIRMED
TABLE SAW	15A	13	A	14	15A	DISC & BELT SANDER
TO BE CONFIRMED	3P	17	C	18	3P	TO BE CONFIRMED
PANEL DP-7A	100A	19	A	20	15A	LATHE
GRINDER	15A	25	A	26	15A	DRILL #1 & #2
LATHE	3P	28	C	30	3P	SPARE
SPARE	15A	31	A	32	20A	(OLD DUST COLL)
BAND SAW	20A	37	A	38	100A	SPARE
TO BE CONFIRMED	3P	39	B	40	3P	TO BE CONFIRMED
TO BE CONFIRMED	3P	41	C	42	3P	TO BE CONFIRMED
TO BE CONFIRMED	15A	43	A	44	50A	TO BE CONFIRMED
TO BE CONFIRMED	3P	45	B	46	3P	TO BE CONFIRMED
TO BE CONFIRMED	3P	47	C	48	3P	TO BE CONFIRMED

150/3P MAIN BREAKER

**3 PANEL SCHEDULE DP-7**  
 E-2 SCALE: N.T.S.

**PANEL : DP-5**

DESCRIPTION	BKBR. SIZE	CCT. NO.	PH.	CCT. NO.	BKBR. SIZE	DESCRIPTION
EXISTING	40A	1	A	2	60A	EXISTING
EXISTING	3P	3	B	4	2P	EXISTING
EXISTING	40A	7	A	8		EXISTING
EXISTING	3P	9	B	10		EXISTING
EXISTING	3P	11	C	12		EXISTING
EXISTING	40A	13	A	14		EXISTING
EXISTING	3P	15	B	16		EXISTING
EXISTING	3P	17	C	18		EXISTING
EXISTING	15A	19	A	20		EXISTING
EXISTING	3P	23	C	24		EXISTING
EXISTING	30A	25	A	26		EXISTING
EXISTING	3P	27	B	28		EXISTING
EXISTING	3P	29	C	30		EXISTING
EXISTING	15A	31	A	32		EXISTING
EXISTING	3P	33	B	34		EXISTING
EXISTING	3P	35	C	36		EXISTING
EXISTING	3P	37	A	38		EXISTING
EXISTING	3P	39	B	40		EXISTING
EXISTING	15A	41	C	42		EXISTING
EXISTING	15A	43	A	44		EXISTING
EXISTING	15A	45	B	46		EXISTING
EXISTING	15A	47	C	48		EXISTING
EXISTING	15A	49	A	50		EXISTING
EXISTING	15A	51	B	52		EXISTING
EXISTING	15A	53	C	54		EXISTING
EXISTING	15A	55	A	56		EXISTING
EXISTING	15A	57	B	58		EXISTING
EXISTING	3P	59	C	60		EXISTING

**5 PANEL SCHEDULE DP-5**  
 E-2 SCALE: N.T.S.

**PANEL : DP-7A**

DESCRIPTION	BKBR. SIZE	CCT. NO.	PH.	CCT. NO.	BKBR. SIZE	DESCRIPTION
TO BE CONFIRMED	15A	1	A	2	15A	TO BE CONFIRMED
TO BE CONFIRMED	3P	3	B	4	15A	TO BE CONFIRMED
TO BE CONFIRMED	3P	5	C	6	15A	TO BE CONFIRMED
TO BE CONFIRMED	15A	7	A	8	15A	TO BE CONFIRMED
TO BE CONFIRMED	15A	13	A	14	15A	TO BE CONFIRMED
TO BE CONFIRMED	3P	15	B	16	3P	TO BE CONFIRMED
TO BE CONFIRMED	15A	17	C	18	3P	TO BE CONFIRMED
TO BE CONFIRMED	15A	19	A	20		TO BE CONFIRMED
TO BE CONFIRMED	3P	21	B	22		TO BE CONFIRMED
TO BE CONFIRMED	3P	23	C	24		TO BE CONFIRMED

**4 PANEL SCHEDULE DP-7A**  
 E-2 SCALE: N.T.S.

DO NOT SCALE THE DRAWINGS. CHECK AND VERIFY ALL DIMENSIONS AT THE SITE. ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN. DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.




NO.	ISSUES	DATE	BY
1	ISSUED FOR REVIEW	JUN 05 2025	TM
2	RE-ISSUED FOR REVIEW	JAN 27 2026	TM
3	ISSUED FOR PERMIT AND TENDER	JAN 30 2026	TM

DYNAMIC DESIGNS AND ENGINEERING INC.  
 111 Hodgson Ave. Kettleby, Ontario L7B 0C7  
 Tel. (905) 841-7278  
 dyneng@rogers.com

PROJECT:  
**EASTSIDE SECONDARY SHOP DUST COLLECTOR REPLACEMENT**  
 275 FARLEY AVENUE  
 BELLEVILLE, ONTARIO

HASTING & PRINCE EDWARD DISTRICT SCHOOL BOARD  
 DRAWING:  
**ELECTRICAL RISERS, DETAILS, AND SCHEDULES**




**BARRY BRYAN ASSOCIATES**  
 Architects  
 Engineers  
 Project Managers  
 250 Water Street  
 Suite 201  
 Whitby, Ontario  
 L1N 0G5  
 Tel: (905) 666-5252  
 Fax: (905) 666-5250  
 e-mail: bba@bba-archeng.com

DESIGN BY: TM  
 DRAWN BY: STAFF  
 CHECKED BY: TM  
 DATE: MAY 2025  
 SCALE: AS NOTED  
 FILE:

PROJECT NO: **25032**  
 DRAWING NO: **E-2**



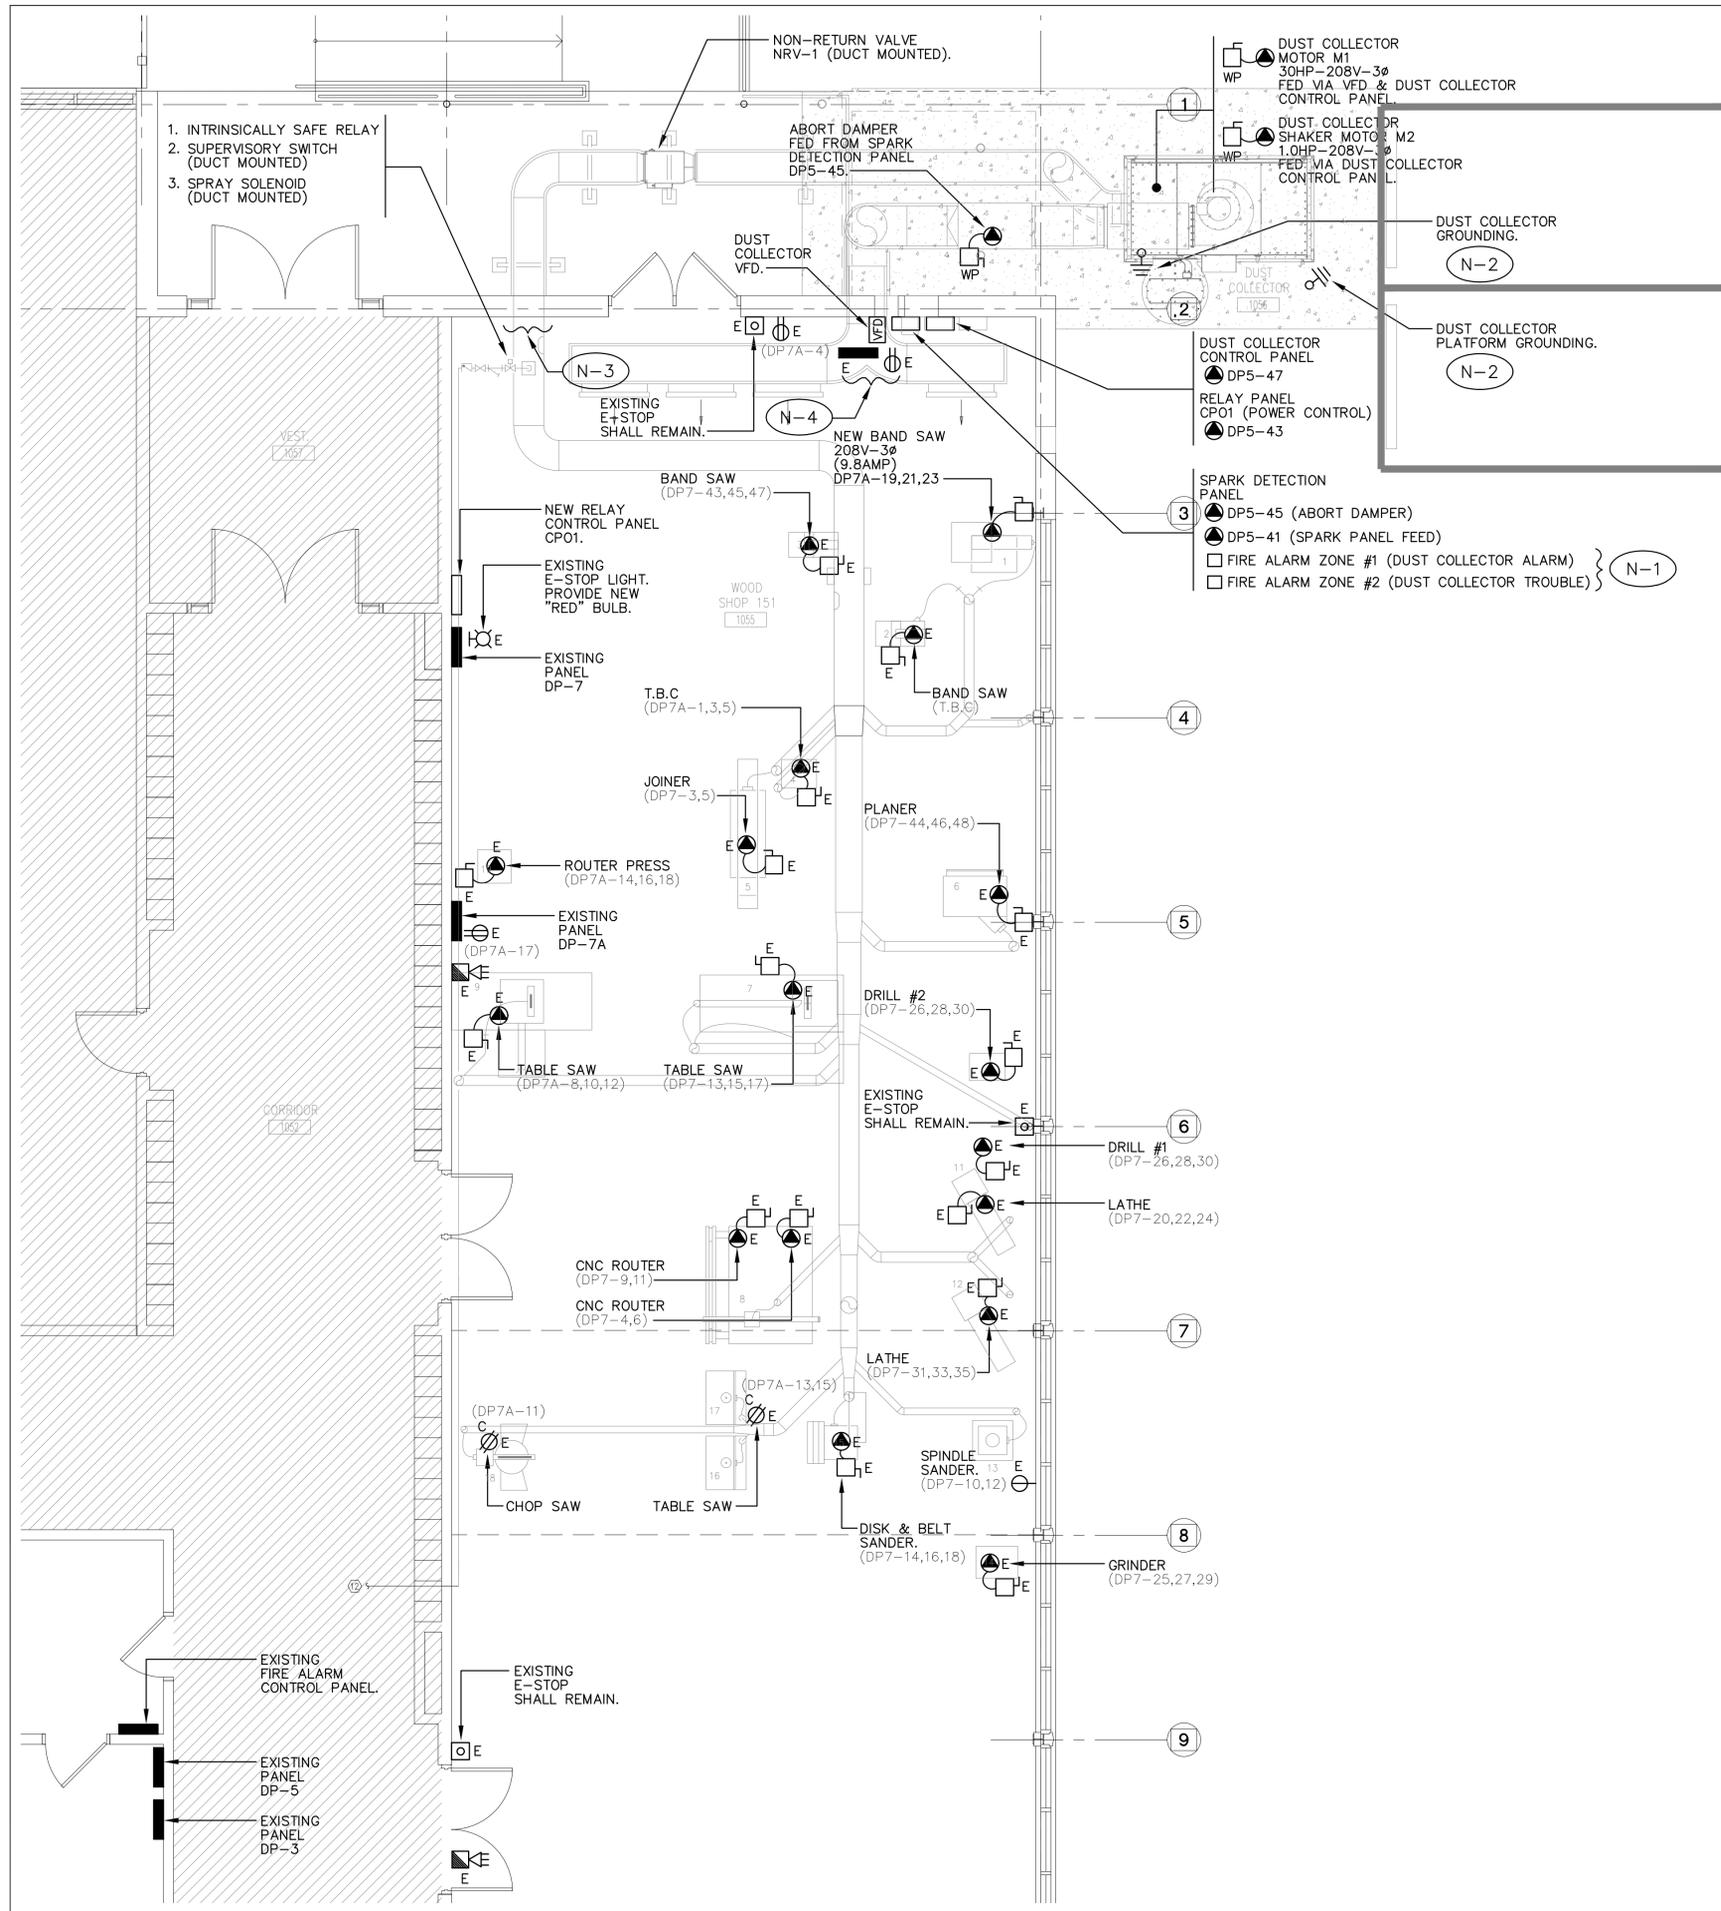

**NOTES:**

- (N-1) PROVIDE NEW FIRE ALARM ZONES AS INDICATED. ELECTRICAL CONTRACTOR SHALL CO-ORDINATE EXACT REQUIREMENTS (DEVICES/MODULES, WIRING, TIE-IN LOCATION, PROGRAMMING, AND SYSTEM UPGRADE) WITH BASE BUILDING FIRE ALARM SYSTEM VERIFYING AGENT. UPDATE FIRE ALARM CONTROL PANEL, AND FIRE ALARM ANNUNCIATOR PANEL TO INCLUDE FOR NEW FIRE ALARM ZONES (TOTAL OF 2). ELECTRICAL CONTRACTOR SHALL CARRY THE COSTS OF THE BASE BUILDING FIRE ALARM SYSTEM VERIFYING AGENT FOR ALL CO-ORDINATION, COMPONENTS, TIE-IN, PROGRAMMING, AND VERIFICATION. SUBMIT FIRE ALARM SYSTEM VERIFICATION/CERTIFICATE AT COMPLETION OF WORK.
- (N-2) DUST COLLECTOR GROUNDING, AND DUST COLLECTOR PLATFORM GROUNDING SHALL BE PROVIDED BY ELECTRICAL CONTRACTOR. REFER TO DETAIL #4 ON DRAWING #E-1.
- (N-3) EXISTING HORIZONTAL, AND VERTICAL CONDUITS C/W JUNCTION BOX SHALL BE REMOVED IF DEEMED REDUNDANT. ALL NON REDUNDANT CONDUIT, AND JUNCTION BOX SHALL BE RE-WORKED, AND RELOCATED AS REQUIRED TO PERMIT DUST COLLECTOR DUCT PENETRATION.
- (N-4) EXISTING SURFACE DUPLEX RECEPTACLE, AND PLYWOOD BACKBOARD C/W EQUIPMENT AT HIGH LEVEL SHALL BE INVESTIGATED FOR IT'S PURPOSE, IF DEEMED NECESSARY TO BE MAINTAINED FOR EXISTING SERVICES TO REMAIN, CONTRACTOR SHALL RELOCATE DUPLEX RECEPTACLE, AND PLYWOOD BACKBOARD C/W EQUIPMENT, AND CONDUIT TO THE LEFT SIDE OF CURRENT LOCATION TO ALLOW FOR NEW DUST COLLECTOR DUCT PENETRATION. IF DEEMED REDUNDANT, CONTRACTOR SHALL TURN OVER PLYWOOD BACKBOARD C/W EQUIPMENT, AND DUPLEX RECEPTACLE SHALL BE RELOCATED TO THE LEFT SIDE OF CURRENT LOCATION TO ALLOW FOR NEW DUST COLLECTOR DUCT PENETRATION. RELOCATE ALL CONDUIT, AND WIRING AS REQUIRED TO CLEAR NEW DUST COLLECTOR DUCT PENETRATION.

DO NOT SCALE THE DRAWINGS  
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.  
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE  
COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED  
UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE  
WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.  
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED  
AND SEALED BY THE CONSULTANT.



NO.	ISSUES	DATE	BY
1	ISSUED FOR REVIEW	JUN 05 2025	TM
2	RE-ISSUED FOR REVIEW	JAN 27 2026	TM
3	ISSUED FOR PERMIT AND TENDER	JAN 30 2026	TM

NO.	REVISIONS	DATE	BY

DYNAMIC DESIGNS AND ENGINEERING INC.  
 111 Hodgson Ave. Kettleby, Ontario L7B 0C7  
 Tel. (905) 841-7278  
 dyneng@rogers.com

**PROJECT:**  
**EASTSIDE SECONDARY SHOP DUST COLLECTOR REPLACEMENT**  
 275 FARLEY AVENUE  
 BELLEVILLE, ONTARIO

HASTING & PRINCE EDWARD DISTRICT SCHOOL BOARD


**DRAWING:**  
**PART GROUND FLOOR WOOD SHOP ELECTRICAL PLAN**

**BARRY BRYAN ASSOCIATES**  
 Architects  
 Engineers  
 Project Managers  
 250 Water Street  
 Suite 201  
 Whitby, Ontario  
 L1N 0G5  
 Tel: (905) 666-5252  
 Fax: (905) 666-5250  
 e-mail: bba@bba-archeng.com

LICENSED PROFESSIONAL ENGINEER  
 D.E. TOMINGAS  
 90236233  
 JAN30/2026  
 PROVINCE OF ONTARIO

DESIGN BY: TM	DOC CONTROL: DATE:
DRAWN BY: STAFF	% COMPLETE:
CHECKED BY: TM	INITIAL:
DATE: MAY 2025	
SCALE: 1:50	
FILE:	

PROJECT NO: **25032**      DRAWING NO: **E-4**

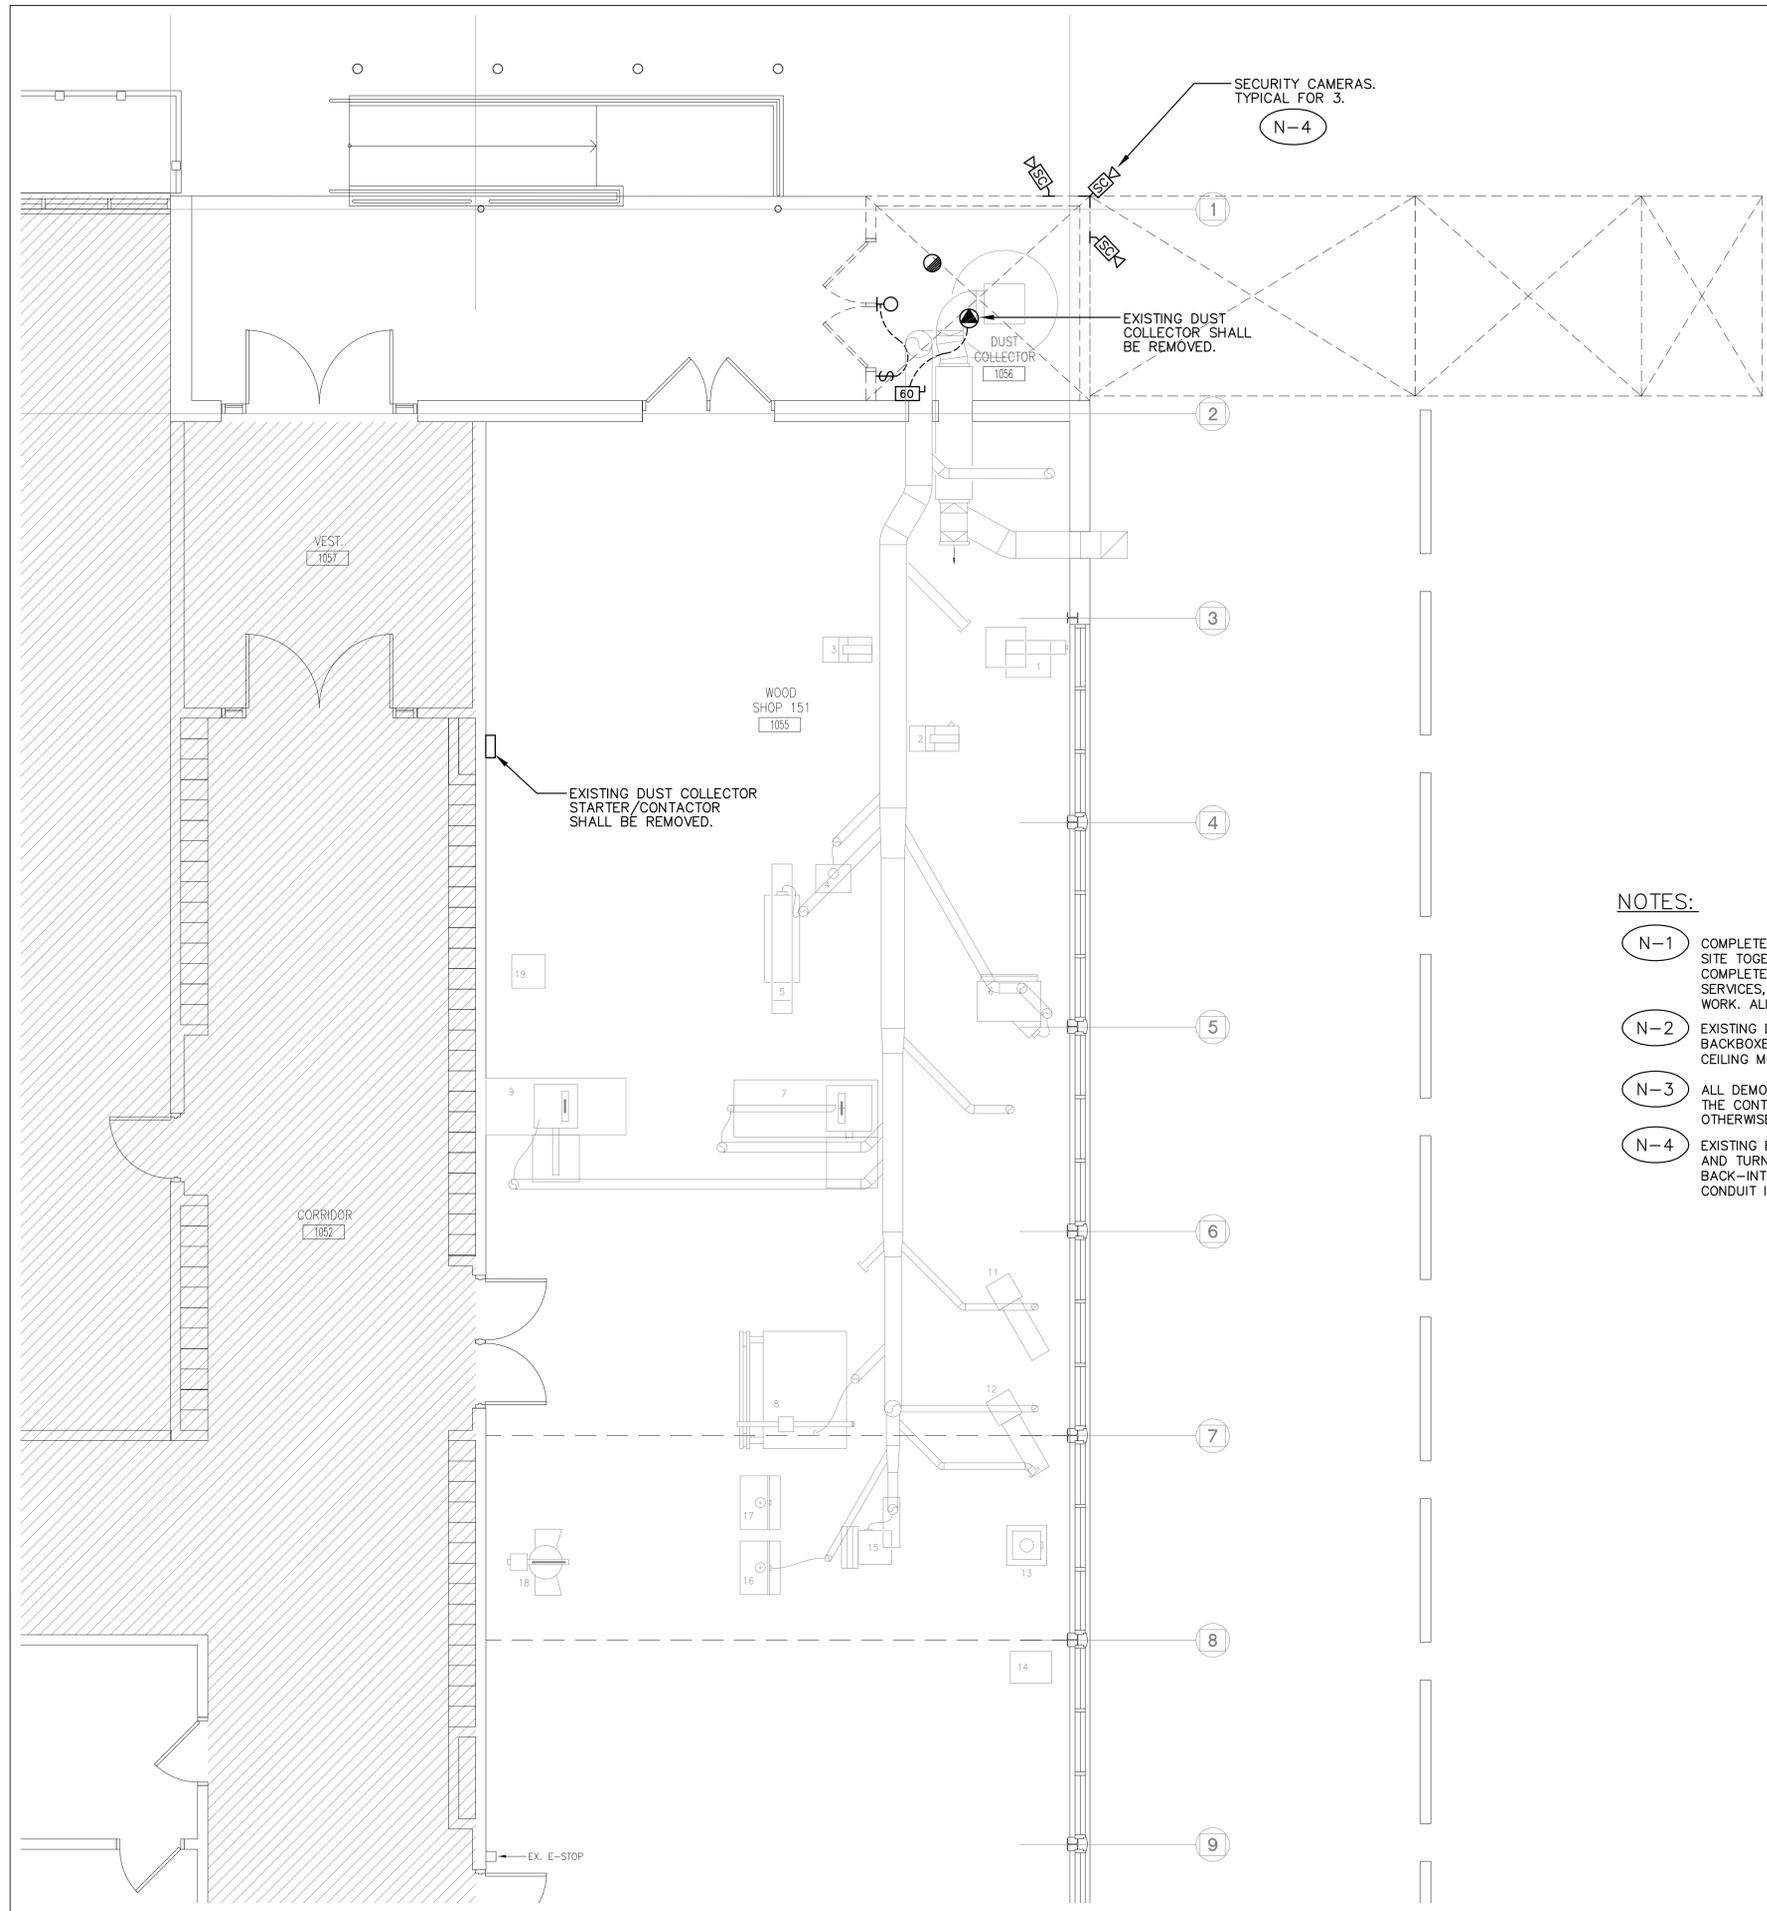

**NOTES:**

- N-1 COMPLETE EXTENT OF DEMOLITION IS NOT SHOWN. TENDERERS SHALL REVIEW THE SITE TOGETHER WITH THE DOCUMENTS OF ALL OTHER TRADES TO DETERMINE THE COMPLETE EXTENT OF DEMOLITION. MAKE ALLOWANCES FOR ANY NEW OR EXISTING SERVICES, DEVICES, OR EQUIPMENT RELOCATIONS NECESSARY TO COMPLETE THE WORK. ALLOW FOR ALL COSTS.
- N-2 EXISTING DEVICES BEING REMOVED SHALL BE REMOVED C/W ALL ASSOCIATED BACKBOXES, WIRING AND CONDUIT BACK TO ASSOCIATED PANELBOARD/CEILING MOUNTED JUNCTION BOX.
- N-3 ALL DEMOLISHED MATERIALS AND EQUIPMENT SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE REMOVED ENTIRELY FROM THE SITE UNLESS OTHERWISE NOTED.
- N-4 EXISTING EXTERIOR CAMERAS, AND MOUNTING ACCESSORIES SHALL BE REMOVED, AND TURNED OVER TO OWNER (HPE) REPRESENTATIVE. CABLING SHALL BE PULLED BACK-INTO WOOD SHOP SPACE AND LEFT COILED FOR FUTURE USE. ALL EXTERIOR CONDUIT IN DEMOLITION AREA SHALL BE REMOVED. TYPICAL FOR 3.

DO NOT SCALE THE DRAWINGS  
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.  
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.  
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES	DATE	BY
1	ISSUED FOR REVIEW	JUN 05 2025	TM
2	RE-ISSUED FOR REVIEW	JAN 27 2026	TM
3	ISSUED FOR PERMIT AND TENDER	JAN 30 2026	TM

NO.	REVISIONS	DATE	BY

DYNAMIC DESIGNS AND ENGINEERING INC.  
 111 Hodgson Ave. Kettleby, Ontario L7B 0C7  
 Tel. (905) 841-7278  
 dyneng@rogers.com

**PROJECT:**  
**EASTSIDE SECONDARY SHOP DUST COLLECTOR REPLACEMENT**  
 275 FARLEY AVENUE  
 BELLEVILLE, ONTARIO  
 HASTING & PRINCE EDWARD DISTRICT SCHOOL BOARD

**DRAWING:**  
**PART GROUND FLOOR WOOD SHOP DEMOLITION PLAN ELECTRICAL**




**BARRY BRYAN ASSOCIATES**  
 Architects  
 Engineers  
 Project Managers  
 250 Water Street  
 Suite 201  
 Whitby, Ontario  
 L1N 0G5  
 Tel: (905) 666-5252  
 Fax: (905) 666-5250  
 e-mail: bba@bba-archeng.com



25 032

DESIGN BY: TM	DOC. CONTROL: DATE:
DRAWN BY: STAFF	% COMPLETE:
CHECKED BY: TM	INITIAL:
DATE: MAY 2025	SCALE: 1:50
FILE:	

PROJECT NO: **25032**      DRAWING NO: **E-5**

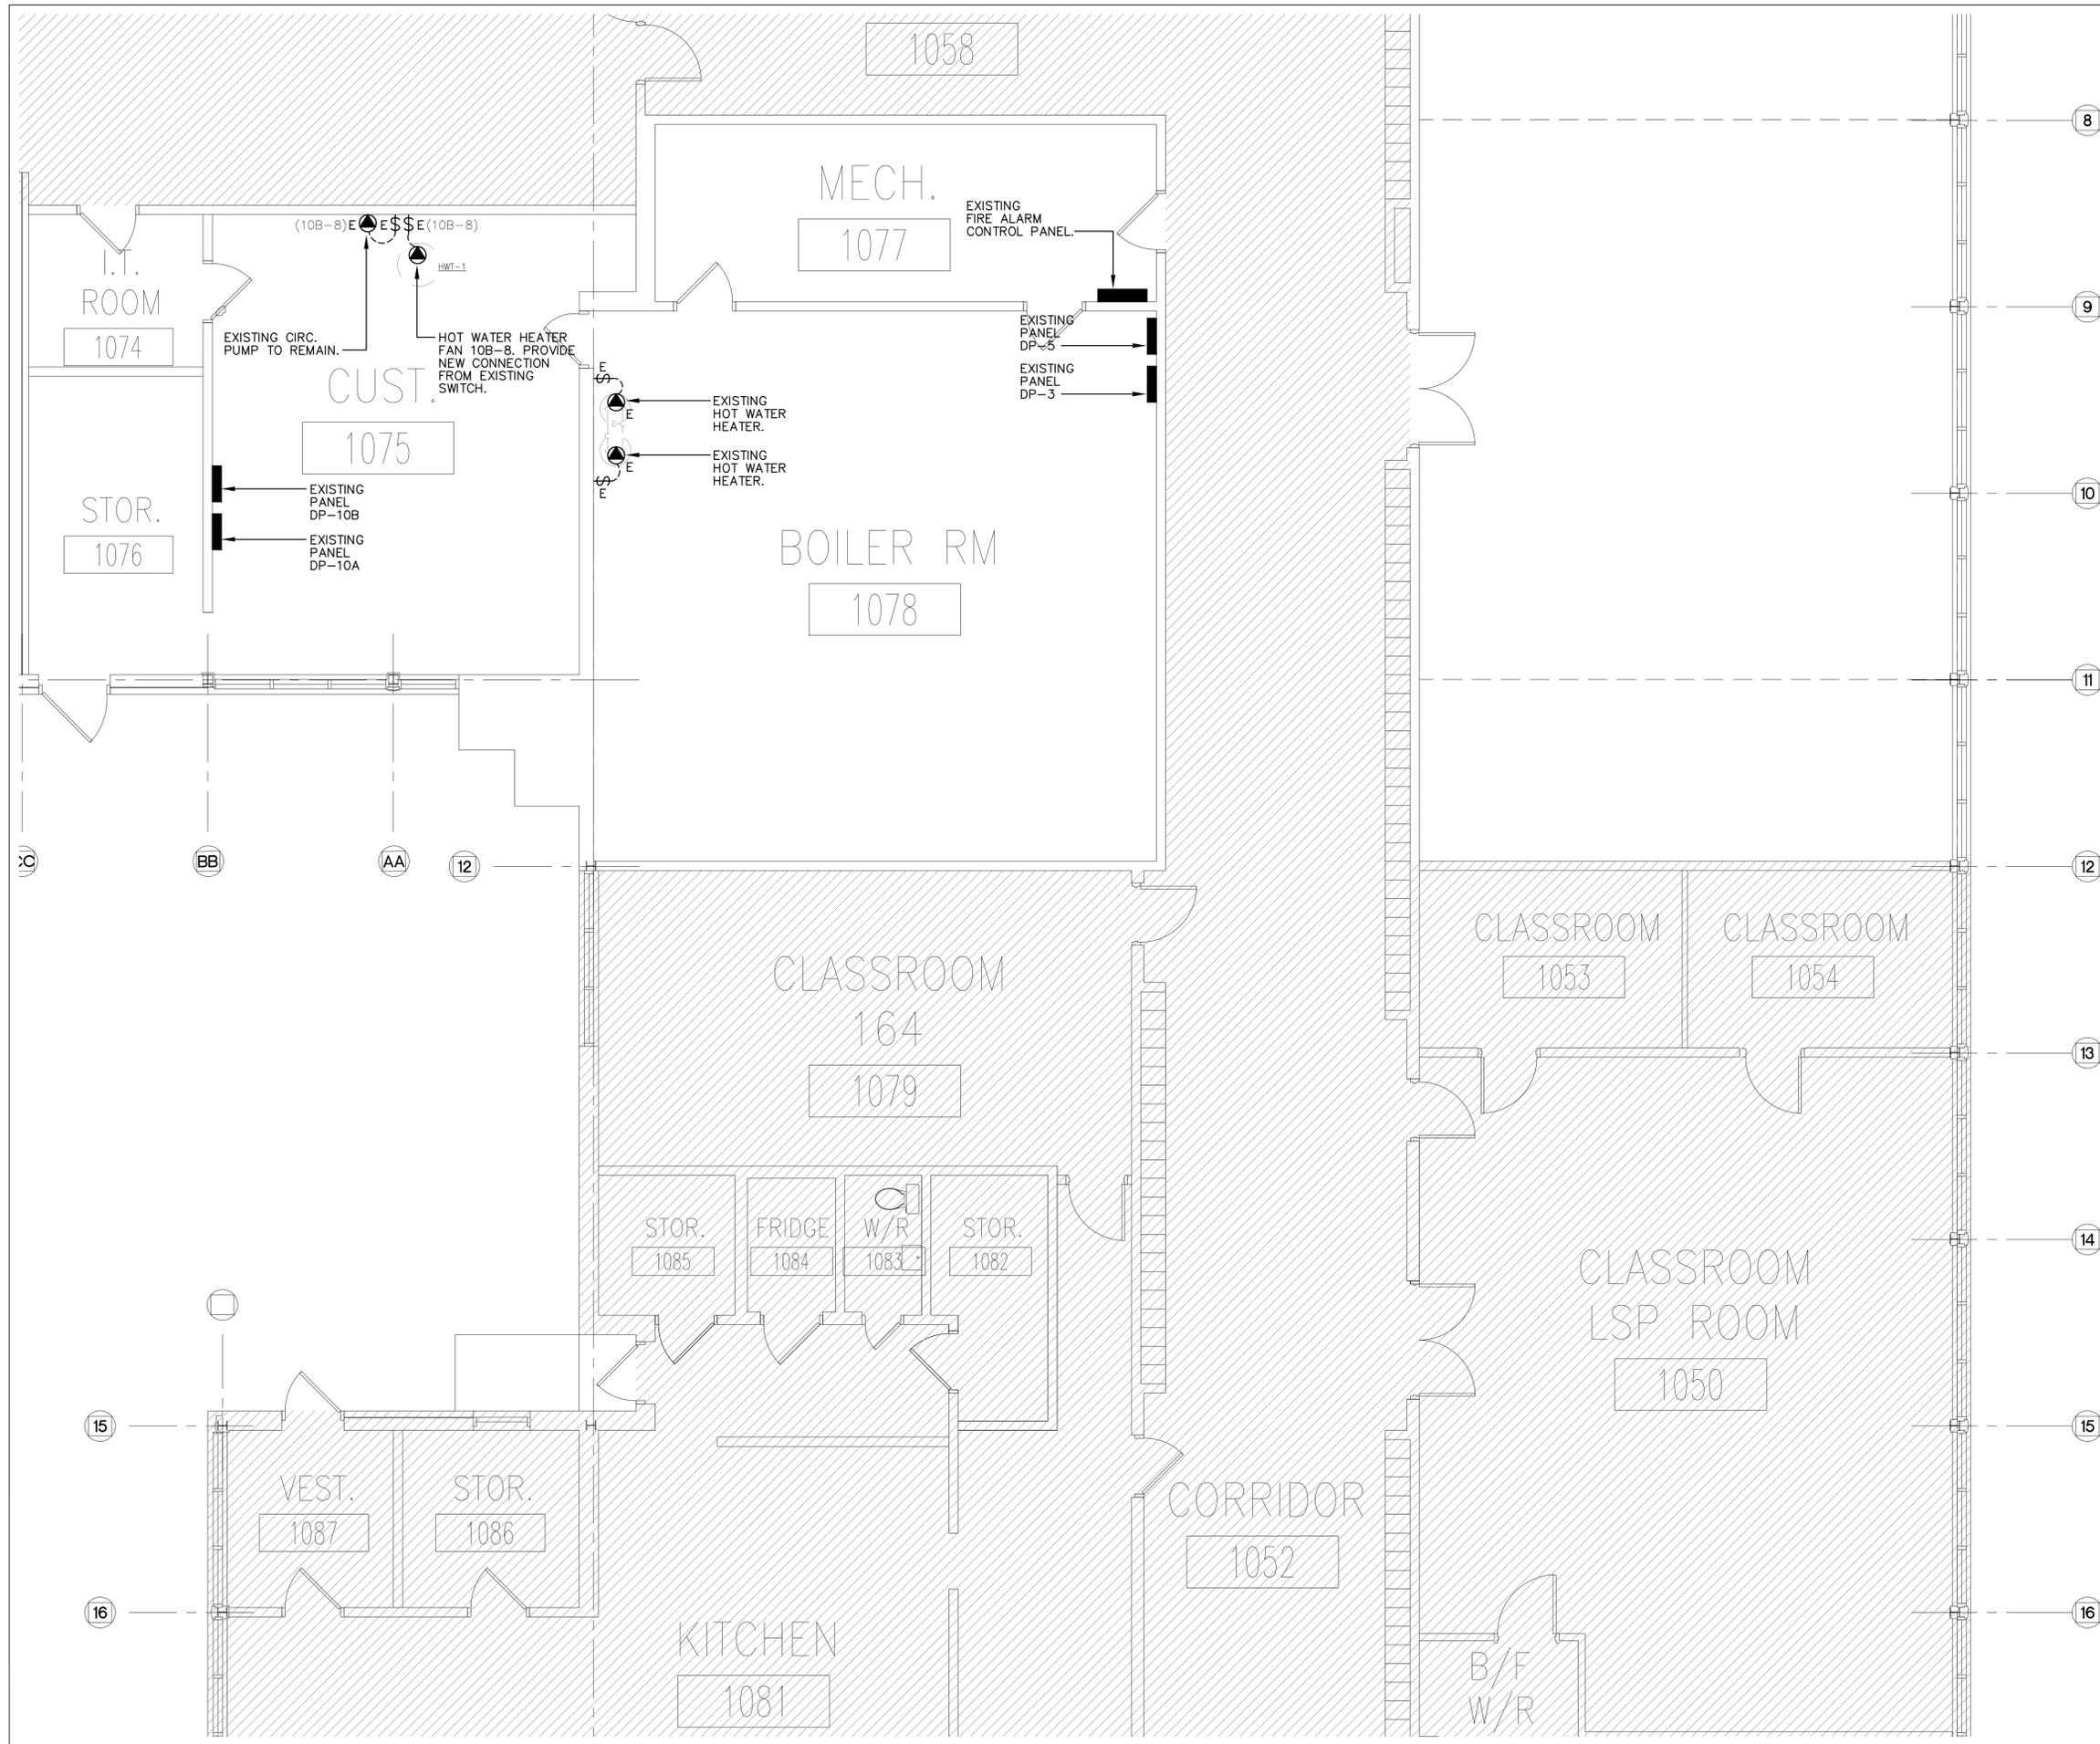

DO NOT SCALE THE DRAWINGS  
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.  
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE  
COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED  
UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE  
WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.  
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED  
AND SEALED BY THE CONSULTANT.



NO.	ISSUES	DATE	BY
1	ISSUED FOR REVIEW	JUN 05 2025	TM
2	RE-ISSUED FOR REVIEW	JAN 27 2026	TM
3	ISSUED FOR PERMIT AND TENDER	JAN 30 2026	TM

NO.	REVISIONS	DATE	BY

DYNAMIC DESIGNS AND ENGINEERING INC.  
♦♦♦  
111 Hodgson Ave. Kettleby, Ontario L7B 0C7  
Tel. (905) 841-7278  
dyneng@rogers.com

PROJECT:  
**EASTSIDE SECONDARY  
SHOP DUST COLLECTOR  
REPLACEMENT**  
275 FARLEY AVENUE  
BELLEVILLE, ONTARIO  
HASTING & PRINCE EDWARD DISTRICT SCHOOL BOARD

DRAWING:  
**PART GROUND FLOOR  
BOILER ROOM  
ELECTRICAL PLAN**

**B B A**

**BARRY BRYAN  
ASSOCIATES**  
Architects  
Engineers  
Project Managers  
250 Water Street  
Suite 201  
Whitby, Ontario  
L1N 0G5  
Tel: (905) 666-5252  
Fax: (905) 666-5250  
e-mail: bba@bba-archeng.com

25 032

DESIGN BY: TM	DOC. CONTROL: DATE:
DRAWN BY: STAFF	% COMPLETE:
CHECKED BY: TM	INITIAL:
DATE: MAY 2025	
SCALE: 1:50	
FILE:	

PROJECT NO: **25032**      DRAWING NO: **E-6**