

**PLUMBING SPECIFICATIONS:**

- 1. ALL PLUMBING PRODUCTS SHALL BE "LEAD-FREE" CERTIFIED TO ANSINFP 372.
- 2. ALL NEW ABOVE GROUND WATER PIPING SHALL BE TYPE 'L' HARD COPPER, CERTIFIED TO ASTM B88, WITH SOLDER JOINTS.
- 3. DRAINAGE SYSTEM (ABOVE GROUND):
  - 1. 2-1/2"(63mm) AND OVER - CAST IRON MJ PIPE WITH MJ FITTINGS AND STAINLESS STEEL CLAMPS.
  - 2. 2"(50mm) AND UNDER - COPPER DWV PIPE WITH WROUGHT COPPER SOLDER FITTINGS OR PEK XFR OR PVC DWV.
- 4. DRAINAGE SYSTEM (UNDERGROUND):
  - 1. PIPE UP TO AND INCLUDING 75mm(3") SHALL BE:
    - 1. ULC CERTIFIED PVC 40 DWV PIPE TO CANCSA B181.2 COMPLETE WITH PVC DWV FITTINGS TO CANCSA B181.2 WITH SOLVENT WELD JOINT.
  - 2. PIPE 75mm(3") UP TO AND INCLUDING 100mm(4") SHALL BE:
    - 1. ULC CERTIFIED PVC 40 DWV PIPE TO CANCSA B181.2 COMPLETE WITH PVC DWV FITTINGS TO CANCSA B181.2 WITH SOLVENT WELD JOINT, OR ULC CERTIFIED PVC SDR 2835 BDS PIPE TO CANCSA B182.1 COMPLETE WITH PVC BDS FITTINGS TO CANCSA B182.2 WITH RING GASKET JOINTS.
  - 3. PIPE 125mm(5") AND UP SHALL BE:
    - 1. ULC CERTIFIED PVC SDR 2835 SEWER PIPE TO CANCSA B182.2 COMPLETE WITH PVC FITTINGS TO CANCSA B182.2 WITH RING GASKET JOINTS.
- 5. VENTS PASSING THROUGH ROOF SHALL USE HEAVY GAUGE, SEAMLESS, SPUN ALUMINUM PRE-INSULATED, VANDAL PROOF VENT FLASHING AS SUPPLIED BY NATIONAL ROOFING SUPPLY OR THALER METAL.
- 6. ALL NEW PIPE HANGERS SHALL BE:
  - 1. EPOXY COATED CLEVIS TYPE WITH THREADED SUSPENSION RODS WHERE HANGER DIRECTLY TOUCHES PIPING
  - 2. ADJUSTABLE WROUGHT IRON CLEVIS TYPE AND/OR ADJUSTABLE RING WITH THREADED SUSPENSION RODS WHERE HANGERS WRAP AROUND OUTSIDE OF PIPE INSULATION. PROVIDE SADDLES TO PREVENT CRUSHING OF INSULATION EXCEPT FOR SIZES LESS THAN EQUAL TO 1-1/4"Ø. INSULATION CAN WRAP AROUND HANGERS.
  - 3. PIPE HANGER SPACING:
    - SIZES UP TO 1-1/4"(32mm) = 8'(2.9m) SPACING
    - SIZES 1-1/2"(38mm) TO 2"(50mm) = 10'(3m) SPACING
    - SIZES 2-1/2"(63mm) AND OVER = 12'(3.5m) SPACING
  - 4. PROVIDE HANGER WITHIN 12"(300mm) OF EVERY ELBOW
- 7. PROVIDE A SUPPLY SHUT OFF VALVE ON HOT, COLD AND/OR TEMPERED WATER SUPPLY TO EACH FIXTURE. SUPPLY SHUT OFF SHALL BE EQUAL TO MCGUIRE H165. ALL VALVES SHALL BE LINE SIZE.
- 8. BALL VALVES SHALL BE LEAD FREE WITH SOLDERED OR THREADED ENDS. BALL VALVES SHALL BE EQUAL TO KITZ #858 & #859. ALL VALVES SHALL BE LINE SIZE.
- 9. CHECK VALVES SHALL BE LEAD FREE. CHECK VALVES 2" AND SMALLER SHALL BE EQUAL TO KITZ #822 & #823 WITH SOLDER OR THREADED ENDS. 2-1/2" AND LARGER CHECK VALVES SHALL BE EQUAL TO KITZ #1500AOM WITH FLANGED ENDS. ALL VALVES SHALL BE LINE SIZE.
- 10. FLEXIBLE SUPPLIES ARE NOT ACCEPTABLE FOR FLUSH TANK TOILETS OR ANY EXPOSED INSTALLATION. WHERE SUPPLIES ARE INSTALLED UNDER COUNTER OR BEHIND SHERRODS FLEXIBLE SUPPLIES ARE ACCEPTABLE.
- 11. REFER TO PLUMBING FIXTURE SPECS INCLUDING FIXTURES, TRAP SEAL PRIMERS, WATER HAMMER ARRESTORS, ACCESS DOORS, ETC.
- 12. INSULATION:
  - 1. EXTERNAL PIPE INSULATION SHALL BE RIGID, SECTIONAL FIBERGLASS TYPE AND BE COMPLETE WITH FACTORY APPLIED ALL PURPOSE VAPOUR BARRIER. PRE-FORMED INSULATION SHALL BE USED AT PIPE FITTINGS, VALVES, ETC. PROVIDE NON-CRUSHING INSULATION AT ALL PIPE HANGERS AND PROVIDE SADDLES.
  - 2. INSULATE DCW, DHW AND DTW PIPING.
  - 3. INSULATE VENT LINES 1.5m BACK FROM ROOF.
  - 4. INSULATION THICKNESS: 1"(25mm)
- 13. ACCESS DOORS/COVERS
  - 1. FLUSH ACCESS DOOR - UNIVERSAL ACUDOR #UF-5000 UNIVERSAL ACCESS DOORS, 14 GA. (1.7mm) STEEL, BAKED ENAMEL PRIME COAT, CONTINUOUS CONCEALED HINGE, WITH POSITIVE AND SELF-OPENING SCREWDRIVER OPERATED LOCK. DOORS IN WASHROOMS SHALL BE STAINLESS STEEL. ALL OTHER PANELS SHALL BE BAKED ENAMEL PRIME COATED FOR FIELD PAINTING. MINIMUM SIZE OF PANELS SHALL BE 12"x18" (300mmx450mm). WHEREVER POSSIBLE 24"x24" (600mmx600mm) PANELS SHALL BE USED.
  - 2. RECESSED ACCESS DOOR - DRYWALL AREA: ACUDOR RDW-5015 SERIES RECESSED ACCESS DOOR, 16 GA. (1.5mm) STEEL, BAKED ENAMEL PRIME COAT, WITH CONCEALED PIVOTING ROD TYPE HINGE AND SELF-OPENING SCREWDRIVER OPERATED LOCK. DOOR TO BE RECESSED 5/8" (16mm) TO RECEIVE DRYWALL. FLANGE OF DOOR TO BE GALVANIZED STEEL FOR FIELD PAINTING TAPING BEADING TO PROVIDE FINISH OF DRYWALL JOINTS FOR FIELD PAINTING.

**HVAC MATERIAL SPECIFICATIONS:**

- 1. DUCTWORK:
  - 1. IN CONFORMANCE WITH SMACNA, ASHRAE, OBC, NFPA 90A.
  - 2. SHEET METAL SHALL BE BEST QUALITY LOCK FORMING GALVANIZED SHEET METAL. GALVANIZING SHALL BE TO ASTM A525 (G90), HAVING A THICKNESS OF 0.054 MM AND WEIGHING NOT LESS THAN 0.31 KG/M2 ON EACH SURFACE. PROVIDE INSTRUMENT TEST PORTS IN DUCTS FOR PITCH TUBE INSERTION WITH CAM-ACTION HANDLE, MOULDED NEOPRENE GASKET AND EXPANSION PLUG. ZINC COATED STEEL CONSTRUCTION.
  - 4. ALL ROUND DUCTWORK SHALL BE SPIRAL.
- 2. DUCT ACCESS DOORS
  - 1. DUCT ACCESS DOORS SHALL BE EQUAL TO NAILOR 085CL(SQUARE) OR 0800(OVAL). REFER TO DETAIL.
- 3. REFRIGERATION PIPING:
  - 1. TYPE A OR COPPER, CERTIFIED TO ASTM B280, WITH BRAZED JOINTS.
  - 2. PROVIDE P-TRAP AT UNIT, SHUT OFF VALVE, FILTER DRYER, REPLACEMENT CARTRIDGE AND TYPE, AND SIGHT GLASS AT THE CONDENSER. MAKE OIL ADJUSTMENT AS REQUIRED TO SUIT LENGTH OF REFRIGERATION PIPING.
  - 3. FOR REFRIGERATION SYSTEMS LARGER THAN 3 TONS OF COOLING AND AIR CONDITIONING SYSTEMS LARGER THAN 5 TONS, CONTRACTOR SHALL SUPPLY A TSSA CERTIFICATE ON COMPLETION OF INSTALLATION AND PROVIDE TO CONSULTANT.
  - 4. PROVIDE 1"(25mm) INSULATION ON ALL INDOOR & OUTDOOR REFRIGERATION PIPING. SUCTION AND LIQUID LINES SHALL BOTH BE INSULATED OUTSIDE OF BUILDING.
  - 5. PROVIDE UV RESISTANT ALUMINUM JACKET ON OUTDOOR REFRIGERATION PIPING EQUAL TO "3M VENTURECLAD".
- 4. HOT WATER HEATING PIPING:
  - 1. PIPING UP TO INCLUDING 2"(50mm) PIPING SHALL BE BLACK STEEL SCHEDULE 40 WITH MALLEABLE STEEL THREADED SCREW FITTINGS OR COPPER WITH SOLDER JOINTS.
  - 2. PIPING 2-1/2"(63mm) AND OVER: PIPING SHALL BE BLACK STEEL SCHEDULE 40 WITH WELDED FITTINGS.
  - 3. BRASS ADAPTERS SHALL BE PROVIDED AT ALL CONNECTIONS BETWEEN COPPER TUBING AND FERROUS PIPING.
  - 4. PROVIDE AUTOMATIC AIR VENTS CW BALL VALVE AT ALL HIGH POINTS. REFER TO SPECIFICATIONS BELOW.
  - 5. PROVIDE DRAIN VALVES CW HOWE CONNECTION AND CAP AT ALL LOW POINTS AND AS NOTED ON DETAILS.
  - 6. ALLOW FOR ANY CHEMICAL TREATMENT OR GLYCOL FILL TO BRING SYSTEM TO ACCEPTABLE LEVELS AND SUBMIT REPORTS.
- 5. PIPE HANGERS:
  - 1. ADJUSTABLE WROUGHT IRON CLEVIS TYPE AND/OR ADJUSTABLE RING WITH THREADED SUSPENSION RODS
  - 2. FOR COPPER PIPING (INCLUDING PIPING WITHIN WALL/FIN ENCLOSURE) PROVIDE COPPER PLATED OR EPOXY TYPE HANGERS OR PROVIDE SEPARATION OF DISSIMILAR METALS WITH APPROVED DIELECTRIC MATERIALS. INSULATING TAPE IS NOT ACCEPTABLE.
  - 3. WHERE HANGERS WRAP AROUND OUTSIDE OF PIPE INSULATION, PROVIDE SADDLES TO PREVENT CRUSHING OF INSULATION.
  - 4. PIPE HANGER SPACING:
    - SIZES UP TO 1-1/4"(32mm) = 8'(2.9m) SPACING
    - SIZES 1-1/2"(38mm) TO 2"(50mm) = 10'(3m) SPACING
    - SIZES 2-1/2"(63mm) AND OVER = 12'(3.5m) SPACING
  - 5. PROVIDE HANGER WITHIN 12"(300mm) OF EVERY ELBOW
- 6. VALVES AND ACCESSORIES:
  - 1. ALL VALVES SHALL BE LINE SIZED UNLESS OTHERWISE NOTED. (CBVs GENERALLY NOT LINE SIZED)
  - 2. CIRCUIT BALANCING VALVES SHALL BE IM TA STAS/STAD/STAF SERIES (NO ALTERNATES ACCEPTABLE). MOUNT WITH PORTS UPRIGHT OR AT LEAST 90° UP FROM BOTTOM. SUBMIT SHOP DRAWINGS COMPLETE WITH VALVE SIZING SCHEDULE.
  - 3. BALL VALVES SHALL BE EQUAL TO KITZ 58 & 59.
  - 4. BUTTERFLY VALVES SHALL BE EQUAL TO KITZ #6122 OR #6141.
  - 5. AUTOMATIC AIR VENTS SHALL BE EQUAL TO:
    - WALLFINS, CONVECTORS, RADS, "MAID-O-MIST" #67 COMPLETE WITH BALL VALVE
    - PIPE MAINS & LINES, MECHANICAL ROOMS, EQUIPMENT, COILS, CEILING SPACES AND ALL OTHER SPACES EXCEPT NOTED ABOVE. "MAID-O-MIST" #71 COMPLETE WITH BALL VALVE
- 7. WATER TREATMENT:
  - 1. ALLOW FOR CHEMICAL TREATMENT TO BRING SYSTEM TO ACCEPTABLE LEVELS AND SUBMIT REPORTS.
  - 2. OBTAIN THE SERVICES OF MK SERVICES FOR ALL WATER TREATMENT.
- 8. DUCT INSULATION:
  - 1. ACOUSTIC DUCT INSULATION
    - 1. FIBERGLASS INSULATION, COATED TO PREVENT FIBRE EROSION AT AIR VELOCITIES UP TO 400 fpm.
    - 2. ALL SUBSTRATE MATERIAL TO BE NON-DARKENED, CONTRASTING COLOUR FROM LINER LAYER.
    - 3. THICKNESS: 1" (25mm)
  - 2. THERMAL DUCT INSULATION
    - 1. INSULATION SHALL BE PRECOVERED, PREFORMED RIGID FIBROUS GLASS INSULATION COMPLETE WITH FOIL OR KRAFT ALL-PURPOSE JACKET.
    - 2. 0.75 PCF (12 kg/m³) DENSITY, 0.29 K-VALUE WITH 25/50 FLAME SPREAD/SMOKE DEVELOPMENT CLASSIFICATION IN ACCORDANCE WITH CANULC-S102.
    - 3. SUPPLY, RETURN AND EXHAUST DUCT APPLICATION THICKNESS: 1" (25mm) MINIMUM.
    - 4. OUTDOOR AIR INTAKE DUCT APPLICATION THICKNESS: 2"(50mm) MINIMUM.
    - 5. RECOVERING JACKETS (INTERIOR): ULC LISTED "THERMO CANVAS" TREATED COTTON FABRIC.
- 9. PIPE INSULATION:
  - 1. PROVIDE 1-1/2"(38mm) PIPE INSULATION ON ALL HEATING PIPING SIZES UP TO AND INCLUDING 1-1/4"(32mm)
  - 2. PROVIDE 2"(50mm) PIPE INSULATION ON ALL HEATING PIPING SIZES 1-1/2"(38mm) AND OVER
  - 3. PROVIDE 1"(25mm) PIPE INSULATION ON ALL VENT PIPING 10'(3m) BACK FROM ROOF
  - 4. EXTERNAL PIPE INSULATION SHALL BE RIGID, SECTIONAL FIBERGLASS TYPE AND BE COMPLETE WITH FACTORY SUPPLIED ALL PURPOSE VAPOUR BARRIER. PRE-FORMED INSULATION SHALL BE USED AT PIPE FITTINGS, VALVES, ETC. PROVIDE NON-CRUSHING INSULATION AT ALL PIPE HANGERS AND PROVIDE SADDLES.
  - 5. PROVIDE PVC JACKET ON ALL INSULATION IN EXPOSED AREAS.
- 10. GAS PIPING
  - 1. ALL GAS PIPING SHALL BE INSTALLED IN ACCORDANCE WITH CSA B149.1:20 AND APPLICABLE TSSA CODE ADOPTION DOCUMENTS.
  - 2. ABOVE GROUND GAS PIPING SHALL BE ASTM A53 SCHEDULE 40 SEAMLESS WROUGHT STEEL WITH STANDARD THREADED MALLEABLE FITTINGS TO ANSI B16.3 (SIZE 2"(50mm) AND SMALLER). PAINT INDOOR PIPING WITH 2 COATS OF YELLOW PAINT IN ACCORDANCE WITH CODE. ALL OUTSIDE PIPING AND SUPPORTS SHALL BE PAINTED WITH 2 COATS OF WEATHERPROOF YELLOW PAINT. ALL PIPING TO BE LABELED WITH SERVICE PRESSURE.
  - 3. GAS PIPING ROOF SUPPORTS SHALL BE RUBBER BLOCKS EQUAL TO COPPER-B-LINE.
- 11. ACCESS DOORS/COVERS
  - 1. FLUSH ACCESS DOOR - UNIVERSAL ACUDOR RUF-5000 UNIVERSAL ACCESS DOORS, 14 GA. (1.7mm) STEEL, BAKED ENAMEL PRIME COAT, CONTINUOUS CONCEALED HINGE, WITH POSITIVE AND SELF-OPENING SCREWDRIVER OPERATED LOCK. DOORS IN WASHROOMS SHALL BE STAINLESS STEEL. ALL OTHER PANELS SHALL BE BAKED ENAMEL PRIME COATED FOR FIELD PAINTING. MINIMUM SIZE OF PANELS SHALL BE 12"x18" (300mmx450mm). WHEREVER POSSIBLE 24"x24" (600mmx600mm) PANELS SHALL BE USED.
  - 2. RECESSED ACCESS DOOR - DRYWALL AREA: ACUDOR RDW-5015 SERIES RECESSED ACCESS DOOR, 16 GA. (1.5mm) STEEL, BAKED ENAMEL PRIME COAT, WITH CONCEALED PIVOTING ROD TYPE HINGE AND SELF-OPENING SCREWDRIVER OPERATED LOCK. DOOR TO BE RECESSED 5/8" (16mm) TO RECEIVE DRYWALL. FLANGE OF DOOR TO BE GALVANIZED STEEL. TAPING BEADING TO PROVIDE FINISH OF DRYWALL JOINTS FOR FIELD PAINTING.

**HVAC NOTES:**

- 1. CONCEAL ALL SERVICES IN CEILING SPACES AND FURRED CONSTRUCTION UNLESS INSTALLED IN UNFINISHED OR EXPOSED AREAS OR IF SPECIFICALLY NOTED TO BE EXPOSED.
- 2. ALL GAS PIPING WORK TO BE COMPLETED BY A TSSA CERTIFIED GAS FITTER WITH THE COMMENSURATE CLASSIFICATION FOR THE SYSTEM / APPLIANCE CAPACITY.
- 3. COORDINATE INSTALLATION WITH ALL OTHER TRADES.
- 4. REFER TO REFLECTED CEILING PLAN TO CONFIRM EXACT LOCATION OF GRILLES AND DIFFUSERS. LIGHTING TAKES PRECEDENCE.
- 5. PROVIDE ACOUSTIC INSULATION IN ALL TRANSFER DUCTS AND AS INDICATED ON DRAWINGS. SEAL ALL EXPOSED ENDS OF INSULATION.
- 6. PROVIDE TURNING VANES IN ALL SQUARE ELBOWS AND SHORT RADIUS ELBOWS FOR SUPPLY AIR DUCTS.
- 7. TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.
- 8. SEAL ALL JOINTS ON ALL SUPPLY & RETURN AIR DUCTS WITH DURODYNE DUCT SEALER IN CONFORMANCE TO CLASS 'C' ASHRAE 90.1 AND SMACNA STANDARDS. USE CLEAR DUCT SEALER OR SEAL BEHIND JOINTS FOR ALL EXPOSED DUCTWORK.
- 9. BRANCH DUCTWORK TO DIFFUSERS TO BE SAME SIZE AS DIFFUSER NECK.
- 10. PROVIDE BALANCE DAMPERS ON ALL BRANCH DUCTS CLOSE TO MAIN TAKE-OFF. REVIEW WITH BALANCING CONTRACTOR TO CONFIRM LOCATIONS OF ALL BALANCE DAMPERS PRIOR TO CONSTRUCTION.
- 11. FLEXIBLE DUCT SHALL ONLY BE USED IN SUPPLY AIR APPLICATIONS FOR CONNECTIONS TO DIFFUSERS IN DROPPED CEILING. FLEXIBLE DUCT SHALL BE MAXIMUM 6' (1.8m) IN LENGTH AND SHALL BE SECURELY FASTENED TO DUCTS AND DIFFUSERS. PROVIDE HANGERS AND FLEXIBLE DUCTWORK WITHOUT SHARP 90°S, SAGGING, OR CRUSHING OF DUCT. FLEXIBLE DUCT IS NOT ACCEPTABLE IN ANY OTHER APPLICATION.
- 12. PROVIDE EXTERNAL INSULATION ON ALL SUPPLY AIR DUCTS, ALL OUTSIDE AIR DUCTS AND ON ALL EXHAUST DUCTS WITHIN 8' (2.4m) OF OUTSIDE WALL/ROOF INCLUDING RIGID AND FLEXIBLE DUCT.
- 13. CONFIRM EXACT LOCATIONS OF SENSORS WITH ENGINEER AND OWNER. MOUNT SENSORS AT 59" (1500mm) AFF. ENSURE THAT SENSOR LOCATIONS WILL NOT BE AFFECTED BY DIRECT SUNLIGHT, COLD WALLS OR MILLWORK.
- 14. ALL INDOOR CONTROL WIRING SHALL BE RUN IN EMT CONDUIT OR FT6 (EMT SHALL BE USED IN EXPOSED AREAS). LAST 3' SHALL BE BX WHEN USING CONDUIT. ALL OUTDOOR CONTROL WIRING SHALL BE RUN IN LIQUIDTIGHT. ALL CONTROL WIRING SHALL RUN PARALLEL TO BUILDING LINES AND TIGHT TO ROOF DECK OR WALLS. ALL CONTROL WIRING PASSING THROUGH WALLS SHALL BE RUN IN EMT CONDUIT CW BUSHINGS AT EACH END.
- 15. PROVIDE SLEEVES FOR PIPES THROUGH ALL NEW BLOCK WALLS. FILL VOIDS AROUND PIPES. ENSURE NO CONTACT BETWEEN DISSIMILAR METALS.
- 16. SUPPLY DRYWALL ACCESS DOORS FOR CONCEALED FIRE AND BALANCE DAMPERS AND ANY OTHER CONCEALED DEVICES AND TURN OVER TO THE GENERAL CONTRACTOR FOR INSTALLATION. DOORS TO BE GALVANIZED STEEL FOR FIELD PAINTING. DOORS SHALL BE RATED WHERE INSTALLED IN FIRE SEPARATIONS.
- 17. DRAIN HEATING SYSTEMS AS REQUIRED FOR NEW WORK. FILL, FLUSH, TEST AND TREAT (CHEMICAL TREATMENT) AFTER WORK IS COMPLETE. PROVIDE ALL PORTS, VALVES AND GAUGES AS REQUIRED. SUBMIT CHEMICAL TREATMENT REPORT TO ENGINEER. FREEZING OF PIPING TO ALLOW ISOLATION OF WORK AREA IS ACCEPTABLE IN LIEU OF DRAINING.
- 18. ALL CBVs SHALL BE MOUNTED WITH PORTS IN HORIZONTAL (90°) POSITION.
- 19. PROVIDE EXTERNAL INSULATION ON ALL HEATING PIPING EXCEPT IN WALL/FIN ENCLOSURES.
- 20. PROVIDE FIRE STOPPING AROUND ALL NEW PIPING THROUGH FIRE SEPARATIONS IN ACCORDANCE WITH CANULC-S115.
- 21. LABEL ALL EXISTING AND NEW HEATING PIPING IN AREAS OF WORK COMPLETE WITH FLOW ARROWS. LABELS SHALL BE MAX 3m(10') SPACING AND ON EITHER SIDE OF WALLS. LABELINGS MUST BE COMPLETED PRIOR TO NEW CEILING BEING INSTALLED OTHERWISE IT IS THE CONTRACTORS RESPONSIBILITY TO REMOVE CEILING TILES FOR INSPECTION AT THE DIRECTION OF THE CONSULTANT.
- 22. LABEL CEILING TILE WITH PERMANENT ADHESIVE LABELS OR LAMACOID NAMEPLATES FOR ACCESS TO MECHANICAL ITEMS.
- 23. OBTAIN THE SERVICES OF A NEBB, CAABC OR NECTA ACCREDITED BALANCING COMPANY TO BALANCE THE COMPLETE HVAC SYSTEM. PROVIDE REPORT TO ENGINEER FOR REVIEW. REFER TO SPECIFICATIONS FOR APPROVED AGENTS.
- 24. PROVIDE TESTING AND STARTUP OF ALL NEW EQUIPMENT AND PROVIDE REPORTS TO THE ENGINEER FOR REVIEW.

**PLUMBING NOTES:**

- 1. PROVIDE BEFORE AND AFTER SCOPING/FLUSHING.
- 2. PROVIDE CLEANOUTS AS REQUIRED BY CODE. SIZE OF CLEANOUTS TO BE SAME SIZE AS SANITARY LINES.
- 3. PROVIDE ALL TRENCHING, EXCAVATING AND BACKFILL FOR UNDERGROUND PLUMBING. ALL SAW CUTTING AND RESTORATION OF CONCRETE FLOOR IS BY GENERAL CONTRACTOR. COORDINATE WITH SAME.
- 4. PROVIDE NEW PLUMBING VENTS THROUGH SECOND FLOOR AND THROUGH ROOF AS REQUIRED BY CODE OR THE INTO EXISTING WHERE POSSIBLE. SUPPLY AND INSTALL ROOF VENTS AS PER SPECIFICATIONS. ALL ROOFING WORK INCLUDING CUTTING, FLASHING AND MODIFICATIONS TO ROOF MEMBRANE SHALL BE BY GENERAL CONTRACTOR. COORDINATE WITH SAME.
- 5. PROVIDE ISOLATION VALVES AT ALL FIXTURES.
- 6. INSULATE ALL NEW DOMESTIC HOT, COLD AND TEMPERED WATER PIPING WITH 1"(25mm) INSULATION. PROVIDE PVC JACKET OVER INSULATION IN EXPOSED AREAS.
- 7. PROVIDE SLEEVES FOR PIPES THROUGH ALL NEW BLOCK WALLS. FILL VOIDS AROUND PIPES. ENSURE NO CONTACT BETWEEN DISSIMILAR METALS.
- 8. PROVIDE FIRE STOPPING AROUND ALL PIPING THROUGH FIRE SEPARATIONS IN ACCORDANCE WITH CANULC-S115.
- 9. COORDINATE EXACT LOCATION OF NEW FLOOR DRAINS WITH GENERAL CONTRACTOR TO SUIT FLOOR SLOPE.
- 10. PROVIDE TRAP SEAL PRIMER FOR ALL FLOOR DRAINS USING PRIMER SPECIFIED IN PLUMBING FIXTURE SCHEDULE. PRIMERS SHALL BE CONCEALED, MOUNT IN CEILING SPACE AND RUN LINE CONCEALED DOWN WALL AND UNDER FLOOR TO DRAIN.
- 11. LABEL ALL NEW PIPING IN AREAS OF WORK COMPLETE WITH SERVICE AND FLOW ARROWS. LABELS SHALL BE MAX 3m(10') SPACING AND ON EITHER SIDE OF WALLS.
- 12. SUPPLY ACCESS DOORS WHERE REQUIRED AND TURN OVER TO GENERAL CONTRACTOR FOR INSTALLATION. REFER TO PLUMBING FIXTURE SCHEDULE.
- 13. PROVIDE SCOTCHCUTCHONS AROUND WATER AND SANITARY PIPING THROUGH WALL, FLOOR OR MILLWORK AT ALL FIXTURES.
- 14. LABEL CEILING GRID AT ACCESS TO ALL DEVICES.
- 15. FLUSH AND PERFORM A VIDEO INSPECTION OF ALL UNDERGROUND PIPING SYSTEMS AFTER CONSTRUCTION AND IMMEDIATELY PRIOR TO APPLYING FOR SUBSTANTIAL COMPLETION.

**GENERAL NOTES:**

- 1. WORK TO BE COMPLETED OUTSIDE REGULAR HOURS:
  - 1. ANY WORK THAT CREATES INTERFERENCE TO REGULAR SCHOOL OR OCCUPANT ACTIVITIES AND OPERATIONS SHALL BE DONE OUTSIDE OF REGULAR BUSINESS SCHOOL HOURS. THIS INCLUDES BUT IS NOT LIMITED TO SERVICE INTERRUPTIONS, WORK THAT GENERATES NOISE, WORK THAT GENERATES VIBRATIONS, WORK THAT CREATES RISKS TO BUILDING OCCUPANTS SHALL BE DONE OUTSIDE OF REGULAR SCHOOL HOURS.
  - 2. ANY WORK INSIDE OR OUTSIDE, THAT CREATES RISK TO BUILDING OCCUPANTS SHALL BE DONE OUTSIDE OF REGULAR SCHOOL HOURS.
  - 3. ANY WELDING SHALL BE DONE OUTSIDE REGULAR SCHOOL HOURS.
- 2. OBTAIN, ARRANGE AND PAY FOR ALL REQUIRED PERMITS AND INSPECTIONS.
- 3. THE CONTRACTOR AND ITS SUB-TRADES SHALL ATTEND BI-WEEKLY SITE MEETINGS OR AS ARRANGED BY CONSULTANT OR OWNER.
- 4. OBTAIN AND REVIEW THE DESIGNATED SUBSTANCE REPORT FROM THE CLIENT AND COORDINATE ANY DESIGNATED SUBSTANCE ISSUES WITH THE CLIENT PRIOR TO ANY WORK BEING DONE.
- 5. PROVIDE SHOP DRAWINGS ELECTRONICALLY IN PDF FORMAT TO CONSULTANT FOR REVIEW. ALL SHOP DRAWINGS MUST BE REVIEWED, STAMPED AND SIGNED BY THE MECHANICAL CONTRACTOR PRIOR TO SUBMITTING TO THE CONSULTANT. REVIEW SHALL INCLUDE BUT NOT BE LIMITED TO: VERIFYING UNIT VOLTAGE WITH ELECTRICIAN AND/OR SITE, EQUIPMENT PERFORMANCE, DIMENSIONS AND CLEARANCES.
- 6. THOROUGHLY REVIEW AND COORDINATE WITH SITE CONDITIONS AND COMPLETE DRAWING SET PRIOR TO PRICING AND INSTALLATION.
- 7. INSTALL ALL WORK IN CONFORMANCE WITH MANUFACTURER'S REQUIREMENTS AND RECOMMENDATIONS.
- 8. DO NOT USE ANY NEW PERMANENT EQUIPMENT FOR TEMPORARY USE DURING CONSTRUCTION WITHOUT WRITTEN APPROVAL. WHERE SYSTEMS ARE USED AND ARE CONTAMINATED BY DUST OR DIRT, THE CONTRACTOR SHALL CLEAN IN A MANNER ACCEPTABLE TO THE CONSULTANT.
- 9. MAINTAIN AS-BUILT DRAWINGS ON AN ON-GOING BASIS. DRAWINGS SHALL BE AVAILABLE FOR PERIODIC REVIEW BY THE CONSULTANT DURING CONSTRUCTION.
- 10. ALL WORK SHALL COMPLY WITH APPLICABLE CODES.
- 11. REMOVE ALL REDUNDANT EQUIPMENT, MATERIALS AND GARBAGE FROM SITE AND DISPOSE OF IN AN APPROVED MANNER. REDUNDANT EQUIPMENT AND MATERIALS SHALL NOT BE ABANDONED IN PLACE.
- 12. ALL CUTTING AND CORING SHALL BE BY THIS CONTRACTOR. COORDINATE PATCHING WITH GENERAL CONTRACTOR. EXCAVATION AND BACKFILL FOR UNDERGROUND PLUMBING SHALL BE BY THIS CONTRACTOR. ALL SAW CUTTING AND RESTORATION OF CONCRETE FLOOR BY GENERAL CONTRACTOR. COORDINATE WITH SAME.
- 13. COORDINATE ROOFING FOR DUCT AND PIPE ROOF PENETRATIONS WITH GENERAL CONTRACTOR. PROVIDE PITCH POCKETS FOR ALL SERVICES THROUGH ROOF UNLESS SERVICES CAN BE FED THROUGH BASE OF EQUIPMENT.
- 14. MAINTAIN REQUIRED ACCESS AND CLEARANCE TO ALL EQUIPMENT AND SYSTEMS AS REQUIRED BY CODE AND AS PER MANUFACTURER'S REQUIREMENTS.
- 15. TAG ALL EQUIPMENT WITH LAMACOID NAMEPLATES. TAG ALL VALVES WITH LAMACOID NAMEPLATES OR BRASS TAGS ON CHAINS.
- 16. LABEL ALL EXISTING AND NEW PIPING IN AREA OF WORK WITH SERVICE AND FLOW ARROWS EVERY 10'(3m) AND ON EITHER SIDE OF WALLS.
- 17. THE CONTRACTOR SHALL ARRANGE FOR INSPECTIONS BY THE ENGINEER PRIOR TO CEILING AND WALLS BEING CLOSED IN. WHERE THIS HAS NOT BEEN ARRANGED IT IS THE CONTRACTORS RESPONSIBILITY TO REMOVE CEILING TILES OR ACCESS DOORS FOR INSPECTION AT THE DIRECTION OF THE CONSULTANT. THE CONTRACTOR SHALL ARRANGE FOR ROUGH-IN INSPECTIONS BY THE ENGINEER PRIOR TO INSULATING OR CONCEALING ANYTHING. WHERE THIS HAS NOT BEEN ARRANGED IT IS THE CONTRACTORS RESPONSIBILITY TO EXPOSE SERVICES FOR INSPECTION AT THE DIRECTION OF THE CONSULTANT.
- 18. PERFORM TESTING AND START UP OF ALL SYSTEMS AS REQUIRED BY CODE, THE CONSULTANT, MANUFACTURER'S REQUIREMENTS, AND AUTHORITIES HAVING JURISDICTION. SUBMIT REPORTS TO THE CONSULTANT.
- 19. INSTRUCT AND DEMONSTRATE TO THE OWNER ON PROPER OPERATION OF THE SYSTEM. RECORD AND SUBMIT A LOG DATED AND SIGNED BY ALL ATTENDEES.
- 20. UPON COMPLETION OF THE PROJECT THE CONSULTANT WILL DO A FINAL REVIEW. UPON RECEIVING THE FINAL INSPECTION REPORT, THE CONTRACTOR MUST CORRECT AND SIGN BACK THE INSPECTION REPORT INDICATING ALL DEFICIENCIES ARE COMPLETED. A RE-INSPECTION WILL ONLY BE DONE ONCE THE CONSULTANT RECEIVES THIS IN WRITING. WHERE THE CONSULTANT PERFORMS THE RE-INSPECTION AND THE WORK IS NOT COMPLETE, THE CONTRACTOR IS RESPONSIBLE FOR REIMBURSING THE CONSULTANT FOR THE FIELD REVIEW. THE FEE FOR ADDITIONAL REVIEWS WILL BE AT THE CONSULTANT'S HOURLY RATES PLUS MILEAGE AND APPLICABLE TAXES TO BE PAID DIRECTLY TO THE CONSULTANT PRIOR TO PERFORMING THE NEXT FIELD REVIEW.
- 21. PROVIDE ONE (1) YEAR WARRANTY ON ALL MATERIAL AND LABOUR FROM THE DATE OF SUBSTANTIAL COMPLETION.
- 22. PROGRESS DRAWS SHALL INCLUDE MINIMUM \$1,500.00 FOR MANUALS AND AS-BUILT DRAWINGS. TOTAL AMOUNT SHALL REMAIN UNBILLED UNTIL MANUALS AND AS-BUILT DRAWINGS HAVE BEEN SUBMITTED AND APPROVED.
- 23. PROVIDE ONE (1) ELECTRONIC COPY OF MAINTENANCE MANUALS ON USB AND BY WEB TRANSFER. MANUAL SHALL INCLUDE:
  - TABLE OF CONTENTS
  - CONTRACTOR INFORMATION
  - WARRANTY LETTER
  - SHOP DRAWINGS
  - O&Ms
  - INSPECTION & TEST REPORTS
  - AS-BUILT DRAWINGSAS-BUILT DRAWINGS SHALL INCLUDE COMPLETE MECHANICAL DRAWING SET WITH ANY CHANGES MARKED CLEARLY AND NEATLY IN COLOUR. AS-BUILTS SHALL BE STAMPED ACCORDINGLY BY THE CONTRACTOR (ALL DRAWINGS). DRAWINGS SHALL BE SUBMITTED IN FULL SIZE. SUBSTANTIAL COMPLETION WILL NOT BE AWARDED UNTIL THE MANUALS AND AS-BUILTS HAVE BEEN SUBMITTED TO THE CONSULTANT AND THE CONSULTANT HAS APPROVED.

**BALANCING SPECIFICATIONS:**

- 1. OBTAIN THE SERVICES OF A 3rd PARTY ACCREDITED BALANCING COMPANY TO BALANCE THE RENOVATED AIR AND WATER HVAC SYSTEM.
- 2. PROVIDE PRELIMINARY REPORT TO ENGINEER FOR REVIEW AND COMMENTS.
- 3. ALLOW FOR ONE FOLLOW-UP SITE VISIT FOR ADJUSTMENTS.
- 4. RETURN TO SITE FOR ANY ADJUSTMENTS AND SUBMIT FINAL REPORT TO ENGINEER AND CONTRACTOR. FOR INCLUSION INTO MAINTENANCE MANUAL.
- 5. ACCEPTABLE AGENTS:
  - 1. QUALITY AIR DISTRIBUTION INC  
CONTACT: MIKE NOONAN  
TEL: (289)892-7168  
EMAIL: mike@qualityairdistribution.com
  - 2. DESIGN TEST & BALANCE  
CONTACT: SURINDER SINGH  
TEL: (905)886-6513  
EMAIL: mail@designrest.ca
  - 3. FLOWSET BALANCING  
CONTACT: CHRIS PITHER  
PHONE: (416)410-9793 OR (647)321-5114  
EMAIL: chrissp@flowset.com
  - 4. AIR FLOW TESTING AND BALANCING  
CONTACT: PAUL LIVIE  
PHONE: 913-372-2244 OR 613-876-9314  
EMAIL: airflowtesting@gmail.com
  - 5. COMPLETE SYSTEMS BALANCING  
CONTACT: TREVOR KELLY  
PHONE: 705-760-0390  
EMAIL: trework@csbalancing.com

HVAC LEGEND	
	DEMO
	EXISTING
	NEW
	EXHAUST RECTANGULAR DUCTS (UP / DOWN)
	EXHAUST ROUND DUCTS (UP / DOWN)
	TRANSFER RECTANGULAR DUCTS (UP / DOWN)
	TRANSFER ROUND DUCTS (UP / DOWN)
	ACOUSTIC LINED DUCT
	BACKDRAFT DAMPER
	BALANCE DAMPER
	FIRE DAMPER
	EXHAUST CEILING GRILLE
	TRANSFER CEILING GRILLE
	TRANSFER SIDE WALL/DUCT GRILLE
	EXHAUST SIDE WALL/DUCT GRILLE
	BRANCH RISING FROM TEE
	BRANCH DROPPING FROM TEE
	EQUIPMENT SYMBOL
	TYPE OF EQUIPMENT NUMBER DESIGNATION
	GRILLE SYMBOL
	TYPE SIZE (mm) AIR FLOW (cfm)

PLUMBING LEGEND	
	NEW
	EXISTING
	DEMOLITION
	DEMO ABOVEGROUND SANITARY
	DOMESTIC COLD WATER (DCW)
	DOMESTIC HOT WATER (DHW)
	DOMESTIC TEMPERED WATER LINE (DTW)
	ABOVEGROUND SANITARY LINE
	UNDERGROUND SANITARY LINE
	UNDERGROUND STORM LINE
	PLUMBING VENT
	FLOOR DRAIN
	STACK / FLOOR CLEANOUT
	HOSEBIBB (HB)
	FIXTURE TAG
	EQUIPMENT TAG
	TYPE OF EQUIPMENT NUMBER DESIGNATION
	ELBOW RISING
	ELBOW DROPPING
	BRANCH RISING FROM TEE
	BRANCH DROPPING FROM TEE
	SHUT-OFF BALL VALVE

DISCLAIMER:  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT



CONSULTANT:

ENGINEER:  
**CIMA+**  
C2 Architecture Inc.  
415 Baseline Road West  
Bowmanville, ON L1C 5M2  
☎ 905.697.4464


WILLIAM DUNBAR PS  
1030 Glenanna Rd, Pickering, ON  
L1V 5E5

WILLIAM DUNBAR PS  
ELEVATOR RENOVATION

SHEET TITLE:

**LEGENDS & NOTES**

MECHANICAL	
DRAWER: SR	SCALE: AS NOTED
DESIGNER: BRT	DATE: 2026-02-23
APPROVER: BRT	CHECKER: BRT
PROJECT No: A0001198	DRAWING No: M-001
SHEET No: 1 of 10	

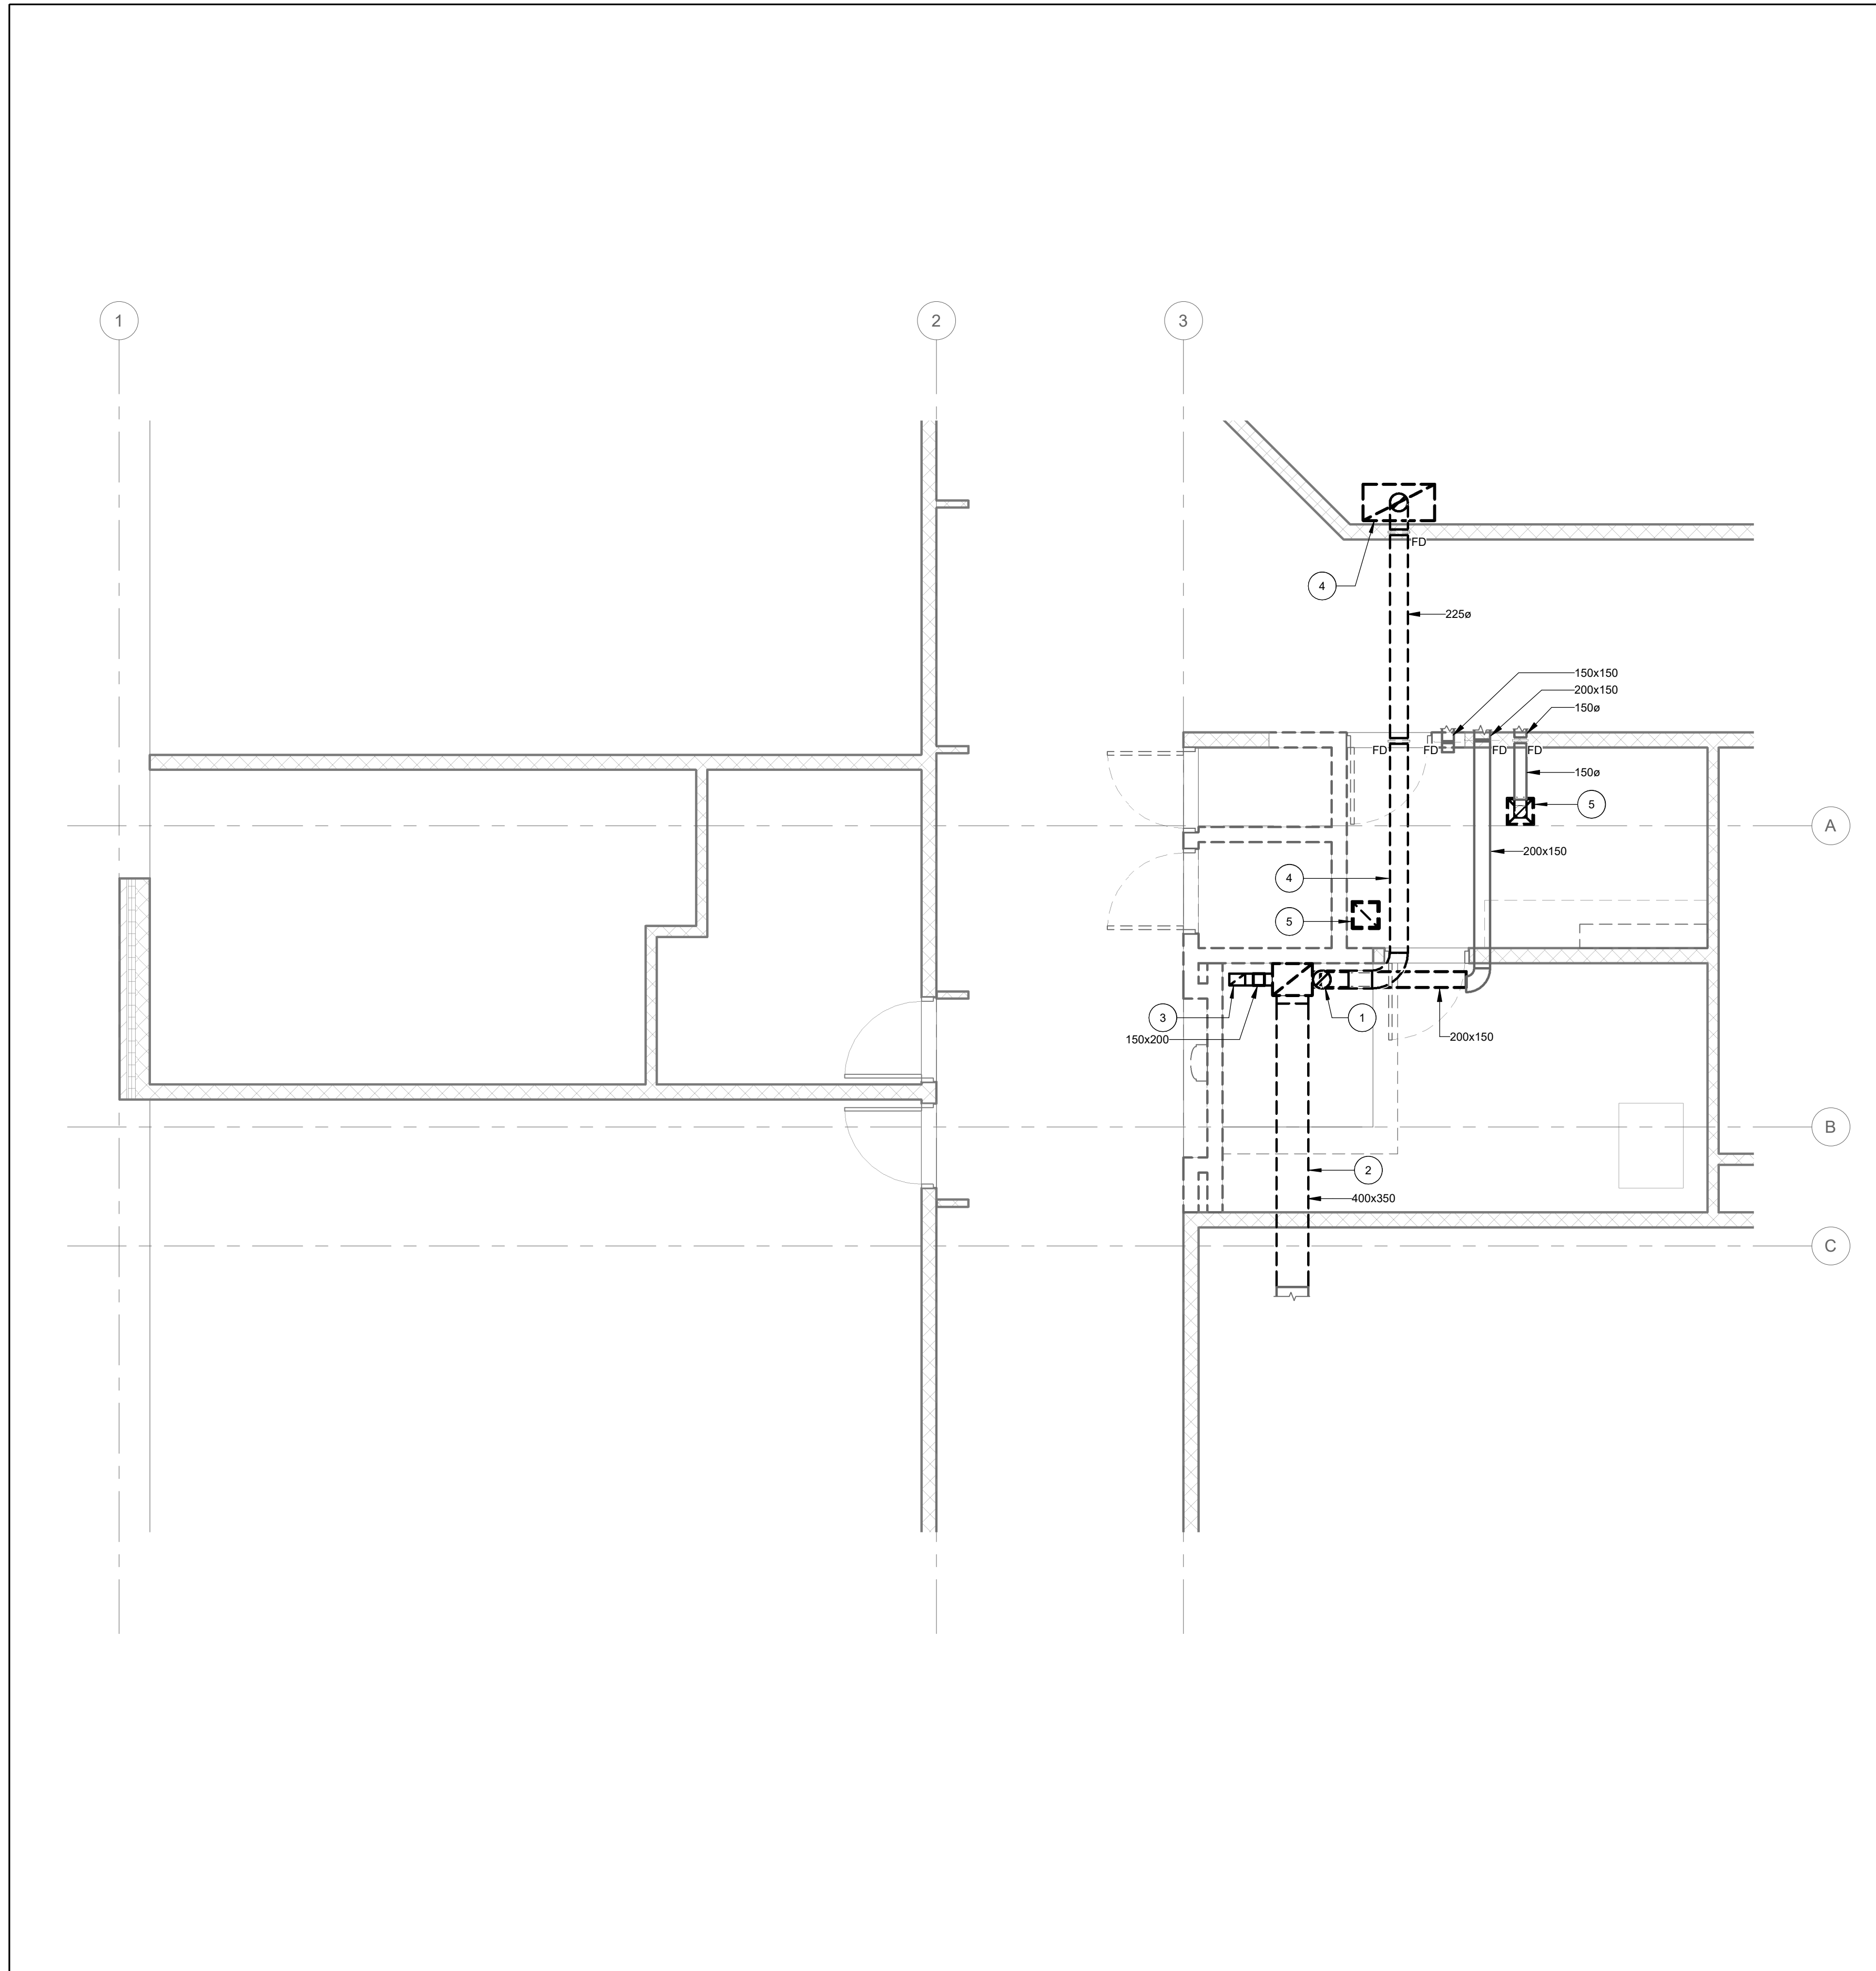


**1** GROUND FLOOR - DEMO HVAC LAYOUT  
SCALE: 1 : 50

- GENERAL DEMOLITION NOTES:**
1. THE CONTRACTOR SHALL ALLOW FOR DETAILED SITE INVESTIGATION TO CONFIRM ALL SERVICES PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES TO THE ENGINEER.
  2. SCOPE/CAMERA EXISTING UNDERGROUND SANITARY AND STORM PIPING THROUGH WORK AREA TO CONFIRM CONDITION OF PIPE, ROUTING AND INVERTS. SUBMIT REPORT AND VIDEO ON USB.
  3. SCAN FLOOR PRIOR TO FLOOR CUTS AND UNDERGROUND PIPING INSTALLATION.
  4. DISCONNECT AND REMOVE ALL REDUNDANT EQUIPMENT, FIXTURES, DUCTWORK, PIPING AND OTHER REDUNDANT SERVICES THROUGHOUT AREA OF WORK.
  5. ABANDON ANY REDUNDANT UNDERGROUND SERVICES AND CAP FLUSH WITH FLOOR. REMOVE REDUNDANT UNDERGROUND SERVICES WHERE REQUIRED TO SUIT NEW UNDERGROUND SERVICES.
  6. REMOVE OBSOLETE ABOVEGROUND SERVICES BACK TO SOURCE/MAINS AND CAP.
  7. ANY REDUNDANT RISERS CAN REMAIN WITHIN EXISTING WALLS (WHERE WALLS ARE SCHEDULED TO REMAIN) BUT SERVICES SHALL BE CUT AND CAPPED WITHIN WALL SO FACE OF WALL CAN BE PATCHED AND FINISHED SMOOTH.
  8. MAINTAIN VENT PIPING FOR REUSE WHERE POSSIBLE AND REMOVE ANY REDUNDANT.
  9. TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.

- DEMOLITION HVAC NOTES:**
1. REMOVE EXISTING 225ø E/A DUCT RISER UP IN SHAFT FROM STAFF ROOM HOOD C/W ALL DAMPERS AND HANGERS.
  2. CUT BACK EXISTING 400x350 E/A DUCTWORK FROM WASHROOMS AS REQUIRED TO SUIT NEW ELEVATOR SHAFT. REMOVE RISER UP IN SHAFT C/W ALL DAMPERS.
  3. CUT BACK EXISTING 200x150 E/A DUCT FROM STAFF ROOM WASHROOMS AS REQUIRED TO SUIT NEW ELEVATOR SHAFT. REMOVE RISER UP IN SHAFT C/W ALL DAMPERS.
  4. REMOVE EXISTING STAFF ROOM RANGE HOOD C/W ALL DUCTWORK, DAMPERS, HANGERS AND ACCESSORIES.
  5. REMOVE EXISTING GRILLE AND DIFFUSER IN WORK ROOM 127 CEILING C/W FLEXIBLE DUCTWORK.

**DISCLAIMER:**  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT

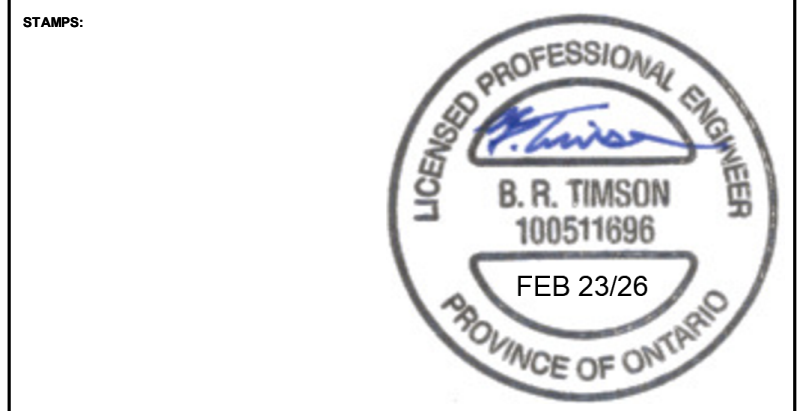

CONSULTANT(S):

ENGINEER:  
**CIMA+**  
 C2 Architecture Inc.  
 415 Baseline Road West  
 Bowmanville, ON L1C 5M2  
 ☎ 905.697.4464


CLIENT:  
**WILLIAM DUNBAR PS**  
 1030 Glenanna Rd., Pickering, ON  
 L1V 5E5

PROJECT NAME:  
**WILLIAM DUNBAR PS  
 ELEVATOR RENOVATION**

SHEET TITLE:  
**GROUND FLOOR - DEMO HVAC  
 LAYOUT**

DISCIPLINE: **MECHANICAL**

DRAWER:	SR	SCALE:	AS NOTED
DESIGNER:	BRT	DATE:	2026-02-23
APPROVER:	BRT	CHECKER:	BRT
PROJECT No.:	A0001198	DRAWING No.:	<b>MD101</b>
SHEET No.:	2 of 10		

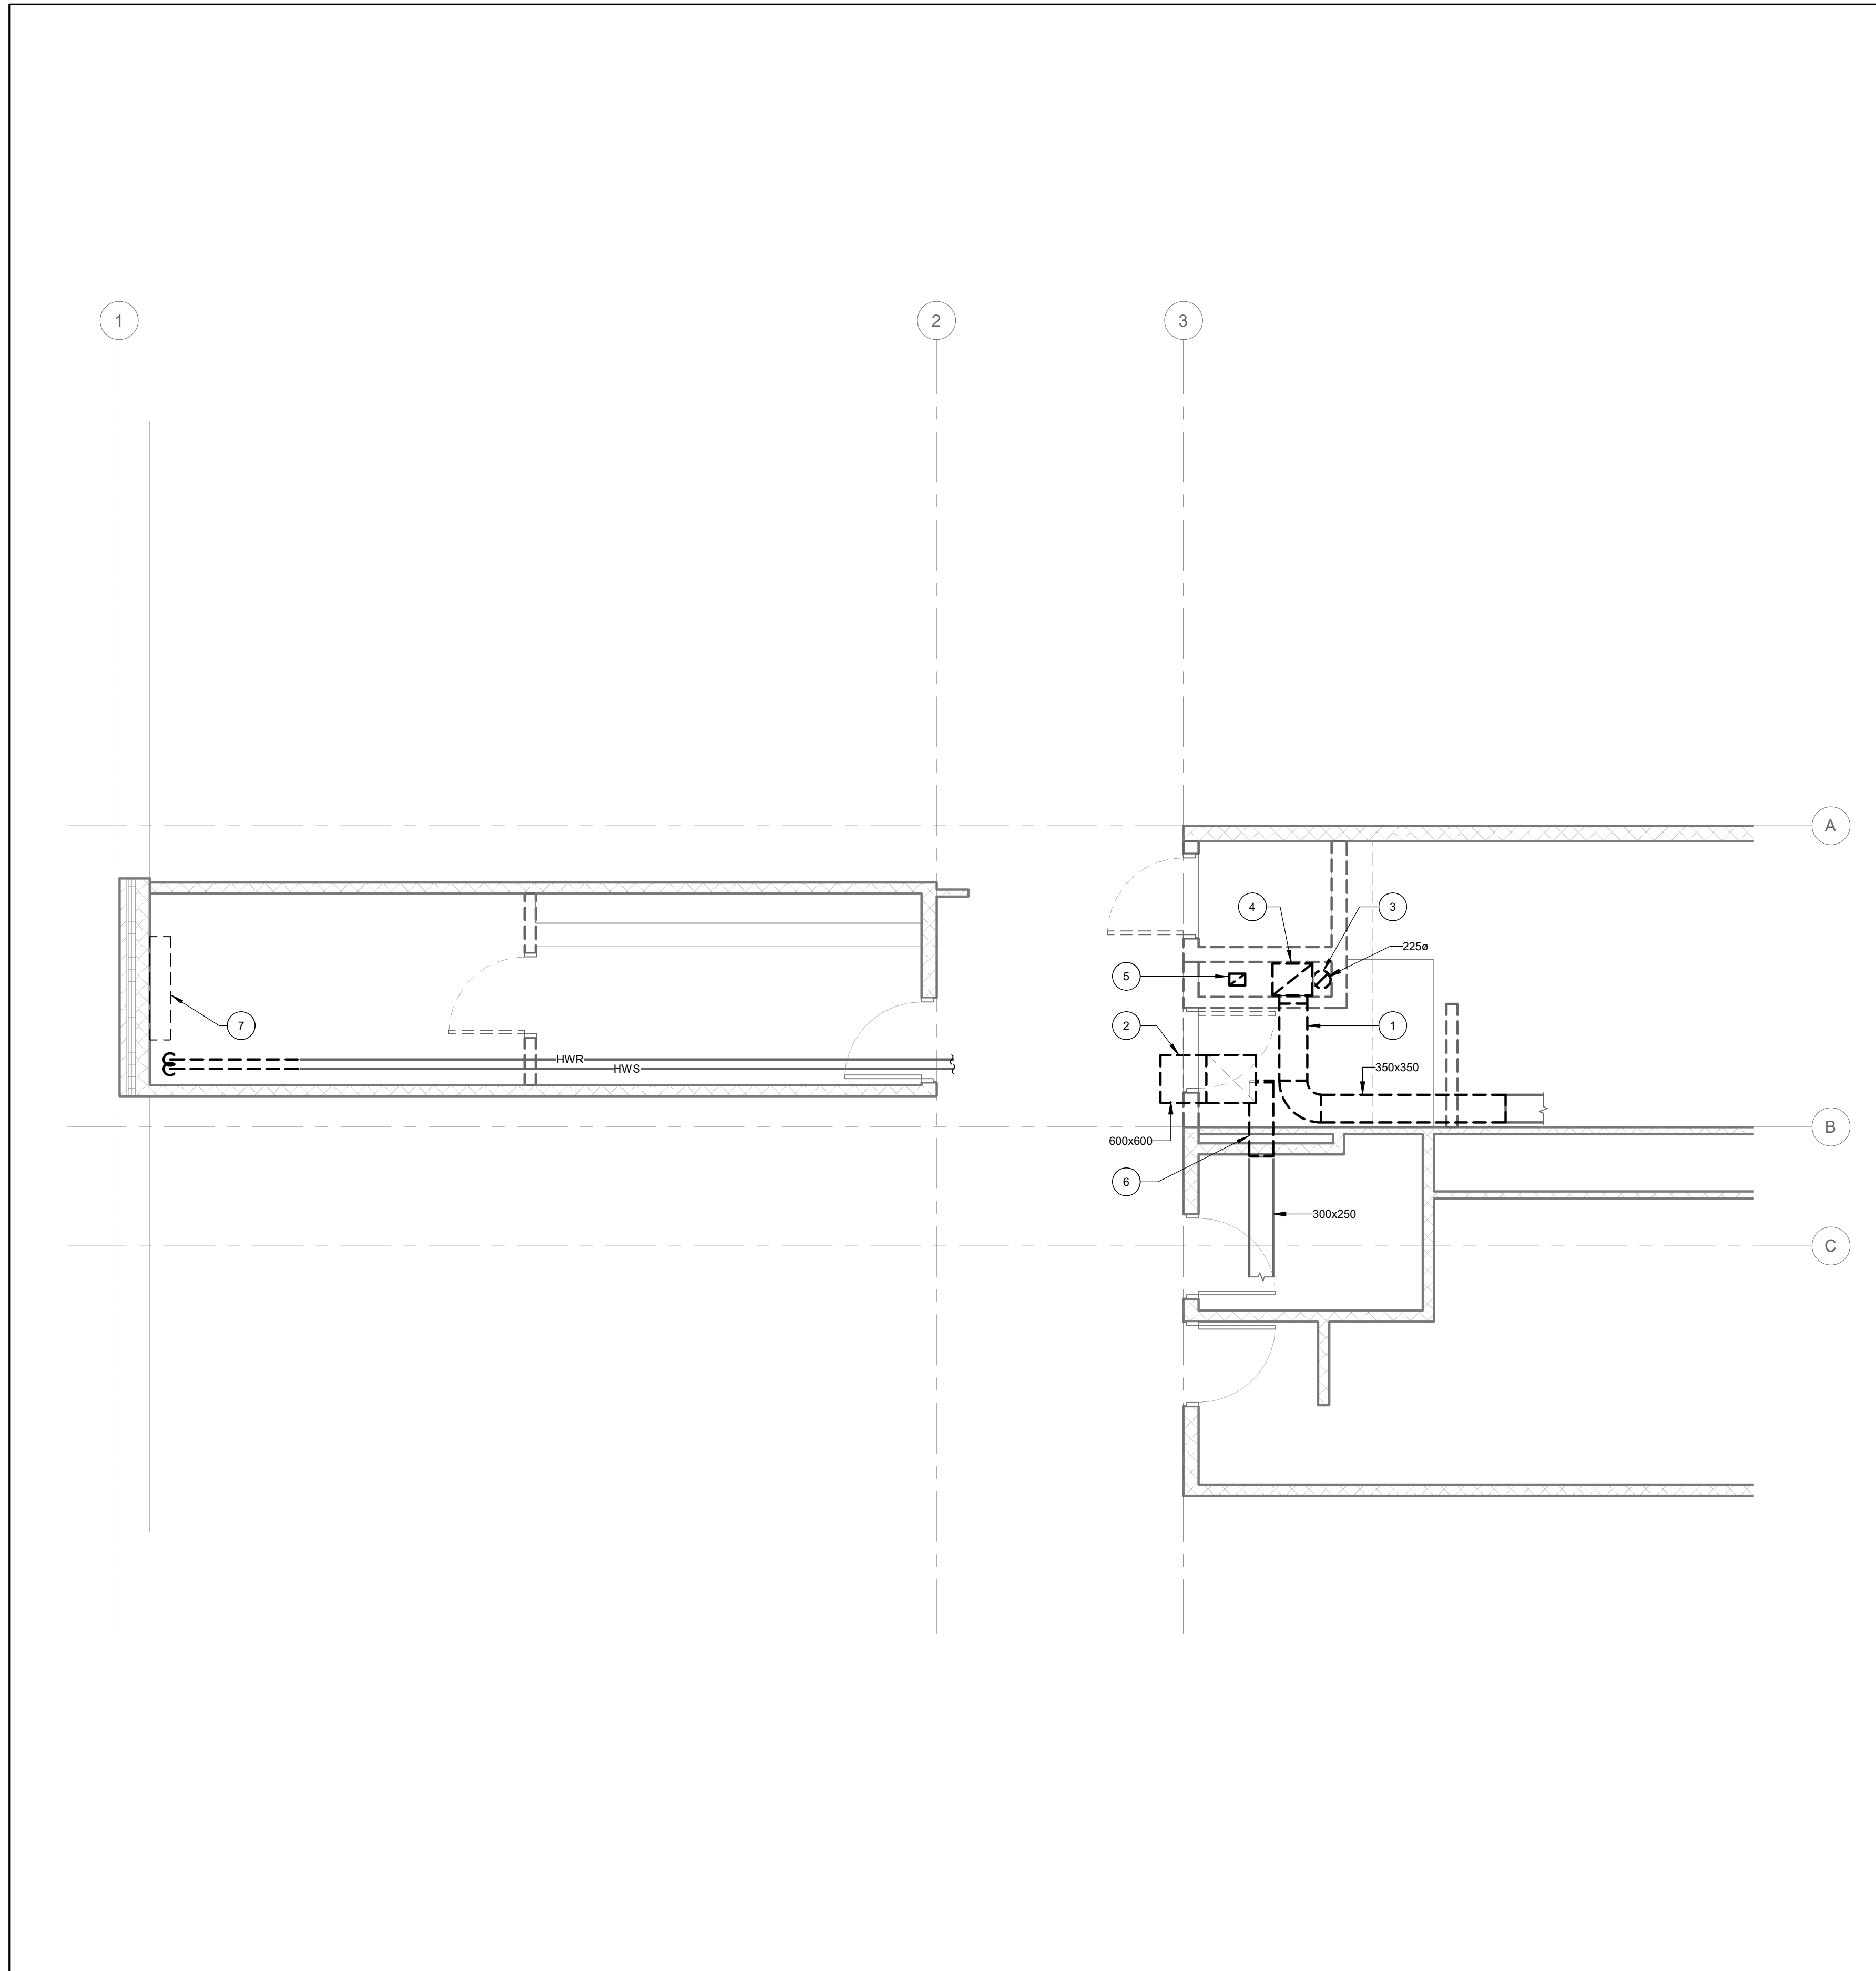


**1 SECOND FLOOR - DEMO HVAC LAYOUT**  
SCALE: 1 : 50

- GENERAL DEMOLITION NOTES:**
1. THE CONTRACTOR SHALL ALLOW FOR DETAILED SITE INVESTIGATION TO CONFIRM ALL SERVICES PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES TO THE ENGINEER.
  2. SCOPE/CAMERA EXISTING UNDERGROUND SANITARY AND STORM PIPING THROUGH WORK AREA TO CONFIRM CONDITION OF PIPE, ROUTING AND INVERTS. SUBMIT REPORT AND VIDEO ON USB.
  3. SCAN FLOOR PRIOR TO FLOOR CUTS AND UNDERGROUND PIPING INSTALLATION.
  4. DISCONNECT AND REMOVE ALL REDUNDANT EQUIPMENT, FIXTURES, DUCTWORK, PIPING AND OTHER REDUNDANT SERVICES THROUGHOUT AREA OF WORK.
  5. ABANDON ANY REDUNDANT UNDERGROUND SERVICES AND CAP FLUSH WITH FLOOR. REMOVE REDUNDANT UNDERGROUND SERVICES WHERE REQUIRED TO SUIT NEW UNDERGROUND SERVICES.
  6. REMOVE OBSOLETE ABOVEGROUND SERVICES BACK TO SOURCE/MAINS AND CAP.
  7. ANY REDUNDANT RISERS CAN REMAIN WITHIN EXISTING WALLS (WHERE WALLS ARE SCHEDULED TO REMAIN) BUT SERVICES SHALL BE CUT AND CAPPED WITHIN WALL SO FACE OF WALL CAN BE PATCHED AND FINISHED SMOOTH.
  8. MAINTAIN VENT PIPING FOR REUSE WHERE POSSIBLE AND REMOVE ANY REDUNDANT.
  9. TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.

- DEMOLITION HVAC NOTES:**
1. CUT BACK EXISTING E/A DUCTWORK AS REQUIRED TO SUIT NEW ELEVATOR SHAFT.
  2. REMOVE EXISTING TRANSFER DUCT AND GRILLE AND RETAIN FOR REINSTALLATION.
  3. REMOVE EXISTING 225ø E/A DUCT UP IN SHAFT FROM STAFF ROOM HOOD AND UP THROUGH ROOF. REMOVE EXISTING EXHAUST FAN C/W ROOF CURB, ALL DAMPERS AND ACCESSORIES.
  4. REMOVE EXISTING 500x400 E/A DUCT UP IN SHAFT FROM WASHROOMS AND UP THROUGH ROOF. REMOVE EXISTING EXHAUST FAN C/W ROOF CURB, ALL DAMPERS AND ACCESSORIES.
  5. REMOVE EXISTING 200x150 E/A DUCT UP IN SHAFT FROM STAFF ROOM WASHROOMS AND UP THROUGH ROOF. REMOVE EXISTING EXHAUST FAN C/W ROOF CURB, ALL DAMPERS AND ACCESSORIES.
  6. CUT BACK EXISTING S/A DUCT AS REQUIRED TO SUIT NEW ELEVATOR SHAFT AND REAPPLY CAP ON END OF DUCT.
  7. REMOVE EXISTING CONVECTOR C/W ALL VALVES AND ACCESSORIES. CUT BACK HS & HR IN CEILING TO SUIT NEW PIPING ARRANGEMENT.

**DISCLAIMER:**  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT

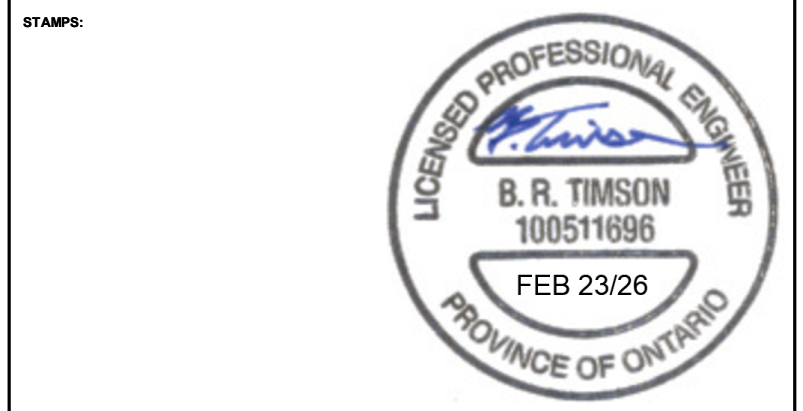

CONSULTANT(S):

ENGINEER:

**CIMA+**  
C2 Architecture Inc.  
415 Baseline Road West  
Bowmanville, ON L1C 5M2  
☎ 905.697.4464

CLIENT:

**WILLIAM DUNBAR PS**  
1030 Glenanna Rd, Pickering, ON  
L1V 5E5

PROJECT NAME:

**WILLIAM DUNBAR PS  
ELEVATOR RENOVATION**


SHEET TITLE:

**SECOND FLOOR - DEMO HVAC  
LAYOUT**

DISCIPLINE:

**MECHANICAL**

DRAFTER:	SR	SCALE:	AS NOTED
DESIGNER:	BRT	DATE:	2026-02-23
APPROVER:	BRT	CHECKER:	BRT
PROJECT No.:	A0001198	DRAWING No.:	<b>MD102</b>
SHEET No.:	3 of 10		

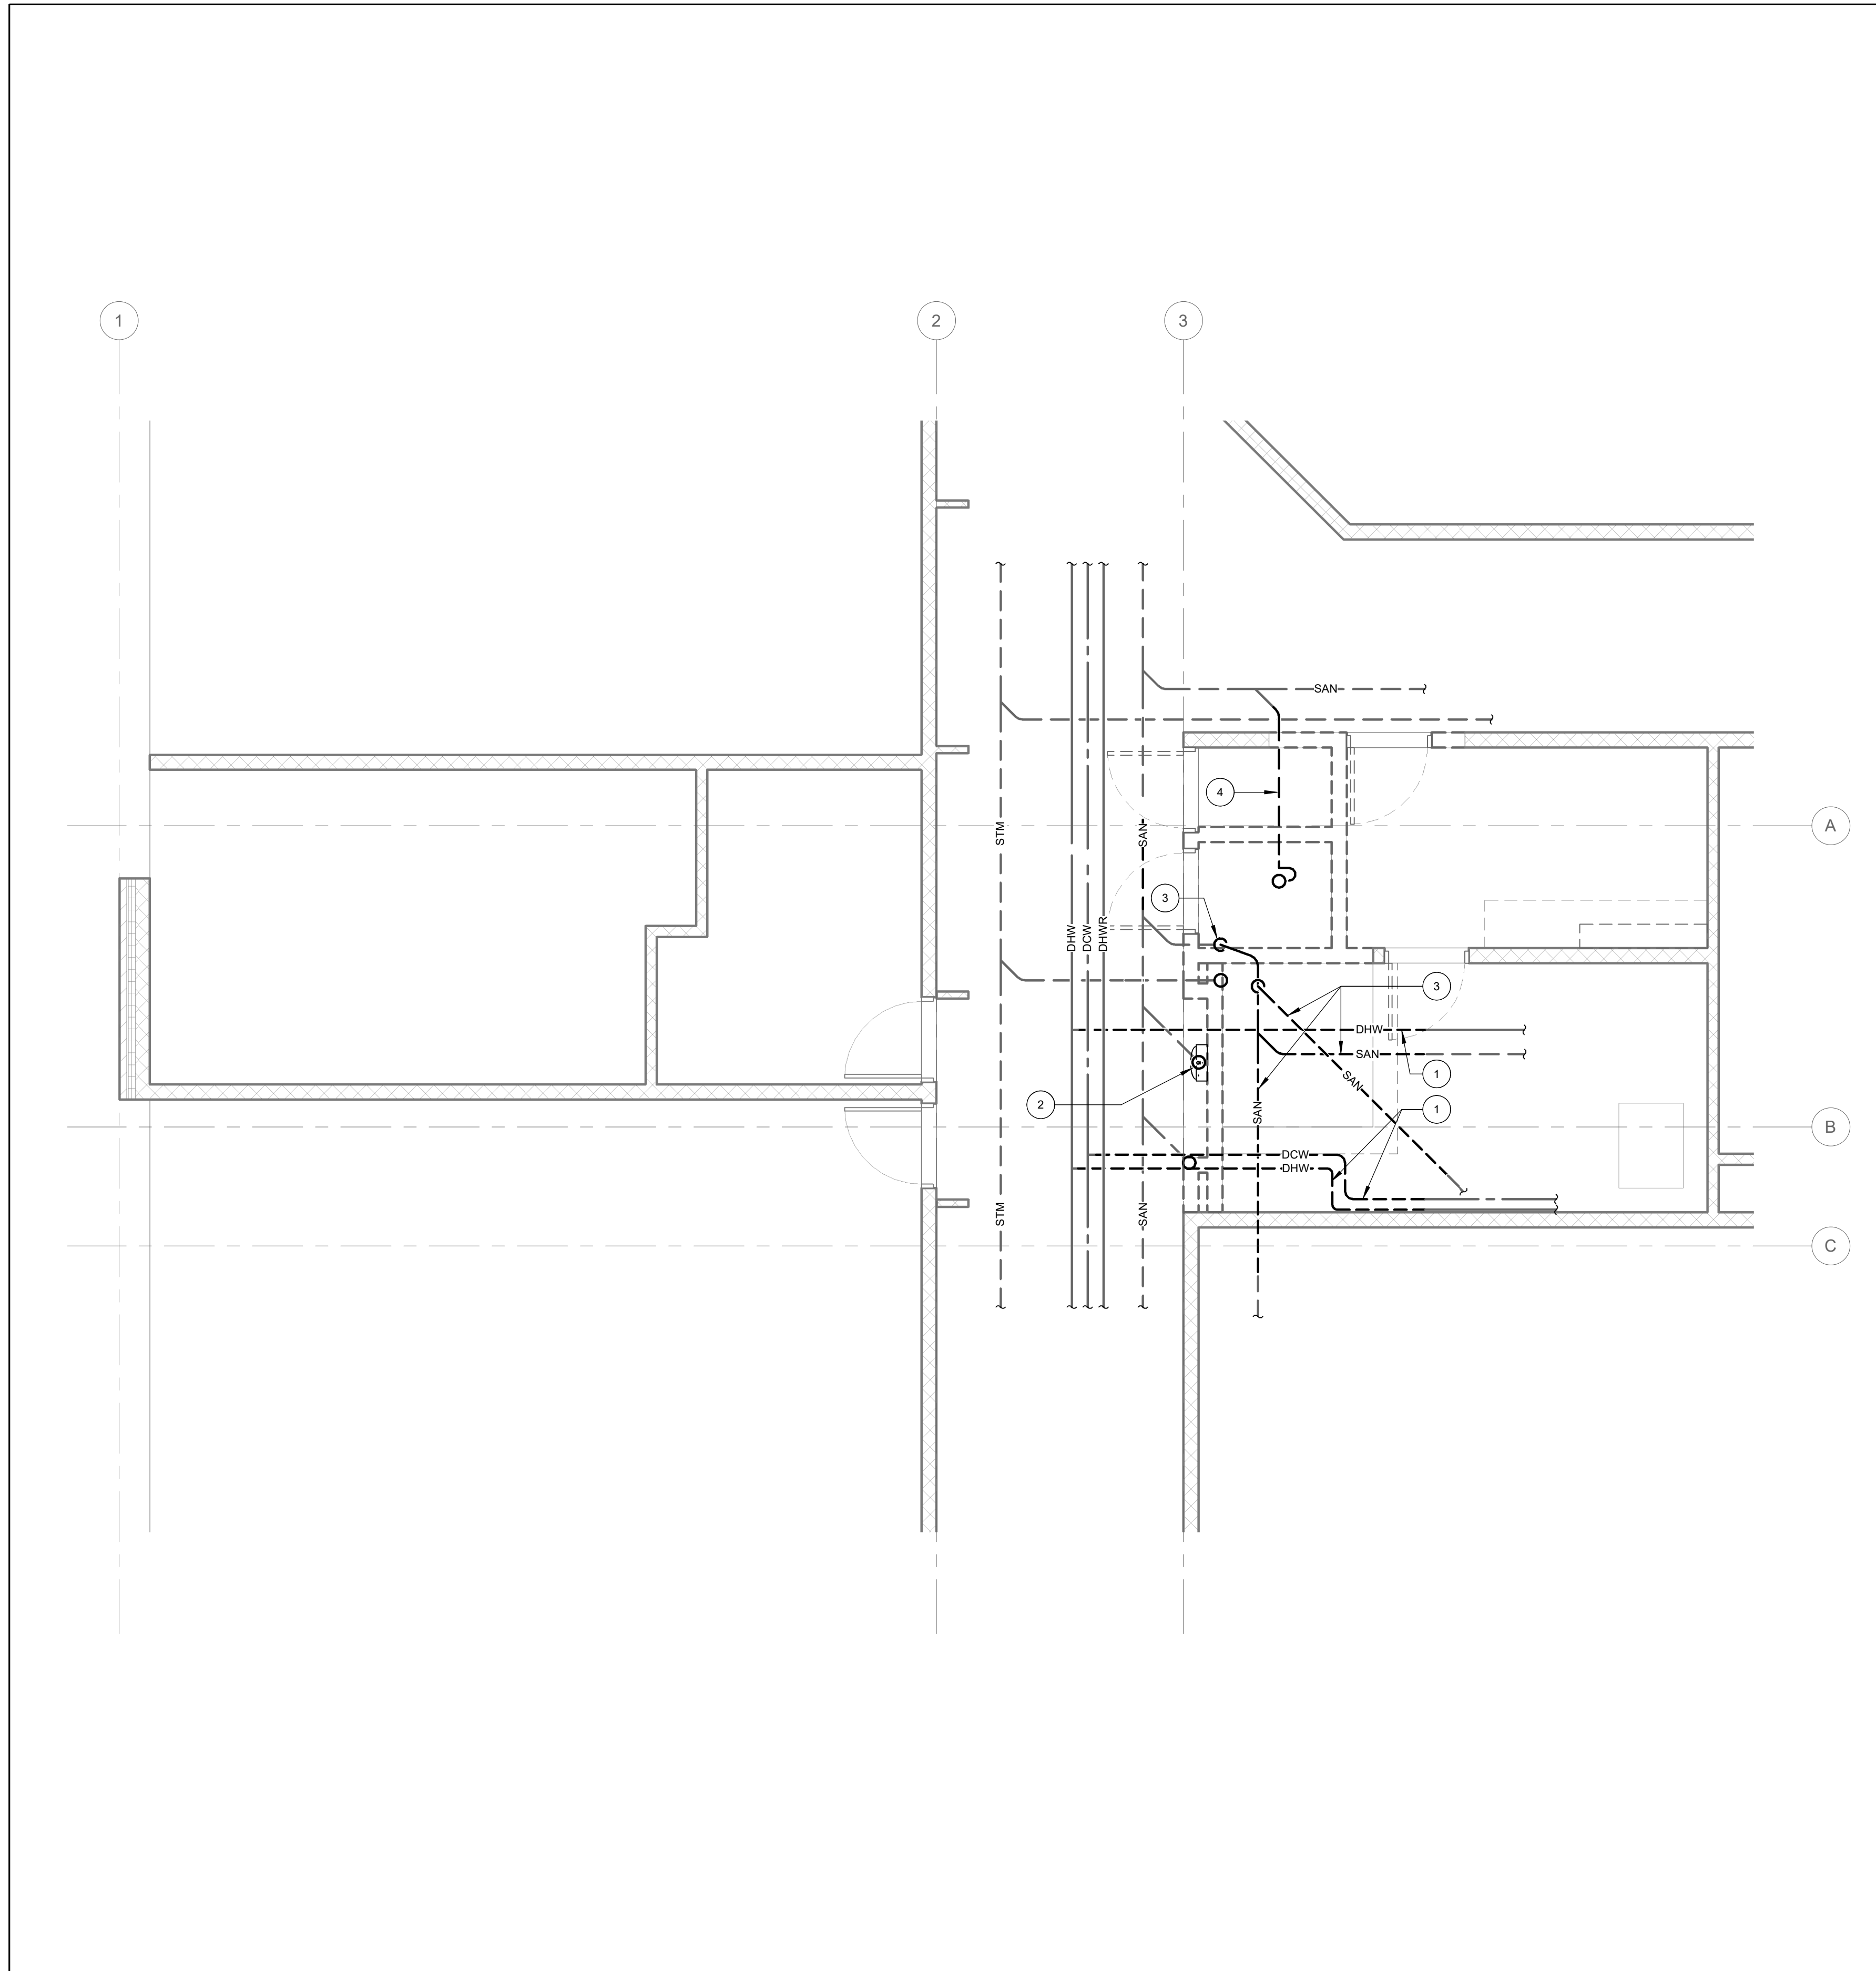


**1** GROUND FLOOR - DEMO PLUMBING LAYOUT  
SCALE: 1 : 50

- GENERAL DEMOLITION NOTES:**
1. THE CONTRACTOR SHALL ALLOW FOR DETAILED SITE INVESTIGATION TO CONFIRM ALL SERVICES PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES TO THE ENGINEER.
  2. SCOPE/CAMERA EXISTING UNDERGROUND SANITARY AND STORM PIPING THROUGH WORK AREA TO CONFIRM CONDITION OF PIPE, ROUTING AND INVERTS. SUBMIT REPORT AND VIDEO ON USB.
  3. SCAN FLOOR PRIOR TO FLOOR CUTS AND UNDERGROUND PIPING INSTALLATION.
  4. DISCONNECT AND REMOVE ALL REDUNDANT EQUIPMENT, FIXTURES, DUCTWORK, PIPING AND OTHER REDUNDANT SERVICES THROUGHOUT AREA OF WORK.
  5. ABANDON ANY REDUNDANT UNDERGROUND SERVICES AND CAP FLUSH WITH FLOOR. REMOVE REDUNDANT UNDERGROUND SERVICES WHERE REQUIRED TO SUIT NEW UNDERGROUND SERVICES.
  6. REMOVE OBSOLETE ABOVEGROUND SERVICES BACK TO SOURCE/MAINS AND CAP.
  7. ANY REDUNDANT RISERS CAN REMAIN WITHIN EXISTING WALLS (WHERE WALLS ARE SCHEDULED TO REMAIN) BUT SERVICES SHALL BE CUT AND CAPPED WITHIN WALL SO FACE OF WALL CAN BE PATCHED AND FINISHED SMOOTH.
  8. MAINTAIN VENT PIPING FOR REUSE WHERE POSSIBLE AND REMOVE ANY REDUNDANT.
  9. TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.

- DEMOLITION PLUMBING & DRAINAGE NOTES:**
1. REMOVE EXISTING DCW & DHW SERVICES AS REQUIRED TO SUIT NEW ELEVATOR SHAFT. REMOVE ANY INSULATION AND REDUNDANT ACCESSORIES AS REQUIRED.
  2. REMOVE EXISTING DRINKING FOUNTAIN AND ALL SERVICES IN WALL. CAP SANITARY BELOW FLOOR. REMOVE SERVICES FOR ACTIVE DRINKING FOUNTAIN AND FOR FOUNTAIN THAT WAS PREVIOUSLY REMOVED.
  3. REMOVE EXISTING ABOVEGROUND SANITARY SERVICES AS REQUIRED TO SUIT NEW ELEVATOR SHAFT. REMOVE ANY REDUNDANT ACCESSORIES AS REQUIRED. CAP SANITARY AT MAIN.
  4. REMOVE EXISTING FLOOR DRAIN AND TRAP TO SUIT REMOVAL OF ELEVATOR PIT. CAP PIPING WITHIN EXCAVATION AREA.

**DISCLAIMER:**  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT

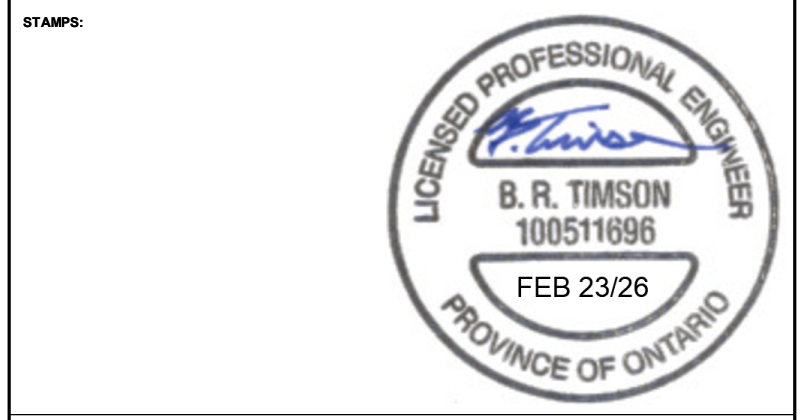

**CONSULTANT:**

**ENGINEER:**

**CIMA+**  
C2 Architecture Inc.  
415 Baseline Road West  
Bowmanville, ON L1C 5M2  
905.697.4464


**CLIENT:**  
WILLIAM DUNBAR PS  
1030 Glenanna Rd, Pickering, ON  
L1V 5E5

**PROJECT NAME:**  
WILLIAM DUNBAR PS  
ELEVATOR RENOVATION

**SHEET TITLE:**  
GROUND FLOOR - DEMO  
PLUMBING LAYOUT

**DISCIPLINE:** MECHANICAL

<b>DRAWER:</b> SR	<b>SCALE:</b> AS NOTED
<b>DESIGNER:</b> BRT	<b>DATE:</b> 2026-02-23
<b>APPROVER:</b> BRT	<b>CHECKER:</b> BRT
<b>PROJECT No.:</b> A0001198	<b>DRAWING No.:</b> MD103
<b>SHEET No.:</b> 4 of 10	

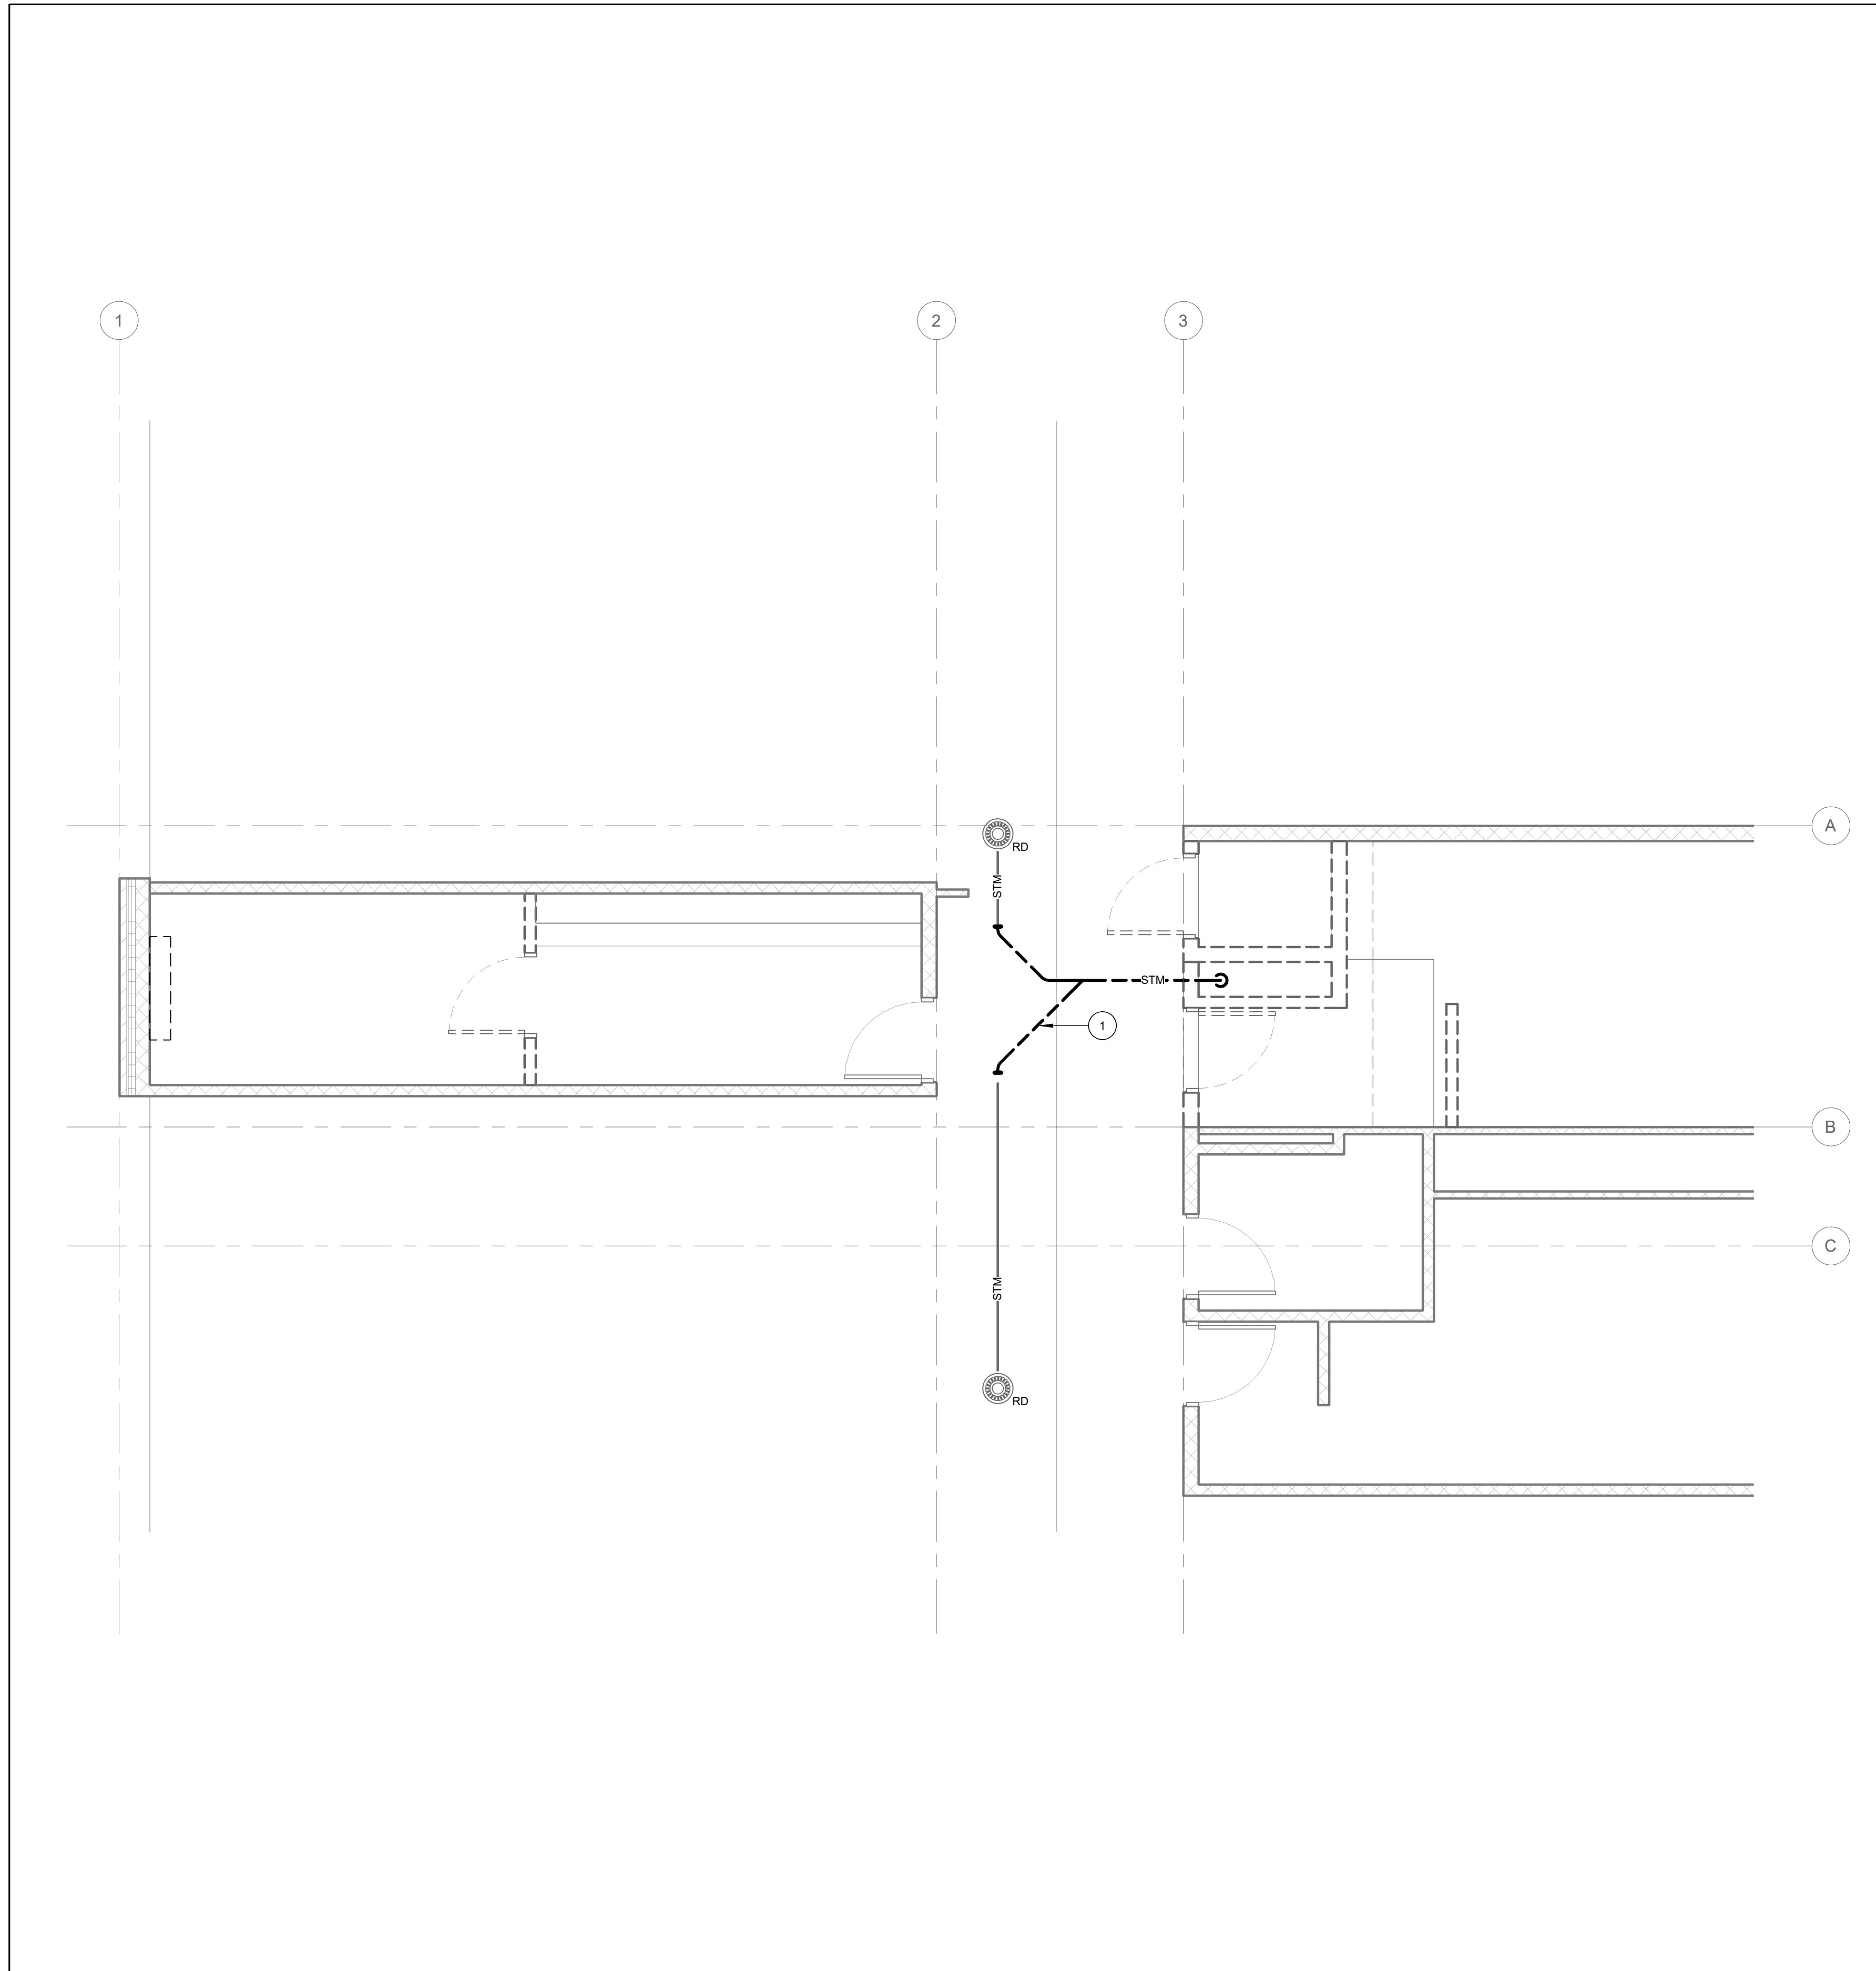

**1 SECOND FLOOR - DEMO PLUMBING LAYOUT**  
SCALE: 1 : 50

- GENERAL DEMOLITION NOTES:**
1. THE CONTRACTOR SHALL ALLOW FOR DETAILED SITE INVESTIGATION TO CONFIRM ALL SERVICES PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES TO THE ENGINEER.
  2. SCOPE/CAMERA EXISTING UNDERGROUND SANITARY AND STORM PIPING THROUGH WORK AREA TO CONFIRM CONDITION OF PIPE, ROUTING AND INVERTS. SUBMIT REPORT AND VIDEO ON USB.
  3. SCAN FLOOR PRIOR TO FLOOR CUTS AND UNDERGROUND PIPING INSTALLATION.
  4. DISCONNECT AND REMOVE ALL REDUNDANT EQUIPMENT, FIXTURES, DUCTWORK, PIPING AND OTHER REDUNDANT SERVICES THROUGHOUT AREA OF WORK.
  5. ABANDON ANY REDUNDANT UNDERGROUND SERVICES AND CAP FLUSH WITH FLOOR. REMOVE REDUNDANT UNDERGROUND SERVICES WHERE REQUIRED TO SUIT NEW UNDERGROUND SERVICES.
  6. REMOVE OBSOLETE ABOVEGROUND SERVICES BACK TO SOURCE/MAINS AND CAP.
  7. ANY REDUNDANT RISERS CAN REMAIN WITHIN EXISTING WALLS (WHERE WALLS ARE SCHEDULED TO REMAIN) BUT SERVICES SHALL BE CUT AND CAPPED WITHIN WALL SO FACE OF WALL CAN BE PATCHED AND FINISHED SMOOTH.
  8. MAINTAIN VENT PIPING FOR REUSE WHERE POSSIBLE AND REMOVE ANY REDUNDANT.
  9. TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.

- DEMOLITION PLUMBING & DRAINAGE NOTES:**
1. REMOVE EXISTING STORM DRAINAGE PIPING AS REQUIRED TO SUIT REVISED ROUTING AROUND NEW ELEVATOR SHAFT. REMOVE INSULATION AS REQUIRED.

**DISCLAIMER:**  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT



CONSULTANT(S):

**ENGINEER:**  
**CIMA+**  
C2 Architecture Inc.  
415 Baseline Road West  
Bowmanville, ON L1C 5M2  
905.697.4464


**CLIENT:**  
**WILLIAM DUNBAR PS**  
1030 Glenanna Rd., Pickering, ON  
L1V 5E5

**PROJECT NAME:**  
**WILLIAM DUNBAR PS  
ELEVATOR RENOVATION**

**SHEET TITLE:**  
**SECOND FLOOR - DEMO  
PLUMBING LAYOUT**

**DISCIPLINE:**  
**MECHANICAL**

<b>DRAFTER:</b> SR	<b>SCALE:</b> AS NOTED
<b>DESIGNER:</b> BRT	<b>DATE:</b> 2026-02-23
<b>APPROVER:</b> BRT	<b>CHECKER:</b> BRT
<b>PROJECT No.:</b> A0001198	<b>DRAWING No.:</b> MD104
<b>SHEET No.:</b> 5 of 10	

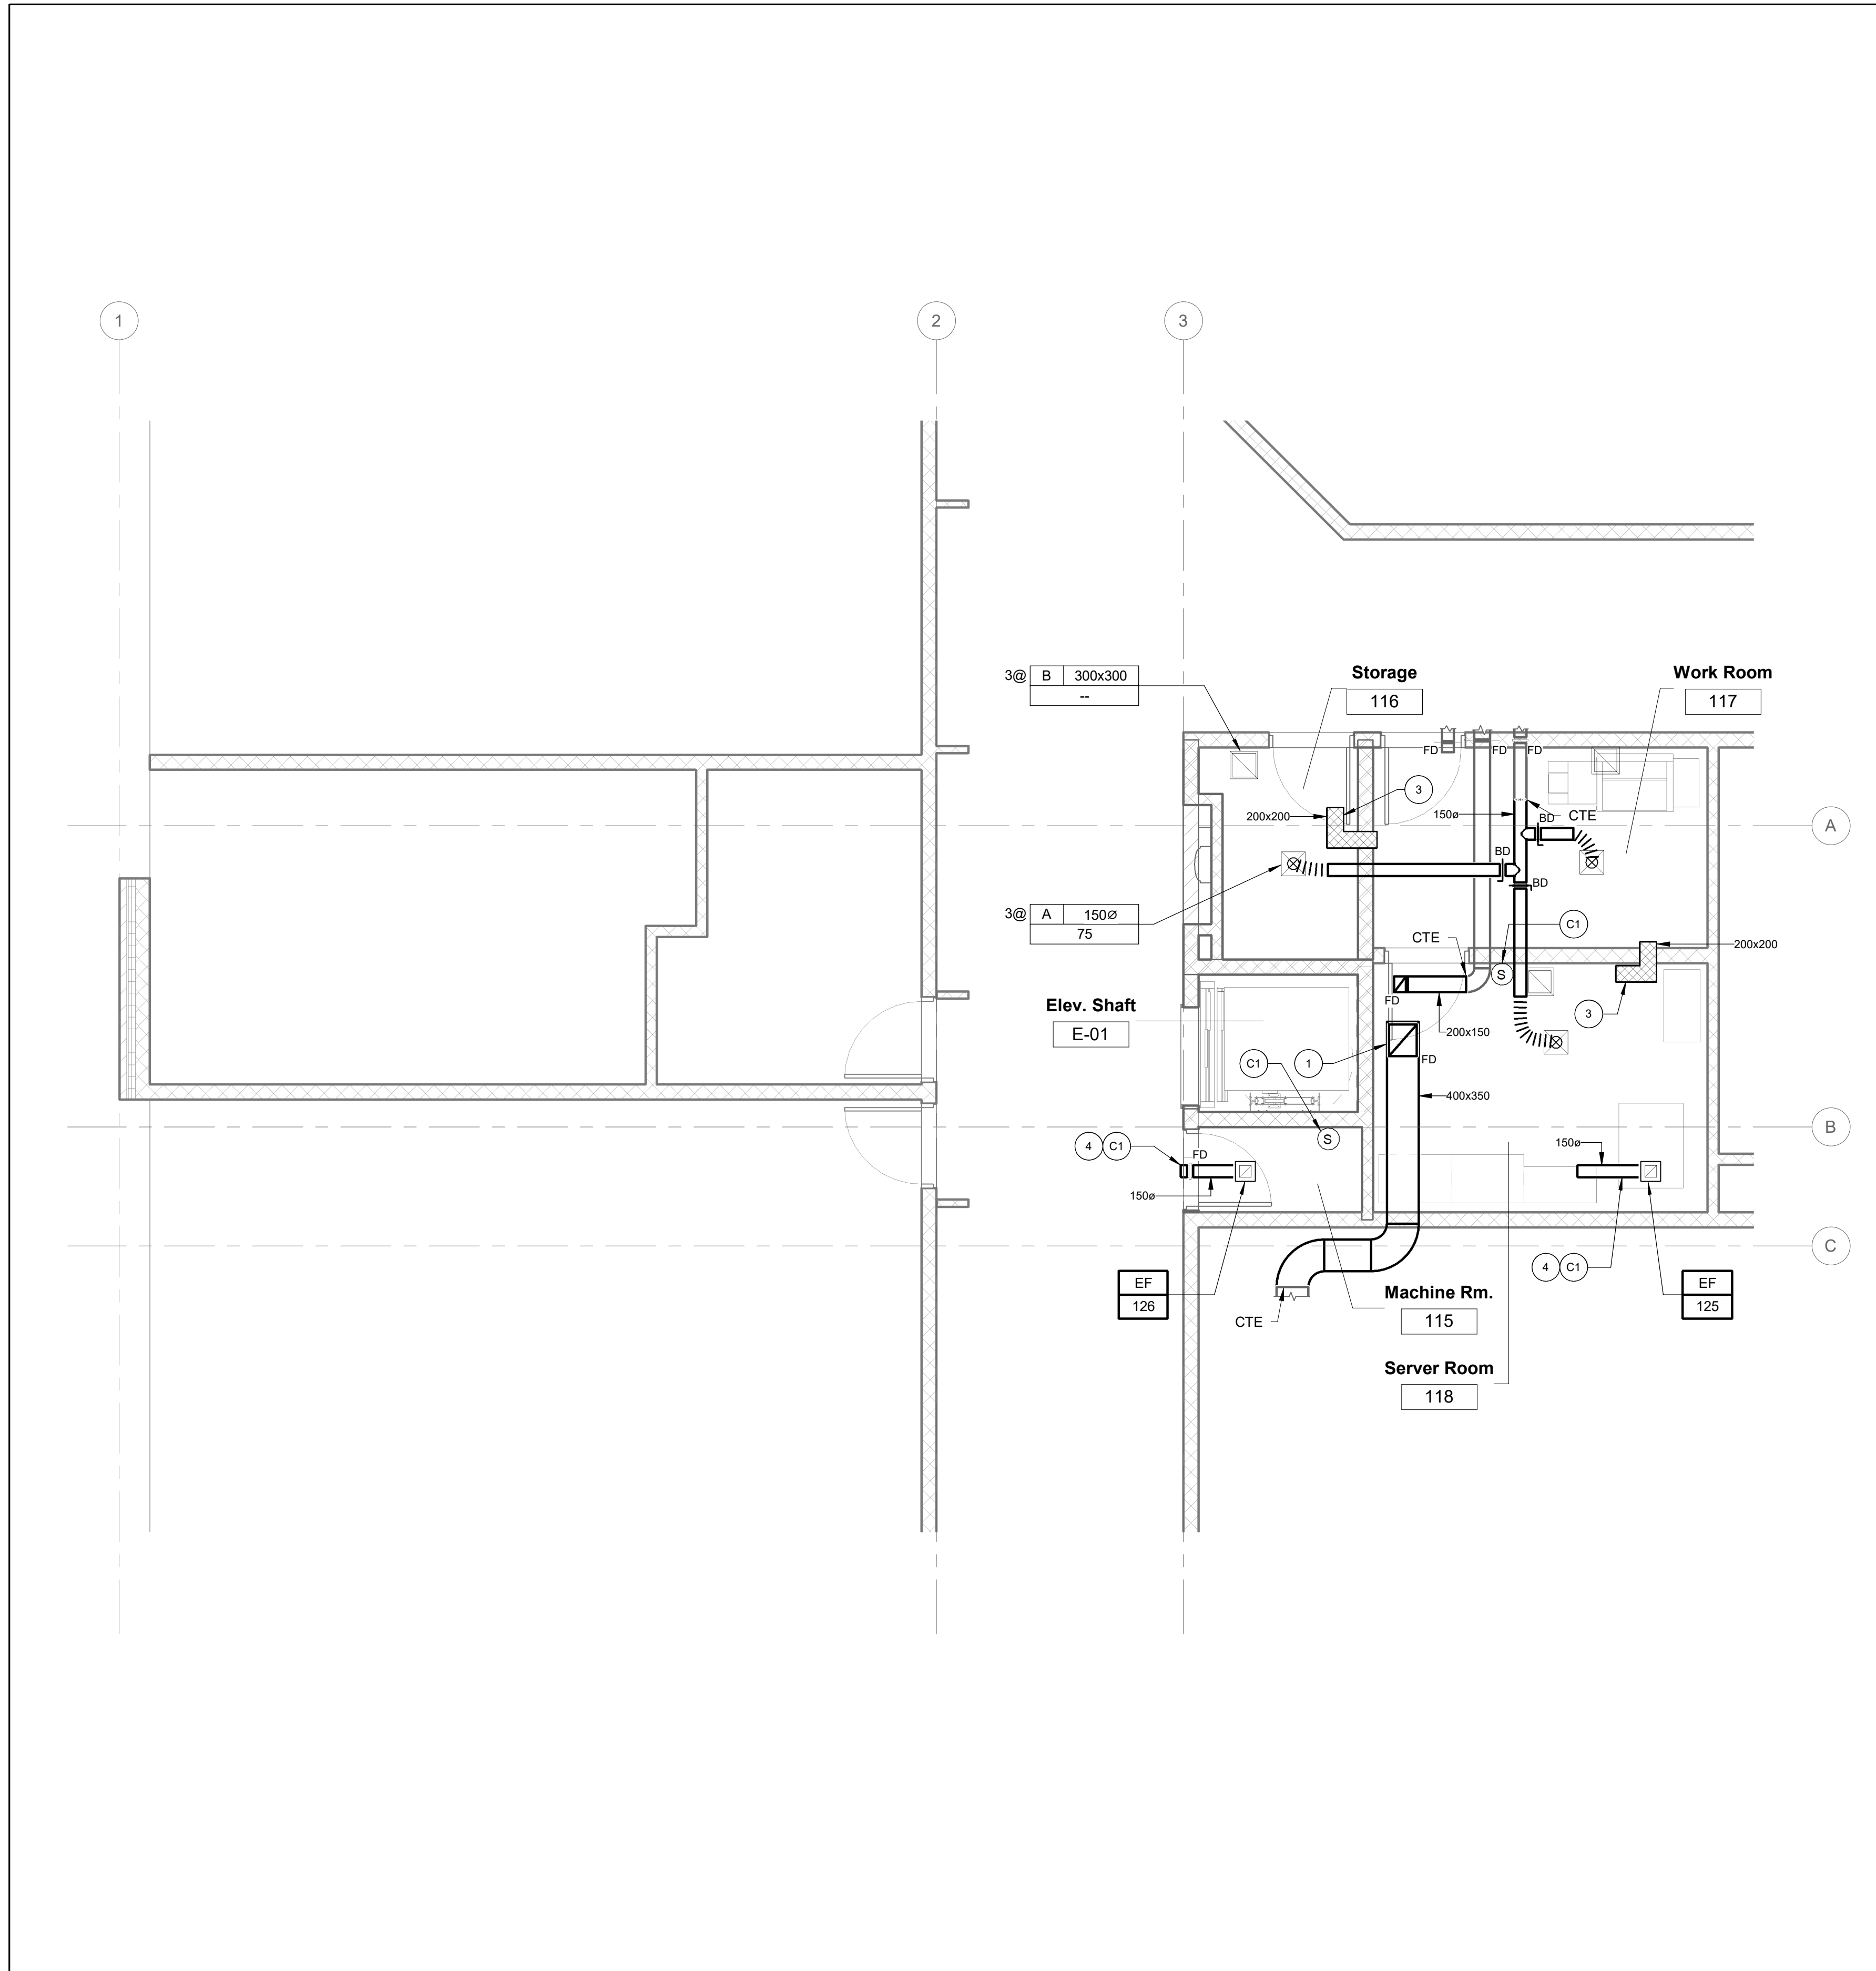

**1** GROUND FLOOR - NEW HVAC LAYOUT  
SCALE: 1 : 50

- GENERAL NEW MECHANICAL NOTES:**
1. THE CONTRACTOR SHALL INVESTIGATE AND CONFIRM SERVICES ON SITE PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES TO CONSULTANT.
  2. SCOPE/CAMERA EXISTING UNDERGROUND SANITARY AND STORM PIPING THROUGH WORK AREA TO CONFIRM CONDITION OF PIPE, ROUTING AND INVERTS. SUBMIT REPORT AND VIDEO ON USB.
  3. SCAN FLOOR PRIOR TO FLOOR CUTS AND UNDERGROUND PIPING INSTALLATION.
  4. REFER TO ARCHITECTURAL DRAWINGS AND/OR GENERAL CONTRACTOR FOR CEILING HEIGHTS TO ENSURE ALL SERVICES ARE CONCEALED WITHIN AVAILABLE CEILING SPACE. RUN ALL NEW SERVICES UP IN JOIST SPACE AND BETWEEN LIGHTS AS NOTED OR AS REQUIRED.
  5. COORDINATE ALL SERVICES WITH ALL TRADES PRIOR TO INSTALLATION.
  6. COVER ALL FLOOR DRAINS DURING CONSTRUCTION.
  7. PROVIDE NEW PLUMBING VENTS THROUGH ALL FLOORS AND THROUGH ROOF AS REQUIRED OR TIE INTO EXISTING WHERE POSSIBLE.
  8. INSULATE AND LABEL ALL NEW PIPING. PROVIDE PVC JACKET ON ALL EXPOSED PIPING.
  9. FIRE STOP ALL NEW PIPING THROUGH RATED WALLS IN AREA OF WORK.
  10. SUPPLY ACCESS DOORS FOR MECHANICAL DEVICES ABOVE DRYWALL CEILING AND TURN OVER TO GENERAL CONTRACTOR FOR INSTALLATION.
  11. ELECTRICAL CONTRACTOR TO PROVIDE BACK BOX, CONDUIT AND PULL STRING FOR WALL SENSORS IN NEW WALLS. COORDINATE WITH ELECTRICAL.
  12. LABEL CEILING GRID AT ACCESS TO MECHANICAL EQUIPMENT AND DEVICES WITH LAMACOID NAMEPLATE.
  13. THE CONTRACTOR SHALL FLUSH, SCOPE, AND PROVIDE VIDEO INSPECTION OF THE SANITARY SYSTEM AFTER COMPLETION OF WORK AND PRIOR TO SUBSTANTIAL COMPLETION. FLUSHING, SCOPING AND VIDEO SHALL INCLUDE AREA OF WORK TO WHERE IT TIES INTO THE MAIN. SUBMIT REPORT AND VIDEO ON USB.
  14. TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.

- NEW HVAC WORKING NOTES:**
- 1 400x350 E/A DUCTWORK FROM GROUND FLOOR WASHROOMS UP TO SECOND FLOOR C/W FIRE DAMPER AT FLOOR PENETRATION.
  - 2 200x150 E/A DUCTWORK UP FROM STAFF ROOM WASHROOMS UP TO SECOND FLOOR C/W FIRE DAMPER AT FLOOR PENETRATION.
  - 3 ACOUSTICALLY LINED TRANSFER DUCT. REFER TO DRAWING FOR SIZE AND REFER TO DETAILS.
  - 4 DISCHARGE EXHAUST FAN INTO CEILING SPACE C/W SCREEN ON INLET. PROVIDE FIRE DAMPERS AT WALL PENETRATIONS.

- CONTROLS WORKING NOTES:**
- C1 PROVIDE CONTROLS AND CONTROL WIRING FOR NEW EXHAUST FAN C/W SPACE SENSOR ON WALL FOR TEMPERATURE CONTROL OF FAN.

**DISCLAIMER:**  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT



CONSULTANT(S):

**ENGINEER:**  
**CIMA+**  
C2 Architecture Inc.  
415 Baseline Road West  
Bowmanville, ON L1C 5M2  
905.697.4464


**CLIENT:**  
**WILLIAM DUNBAR PS**  
1030 Glenanna Rd, Pickering, ON  
L1V 5E5

**PROJECT NAME:**  
**WILLIAM DUNBAR PS  
ELEVATOR RENOVATION**

**SHEET TITLE:**  
**GROUND FLOOR - NEW HVAC  
LAYOUT**

**DISCIPLINE:**  
**MECHANICAL**

<b>DRAWER:</b> SR	<b>SCALE:</b> AS NOTED
<b>DESIGNER:</b> BRT	<b>DATE:</b> 2026-02-23
<b>APPROVER:</b> BRT	<b>CHECKER:</b> BRT
<b>PROJECT No.:</b> A0001198	<b>DRAWING No.:</b> M-101
<b>SHEET No.:</b> 6 of 10	

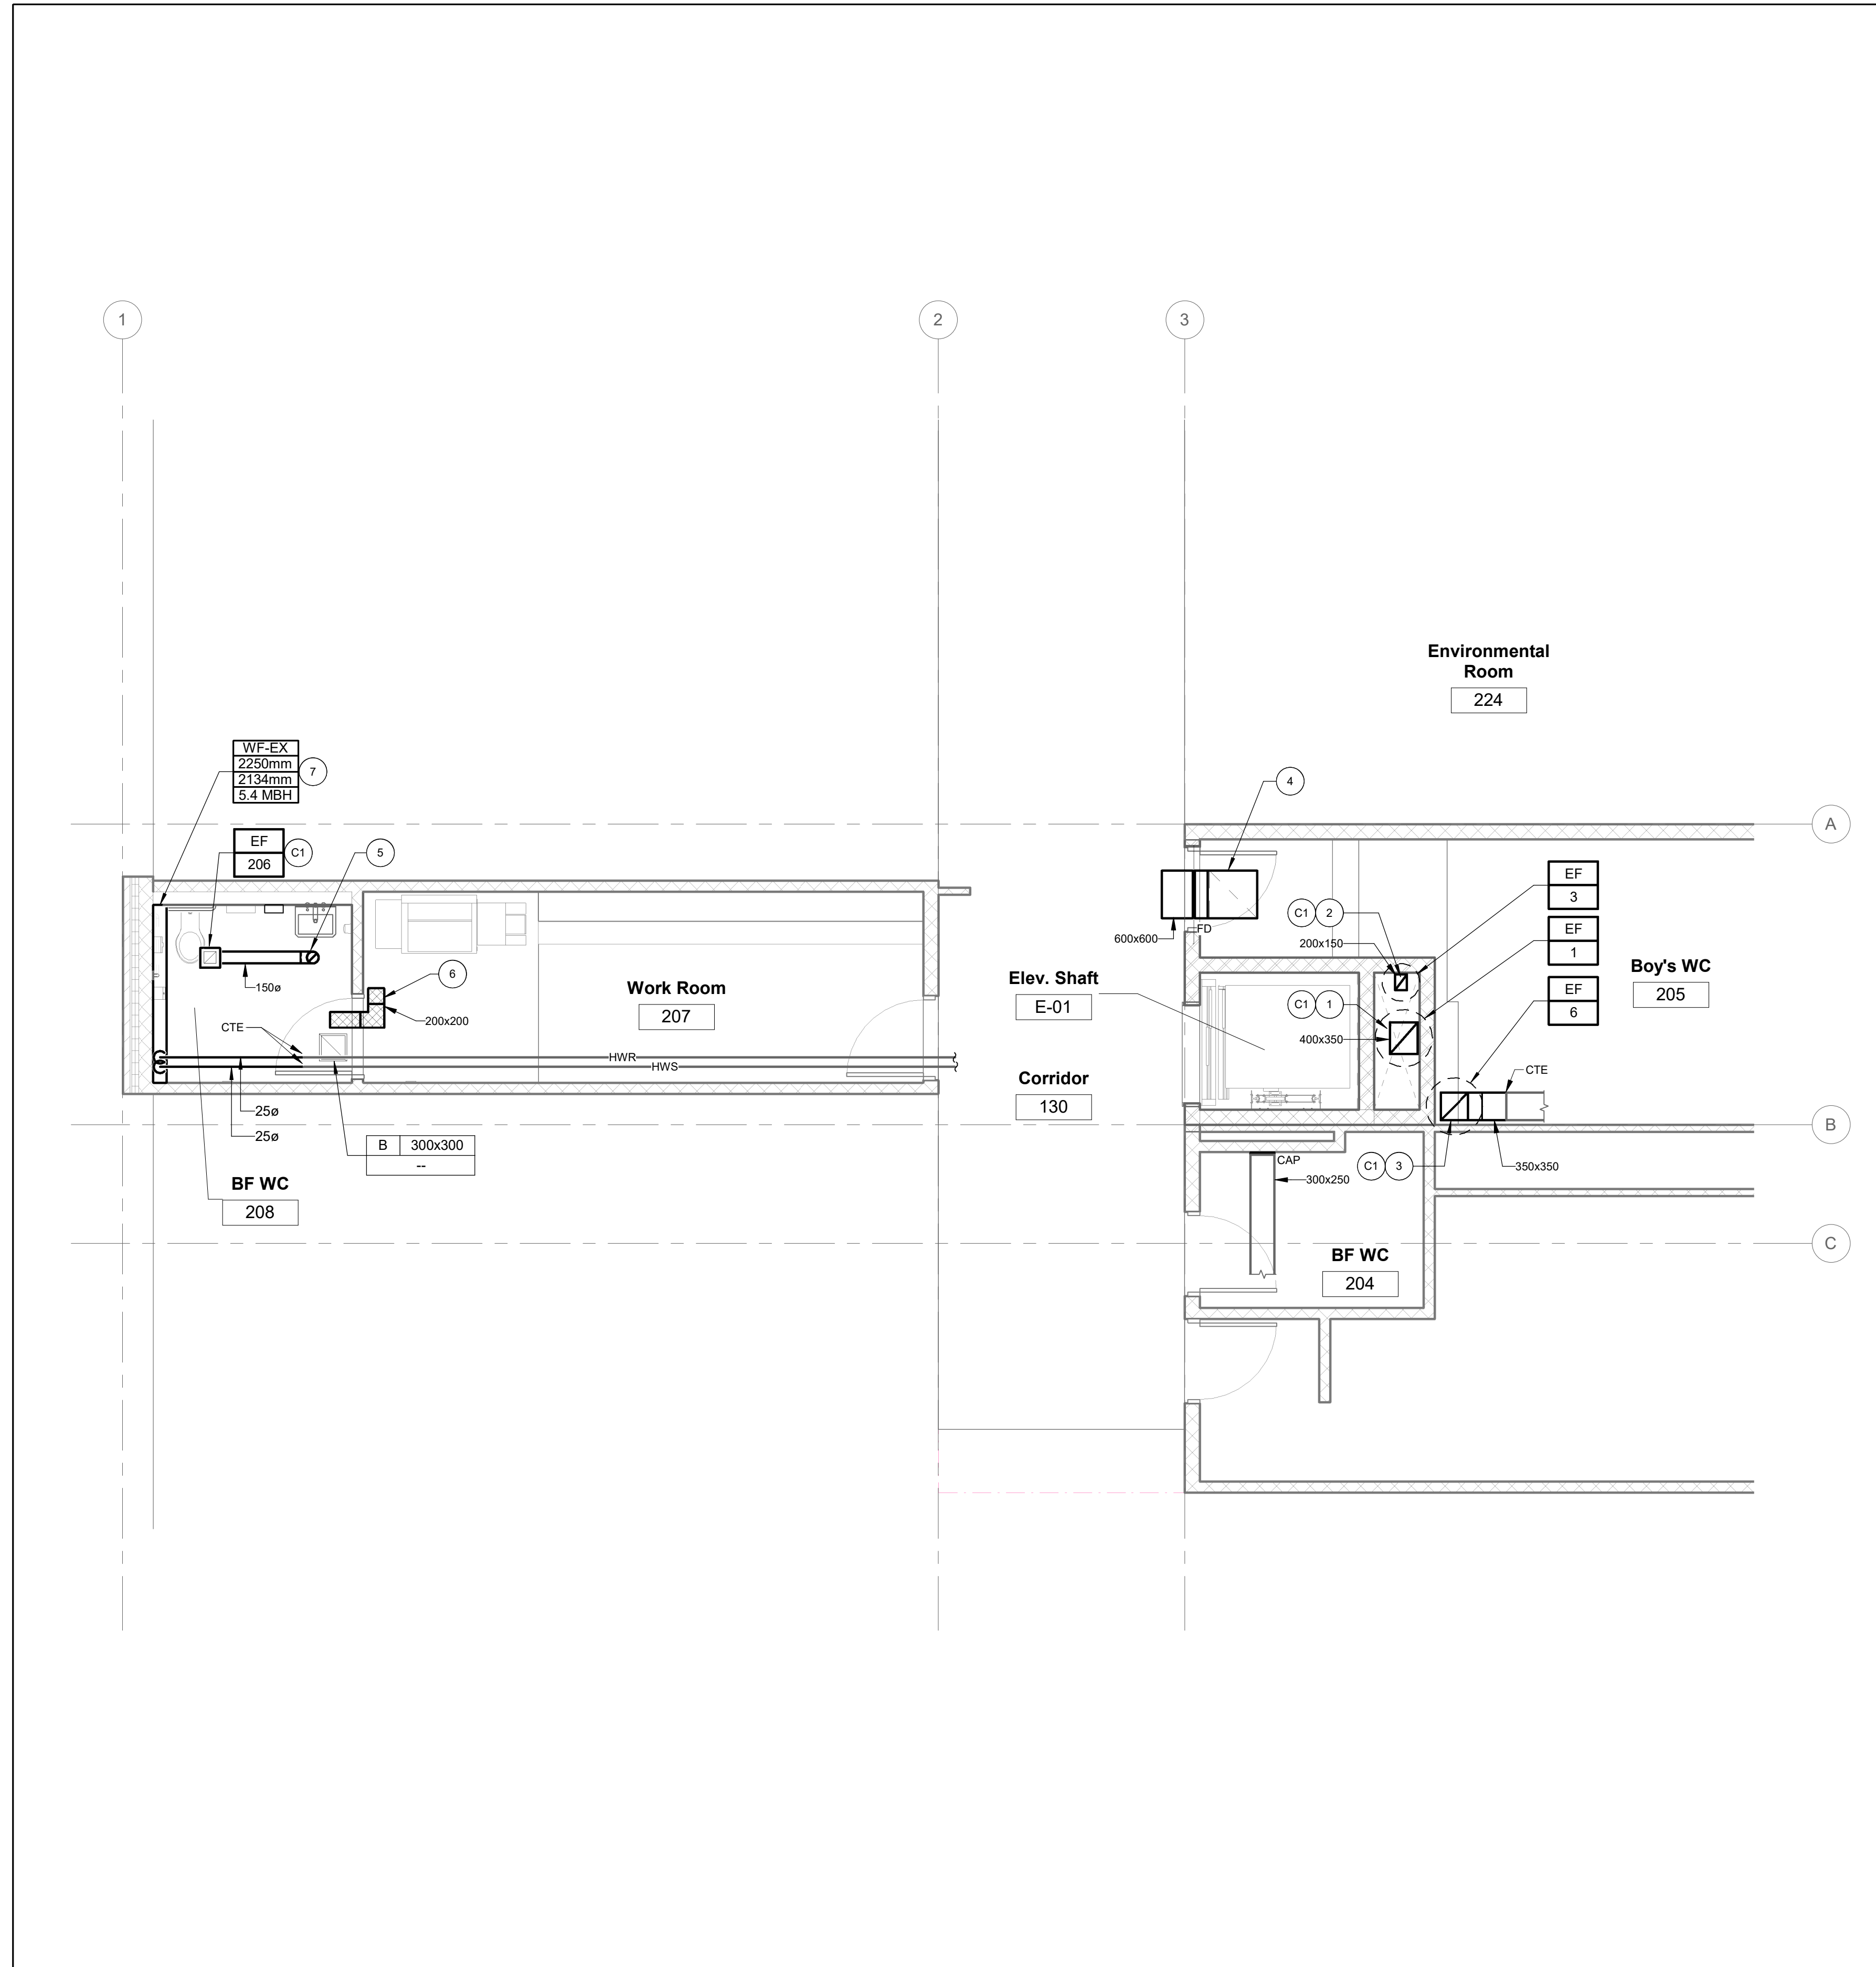

**1 SECOND FLOOR - NEW HVAC LAYOUT**  
SCALE: 1 : 50


- GENERAL NEW MECHANICAL NOTES:**
1. THE CONTRACTOR SHALL INVESTIGATE AND CONFIRM SERVICES ON SITE PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES TO CONSULTANT.
  2. SCOPE/CAMERA EXISTING UNDERGROUND SANITARY AND STORM PIPING THROUGH WORK AREA TO CONFIRM CONDITION OF PIPE, ROUTING AND INVERTS. SUBMIT REPORT AND VIDEO ON USB.
  3. SCAN FLOOR PRIOR TO FLOOR CUTS AND UNDERGROUND PIPING INSTALLATION.
  4. REFER TO ARCHITECTURAL DRAWINGS AND/OR GENERAL CONTRACTOR FOR CEILING HEIGHTS TO ENSURE ALL SERVICES ARE CONCEALED WITHIN AVAILABLE CEILING SPACE. RUN ALL NEW SERVICES UP IN JOIST SPACE AND BETWEEN LIGHTS AS NOTED OR AS REQUIRED.
  5. COORDINATE ALL SERVICES WITH ALL TRADES PRIOR TO INSTALLATION.
  6. COVER ALL FLOOR DRAINS DURING CONSTRUCTION.
  7. PROVIDE NEW PLUMBING VENTS THROUGH ALL FLOORS AND THROUGH ROOF AS REQUIRED OR TIE INTO EXISTING WHERE POSSIBLE.
  8. INSULATE AND LABEL ALL NEW PIPING. PROVIDE PVC JACKET ON ALL EXPOSED PIPING.
  9. FIRE STOP ALL NEW PIPING THROUGH RATED WALLS IN AREA OF WORK.
  10. SUPPLY ACCESS DOORS FOR MECHANICAL DEVICES ABOVE DRYWALL CEILING AND TURN OVER TO GENERAL CONTRACTOR FOR INSTALLATION.
  11. ELECTRICAL CONTRACTOR TO PROVIDE BACK BOX, CONDUIT AND PULL STRING FOR WALL SENSORS IN NEW WALLS. COORDINATE WITH ELECTRICAL.
  12. LABEL CEILING GRID AT ACCESS TO MECHANICAL EQUIPMENT AND DEVICES WITH LAMACOID NAMEPLATE.
  13. THE CONTRACTOR SHALL FLUSH, SCOPE, AND PROVIDE VIDEO INSPECTION OF THE SANITARY SYSTEM AFTER COMPLETION OF WORK AND PRIOR TO SUBSTANTIAL COMPLETION. FLUSHING, SCOPING AND VIDEO SHALL INCLUDE AREA OF WORK TO WHERE IT TIES INTO THE MAIN. SUBMIT REPORT AND VIDEO ON USB.
  14. TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.

- NEW HVAC WORKING NOTES:**
1. 400x350 E/A DUCTWORK FROM GROUND FLOOR WASHROOMS UP IN SHAFT AND UP THROUGH ROOF TO NEW EXHAUST FAN C/W NEW CURB. COORDINATE ROOFING AND STRUCTURAL REQUIREMENTS WITH GENERAL CONTRACTOR. THERMALLY INSULATE LAST 2.3m OF E/A DUCTWORK BACK FROM ROOF.
  2. 200x150 E/A DUCTWORK UP FROM STAFF ROOM WASHROOMS UP IN SHAFT AND UP THROUGH ROOF TO NEW EXHAUST FAN C/W NEW CURB. COORDINATE ROOFING AND STRUCTURAL REQUIREMENTS WITH GENERAL CONTRACTOR. THERMALLY INSULATE LAST 2.3m OF E/A DUCTWORK BACK FROM ROOF.
  3. 350x350 E/A DUCTWORK FROM SECOND FLOOR WASHROOMS UP THROUGH ROOF TO NEW EXHAUST FAN C/W NEW CURB. COORDINATE ROOFING AND STRUCTURAL REQUIREMENTS WITH GENERAL CONTRACTOR. THERMALLY INSULATE LAST 2.3m OF E/A DUCTWORK BACK FROM ROOF.
  4. REINSTALL EXISTING RETURN AIR TRANSFER DUCT AND GRILLE C/W NEW FIRE DAMPER AT WALL PENETRATION. EXTEND DUCT AT CONNECTION TO WALL AS REQUIRED TO SUIT RCP. COORDINATE WITH GENERAL CONTRACTOR.
  5. 150ø E/A UP THROUGH ROOF TO GOOSENECK. THERMALLY INSULATE LAST 2.3m BACK FROM ROOF.
  6. ACOUSTICALLY LINED TRANSFER DUCT. REFER TO DRAWING FOR SIZE AND REFER TO DETAILS.
  7. PROVIDE NEW WALLFIN MOUNTED TIGHT TO UNDERSIDE OF CEILING. PROVIDE NEW VALVES AND ACCESSORIES AS PER DETAIL.

- CONTROLS WORKING NOTES:**
- (C1) PROVIDE CONTROLS AND CONTROL WIRING FOR NEW EXHAUST FAN.

**DISCLAIMER:**  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT

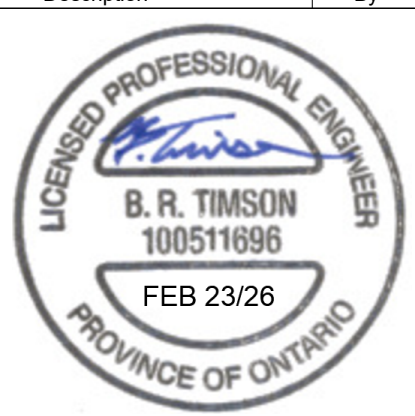

**CONSULTANT(S):**

**ENGINEER:**

**CIMA+**  
C2 Architecture Inc.  
415 Baseline Road West  
Bowmanville, ON L1C 5M2  
☎ 905.697.4464

**CLIENT:**

**WILLIAM DUNBAR PS**  
1030 Glenanna Rd., Pickering, ON  
L1V 5E5


**PROJECT NAME:**

**WILLIAM DUNBAR PS  
ELEVATOR RENOVATION**

**SHEET TITLE:**

**SECOND FLOOR - NEW HVAC  
LAYOUT**

DISCIPLINE:	
<b>MECHANICAL</b>	
<b>DRAFTER:</b>	<b>SCALE:</b>
SR	AS NOTED
<b>DESIGNER:</b>	<b>DATE:</b>
BRT	2026-02-23
<b>APPROVER:</b>	<b>CHECKER:</b>
BRT	BRT
<b>PROJECT No.:</b>	<b>DRAWING No.:</b>
A0001198	M-102
7 of 10	

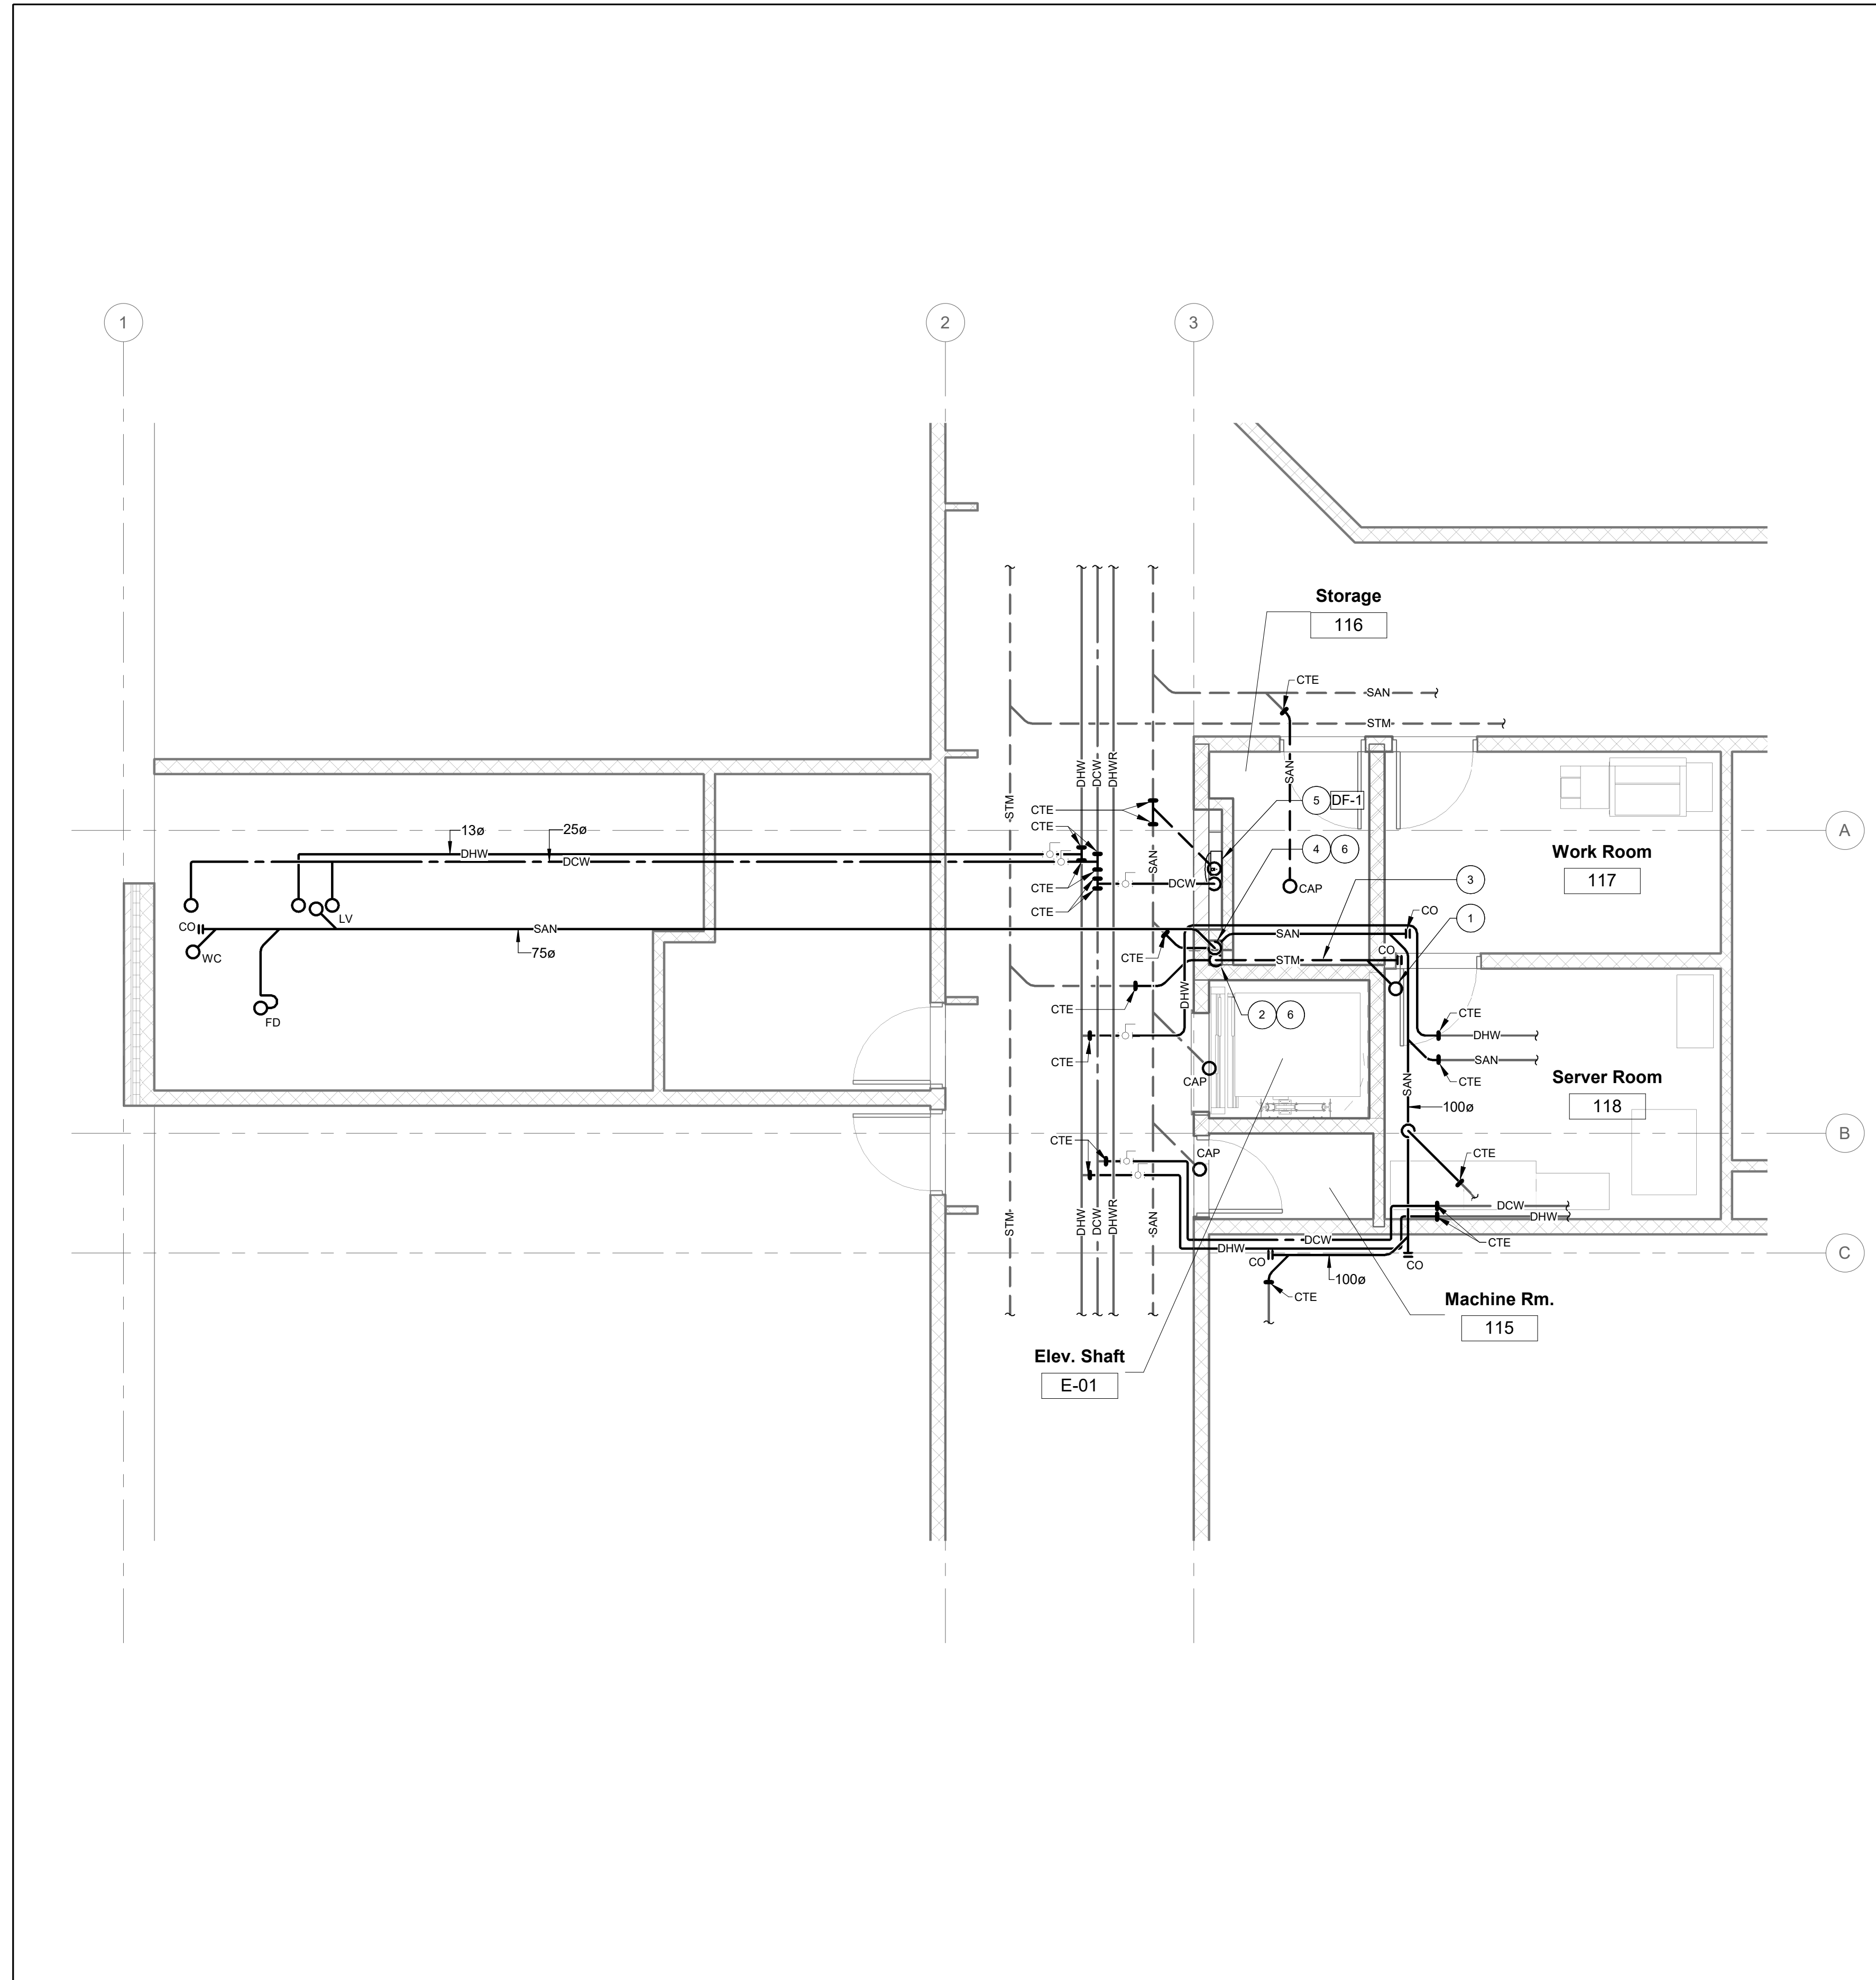

**1 GROUND FLOOR - NEW PLUMBING LAYOUT**  
SCALE: 1 : 50

- GENERAL NEW MECHANICAL NOTES:**
- THE CONTRACTOR SHALL INVESTIGATE AND CONFIRM SERVICES ON SITE PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES TO CONSULTANT.
  - SCOPE/CAMERA EXISTING UNDERGROUND SANITARY AND STORM PIPING THROUGH WORK AREA TO CONFIRM CONDITION OF PIPE, ROUTING AND INVERTS. SUBMIT REPORT AND VIDEO ON USB.
  - SCAN FLOOR PRIOR TO FLOOR CUTS AND UNDERGROUND PIPING INSTALLATION.
  - REFER TO ARCHITECTURAL DRAWINGS AND/OR GENERAL CONTRACTOR FOR CEILING HEIGHTS TO ENSURE ALL SERVICES ARE CONCEALED WITHIN AVAILABLE CEILING SPACE. RUN ALL NEW SERVICES UP IN JOIST SPACE AND BETWEEN LIGHTS AS NOTED OR AS REQUIRED.
  - COORDINATE ALL SERVICES WITH ALL TRADES PRIOR TO INSTALLATION.
  - COVER ALL FLOOR DRAINS DURING CONSTRUCTION.
  - PROVIDE NEW PLUMBING VENTS THROUGH ALL FLOORS AND THROUGH ROOF AS REQUIRED OR TIE INTO EXISTING WHERE POSSIBLE.
  - INSULATE AND LABEL ALL NEW PIPING. PROVIDE PVC JACKET ON ALL EXPOSED PIPING.
  - FIRE STOP ALL NEW PIPING THROUGH RATED WALLS IN AREA OF WORK.
  - SUPPLY ACCESS DOORS FOR MECHANICAL DEVICES ABOVE DRYWALL CEILING AND TURN OVER TO GENERAL CONTRACTOR FOR INSTALLATION.
  - ELECTRICAL CONTRACTOR TO PROVIDE BACK BOX, CONDUIT AND PULL STRING FOR WALL SENSORS IN NEW WALLS. COORDINATE WITH ELECTRICAL.
  - LABEL CEILING GRID AT ACCESS TO MECHANICAL EQUIPMENT AND DEVICES WITH LAMACOID NAMEPLATE.
  - THE CONTRACTOR SHALL FLUSH, SCOPE, AND PROVIDE VIDEO INSPECTION OF THE SANITARY SYSTEM AFTER COMPLETION OF WORK AND PRIOR TO SUBSTANTIAL COMPLETION. FLUSHING, SCOPING AND VIDEO SHALL INCLUDE AREA OF WORK TO WHERE IT TIES INTO THE MAIN. SUBMIT REPORT AND VIDEO ON USB.
  - TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.

- NEW PLUMBING WORKING NOTES:**
- 100Ø STORM DOWN FROM SECOND FLOOR C/W FIRE STOPPING AT FLOOR PENETRATION.
  - 100Ø STORM DOWN IN NEW CHASE TO UNDERGROUND C/W CLEANOUT AT BOTTOM OF RISER. CONNECT BACK TO MAIN IN CORRIDOR.
  - THERMALLY INSULATE AND LABEL ALL NEW STORM PIPING.
  - 100Ø SAN DOWN IN NEW CHASE TO UNDERGROUND C/W CLEANOUT AT BOTTOM OF RISER. CONNECT BACK TO MAIN IN CORRIDOR.
  - 13Ø DCW DOWN TO NEW DRINKING FOUNTAIN. CONNECT SANITARY TO MAIN IN CORRIDOR.
  - SUPPLY ACCESS DOOR FOR CLEANOUTS AND TURN OVER TO THE GENERAL CONTRACTOR FOR INSTALLATION.


**TYPICAL PLUMBING PIPE SIZING**

	DCW	DHW	DTW	SAN.	VENT
WC (TANK TYPE)	13Ø	--	--	75Ø	38Ø
WC (FLUSH TYPE)	25Ø	--	--	75Ø	38Ø
LAVATORY	--	--	13Ø	32Ø	32Ø
SINK (DOMESTIC)	13Ø	13Ø	--	38Ø	32Ø
MOP SINK	13Ø	13Ø	--	38Ø	32Ø
DRINKING FOUNTAIN	13Ø	--	--	32Ø	32Ø
75Ø FD	--	--	--	75Ø	38Ø
100Ø FD	--	--	--	100Ø	38Ø

PROVIDE ISOLATION VALVES AT ALL FIXTURES

**DISCLAIMER:**  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT

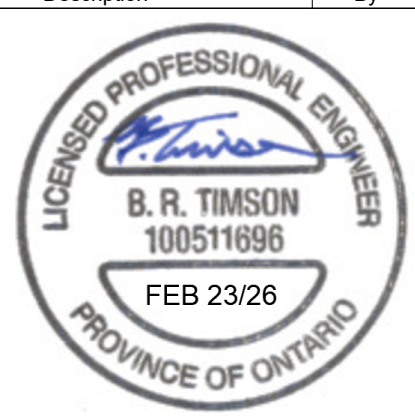

**CONSULTANT:**

**ENGINEER:**



**CLIENT:**

**WILLIAM DUNBAR PS**  
1030 Glenanna Rd., Pickering, ON L1V 5E5

**PROJECT NAME:**

**WILLIAM DUNBAR PS ELEVATOR RENOVATION**


**SHEET TITLE:**

**GROUND FLOOR - NEW PLUMBING LAYOUT**

**DISCIPLINE:**

**MECHANICAL**

<b>DRAWER:</b> SR	<b>SCALE:</b> AS NOTED
<b>DESIGNER:</b> BRT	<b>DATE:</b> 2026-02-23
<b>APPROVER:</b> BRT	<b>CHECKER:</b> BRT
<b>PROJECT No.:</b> A0001198	<b>DRAWING No.:</b> M-103
<b>SHEET No.:</b> 8 of 10	

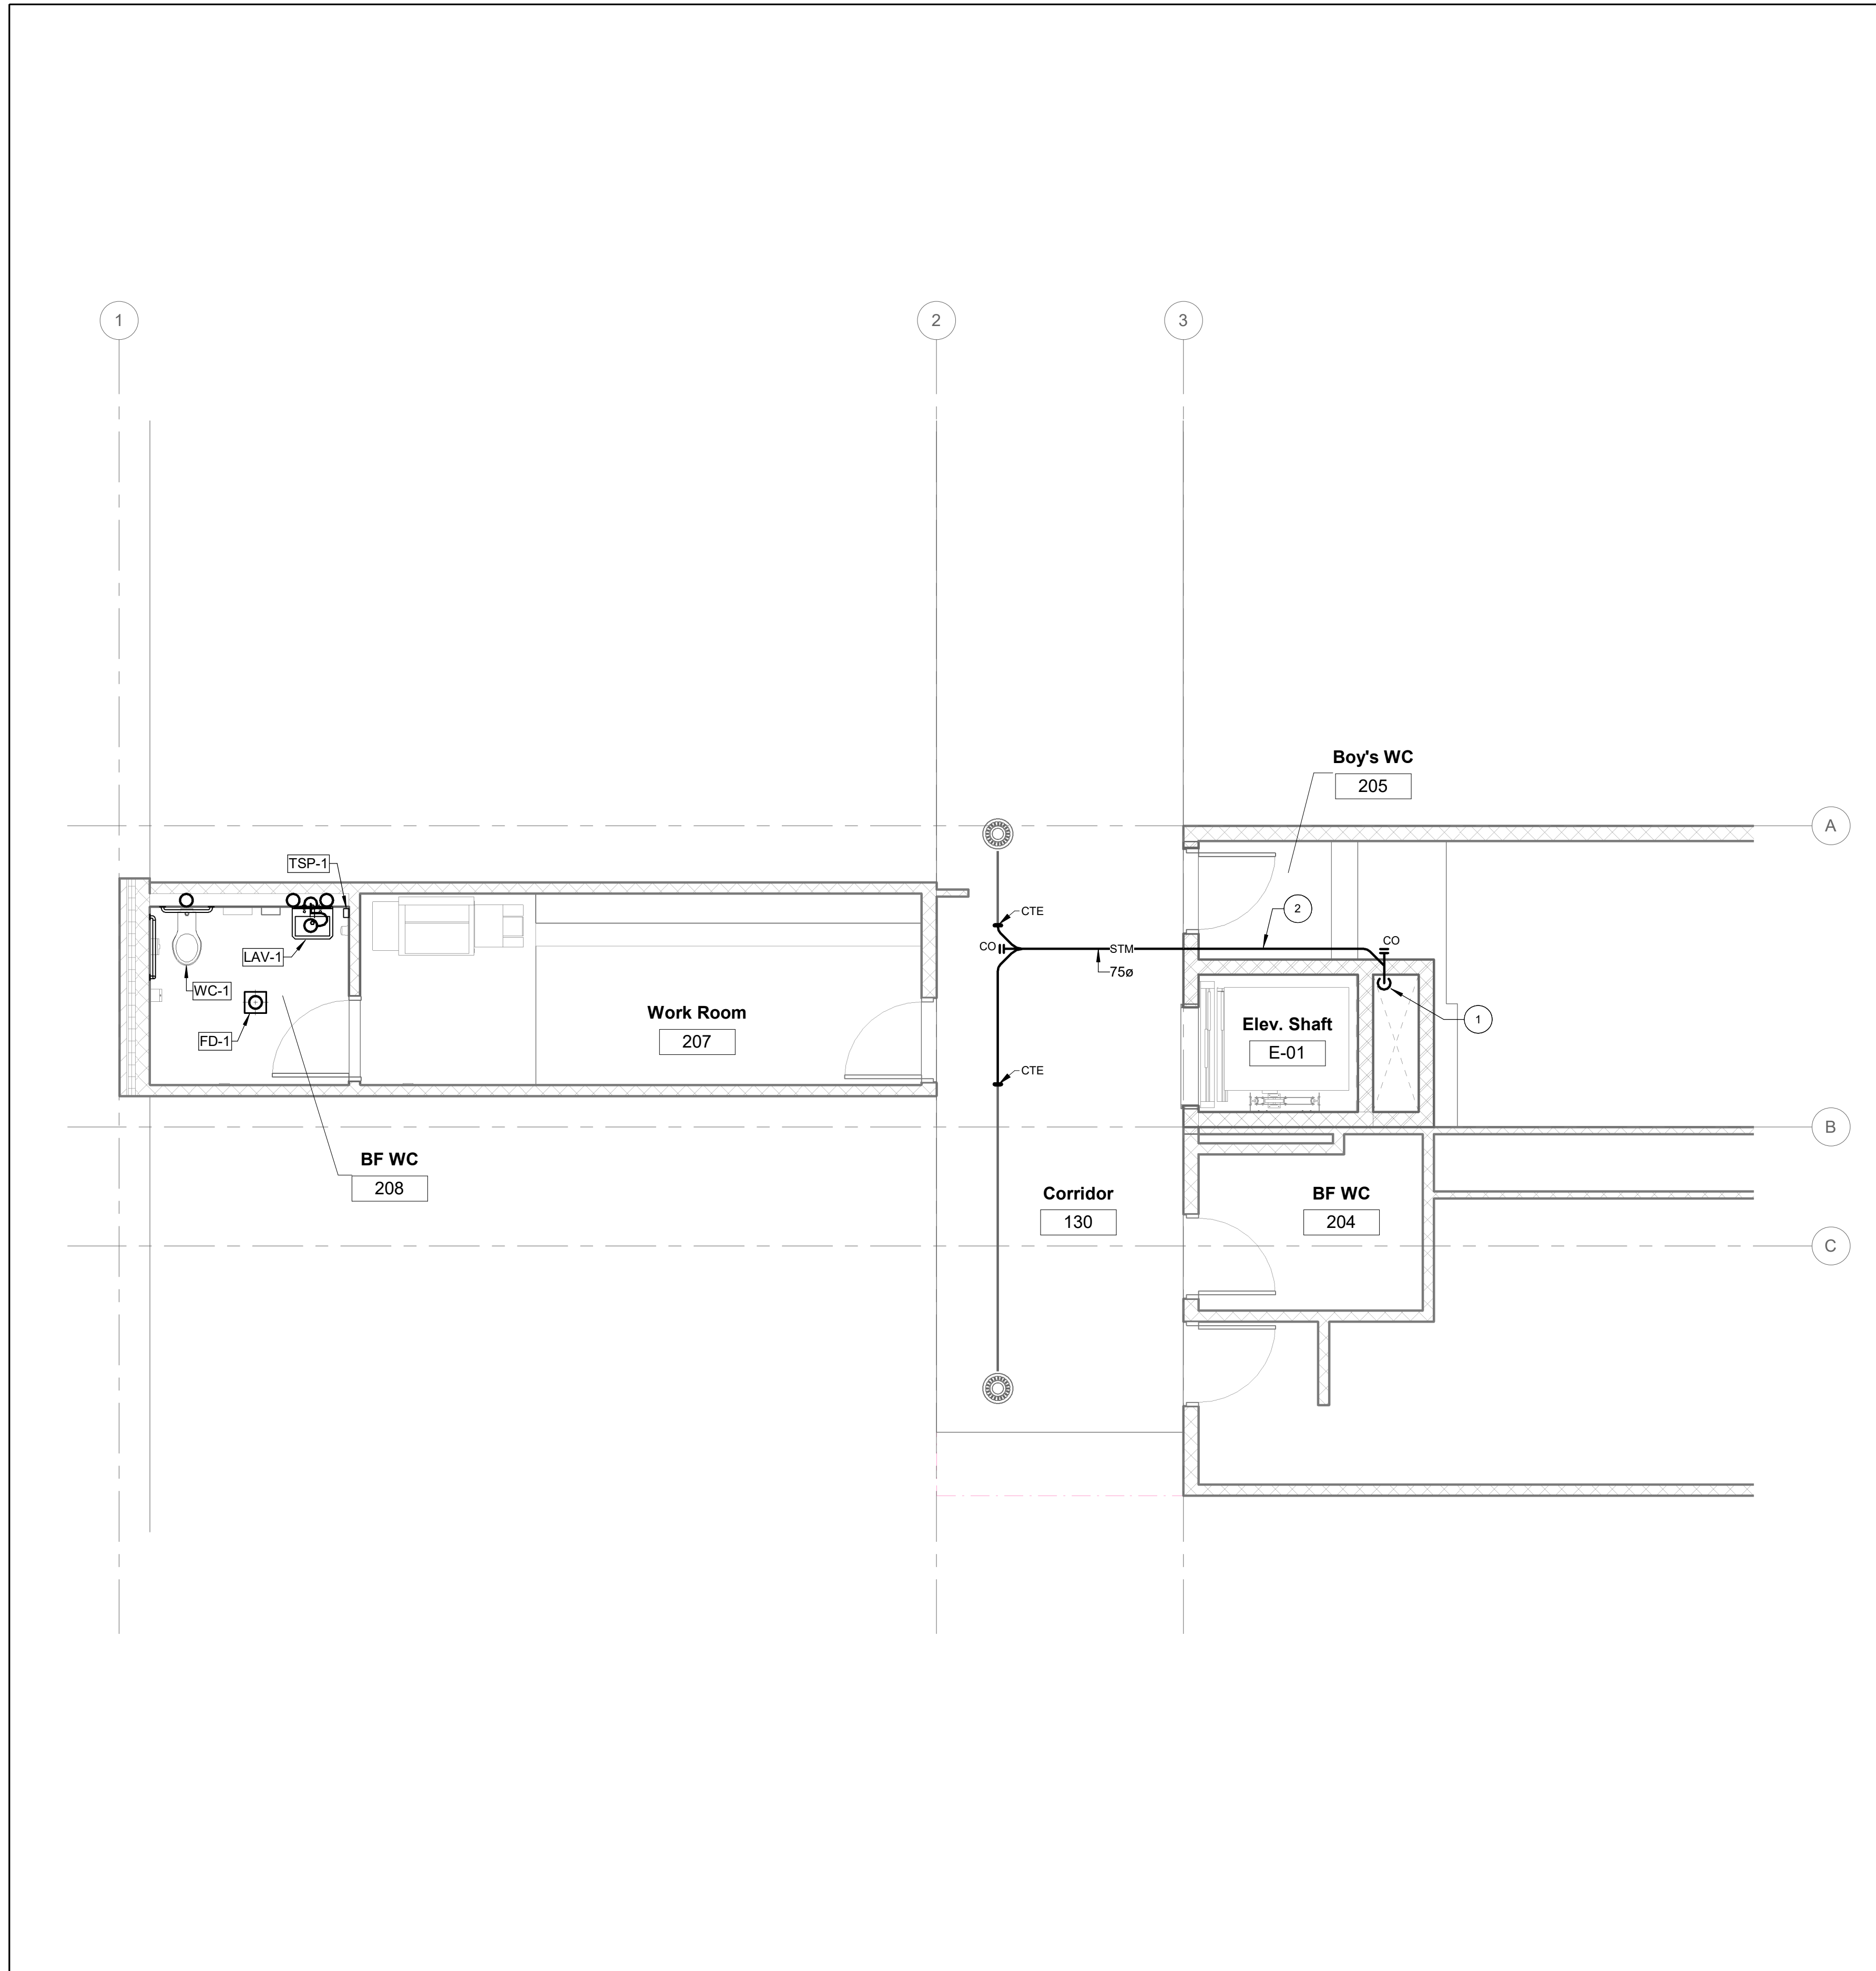

**1 SECOND FLOOR - NEW PLUMBING LAYOUT**  
SCALE: 1 : 50

- GENERAL NEW MECHANICAL NOTES:**
1. THE CONTRACTOR SHALL INVESTIGATE AND CONFIRM SERVICES ON SITE PRIOR TO CONSTRUCTION AND REPORT ANY DISCREPANCIES TO CONSULTANT.
  2. SCOPE/CAMERA EXISTING UNDERGROUND SANITARY AND STORM PIPING THROUGH WORK AREA TO CONFIRM CONDITION OF PIPE, ROUTING AND INVERTS. SUBMIT REPORT AND VIDEO ON USB.
  3. SCAN FLOOR PRIOR TO FLOOR CUTS AND UNDERGROUND PIPING INSTALLATION.
  4. REFER TO ARCHITECTURAL DRAWINGS AND/OR GENERAL CONTRACTOR FOR CEILING HEIGHTS TO ENSURE ALL SERVICES ARE CONCEALED WITHIN AVAILABLE CEILING SPACE. RUN ALL NEW SERVICES UP IN JOIST SPACE AND BETWEEN LIGHTS AS NOTED OR AS REQUIRED.
  5. COORDINATE ALL SERVICES WITH ALL TRADES PRIOR TO INSTALLATION.
  6. COVER ALL FLOOR DRAINS DURING CONSTRUCTION.
  7. PROVIDE NEW PLUMBING VENTS THROUGH ALL FLOORS AND THROUGH ROOF AS REQUIRED OR TIE INTO EXISTING WHERE POSSIBLE.
  8. INSULATE AND LABEL ALL NEW PIPING. PROVIDE PVC JACKET ON ALL EXPOSED PIPING.
  9. FIRE STOP ALL NEW PIPING THROUGH RATED WALLS IN AREA OF WORK.
  10. SUPPLY ACCESS DOORS FOR MECHANICAL DEVICES ABOVE DRYWALL CEILING AND TURN OVER TO GENERAL CONTRACTOR FOR INSTALLATION.
  11. ELECTRICAL CONTRACTOR TO PROVIDE BACK BOX, CONDUIT AND PULL STRING FOR WALL SENSORS IN NEW WALLS. COORDINATE WITH ELECTRICAL.
  12. LABEL CEILING GRID AT ACCESS TO MECHANICAL EQUIPMENT AND DEVICES WITH LAMACOID NAMEPLATE.
  13. THE CONTRACTOR SHALL FLUSH, SCOPE, AND PROVIDE VIDEO INSPECTION OF THE SANITARY SYSTEM AFTER COMPLETION OF WORK AND PRIOR TO SUBSTANTIAL COMPLETION. FLUSHING, SCOPING AND VIDEO SHALL INCLUDE AREA OF WORK TO WHERE IT TIES INTO THE MAIN. SUBMIT REPORT AND VIDEO ON USB.
  14. TEMPORARILY SEAL ALL OPEN DUCTS THROUGHOUT CONSTRUCTION TO PREVENT DUST AND DIRT FROM ENTERING THE SYSTEM. WHERE THE CONTRACTOR DOES NOT CONFORM THEY ARE RESPONSIBLE FOR CLEANING OF THE SYSTEMS IN A MANNER APPROVED BY THE CONSULTANT.

- NEW PLUMBING WORKING NOTES:**
- 1 100Ø STORM DOWN IN NEW CHASE TO GROUND FLOOR C/W FIRE STOPPING AT FLOOR PENETRATION AND WALL PENETRATIONS.
  - 2 THERMALLY INSULATE AND LABEL ALL NEW STORM PIPING.

**TYPICAL PLUMBING PIPE SIZING**

	DCW	DHW	DTW	SAN.	VENT
WC (TANK TYPE)	13Ø	--	--	75Ø	38Ø
WC (FLUSH TYPE)	25Ø	--	--	75Ø	38Ø
LAVATORY	--	--	13Ø	32Ø	32Ø
SINK (DOMESTIC)	13Ø	13Ø	--	38Ø	32Ø
MOP SINK	13Ø	13Ø	--	38Ø	32Ø
DRINKING FOUNTAIN	13Ø	--	--	32Ø	32Ø
75Ø FD	--	--	--	75Ø	38Ø
100Ø FD	--	--	--	100Ø	38Ø

PROVIDE ISOLATION VALVES AT ALL FIXTURES

**DISCLAIMER:**  
This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT



CONSULTANT(S):

**ENGINEER:**  
**CIMA+**  
C2 Architecture Inc.  
415 Baseline Road West  
Bowmanville, ON L1C 5M2  
☎ 905.697.4464



**CLIENT:**  
**WILLIAM DUNBAR PS**  
1030 Glenanna Rd, Pickering, ON  
L1V 5E5

**PROJECT NAME:**  
**WILLIAM DUNBAR PS  
ELEVATOR RENOVATION**

**SHEET TITLE:**  
**SECOND FLOOR - NEW PLUMBING  
LAYOUT**

**DISCIPLINE:**  
**MECHANICAL**

<b>DRAFTER:</b> SR	<b>SCALE:</b> AS NOTED
<b>DESIGNER:</b> BRT	<b>DATE:</b> 2026-02-23
<b>APPROVER:</b> BRT	<b>CHECKER:</b> BRT
<b>PROJECT No.:</b> A0001198	<b>DRAWING No.:</b> M-104
<b>SHEET No.:</b> 9 of 10	

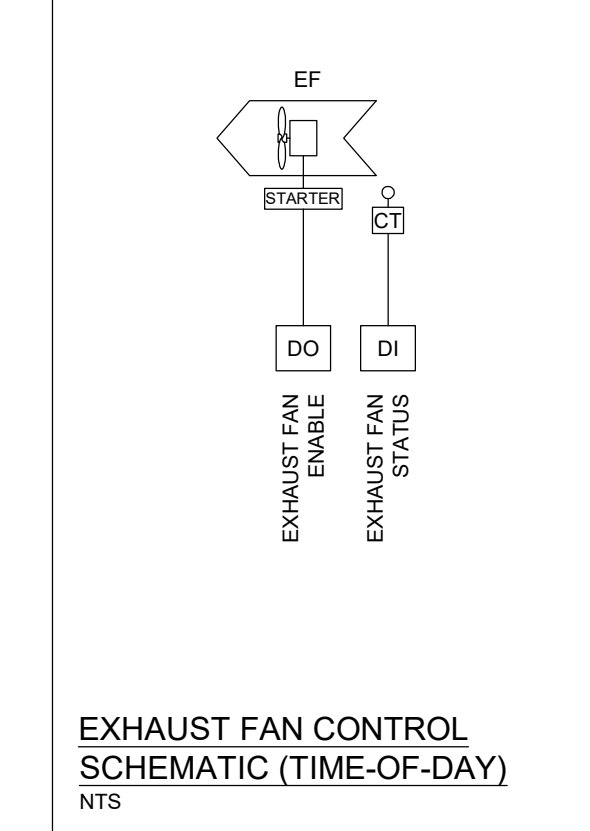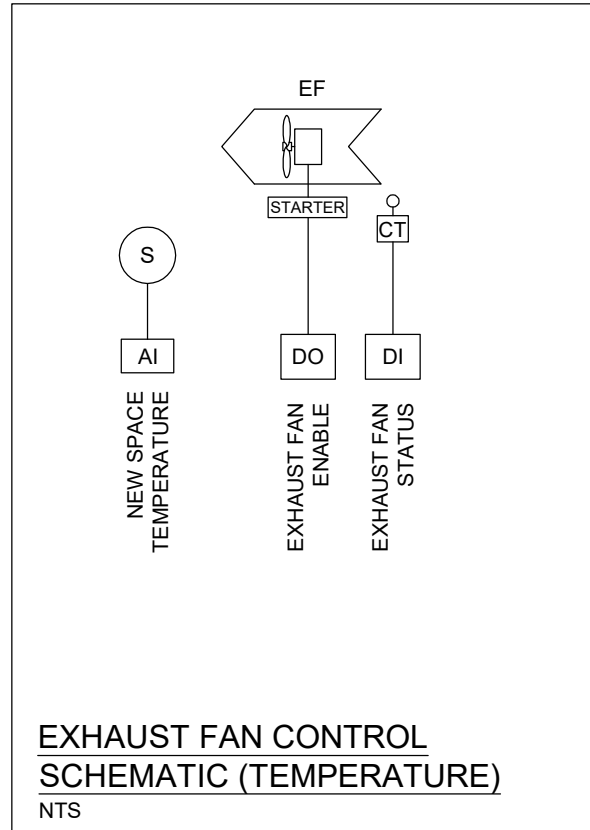

**CONTROLS SCOPE OF WORK:**

- THE GENERAL (PRIME) CONTRACTOR SHALL RETAIN THE INSTALLING CONTROLS CONTRACTOR FOR ALL NEW BAS CONTROLS WORK UNDER A CASH ALLOWANCE. ONCE THE CONTRACT IS AWARDED, THE DDBS SHALL SELECT A PRE-QUALIFIED INSTALLING CONTROLS CONTRACTOR BASED ON THE SCOPE OF WORK OUTLINED ON THE DRAWINGS. THE GENERAL (PRIME) CONTRACTOR SHALL CARRY THE SUCCESSFUL INSTALLING CONTROLS CONTRACTOR AS A SUB-TRADE UNDER THE ALLOTTED CASH ALLOWANCE (REFER TO CASH ALLOWANCE SPECIFICATION).
- THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEMO ELECTRIC (120V) CONTROLS WORK AND CONTROL WIRING ASSOCIATED WITH THE EXISTING AC UNITS.
- THE INSTALLING CONTROLS CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEMO AND NEW BAS CONTROLS WORK.
- DDBS SHALL SUPPLY ALL REQUIRED SENSORS, RELAYS, CURRENT SWITCHES, CONTROL ENCLOSURES, AND ALL OTHER NECESSARY CONTROL DEVICES FOR A FULLY OPERATIONAL SYSTEM EXCEPT AS NOTED HEREIN AND TURN OVER TO INSTALLING CONTROLS CONTRACTOR FOR INSTALLATION. (THE EXISTING BAS SYSTEM IS SIEMENS CONTROLS).
- DDBS SHALL SUPPLY ALL ELECTRIC (24V) AND NEW BAS CONTROL VALVES AND TURN OVER CONTROL VALVE BODIES TO MECHANICAL CONTRACTOR FOR INSTALLATION. MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PICKING UP VALVES FROM DDBS OFFICE AND TRANSPORTING VALVES TO SITE. COORDINATE WITH DDBS.
- DDBS SHALL SUPPLY ALL NEW TEMPERATURE SENSOR WELLS AND TURN OVER TO MECHANICAL CONTRACTOR FOR INSTALLATION. MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR PICKING UP WELLS FROM DDBS OFFICE AND TRANSPORTING WELLS TO SITE. COORDINATE WITH DDBS.
- SCOPE OF WORK SHALL INCLUDE BUT IS NOT LIMITED TO:
  - REMOVAL OF REDUNDANT CONTROLS.
  - PROVIDE NEW SPACE SENSORS, RELOCATE EXISTING SENSORS, OR REWIRE EXISTING SENSORS TO SUIT NEW CONTROLS AS REQUIRED AND AS INDICATED ON DRAWINGS.
  - PROVIDE NEW OR UPGRADE EXISTING BAS CONTROLLERS AS INDICATED AND FOR COMPLETELY FUNCTIONAL SYSTEMS, TIE NEW CONTROLLERS INTO EXISTING BAS CONTROL NETWORK. RELOCATE EXISTING CONTROLLERS AS REQUIRED AND TIE BACK INTO EXISTING BAS CONTROL NETWORK.
  - PROVIDE CONTROL FOR NEW EXHAUST FANS.
- MECHANICAL CONTRACTOR AND INSTALLING CONTROLS CONTRACTOR SHALL TAKE PRECAUTIONS DURING DEMOLITION AND NEW WORK TO ENSURE BAS COMMUNICATIONS WIRING REMAINS FULLY FUNCTIONAL AND OPERATIONAL DURING RENOVATION. CONTROLS CONTRACTOR SHALL PROVIDE ANY TEMPORARY WIRING REQUIRED TO MAINTAIN SYSTEM UPTIME AND INTEGRITY.
- GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR PATCHING, REPAIRING, AND SEALING ANY WALLS, CEILINGS, OR EQUIPMENT WHERE EXISTING CONTROLS DEVICES ARE REMOVED. COORDINATE LOCATION AND PATCHING FOR NEW CONTROLS WITH INSTALLING CONTROLS CONTRACTOR.

FAN SCHEDULE						
TAG		EF-1	EF-3	EF-6	EF-125 & EF-126	EF-206
SERVICE		GROUND FLOOR WASHROOMS	STAFF ROOM WASHROOMS	SECOND FLOOR WASHROOMS	HUB ROOM/ELEVATOR MACHINE	UNIVERSAL WASHROOM
TYPE		ROOF MOUNTED	ROOF MOUNTED	ROOF MOUNTED	IN-LINE	IN-LINE
MANUFACTURER		COOK	COOK	COOK	GREENHECK VARI-GREEN	GREENHECK VARI-GREEN
MODEL		120C15D	90C15DH	120C15D	SG-70-VG	SG-70-VG
AIR FLOW	cfm	1100	150	960	150(HIGH)/90(LOW)	150(HIGH)/90(LOW)
EXTERNAL STATIC	in.wc.	0.6	0.5	0.5	0.25	0.25
SOUND		57 dBA@8.7 SONES	56 dBA@8.2 SONES	56 dBA@7.9 SONES	41 dBA@2.9 SONES	41 dBA@2.9 SONES
FAN RPM		1550	1550	1300	2970/878	2970/878
FAN MOTOR	hp	FRACTIONAL	FRACTIONAL	FRACTIONAL	FRACTIONAL	FRACTIONAL
FAN TYPE		DIRECT DRIVE C/W FSC	DIRECT DRIVE C/W FSC	DIRECT DRIVE C/W FSC	VARIABLE DIRECT DRIVE	VARIABLE DIRECT DRIVE
AMPS	amps	-	-	-	2.6	2.6
ELECTRICAL	volt/ph	115/1	115/1	115/1	120/1	120/1
DIMENSIONS	inches	28-7/16 Ø x 27-1/16 H	18-3/4 Ø x 16-13/16 H	28-7/16 Ø x 27-1/16 H	12W x 15L x 12H	12W x 15L x 12H
APPROX. WEIGHT	lbs	32	22	30	42	42
CONTROLS		-TIE INTO BAS TO RUN DURING OCCUPIED HOURS	-TIE INTO BAS TO RUN DURING OCCUPIED HOURS	-TIE INTO BAS TO RUN DURING OCCUPIED HOURS	-LOW SPEED BY OCCUPIED SCHEDULE HIGH SPEED BY TIMER (TIMER BY ELECTRICAL)	-LOW SPEED BY OCCUPIED SCHEDULE HIGH SPEED BY TIMER (TIMER BY ELECTRICAL)
ACCESSORIES		-ROOF CURB -FAN SPEED CONTROLLER -NEMA-1 DISCONNECT -BACKDRAFT DAMPER	-ROOF CURB -FAN SPEED CONTROLLER -NEMA-1 DISCONNECT -BACKDRAFT DAMPER	-ROOF CURB -FAN SPEED CONTROLLER -NEMA-1 DISCONNECT -BACKDRAFT DAMPER	-HANGING ISOLATOR KIT -BACKDRAFT DAMPER -DUAL SPEED VARI-GREEN CONTROLLER	-HANGING ISOLATOR KIT -BACKDRAFT DAMPER -DUAL SPEED VARI-GREEN CONTROLLER
ALTERNATE MANUFACTURERS		GREENHECK, CARNES, PENN		REVERSOMATIC, ZONEX	NO ALTERNATES ALLOWED	NO ALTERNATES ALLOWED

AIR OUTLET SCHEDULE			
TAG	A	B	C
TYPE	FIRE RATED SQUARE CONE DIFFUSER	FIRE RATED EGG CRATE RETURN	FIRE RATED LOUVERED FACE RETURN
MANUFACTURER	PRICE	PRICE	PRICE
MODEL	SCD-FR-3C	80-FR	535-FR-L
SIZE	SEE DRAWINGS	SEE DRAWINGS	SEE DRAWINGS
COLOUR	B12	B12	B12
NOTES	-12x12 CEILING MODULE FOR T-BAR MOUNTING -THERMAL BLANKET -STANDARD 165°F FUSIBLE LINK -JLIC LISTED	-CEILING MODULE FOR T-BAR MOUNTING -CEILING FIRESTOP FLAP -STANDARD 165°F FUSIBLE LINK -JLIC LISTED	-SINGLE DEFLECTION -1/2" BLADE SPACING -CEILING FIRESTOP FLAP -STANDARD 165°F FUSIBLE LINK -JLIC LISTED -LESS DAMPER
ALTERNATE MANUFACTURERS	METALAIRE, KREUGER		

NEW HOT WATER WALLFIN SCHEDULE		WF-A
MANUFACTURER		SIGMA
WALLFIN MODEL		SWE-SS
ELEMENT		ELMT-44C075
TYPE		SLOPE LOUVERED TOP OUTLET OPEN BOTTOM INLET
FLUID		WATER (0% GLYCOL)
ENCLOSURE HEIGHT	in.	12
ENCLOSURE DEPTH	in.	5-1/4
ENCLOSURE LENGTH		SITE MEASURE
ENCLOSURE COLOUR		STAINLESS STEEL
ELEMENT LENGTH		REFER TO DRAWINGS
HEATING CAPACITY	blu/hft	630
EWTL/LWT	*F	160/140
NO OF TIERS/ROWS		1
COPPER TUBING DIA.	in.	3/4"
ALUMINIUM FINIS	in.	4"x4"
CONTROLS		-DANFOSS VALVE. REFER TO DETAILS.
ACCESSORIES		-CONTINUOUS COVER C/W SPACERS, JOINERS ETC. AS REQUIRED -OPEN TOP, FRONT LOUVERED BOTTOM OUTLET AND SLOPE LOUVERED BOTTOM INLET
NOTES		-CONTRACTOR / SUPPLIER SHALL SITE MEASURE ALL ELEMENT AND ENCLOSURE LENGTHS & HEIGHTS PRIOR TO ORDERING MATERIAL. LENGTHS & HEIGHTS ARE THE RESPONSIBILITY OF THE CONTRACTOR.
ALTERNATE MANUFACTURERS		ENGINEERED AIR, EH PRICE, TRANE

**PLUMBING FIXTURE SCHEDULE**

**WC-1 FLOOR MOUNTED TOILET - VITREOUS CHINA - FLUSH VALVE - BARRIER FREE**

American Standard Madera FlowWise Right Height Elongated #3461.001 High Efficiency, Low consumption Toilet, white vitreous china with EverClean antimicrobial surface which inhibits the growth of stain and odor causing bacteria mold and mildew, elongated bowl, White Finish, Floor Mounted, siphon jet flush action, operates in the range of 4.2 L to 6 L (1.1 US Gal to 1.6 US Gal) per flush, condensate channel, 420mm rim height, 305 mm x 254 mm (12" x 10") water surface, elongated bowl, 54 mm (2-1/8") fully glazed internal trapway, 38 mm (1-1/2") dia. Top spud, floor outlet, bolt caps. Toilet seat not included. Delta TECK 61201-48 Manual Water Closet Flush Valve, piston-operated delivering 1.28gpi (4.8L/m) volume, non-hold open handle, cast-brass body and stop.  
 Centocoo #820STS-407 Toilet Seat, extra heavy duty, black finish, For elongated bowl, open front, Solid plastic. With cover, stainless steel self-sustaining check hinges, metal flat washers stainless steel points and nuts.  
 McGuire #LFH165LKN3 Toilet Supply, Chrome plated finish polished brass, heavy duty angle stops, 13 mm (1/2") I.P.S. Inlet x 76 mm (3") long rigid horizontal nipples, V.P. Loose keys, Escutcheon and flexible copper risers.  
 Provide Floor Flange, (Same material as the connecting pipe drain), with all brass bolts and with rubber gasket.

**LV-1 WALL HUNG BASIN - SINGLE HANDLE FAUCET - BARRIER FREE**

American Standard Murro with EverClean #0954.004EC.020/0062.000EC.020 Basin, 3 holes, 4" (102 mm) center, 540 mm x 520 mm x 165 mm (21-1/4" x 20-1/2" x 6-1/2") high, Vitreous china, White Finish, for carrier with concealed arms, Rear overflow, recessed self-draining faucet ledge, semi-pedestal P-trap cover.  
 Moen Commercial #8894 M-Press faucet with 4" deck plate, chrome plated brass construction, vandal resistant, ADA lever style handle, cycle time adjustment from 5 to 60 seconds, 0.5 gpm (1.9L/min) vandal-resistant multi-stream laminar flow limits water discharge to a maximum of 0.25 gpc (0.96L/cycle) @ 30 seconds or 0.20 gpc (0.76L/cycle) @ 24 seconds.  
 McGuire #LFH165LKN3 Faucet Supplies, Chrome plated finish polished brass, heavy duty angle stops, 10 mm (3/8") I.P.S. Inlet x 76 mm (3") long rigid horizontal nipples, V.P. Loose keys, Escutcheon and flexible copper risers.  
 McGuire #8872C P-Trap, heavy cast brass adjustable body, with slip nut, 32 mm (1-1/4") size, Shallow wall flange and Seamless tubular wall bend.  
 Watts #WCA-411 Basin Carrier, concealed arms, wall flanges to attach to backing plate secured in wall with locking device and leveling screws, heavy gauge steel uprights with integral welded feet. For one unit: 102 mm (4") for two to six units in a row: 152 mm (6") finished metal stud wall to back of pipe space.  
 Lawler TMM-1070, bronze body construction, high temperature limit stop with shut off temperature of 118° (+/- 3°). Integral rubber duck-bill back-flow checks within inlets, temperature adjustment dial, thermostatic mechanical mixing valve with outlet temperature range within 95-115°F (35-46°C), ASSE 1070 approved, valve shall control temperature from a low of 12gpm, 1gpm at 10psi and 1.6gpm at 20psi drop across the valve, 3/8" O compression fit inlets and outlets, ASSE Lead Free Certified.

**DF-1 - BOTTLE FILLING STATION**

Murdock Model No. BF16, non-refrigerated, non-filtered, lead-free, wall mounted, sensor operated bottle filling station with stainless steel finish, barrier free ADA compliant, 1.0 gpm delivery, push button activation.

**FD - FLOOR DRAINS - FINISHED AREA - ADJUSTABLE STRAINER**

Watts #FD-100-C-7A5-1 Floor Drain - epoxy coated, cast iron body, reversible flashing clamp with primary and secondary weepholes, trap primer connection with plug, no hub outlet. Watts-A5-1 5" (127mm) diameter, nickel bronze, adjustable, round strainer.  
 Alternates: Zurn, J.R. Smith

**CO - CLEANOUTS / ACCESS COVERS - ADJUSTABLE CLEANOUTS**

Watts #CO-200-R-34G Cleanout - epoxy coated, cast iron body, with 5" (127mm) round, adjustable, gasketed, nickel bronze top, ABS plug with neoprene gasket, no hub outlet.  
 Alternates: Zurn, J.R. Smith

**ACCESS DOORS/COVERS - FLUSH ACCESS DOOR - UNIVERSAL**











Acudor #UF-5000 Universal Access Doors, 14 GA. (1.7mm) steel, baked enamel prime coat, continuous concealed hinge, with positive and self-opening screwdriver operated lock. Doors in washroom shall be stainless steel. All other panels shall be baked enamel prime coated for field painting. Minimum size of panels shall be 12" x 18" (300mm x 450mm). Wherever possible 24" x 24" (600mm x 600mm) panels shall be used.

**WATER HAMMER ARRESTORS - PPP SC SERIES**

SMS INC. #SC Series Water Hammer Arrestors with brass piston in a type "K" copper casing size according to manufacturer's recommendations to eliminate water hammer and shock from piping system. Provide Water Hammer Arrestors on hot and cold water supplies to all quick valves, solenoids, and plumbing fixtures, and locate in an upright position between the last two fixtures on a line, or horizontally at the end of line closest to supply source. On projects exceeding five stories in height, provide water hammer arrestors on domestic water risers as follows. Locate arrestors at the end of riser opposite supply source.

**TSP - TRAP SEAL PRIMERS**

Sioux Chief #695-ES01, surface mount electronic trap primer, single outlet, solenoid valve, vacuum breaker, configurable electronic primer controller, water hammer arrestor, 120VAC power, 1/2" (13mm) inlet and outlet. Provide manifold as required to suit number of traps.

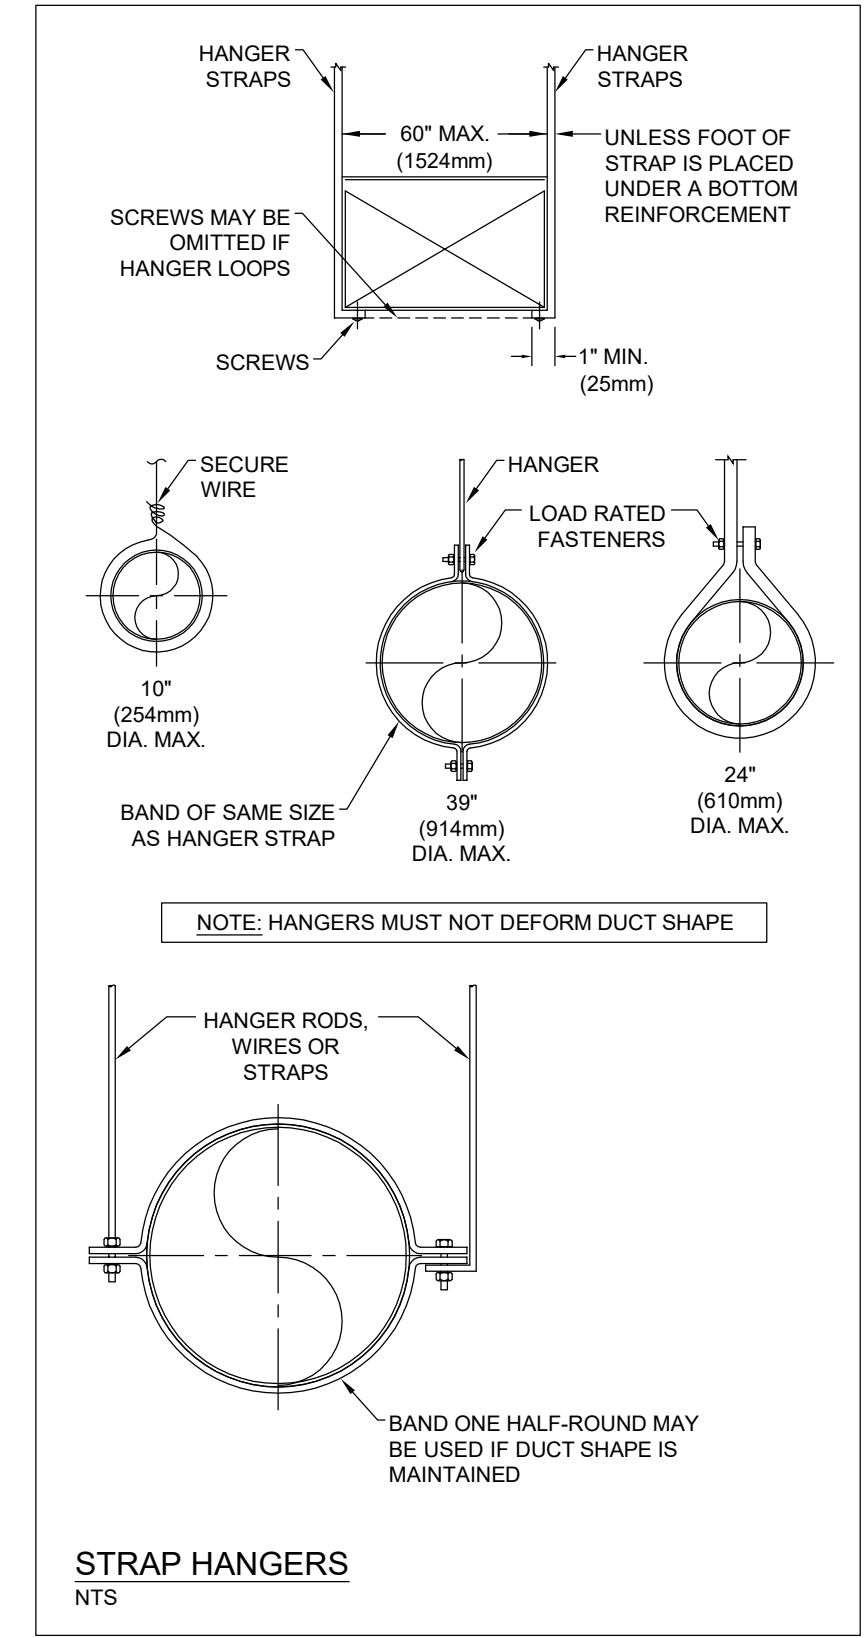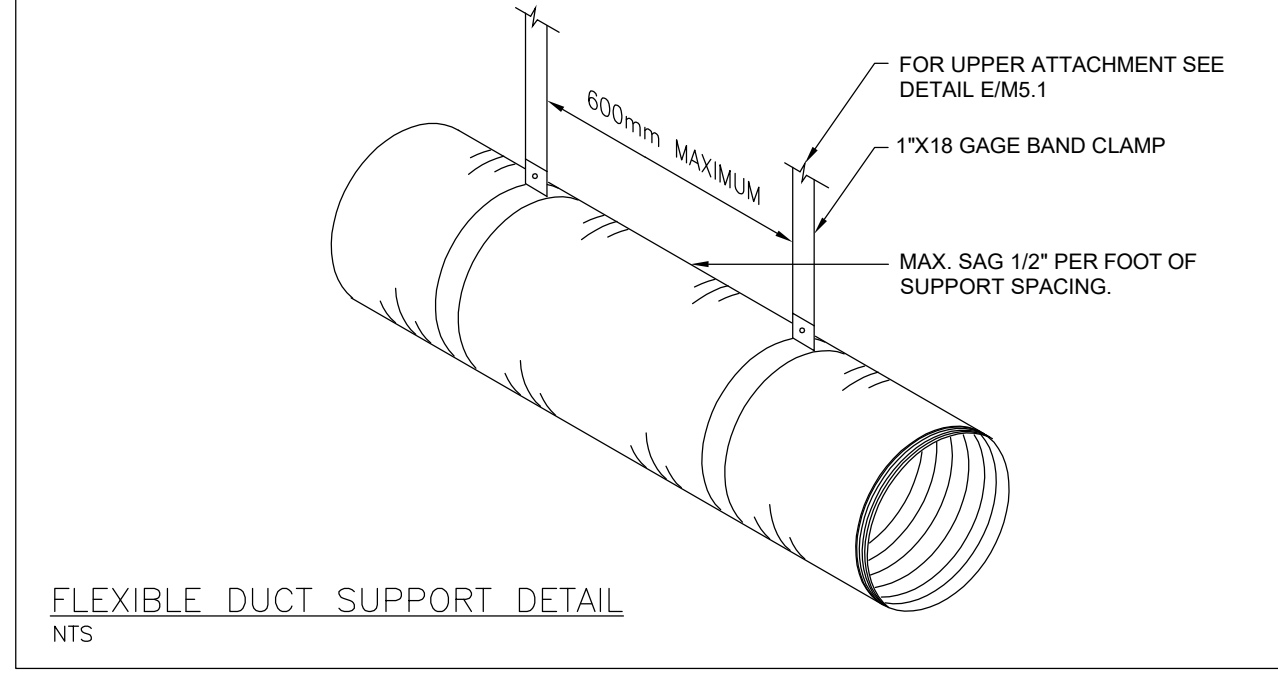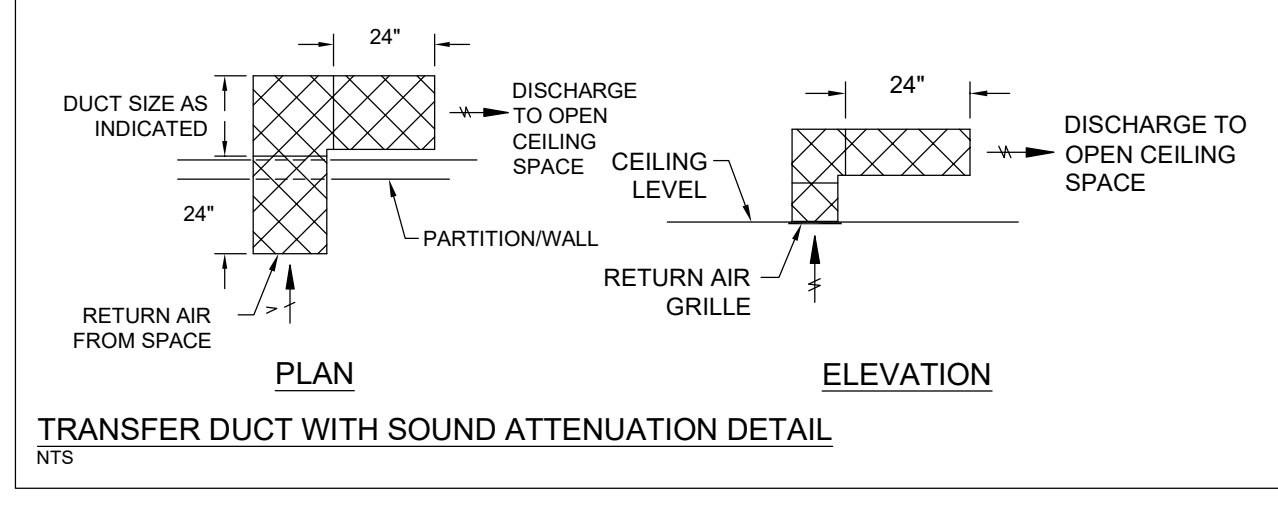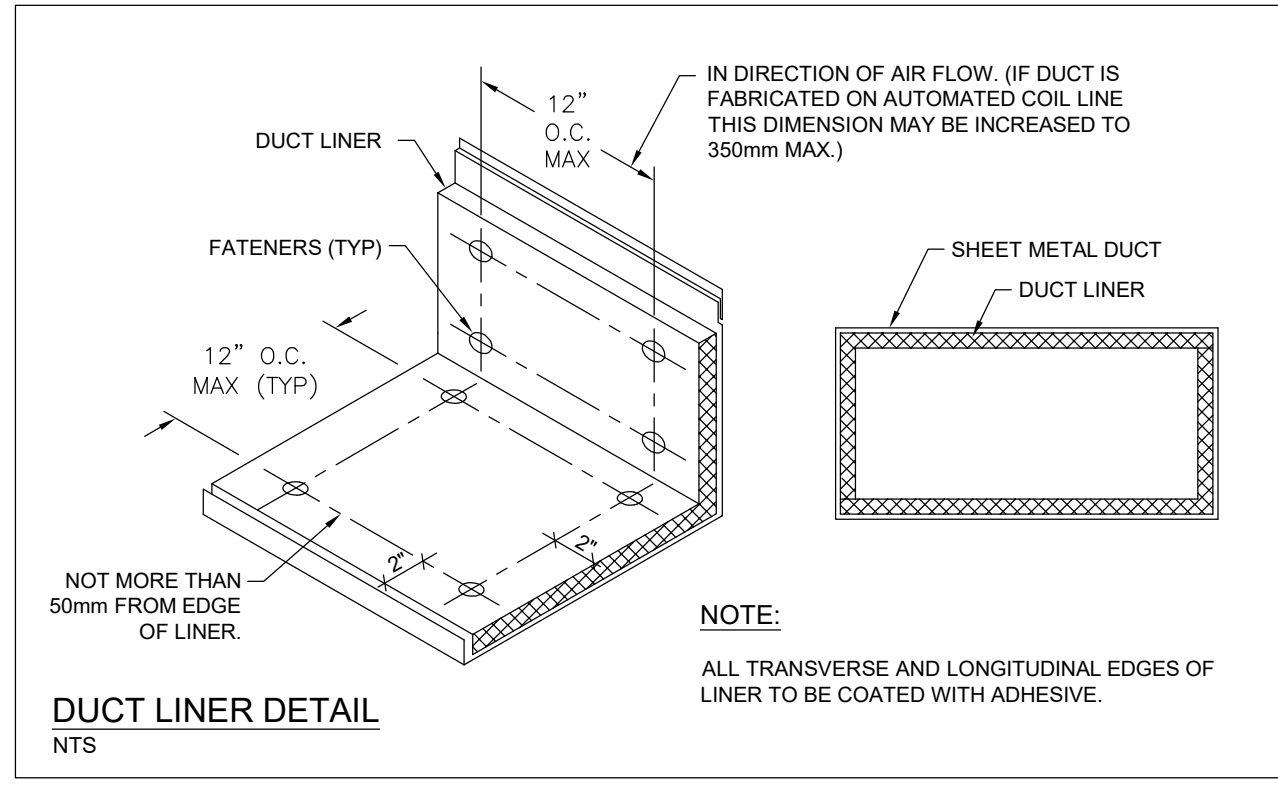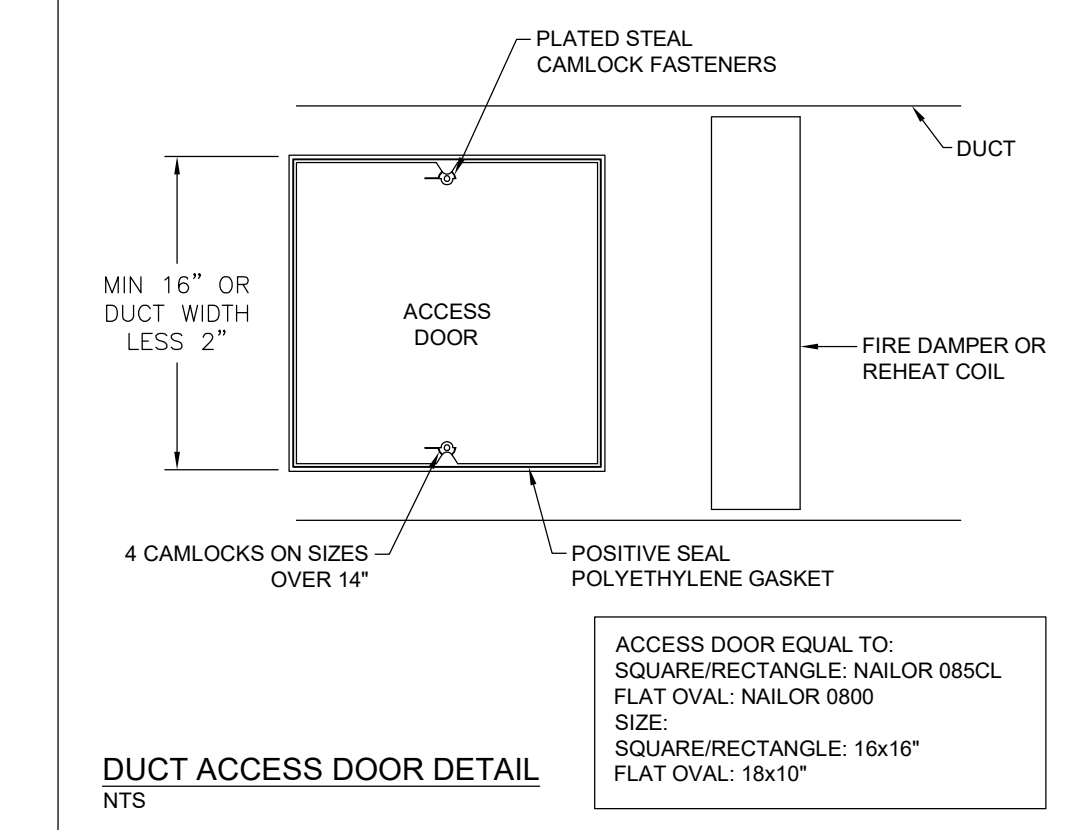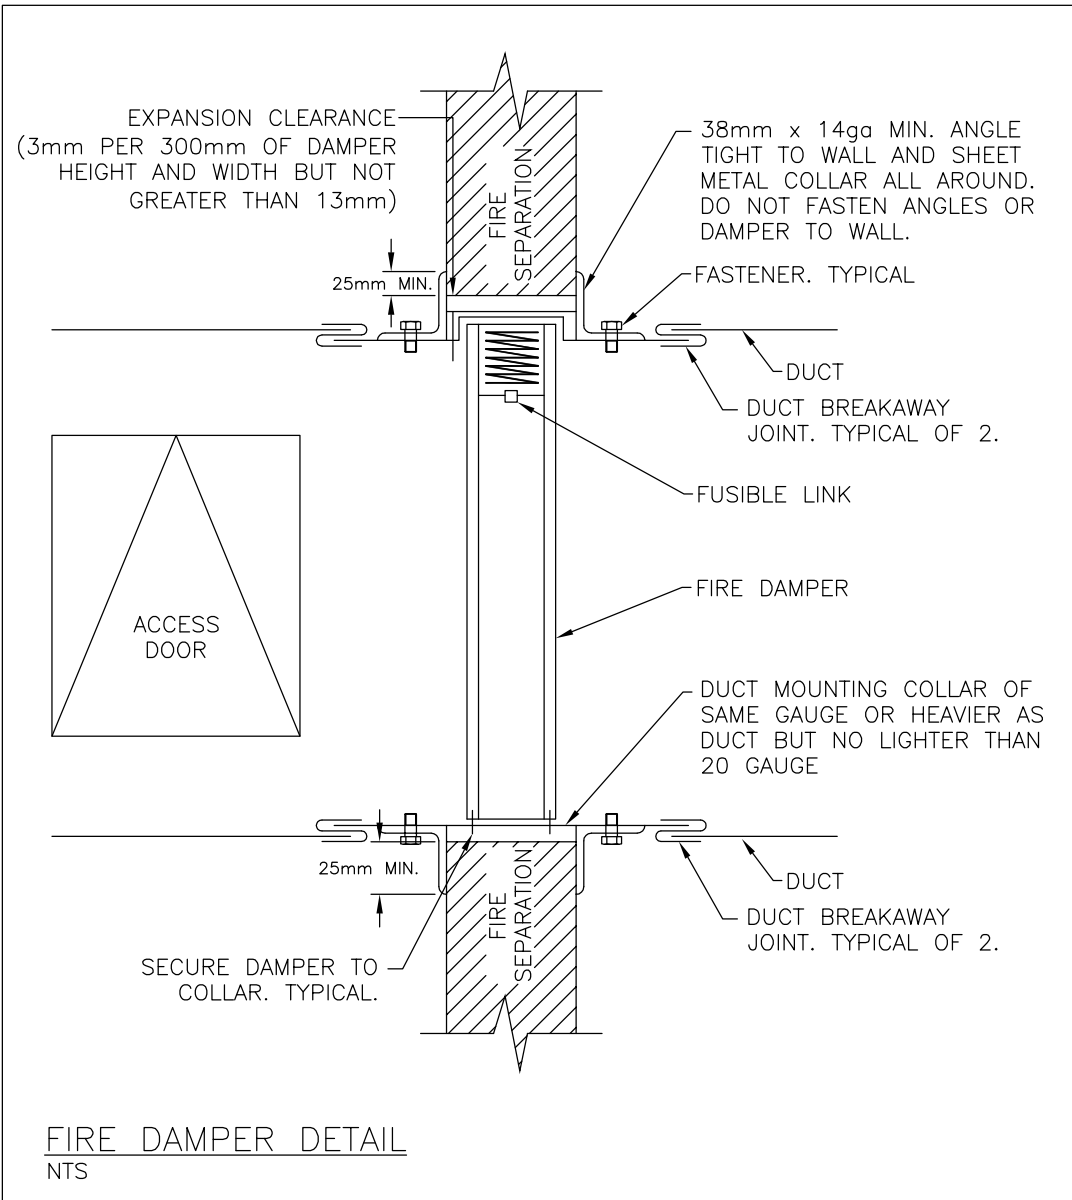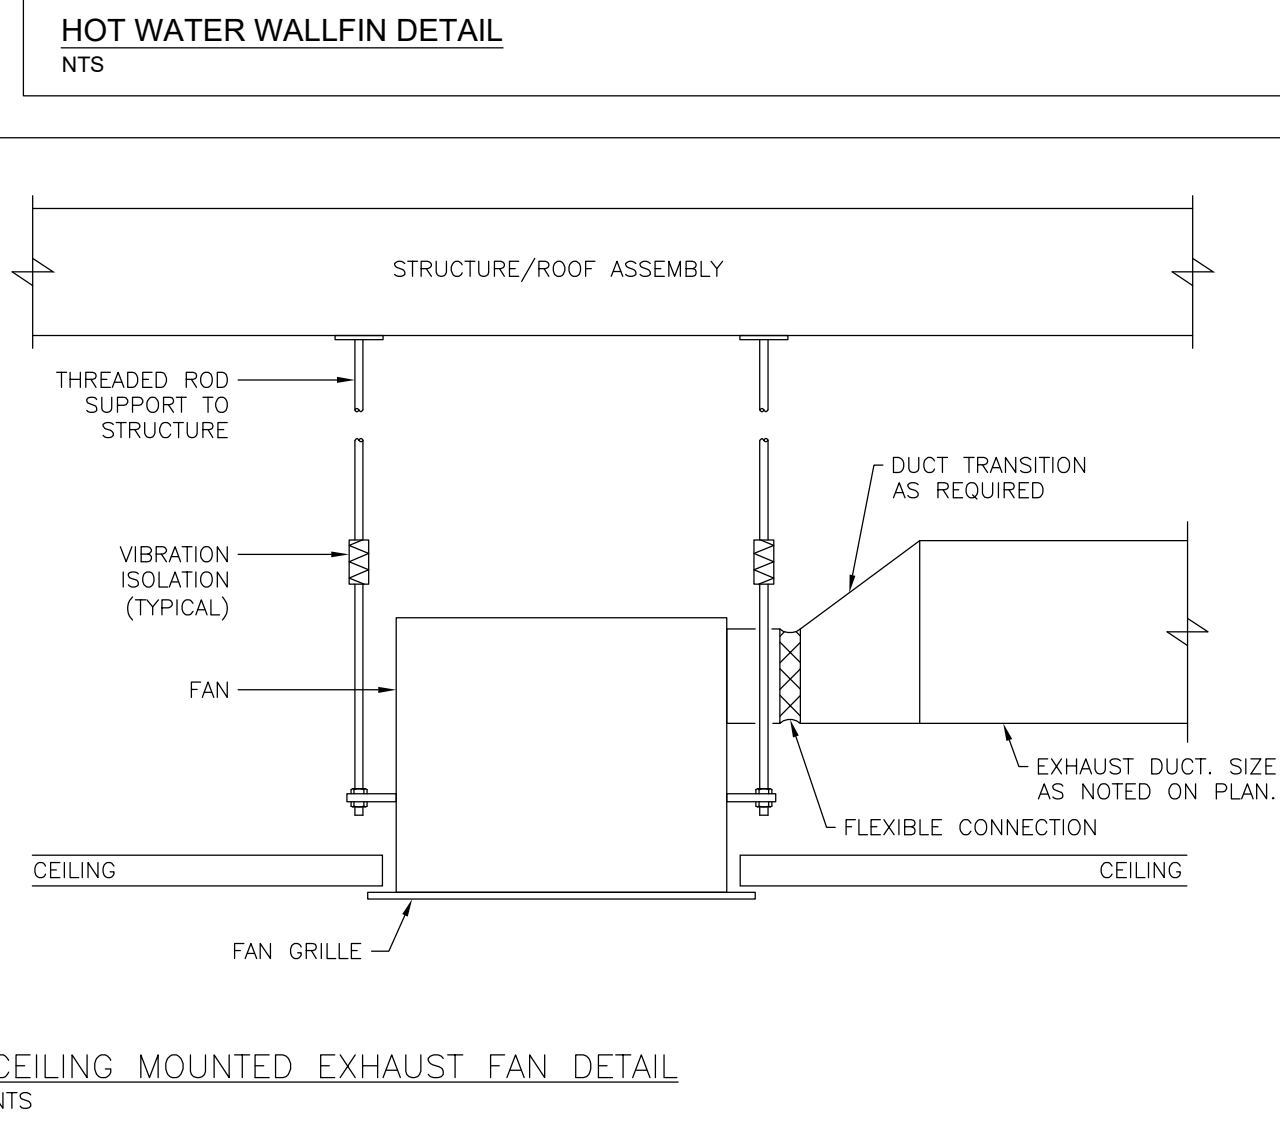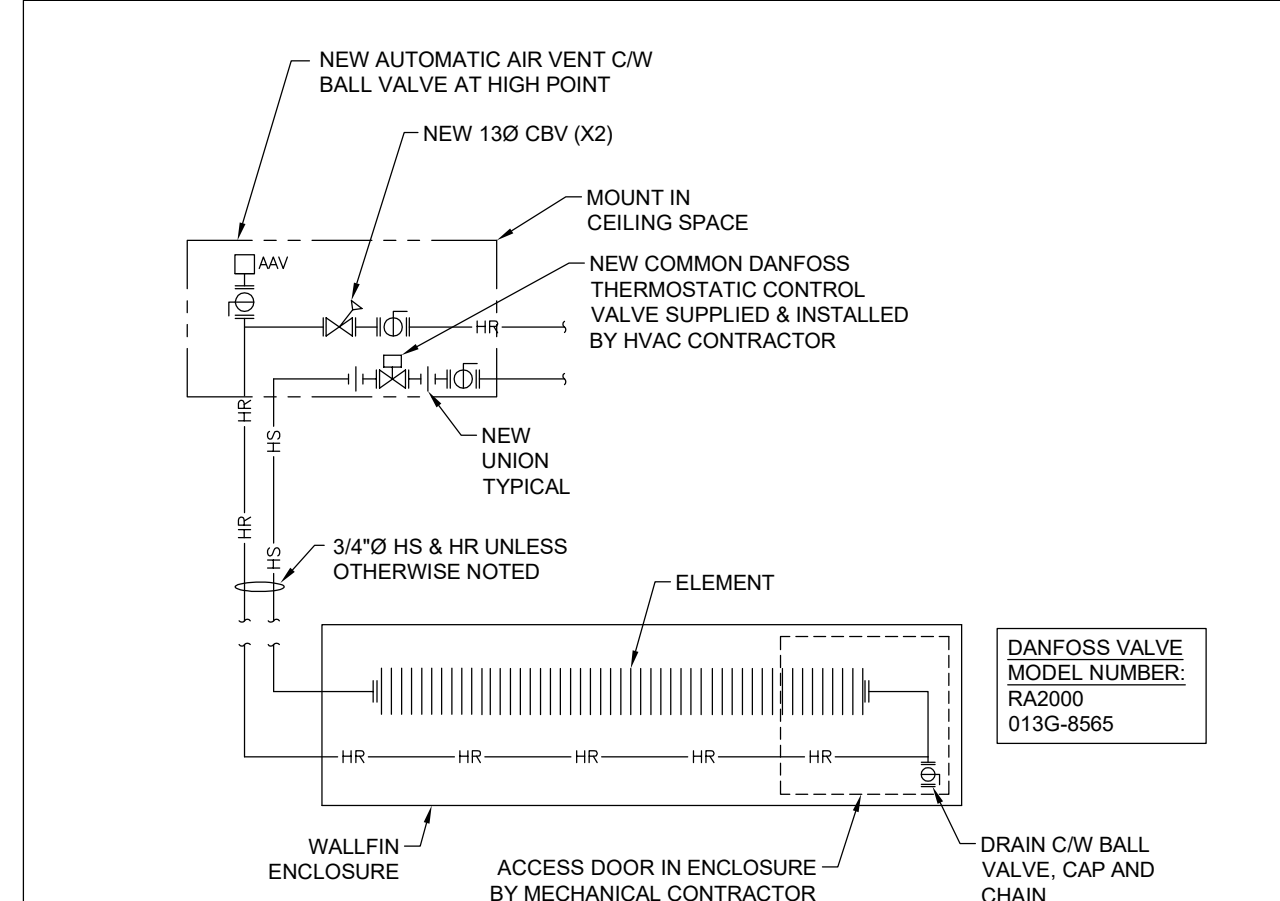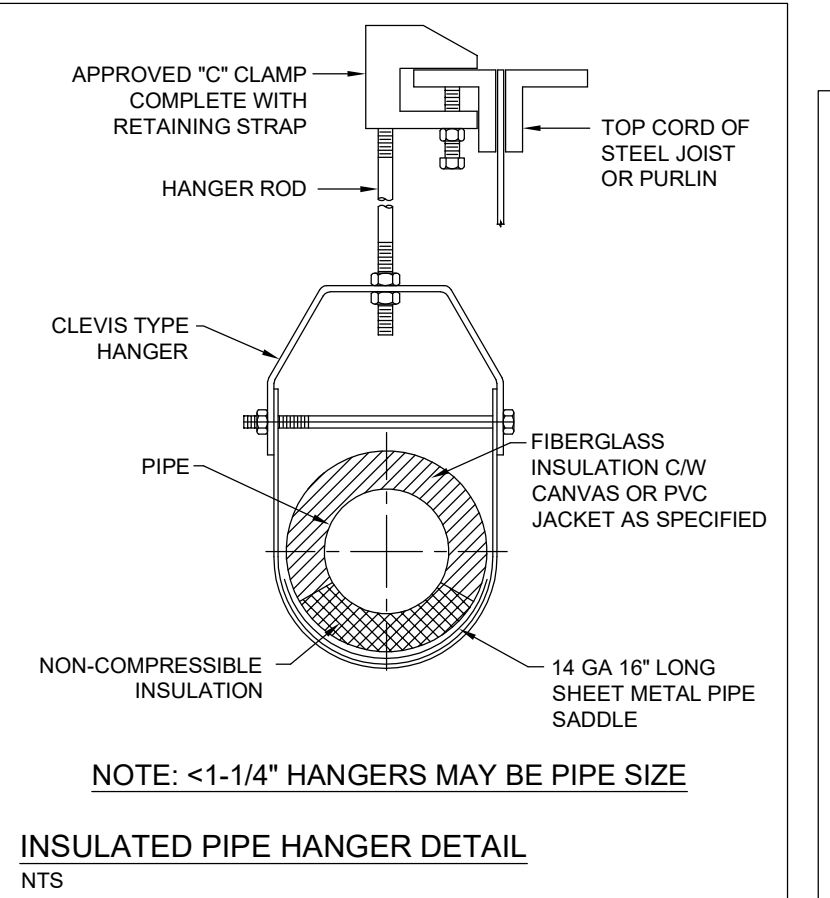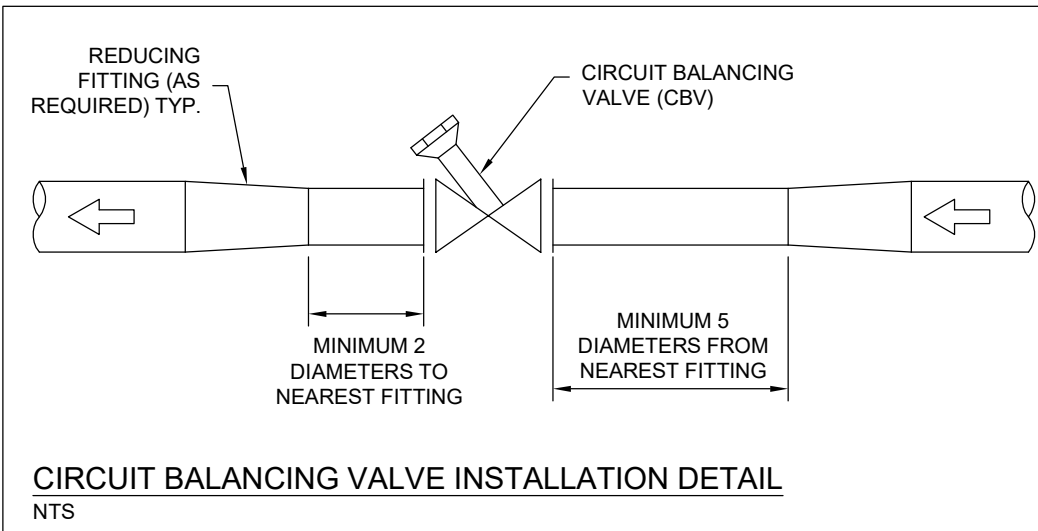

**DISCLAIMER:**  
 This drawing has been prepared for the use of CIMA+'s client and may not be used, reproduced or relied upon by third parties, except as agreed by CIMA+ and its client, as required by law or for use by governmental reviewing agencies. CIMA+ accepts no responsibility, and denies any liability whatsoever, to any party that modifies this drawing without CIMA+'s express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

No.	Date	Description	By
A	2026-02-23	ISSUED FOR PERMIT & TENDER	BRT



**CONSULTANT:**

**ENGINEER:**  
**CIMA+**  
 C2 Architecture Inc.  
 415 Baseline Road West  
 Bowmanville, ON L1C 5M2  
 ☎ 905.697.4464

**CLIENT:**  
**WILLIAM DUNBAR PS**  
 1030 Glenanna Rd, Pickering, ON  
 L1V 5E5

**PROJECT NAME:**  
**WILLIAM DUNBAR PS  
 ELEVATOR RENOVATION**

**SHEET TITLE:**  
**DETAILS**

MECHANICAL			
DRAWER:	SR	SCALE:	AS NOTED
DESIGNER:	BRT	DATE:	2026-02-23
APPROVER:	BRT	CHECKER:	BRT
PROJECT No:	A0001198	DRAWING No:	M-601
SHEET No:	10 of 10		