

PETERBOROUGH FIRE STATION #1 2026 RENOVATIONS



DRAWING LIST

- GENERAL**
 G-1, Flooring Demolition Layouts
 G-2, New Flooring Layouts
- MECHANICAL**
 M-1, HVAC Renovations, Roof Demolition Layout
 M-2, HVAC Renovations, Ground Floor Demolition Layout
 M-3, HVAC Renovations, New Roof Layout
 M-4, HVAC Renovations, New Ground Floor Layout
 M-5, HVAC Renovations, Ground, Second & Third Floors Air Distribution Layout
 M-6, Building Automation System, New Basement Layout
 M-7, Building Automation System, New Ground Floor Layout
 M-8, Building Automation System, New Second Floor Layout
 M-9, Building Automation System, New Third Floor Layout
 M-10, Building Automation System, New Roof Layout
 M-11, Building Automation System, Control Details & Notes

- STRUCTURAL**
 S1-01, Wall Opening Detail & General Notes
- BUILDING ENVELOPE**
 A-1, Roof Plan & Details

- ELECTRICAL**
 E-1, Mechanical Renovations, New Roof Electrical Layout
 E-2, Mechanical Renovations, New Ground Floor Electrical Layout

DESIGN TEAM



Drawn By: TSE Checked By: MF





No.	Revision/Issue	Date
0	Issued for Tender	Jan. 20 2026

Project:
 City of Peterborough
 Fire Station #1, 2026 Renovations
 210 Sherbrooke Street
 Peterborough, ON, K9J 2N3

Drawing Title:
Title Page

Project Number: TS25-0291
 Date: November 2025
 Scale: NTS
 Drawing Number: COVER

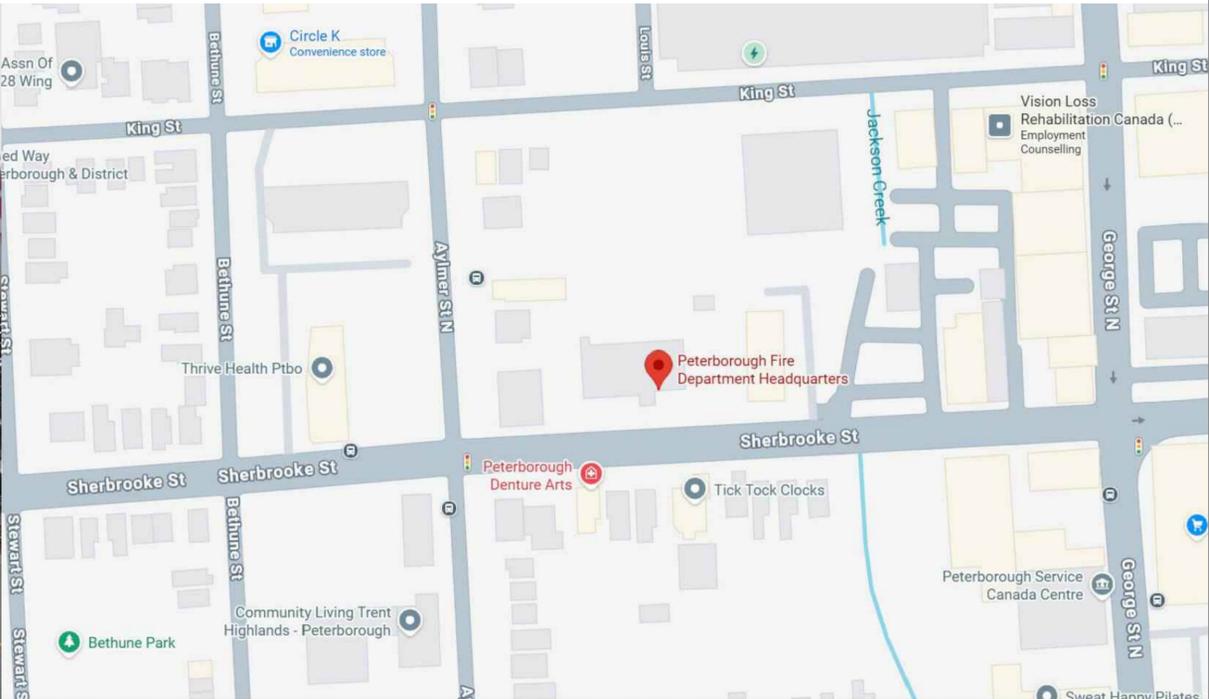

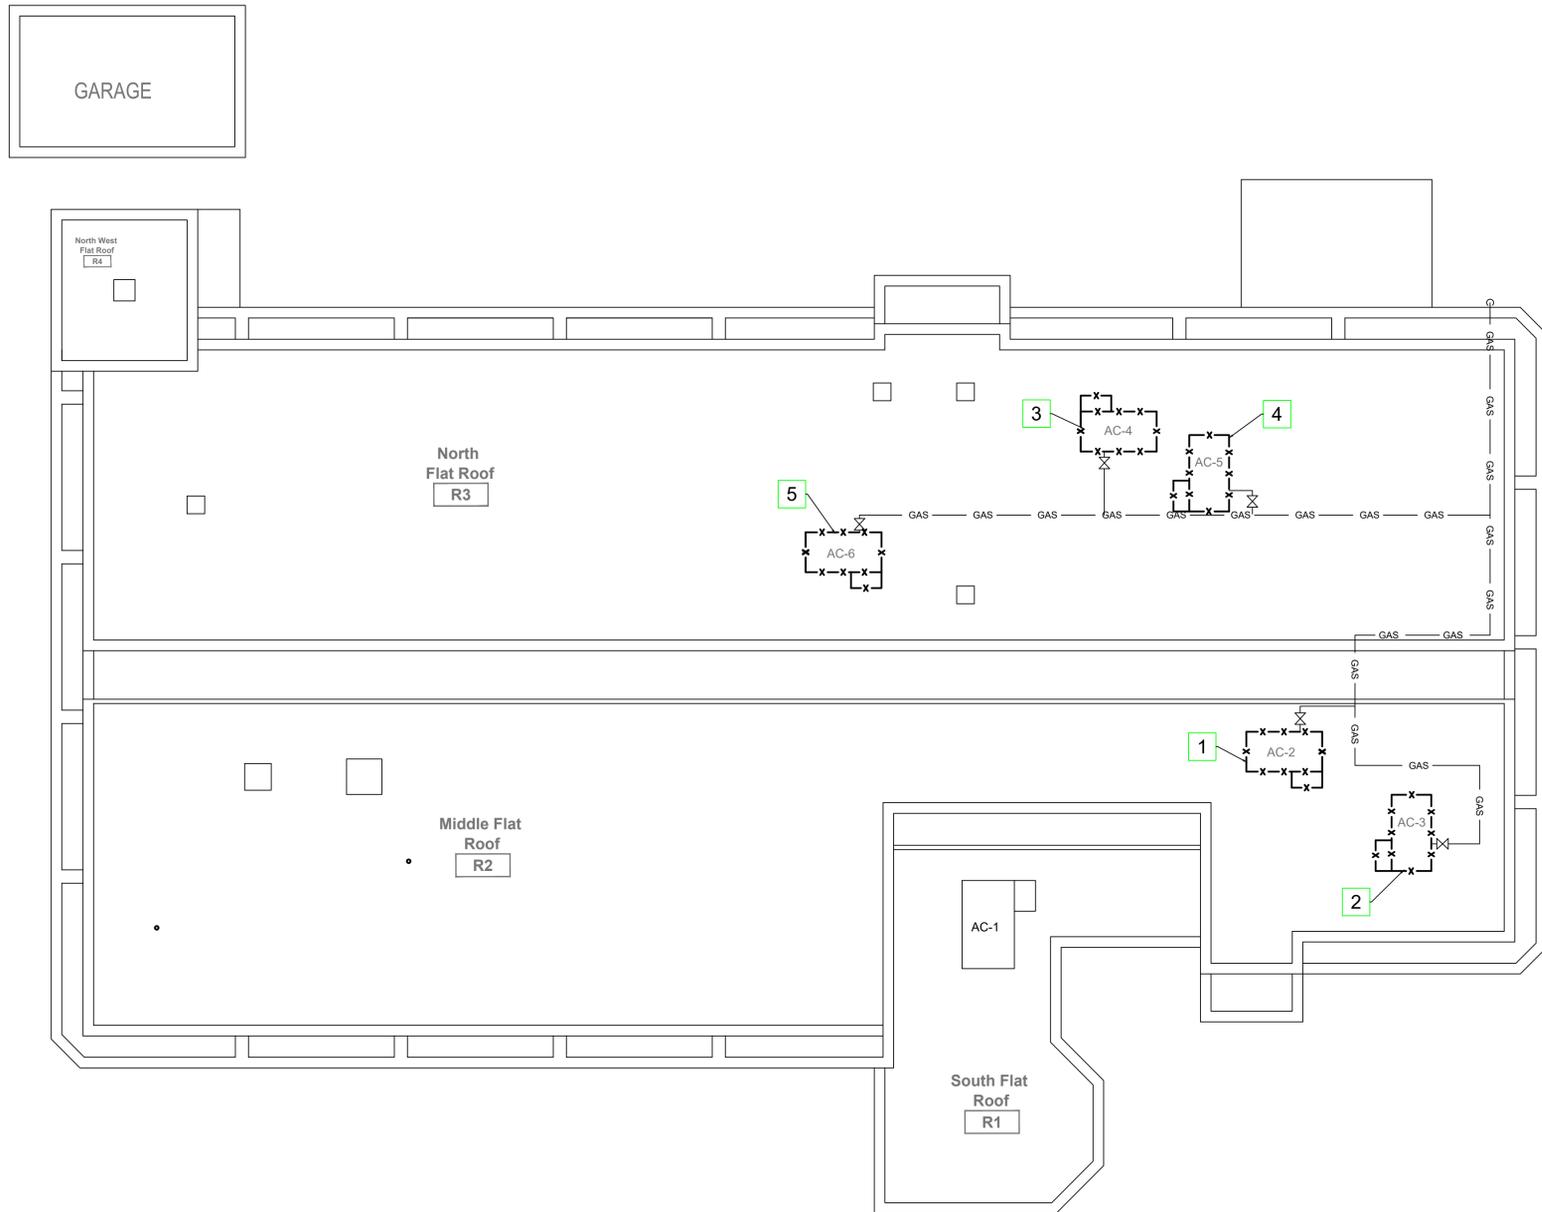

GENERAL NOTES


1. ALL WORK RELATED TO THE EQUIPMENT REPLACEMENTS MUST CONFORM TO APPLICABLE BUILDING CODES, FIRE CODES, AND OTHER RELEVANT REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING COMPLIANCE.
2. THE LAYOUT DRAWINGS ARE DIAGRAMMATIC AND SHOW THE GENERAL DESIGN INTENT, ARRANGEMENT, AND EXTENT OF SYSTEMS. THEY SHOULD NOT BE SCALED OR USED AS SHOP DRAWINGS. ANY ALTERNATIVE ROUTING, OFFSETS, OR TRANSITIONS REQUIRED FOR FIELD COORDINATION SHOULD BE ADDRESSED BY THE CONTRACTOR WITHOUT ADDITIONAL COSTS.
3. COORDINATION WITH OTHER TRADES: THE CONTRACTOR MUST CLOSELY COORDINATE NEW MECHANICAL WORK WITH EXISTING MECHANICAL, PLUMBING, ELECTRICAL, FIRE PROTECTION, ARCHITECTURAL, AND STRUCTURAL ELEMENTS. EXISTING SYSTEMS MAY NEED TO BE RELOCATED TO ACCOMMODATE NEW WORK.
4. ALL EQUIPMENT SHOULD BE INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY DIRECTED OTHERWISE. CONTRACTORS ARE RESPONSIBLE FOR ENSURING COMPLETE INSTALLATIONS IN ACCORDANCE WITH EQUIPMENT MANUFACTURER'S WRITTEN INSTRUCTIONS.

SCOPE LEGEND

1. **ROOFTOP UNIT AC-2**
 - LOCK OUT ROOFTOP UNIT BREAKER IN PANEL LP-D (40A, 3P BREAKER 9/11/13) LOCATED IN THIRD FLOOR KITCHEN.
 - PUMP OUT, STORE AND DISPOSE OF R22 REFRIGERANT ACCORDING TO PROVINCIAL REGULATIONS.
 - DISCONNECT EXISTING DUCTWORK AND NATURAL GAS PIPING.
 - REMOVE AND DISPOSE OF EXISTING AC-2 ROOFTOP UNIT
 - PROVIDE TEMPORARY WEATHERPROOF COVER OVER EXPOSED ROOF OPENINGS AS REQUIRED DURING ROOFTOP UNIT REPLACEMENT
2. **ROOFTOP UNIT AC-3**
 - LOCK OUT ROOFTOP UNIT BREAKER IN PANEL LP-B (30A, 3P BREAKER 19/21/23) LOCATED ON GROUND FLOOR OPPOSITE DUCT CHASE DOOR.
 - PUMP OUT, STORE AND DISPOSE OF R22 REFRIGERANT ACCORDING TO PROVINCIAL REGULATIONS.
 - DISCONNECT EXISTING DUCTWORK AND NATURAL GAS PIPING.
 - REMOVE AND DISPOSE OF EXISTING AC-3 ROOFTOP UNIT
 - PROVIDE TEMPORARY WEATHERPROOF COVER OVER EXPOSED ROOF OPENINGS AS REQUIRED DURING ROOFTOP REPLACEMENT
3. **ROOFTOP UNIT AC-4**
 - LOCK OUT ROOFTOP UNIT BREAKER IN PANEL LP-D (30A, 3P BREAKER 16/18/20) LOCATED IN THIRD FLOOR KITCHEN.
 - PUMP OUT, STORE AND DISPOSE OF REFRIGERANT ACCORDING TO PROVINCIAL REGULATIONS.
 - DISCONNECT EXISTING DUCTWORK AND NATURAL GAS PIPING.
 - REMOVE AND DISPOSE OF EXISTING AC-4 ROOFTOP UNIT
 - PROVIDE TEMPORARY WEATHERPROOF COVER OVER EXPOSED ROOF OPENINGS AS REQUIRED DURING ROOFTOP UNIT REPLACEMENT
4. **ROOFTOP UNIT AC-5**
 - LOCK OUT ROOFTOP UNIT BREAKER IN PANEL LP-D (40A, 3P BREAKER 31/33/35) LOCATED IN THIRD FLOOR KITCHEN.
 - PUMP OUT, STORE AND DISPOSE OF R22 REFRIGERANT ACCORDING TO PROVINCIAL REGULATIONS.
 - DISCONNECT EXISTING DUCTWORK AND NATURAL GAS PIPING.
 - REMOVE AND DISPOSE OF EXISTING AC-5 ROOFTOP UNIT
 - PROVIDE TEMPORARY WEATHERPROOF COVER OVER EXPOSED ROOF OPENINGS AS REQUIRED DURING ROOFTOP UNIT REPLACEMENT
5. **ROOFTOP UNIT AC-6**
 - LOCK OUT ROOFTOP UNIT BREAKER IN PANEL LP-D (50A, 3P BREAKER 36/38/40) LOCATED IN THIRD FLOOR KITCHEN.
 - PUMP OUT, STORE AND DISPOSE OF R22 REFRIGERANT ACCORDING TO PROVINCIAL REGULATIONS.
 - DISCONNECT EXISTING DUCTWORK AND NATURAL GAS PIPING.
 - REMOVE AND DISPOSE OF EXISTING AC-6 ROOFTOP UNIT
 - PROVIDE TEMPORARY WEATHERPROOF COVER OVER EXPOSED ROOF OPENINGS AS REQUIRED DURING ROOFTOP UNIT REPLACEMENT



Drawn By: TSE Checked By: MF

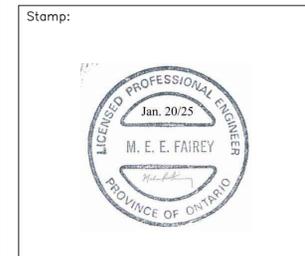



1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026
No.	Revision/Issue	Date

Project:
**City of Peterborough
 Fire Station #1, 2026 Renovations**
 210 Sherbrooke Street,
 Peterborough, ON, K9J 2N3

Drawing Title:
**HVAC Renovations
 Roof Demolition Layout**

Project Number: TS25-0291
 Date: September 2025
 Scale: 1/8" = 1 ft
 Drawing Number: M-1



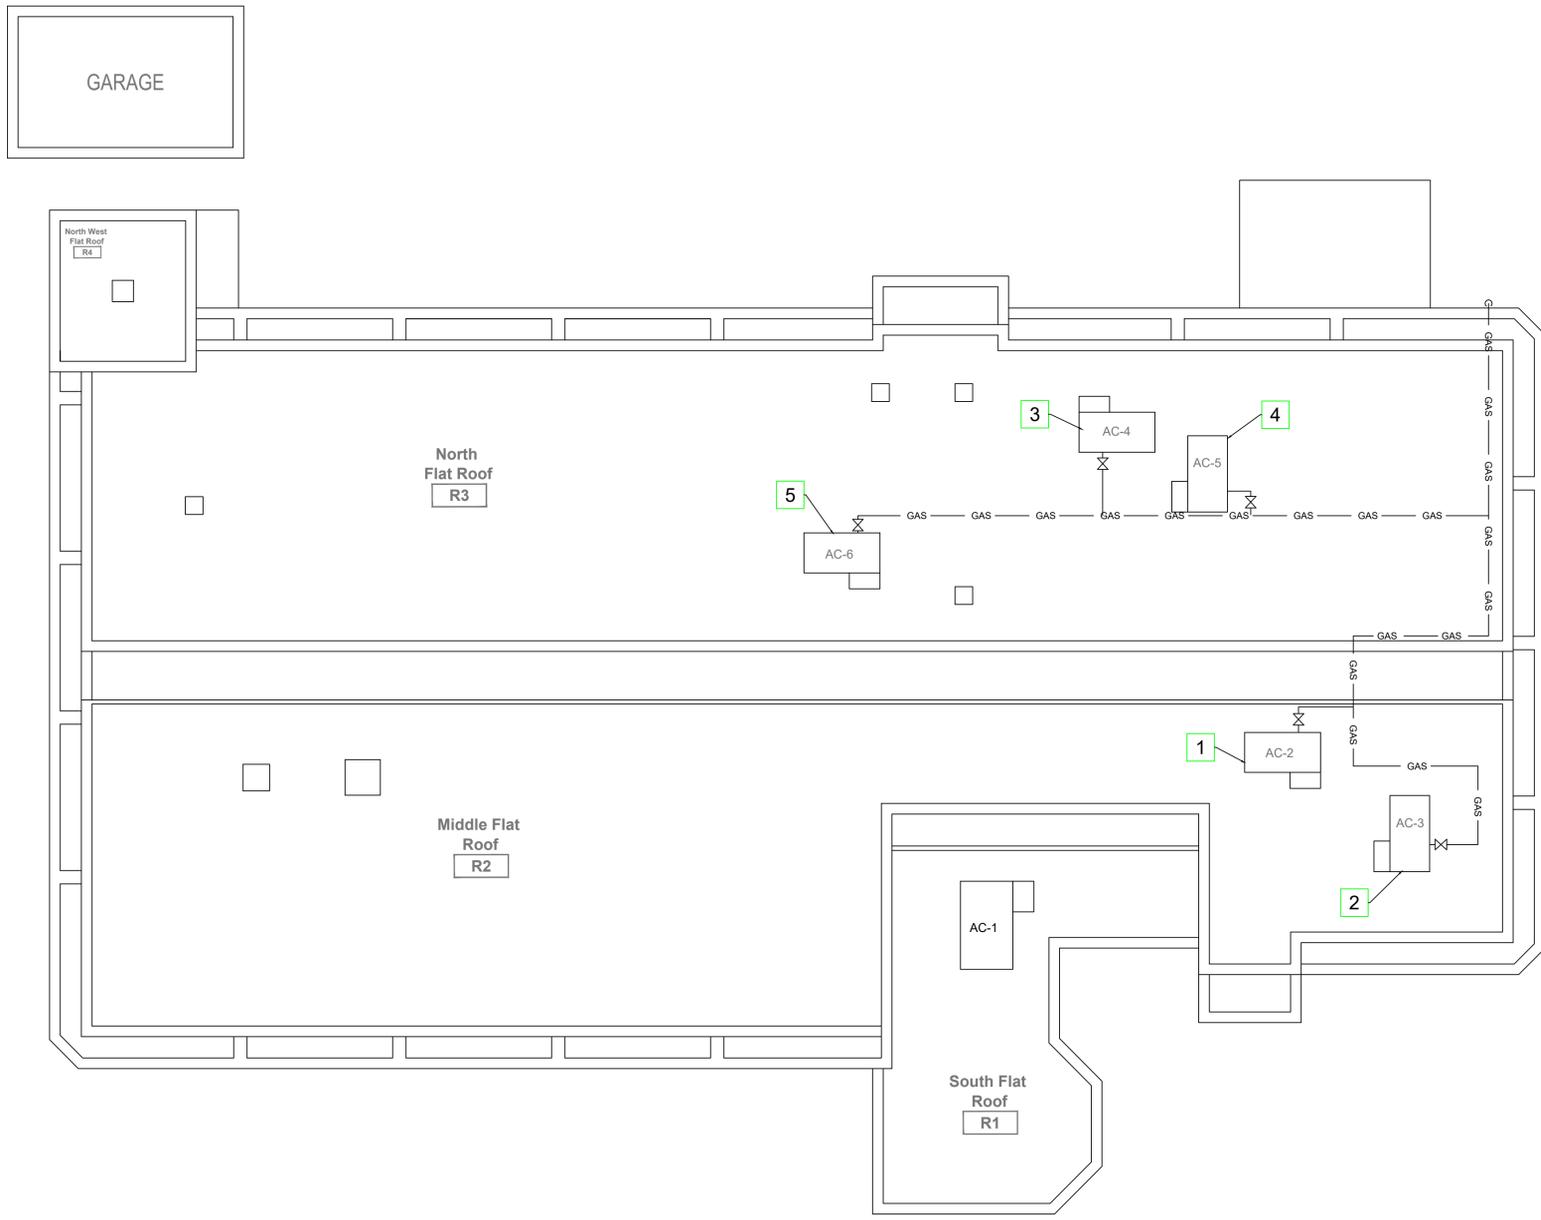

SCOPE LEGEND

- 1** NEW ROOFTOP UNIT AC-2
 - SUPPLY AND INSTALL NEW ROOFTOP UNIT AC-2 AS SCHEDULED.
 - FURNISH AND INSTALL NEW CURB ADAPTER ON EXISTING CURB.
 - PROVIDE NEW PERIMETER CURB GASKETS. INSTALL NEW RTU ON CURB ADAPTER.
 - CONNECT TO EXISTING DUCTS & PROVIDE NEW DUCT TRANSITIONS AS REQUIRED.
 - RECONNECT EXISTING GAS LINE. PROVIDE DRIP LEG & UNION AT UNIT CONNECTION AS REQUIRED. CLAMP ALL NEW PIPING TO NEW MOLDED PLASTIC PIPE SUPPORTS WITH STYROFOAM UNDERLAY AND PAINT ALL NEW PIPING WITH 2 COATS OF SAFETY YELLOW PAINT.
 - INSTALL NEW CONDENSATE DRAIN
 - COMMISSIONING AND AIR BALANCING
- 2** NEW ROOFTOP UNIT AC-3
 - SUPPLY AND INSTALL NEW ROOFTOP UNIT AC-3 AS SCHEDULED.
 - FURNISH AND INSTALL NEW CURB ADAPTER ON EXISTING CURB.
 - PROVIDE NEW PERIMETER CURB GASKETS. INSTALL NEW RTU ON CURB ADAPTER.
 - CONNECT TO EXISTING DUCTS & PROVIDE NEW DUCT TRANSITIONS AS REQUIRED.
 - RECONNECT EXISTING GAS LINE. PROVIDE DRIP LEG & UNION AT UNIT CONNECTION AS REQUIRED. CLAMP ALL NEW PIPING TO NEW MOLDED PLASTIC PIPE SUPPORTS WITH STYROFOAM UNDERLAY AND PAINT ALL NEW PIPING WITH 2 COATS OF SAFETY YELLOW PAINT.
 - INSTALL NEW CONDENSATE DRAIN
 - COMMISSIONING AND AIR BALANCING
- 3** NEW ROOFTOP UNIT AC-4
 - SUPPLY AND INSTALL NEW ROOFTOP UNIT AC-4 AS SCHEDULED.
 - FURNISH AND INSTALL NEW CURB ADAPTER ON EXISTING CURB.
 - PROVIDE NEW PERIMETER CURB GASKETS. INSTALL NEW RTU ON CURB ADAPTER.
 - CONNECT TO EXISTING DUCTS & PROVIDE NEW DUCT TRANSITIONS AS REQUIRED.
 - RECONNECT EXISTING GAS LINE. PROVIDE DRIP LEG & UNION AT UNIT CONNECTION AS REQUIRED. CLAMP ALL NEW PIPING TO NEW MOLDED PLASTIC PIPE SUPPORTS WITH STYROFOAM UNDERLAY AND PAINT ALL NEW PIPING WITH 2 COATS OF SAFETY YELLOW PAINT.
 - INSTALL NEW CONDENSATE DRAIN
 - COMMISSIONING AND AIR BALANCING
- 4** NEW ROOFTOP UNIT AC-5
 - SUPPLY AND INSTALL NEW CONDENSING UNIT AC-5 AS SCHEDULED.
 - FURNISH AND INSTALL NEW CURB ADAPTER ON EXISTING CURB.
 - PROVIDE NEW PERIMETER CURB GASKETS. INSTALL NEW RTU ON CURB ADAPTER.
 - CONNECT TO EXISTING DUCTS & PROVIDE NEW DUCT TRANSITIONS AS REQUIRED.
 - RECONNECT EXISTING GAS LINE. PROVIDE DRIP LEG & UNION AT UNIT CONNECTION AS REQUIRED. CLAMP ALL NEW PIPING TO NEW MOLDED PLASTIC PIPE SUPPORTS WITH STYROFOAM UNDERLAY AND PAINT ALL NEW PIPING WITH 2 COATS OF SAFETY YELLOW PAINT.
 - INSTALL NEW CONDENSATE DRAIN
 - COMMISSIONING AND AIR BALANCING
- 5** NEW ROOFTOP UNIT AC-6
 - SUPPLY AND INSTALL NEW CONDENSING UNIT AC-6 AS SCHEDULED.
 - FURNISH AND INSTALL NEW CURB ADAPTER ON EXISTING CURB.
 - PROVIDE NEW PERIMETER CURB GASKETS. INSTALL NEW RTU ON CURB ADAPTER.
 - CONNECT TO EXISTING DUCTS & PROVIDE NEW DUCT TRANSITIONS AS REQUIRED.
 - RECONNECT EXISTING GAS LINE. PROVIDE DRIP LEG & UNION AT UNIT CONNECTION AS REQUIRED. CLAMP ALL NEW PIPING TO NEW MOLDED PLASTIC PIPE SUPPORTS WITH STYROFOAM UNDERLAY AND PAINT ALL NEW PIPING WITH 2 COATS OF SAFETY YELLOW PAINT.
 - INSTALL NEW CONDENSATE DRAIN
 - COMMISSIONING AND AIR BALANCING

GENERAL NOTES


1. ALL WORK RELATED TO THE EQUIPMENT REPLACEMENTS MUST CONFORM TO APPLICABLE BUILDING CODES, FIRE CODES, AND OTHER RELEVANT REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING COMPLIANCE.
2. THE LAYOUT DRAWINGS ARE DIAGRAMMATIC AND SHOW THE GENERAL DESIGN INTENT, ARRANGEMENT, AND EXTENT OF SYSTEMS. THEY SHOULD NOT BE SCALED OR USED AS SHOP DRAWINGS. ANY ALTERNATIVE ROUTING, OFFSETS, OR TRANSITIONS REQUIRED FOR FIELD COORDINATION SHOULD BE ADDRESSED BY THE CONTRACTOR WITHOUT ADDITIONAL COSTS.
3. COORDINATION WITH OTHER TRADES: THE CONTRACTOR MUST CLOSELY COORDINATE NEW MECHANICAL WORK WITH EXISTING MECHANICAL, PLUMBING, ELECTRICAL, FIRE PROTECTION, ARCHITECTURAL, AND STRUCTURAL ELEMENTS. EXISTING SYSTEMS MAY NEED TO BE RELOCATED TO ACCOMMODATE NEW WORK.
4. ALL EQUIPMENT SHOULD BE INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY DIRECTED OTHERWISE. CONTRACTORS ARE RESPONSIBLE FOR ENSURING COMPLETE INSTALLATIONS IN ACCORDANCE WITH EQUIPMENT MANUFACTURER'S WRITTEN INSTRUCTIONS.

NEW ROOFTOP UNIT SCHEDULE

Tag	Serving	Make & Model	Size	Weight	Air Flow	ESP	Cooling	Heating	Voltage	MCA	MOCP	Accessories
AC-2 Rooftop Unit	Lobby 102, Office 103, Office 109, Office 111, Office 112, Office 113, Office 114, Kitchen 117, Office 119, Office 120, Office 122, Office 123A, Office 123B	Lennox LGX07255T	83.25' x 47.00' x 36.38"	707 lbs + 250 lbs curb adapter	2400 cfm 240 cfm O/A	.9" wg	75.6 mbh total 61.2 mbh sensible single stage	150 mbh input 120 mbh output two stage	3/60/208V	34 A	50 A	2HP constant air volume process fan Factory installed economizer package Barometric relief damper Filter section for 2" MERV filters Single stage R454 cooling Two stage gas heat On board refrigerant leak detection and alarming Main disconnect switch Field installed smoke sensor
AC-3 Rooftop Unit	Training Room 201, Board Room 202, Kitchen 211	Lennox LGX03655D	83.25' x 47.00' x 36.38"	624 lbs + 250 lbs curb adapter	1200 cfm 120 cfm O/A	.6" wg	39.4 mbh total 30.8 mbh sensible single stage	106 mbh input 87 mbh output two stage	3/60/208V	17 A	25 A	.5HP constant air volume process fan Factory installed economizer package Barometric relief damper Filter section for 2" MERV filters Single stage R454 cooling Two stage gas heat On board refrigerant leak detection and alarming Main disconnect switch
AC-4 Rooftop Unit	Emergency Operations Centre 203, Emergency Management 208, Female WR 211	Lennox LGX03655D	83.25' x 47.00' x 36.38"	624 lbs + 250 lbs curb adapter	1200 cfm 120 cfm O/A	.8" wg	39.4 mbh total 30.8 mbh sensible single stage	108 mbh input 87 mbh output two stage	3/60/208V	17 A	25 A	.5HP constant air volume process fan Factory installed economizer package Barometric relief damper Filter section for 2" MERV filters Single stage R454 cooling Two stage gas heat On board refrigerant leak detection and alarming Main disconnect switch
AC-5 Rooftop Unit	Corridor C01, Kitchen 303, Male WR 311, Gymnasium 320	Lennox LGX04855E	83.25' x 47.00' x 36.38"	635 lbs + 250 lbs curb adapter	1600 cfm 160 cfm O/A	.6" wg	50.3 mbh total 37.2 mbh sensible single stage	150 mbh input 120 mbh output two stage	3/60/208V	25 A	35 A	1HP constant air volume process fan Factory installed economizer package Barometric relief damper Filter section for 2" MERV filters Single stage R454 cooling Two stage gas heat On board refrigerant leak detection and alarming Main disconnect switch
AC-6 Rooftop Unit	Bedroom 310, Bedroom 312, Bedroom 316, Bedroom 317, Bedroom 318, Bedroom 314, Bedroom 315, Bedroom 316, Gymnasium 320	Lennox LGX06055B	83.25' x 47.00' x 36.38"	635 lbs + 250 lbs curb adapter	2000 cfm 200 cfm O/A	.8" wg	61.4 mbh total 46.3 mbh sensible single stage	150 mbh input 120 mbh output two stage	3/60/208V	30 A	45 A	2HP constant air volume process fan Manufacturer's field installed economizer package Barometric relief damper Filter section for 2" MERV filters Single stage R454 cooling Two stage gas heat On board refrigerant leak detection and alarming Main disconnect switch Field installed smoke sensor



Drawn By: TSE Checked By: MF

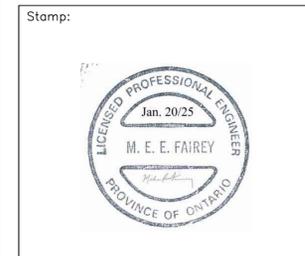

No.	Revision/Issue	Date
1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026


No.	Revision/Issue	Date

Project:
**City of Peterborough
 Fire Station #1, 2026 Renovations
 210 Sherbrooke Street,
 Peterborough, ON, K9J 2N3**

Drawing Title:
**HVAC Renovations
 New Roof Layout**

Project Number: **TS25-0291**
 Date: **September 2025**
 Scale: **1/8" = 1 ft**
 Drawing Number: **M-3**



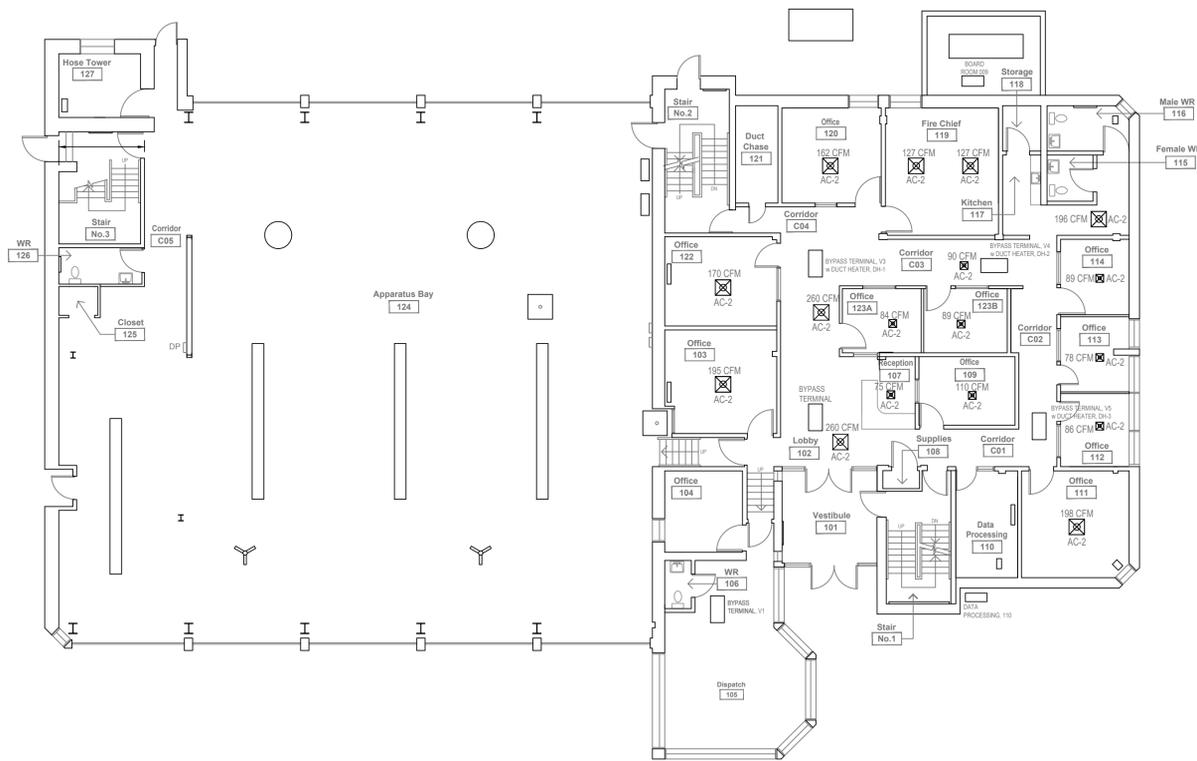

EXISTING AIR DISTRIBUTION LAYOUT - GROUND FLOOR


TESTING & BALANCING SCHEDULE

Tag	Location	Serving	Supply Air Diffusers	Bypass Terminals	Slot Diffusers	Drilled Duct
AC-2	Roof	Lobby 102, Office 103, Reception 107, Office 109, Office 111, Office 112, Office 113, Office 114, Kitchen 117, Office 118, Office 120, Office 122, Office 123A, Office 123B	Seventeen (17)	Four (4)	0 (existing are not connected)	0
AC-3	Roof	Training Room 201, Board Room 202, Kitchen 211	Seven (7)	One (1)	0	0
AC-4	Roof	Emergency Operations Centre 203, Emergency Management 208, Female WR 211	Six (6)	One (1)	0	0
AC-5	Roof	Corridor C01, Kitchen 303, Male WR 311, Gymnasium 320	Eight (8)	0	0	One (1)
AC-6	Roof	Bedroom 310, Bedroom 312, Bedroom 316, Bedroom 317, Bedroom 318, Bedroom 314, Bedroom 315, Bedroom 318, Gymnasium 320	Twelve (12)	One (1)	0	One (1)


TESTING & BALANCING NOTE
 Where available, existing air distribution system drawings with terminal locations & design flow rates will be available to the successful contractor. These drawings and the summary above may not reflect system modifications made after commissioning and their content must be verified onsite. Work to include testing & balancing of all equipment & terminals scheduled. Allow for cooperation with BAS contractor to operate equipment while performing work. Air flows shown on floor plans are approximate and have been taken from the existing drawings or estimated where the system has been renovated and the sum of the air flows may not exactly match rooftop unit air flow.



Drawn By: TSE Checked By: MF

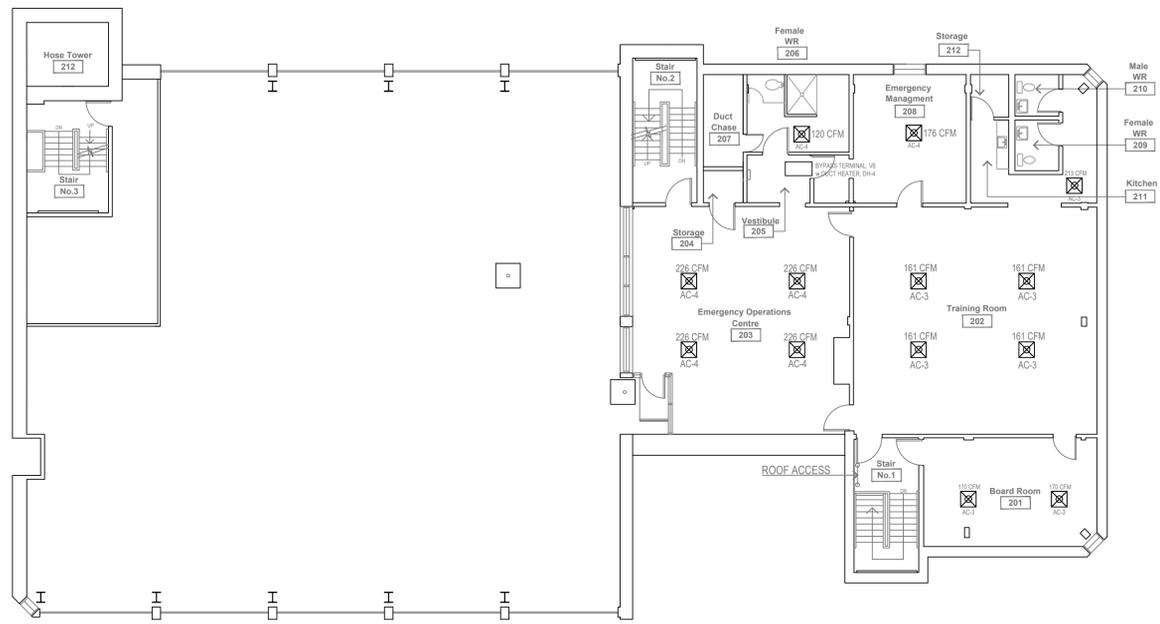

EXISTING AIR DISTRIBUTION LAYOUT - SECOND FLOOR

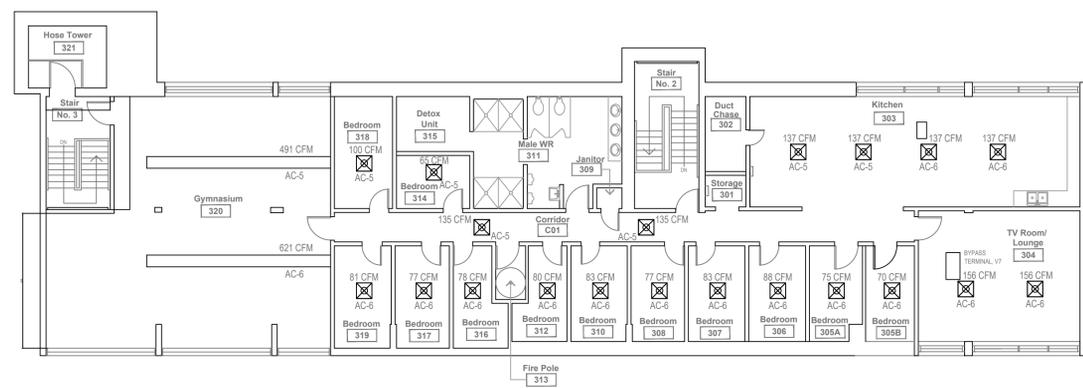


EXISTING AIR DISTRIBUTION LAYOUT - THIRD FLOOR

No.	Revision/Issue	Date
1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026

Project:
City of Peterborough
Fire Station #1, 2026 Renovations
210 Sherbrooke Street,
Peterborough, ON, K9J 2N3

Drawing Title:
HVAC Renovations
Ground, Second and Third
Floor Air Distribution Layout

Project Number: TS25-0291
 Date: September 2025
 Scale: NTS
 Drawing Number: M-5





Drawn By: TSE Checked By: MF





1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026
No.	Revision/Issue	Date

Project:
**City of Peterborough
 Fire Station #1, 2026 Renovations**
 210 Sherbrooke Street
 Peterborough, ON, K9J 2N3

Drawing Title:
**Building Automation System
 New Basement Layout**

Project Number: TS25-0291
 Date: September 2025
 Scale: 1/8" = 1 ft
 Drawing Number: M-6

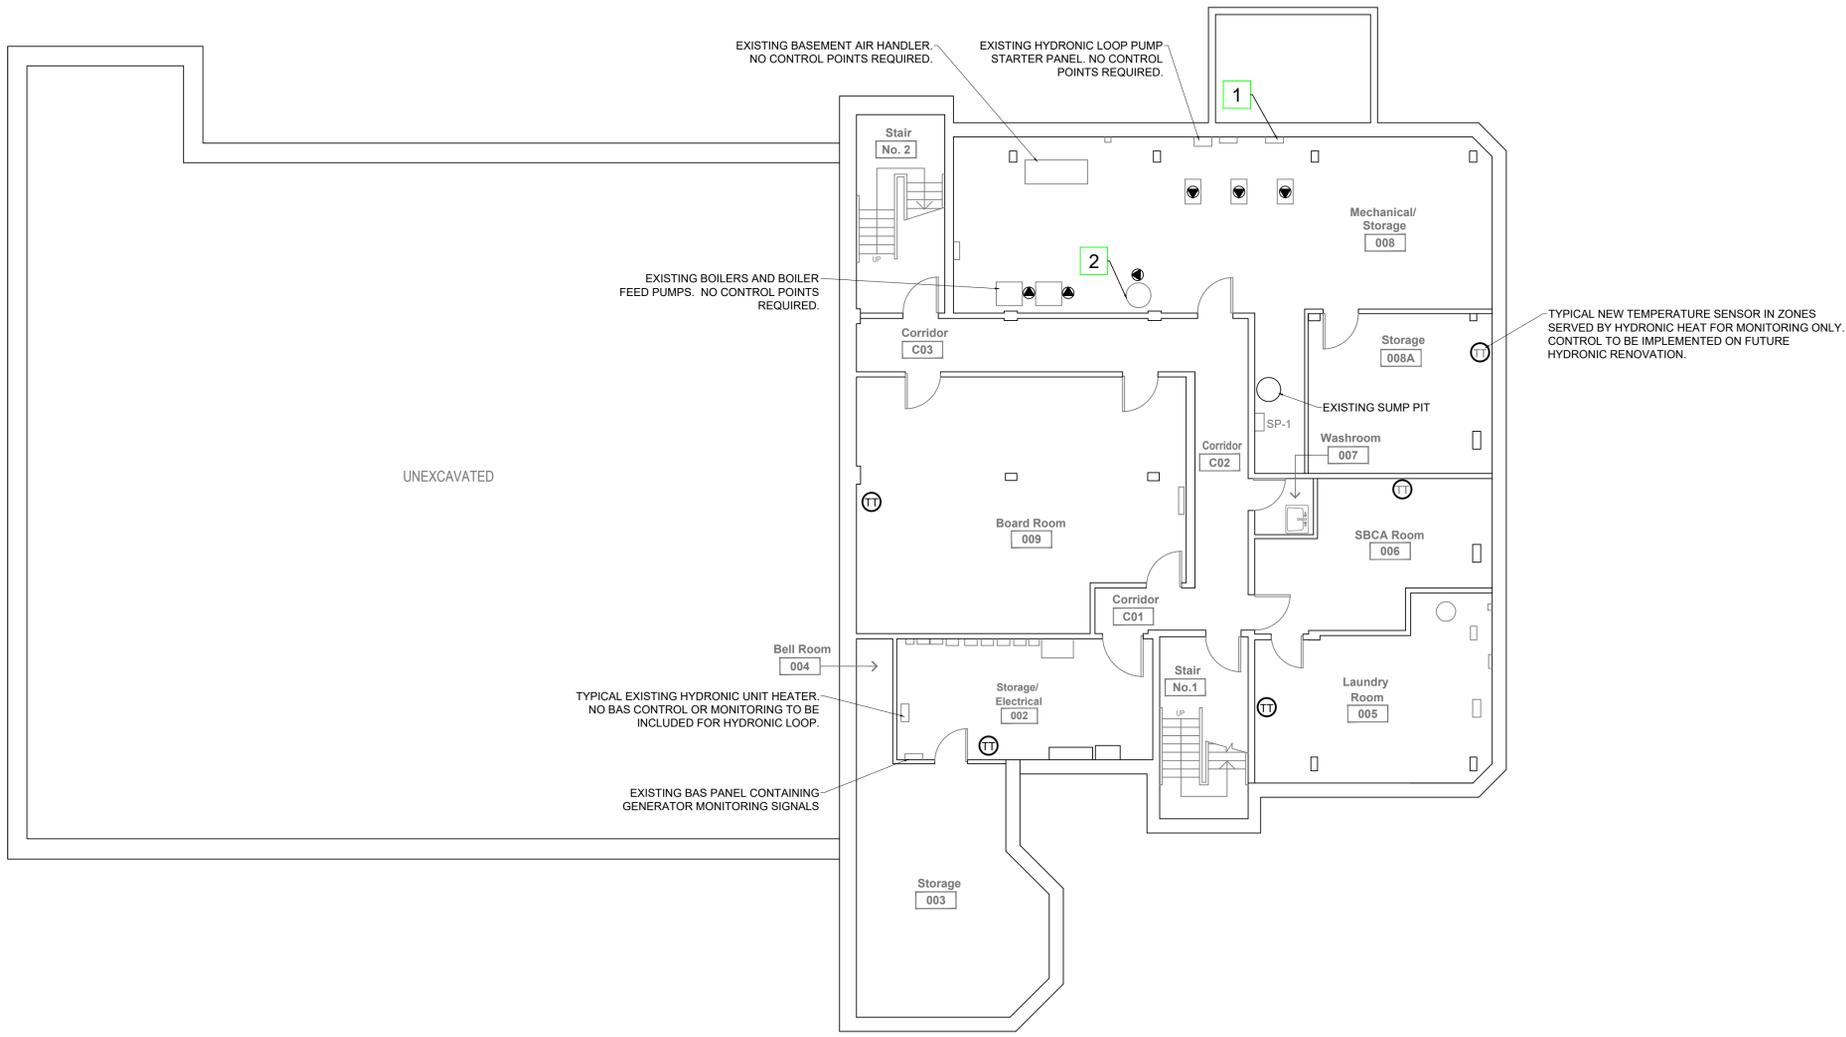


SCOPE LEGEND

- 1** NEW BAS PANEL
 - FURNISH AND INSTALL NEW BAS PANEL FOR BASEMENT INPUTS AND OUTPUTS. WALL MOUNT IN LOCATION SHOWN.
 - FURNISH AND INSTALL NEW BREAKER IN NEAREST AVAILABLE DISTRIBUTION PANEL. PROVIDE NEW CONDUIT AND CONDUCTORS TO NEW BAS PANEL.
- 2** DOMESTIC HOT WATER TANK, DWH-1
 - FURNISH AND INSTALL NEW MONITORING POINTS FOR THE DOMESTIC HOT WATER HEATER AND RECIRCULATION PUMP

GENERAL NOTES

1. ALL WORK RELATED TO THE EQUIPMENT REPLACEMENTS MUST CONFORM TO APPLICABLE BUILDING CODES, FIRE CODES, AND OTHER RELEVANT REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING COMPLIANCE.
2. THE LAYOUT DRAWINGS ARE DIAGRAMMATIC AND SHOW THE GENERAL DESIGN INTENT, ARRANGEMENT, AND EXTENT OF SYSTEMS. THEY SHOULD NOT BE SCALED OR USED AS SHOP DRAWINGS. ANY ALTERNATIVE ROUTING, OFFSETS, OR TRANSITIONS REQUIRED FOR FIELD COORDINATION SHOULD BE ADDRESSED BY THE CONTRACTOR WITHOUT ADDITIONAL COSTS.
3. COORDINATION WITH OTHER TRADES: THE CONTRACTOR MUST CLOSELY COORDINATE NEW MECHANICAL WORK WITH EXISTING MECHANICAL, PLUMBING, ELECTRICAL, FIRE PROTECTION, ARCHITECTURAL, AND STRUCTURAL ELEMENTS. EXISTING SYSTEMS MAY NEED TO BE RELOCATED TO ACCOMMODATE NEW WORK.
4. ALL EQUIPMENT SHOULD BE INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY DIRECTED OTHERWISE. CONTRACTORS ARE RESPONSIBLE FOR ENSURING COMPLETE INSTALLATIONS IN ACCORDANCE WITH EQUIPMENT MANUFACTURER'S WRITTEN INSTRUCTIONS.

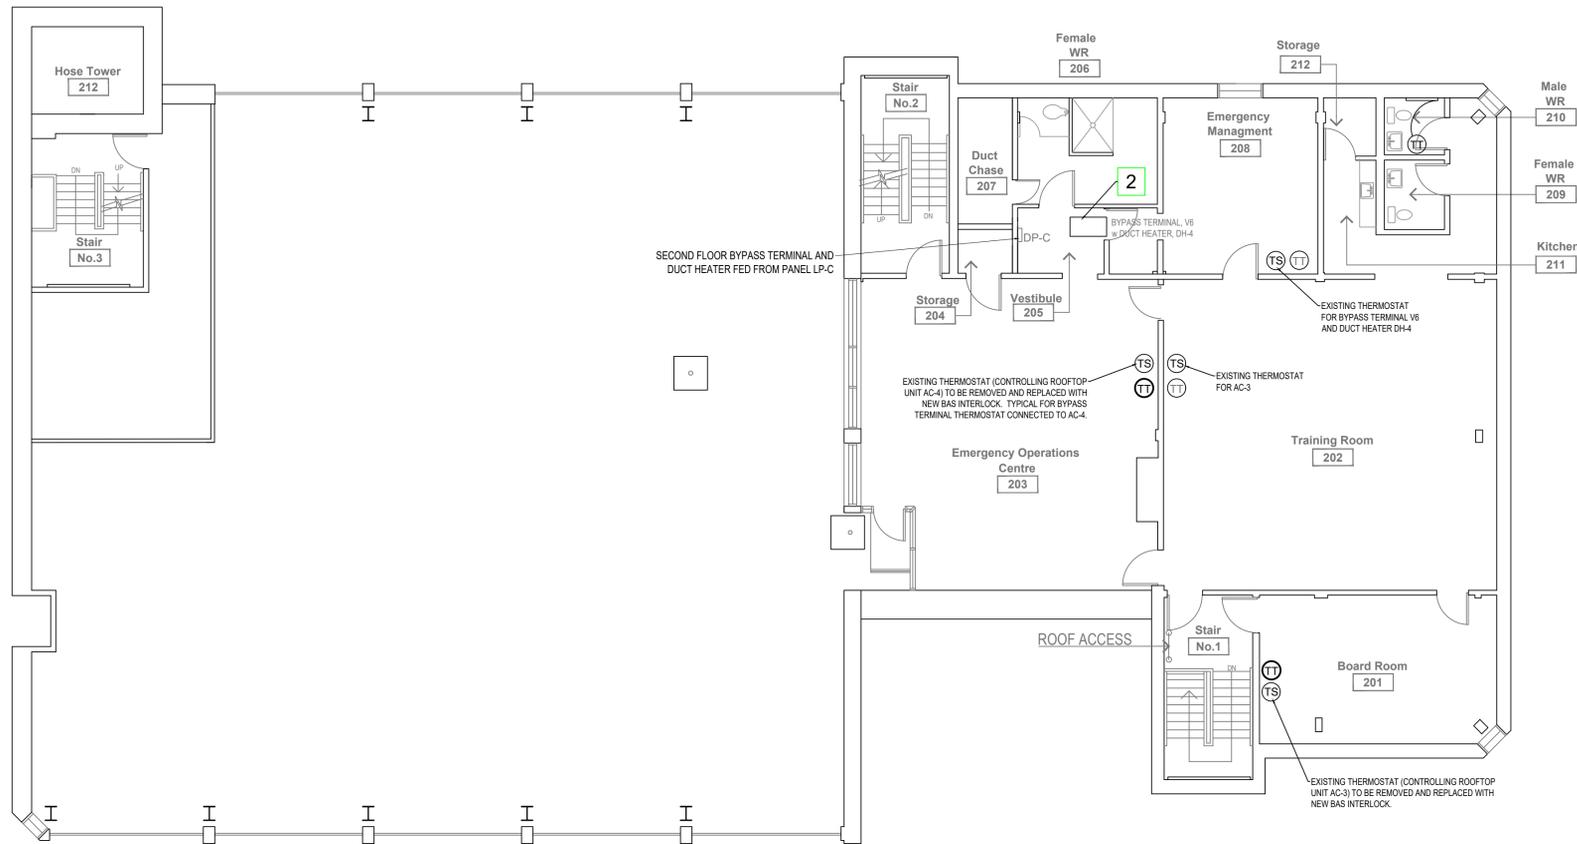

SCOPE LEGEND

- 1** NEW BAS PANEL
 - FURNISH AND INSTALL NEW BAS PANEL FOR SECOND FLOOR INPUTS AND OUTPUTS. WALL MOUNT IN LOCATION SHOWN.
 - FURNISH AND INSTALL NEW BREAKER IN NEAREST AVAILABLE DISTRIBUTION PANEL. PROVIDE NEW CONDUIT AND CONDUCTORS TO NEW BAS PANEL.
- 2** BYPASS TERMINALS WITH DUCT HEATERS
 - LOCATE BYPASS TERMINAL BREAKER AND DUCT HEATER BREAKER. LOCK OUT AND TAG AS REQUIRED.
 - REMOVE AND DISPOSE OF EXISTING BYPASS TERMINAL THERMOSTAT AND DISCONNECT SWITCH.
 - REMOVE AND DISPOSE OF EXISTING BYPASS TERMINAL ACTUATOR
 - FURNISH AND INSTALL NEW BYPASS TERMINAL ACTUATOR AND BAS CONTROLS FOR BOTH THE TERMINAL AND DUCT HEATER INCLUDING ROOM TEMPERATURE SENSOR AND 24V RELAYS

GENERAL NOTES

1. ALL WORK RELATED TO THE EQUIPMENT REPLACEMENTS MUST CONFORM TO APPLICABLE BUILDING CODES, FIRE CODES, AND OTHER RELEVANT REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING COMPLIANCE.
2. THE LAYOUT DRAWINGS ARE DIAGRAMMATIC AND SHOW THE GENERAL DESIGN INTENT, ARRANGEMENT, AND EXTENT OF SYSTEMS. THEY SHOULD NOT BE SCALED OR USED AS SHOP DRAWINGS. ANY ALTERNATIVE ROUTING, OFFSETS, OR TRANSITIONS REQUIRED FOR FIELD COORDINATION SHOULD BE ADDRESSED BY THE CONTRACTOR WITHOUT ADDITIONAL COSTS.
3. COORDINATION WITH OTHER TRADES: THE CONTRACTOR MUST CLOSELY COORDINATE NEW MECHANICAL WORK WITH EXISTING MECHANICAL, PLUMBING, ELECTRICAL, FIRE PROTECTION, ARCHITECTURAL, AND STRUCTURAL ELEMENTS. EXISTING SYSTEMS MAY NEED TO BE RELOCATED TO ACCOMMODATE NEW WORK.
4. ALL EQUIPMENT SHOULD BE INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY DIRECTED OTHERWISE. CONTRACTORS ARE RESPONSIBLE FOR ENSURING COMPLETE INSTALLATIONS IN ACCORDANCE WITH EQUIPMENT MANUFACTURER'S WRITTEN INSTRUCTIONS.



Drawn By: TSE Checked By: MF





No.	Revision/Issue	Date
1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026

Project:
City of Peterborough
Fire Station #1, 2026 Renovations
 210 Sherbrooke Street
 Peterborough, ON, K9J 2N3

Drawing Title:
Building Automation System
New Second Floor Layout

Project Number: TS25-0291
 Date: September 2025
 Scale: 1/8" = 1 ft
 Drawing Number: M-8



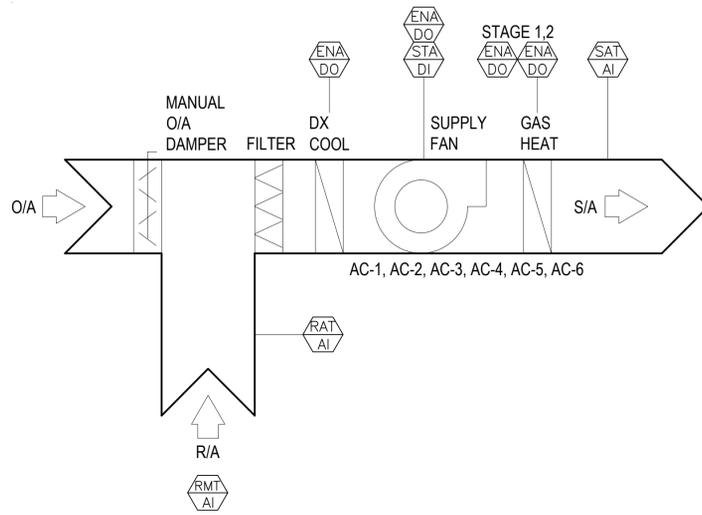

1 PACKAGED ROOFTOP UNIT CONTROL DETAILS
E-6

CONTROL NOTES


- OCCUPANCY**
- OCCUPANCY VARIES IN DIFFERENT AREAS OF THE FACILITY AND IS DEFINED BASED ON ROOFTOP UNIT AS FOLLOWS:
- AC-3,4,5,6 SPACES: OCCUPIED 24/7
 AC-1,2 SPACES: OCCUPIED MONDAY THROUGH FRIDAY 8AM TO 5PM.

- TEMPERATURE SETPOINTS**
- USER SPECIFIED COOLING SETPOINT
 - USER SPECIFIED HEATING SETPOINT

- HEATING CONTROL - OCCUPIED**
- INITIATE HEATING STAGE 1 UPON ROOM TEMPERATURE DROP BELOW SETPOINT
 - INITIATE HEATING STAGE 2 IF SETPOINT HAS NOT BEEN REACHED IN 15 MINUTES.

- COOLING CONTROL - OCCUPIED**
- INITIATE COOLING UPON ROOM TEMPERATURE RISE ABOVE SETPOINT
 - UTILIZE ECONOMIZER TO COOL SPACE WHEN AMBIENT TEMPERATURE IS 15°C OR LESS. IF ECONOMIZER BASED COOLING DOES NOT ACHIEVE SETPOINT WITHIN 20 MINUTES, MECHANICAL COOLING SHALL BE STARTED.
 - MECHANICAL COOLING SHALL BE USED EXCLUSIVELY WHEN AMBIENT TEMPERATURE IS ABOVE 15°C.


- TEMPERATURE CONTROL - UNOCCUPIED**
- INITIATE HEATING STAGE 1 UPON ROOM TEMPERATURE DROP BELOW SETPOINT
 - INITIATE HEATING STAGE 2 IF SETPOINT HAS NOT BEEN REACHED IN 15 MINUTES.
 - MECHANICAL COOLING IS DISABLED DURING UNOCCUPIED TIMES.
 - USE ECONOMIZER TO COOL SPACE WHEN AMBIENT TEMPERATURE IS 15°C OR LESS.

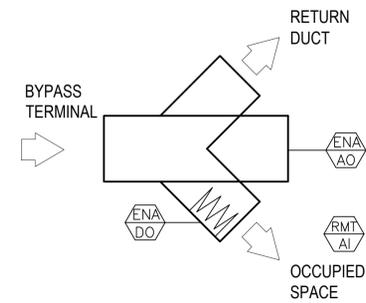

4 BYPASS TERMINAL CONTROL DETAILS
E-6

CONTROL NOTES


- OCCUPANCY**
- GROUND FLOOR OFFICES ARE OCCUPIED 8AM - 5PM MONDAY TO FRIDAY.
 - ALL OTHER TIMES, THE GROUND FLOOR OFFICES ARE CONSIDERED UNOCCUPIED.
 - SECOND FLOOR SPACES SERVED BY BYPASS BOXES ARE OCCUPIED 24/7.
 - THIRD FLOOR SPACES SERVED BY BYPASS BOXES ARE OCCUPIED 24/7.
- TEMPERATURE SETPOINTS**
- USER SPECIFIED COOLING SETPOINT.
 - USER SPECIFIED HEATING SETPOINT
- HEATING CONTROL - OCCUPIED**
- BYPASS AIR WHEN THE RESPECTIVE ROOFTOP UNIT IS RUNNING AND ROOM TEMPERATURE IS AT OR ABOVE SETPOINT.
 - ENABLE DUCT HEATER (WHERE APPLICABLE) WHEN ROOFTOP UNIT IS RUNNING AND ROOM TEMPERATURE SETPOINT IS GREATER THAN RTU SETPOINT. DISABLE IF ROOM SETPOINT IS REACHED AND ROOFTOP UNIT CONTINUES TO RUN.
- COOLING CONTROL - OCCUPIED**
- BYPASS AIR WHEN RESPECTIVE ROOFTOP UNIT IS RUNNING AND ROOM TEMPERATURE IS AT OR BELOW SETPOINT.
- EXISTING ACTUATORS**
- EXISTING BYPASS BOX ACTUATORS SHALL BE REPLACED AS PART OF THE PROJECT.

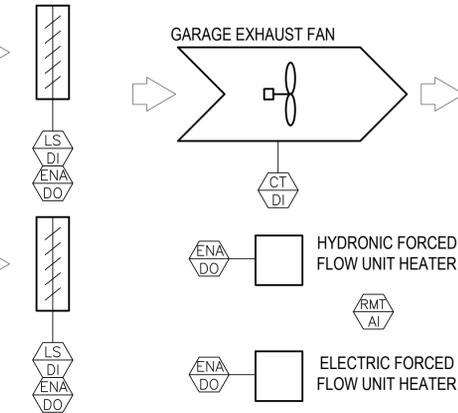

5 GARAGE TEMPERATURE CONTROL DETAIL
E-6

CONTROL NOTES

- OCCUPANCY**
- TEMPERATURE CONTROL IS REQUIRED IN THE GARAGE 24/7
- TEMPERATURE SETPOINTS**
- WINTER HEATING SETPOINT TO BE USER DEFINED. DEFAULT VALUE OF 18°F.
 - SUMMER COOLING SETPOINT TO BE USER DEFINED. DEFAULT VALUE OF 22°F.
- WINTER HEATING CONTROL**
- USER SPECIFIED HEATING SETPOINT
 - INITIATE HEATING STAGE 1 (HYDRONIC HEATER) UPON ROOM TEMPERATURE DROP BELOW SETPOINT. (HYDRONIC HEATER TO BE REPLACED WITH 2ND ELECTRIC HEATER UNDER FUTURE HYDRONIC RENOVATION).
 - INITIATE HEATING STAGE 2 (ELECTRIC HEATER) IF SETPOINT HAS NOT BEEN REACHED IN 15 MINUTES.
- SUMMER COOLING CONTROL**
- INITIATE VENTILATION WHEN ROOM TEMPERATURE IS ABOVE SETPOINT BY STARTING EXHAUST FAN AND OPENING FRESH AIR DAMPERS. DAMPER LIMIT SWITCHES TO SIGNAL BAS WHEN THEY ARE FULLY OPEN OR CLOSED.

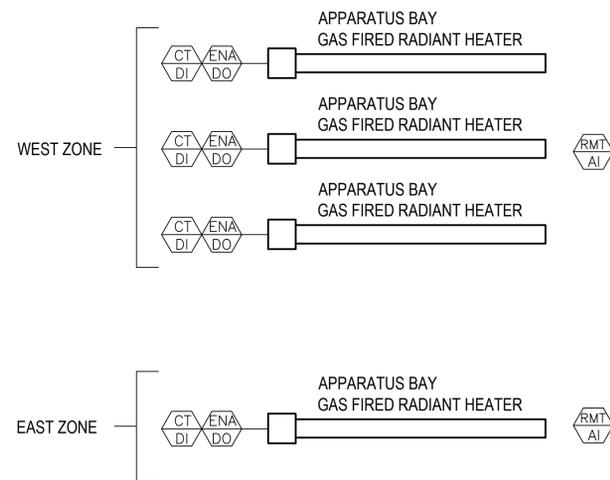


2 APPARATUS BAY GAS FIRED RADIANT HEATER CONTROL DETAILS
E-6

CONTROL NOTES

- OCCUPANCY**
- THE APPARATUS BAY IS OCCUPIED 24/7.
 - USER TO HAVE ABILITY TO LOCKOUT UNITS FOR USER SPECIFIED TIME PERIOD DURING WHICH THE GAS FIRED RADIANTS ARE TO REMAIN IDLE WITH NO TEMPERATURE ALARM. UPON COMPLETION OF THE SHUTDOWN PERIOD, THE UNITS SHALL BE ENABLED.
 - IF THE APPARATUS BAY TEMPERATURE IS BELOW SETPOINT WHEN THE SHUTDOWN PERIOD ELAPSES, THE ALARM SHALL BE LOCKED OUT UNTIL SETPOINT IS ACHIEVED.

- TEMPERATURE SETPOINTS**
- APPARATUS BAY HEATING SETPOINTS TO BE USER DEFINED. DEFAULT VALUE OF 18°F.
 - GAS FIRED RADIANTS ARE DIVIDED INTO ZONES. THE THREE WESTERN MOST UNITS COMPRISE ONE ZONE AND THE LONE EASTERN MOST UNIT IS THE SECOND ZONE. THE EASTERN ZONE IS TYPICALLY MAINTAINED AT A HIGHER TEMPERATURE.

- HEATING CONTROL**
- USER SPECIFIED HEATING SETPOINT
 - INITIATE HEATING STAGE UPON ROOM TEMPERATURE DROP BELOW SETPOINT

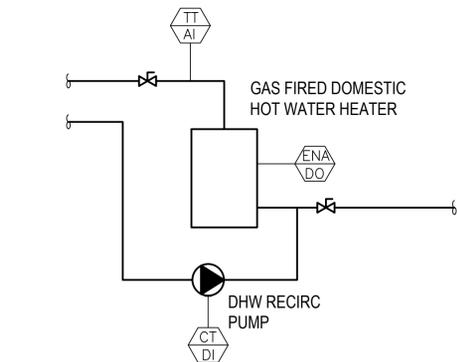

3 DOMESTIC HOT WATER CONTROL DETAIL
E-6

CONTROL NOTES

- OCCUPANCY**
- THE FACILITY'S NEEDS FOR HOT WATER CAN OCCUR 24/7.
- RECIRCULATION PUMP MONITORING**
- THE RECIRCULATION PUMP IS REQUIRED TO RUN 24/7.
 - PUMP STATUS TO BE MONITORED ONLY.
- HOT WATER HEATER MONITORING**
- ALARM WHEN HOT WATER TEMPERATURE FALLS BELOW USER SETPOINT



Drawn By: TSE Checked By: MF




No.	Revision/Issue	Date
1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026

Project:
 City of Peterborough
 Fire Station #1, 2026 Renovations
 210 Sherbrooke Street
 Peterborough, ON, K9J 2N3

Drawing Title:
 Building Automation System
 Control Details

Project Number: TS25-0291
 Date: October 2025
 Scale: NTS
 Drawing Number: M-11

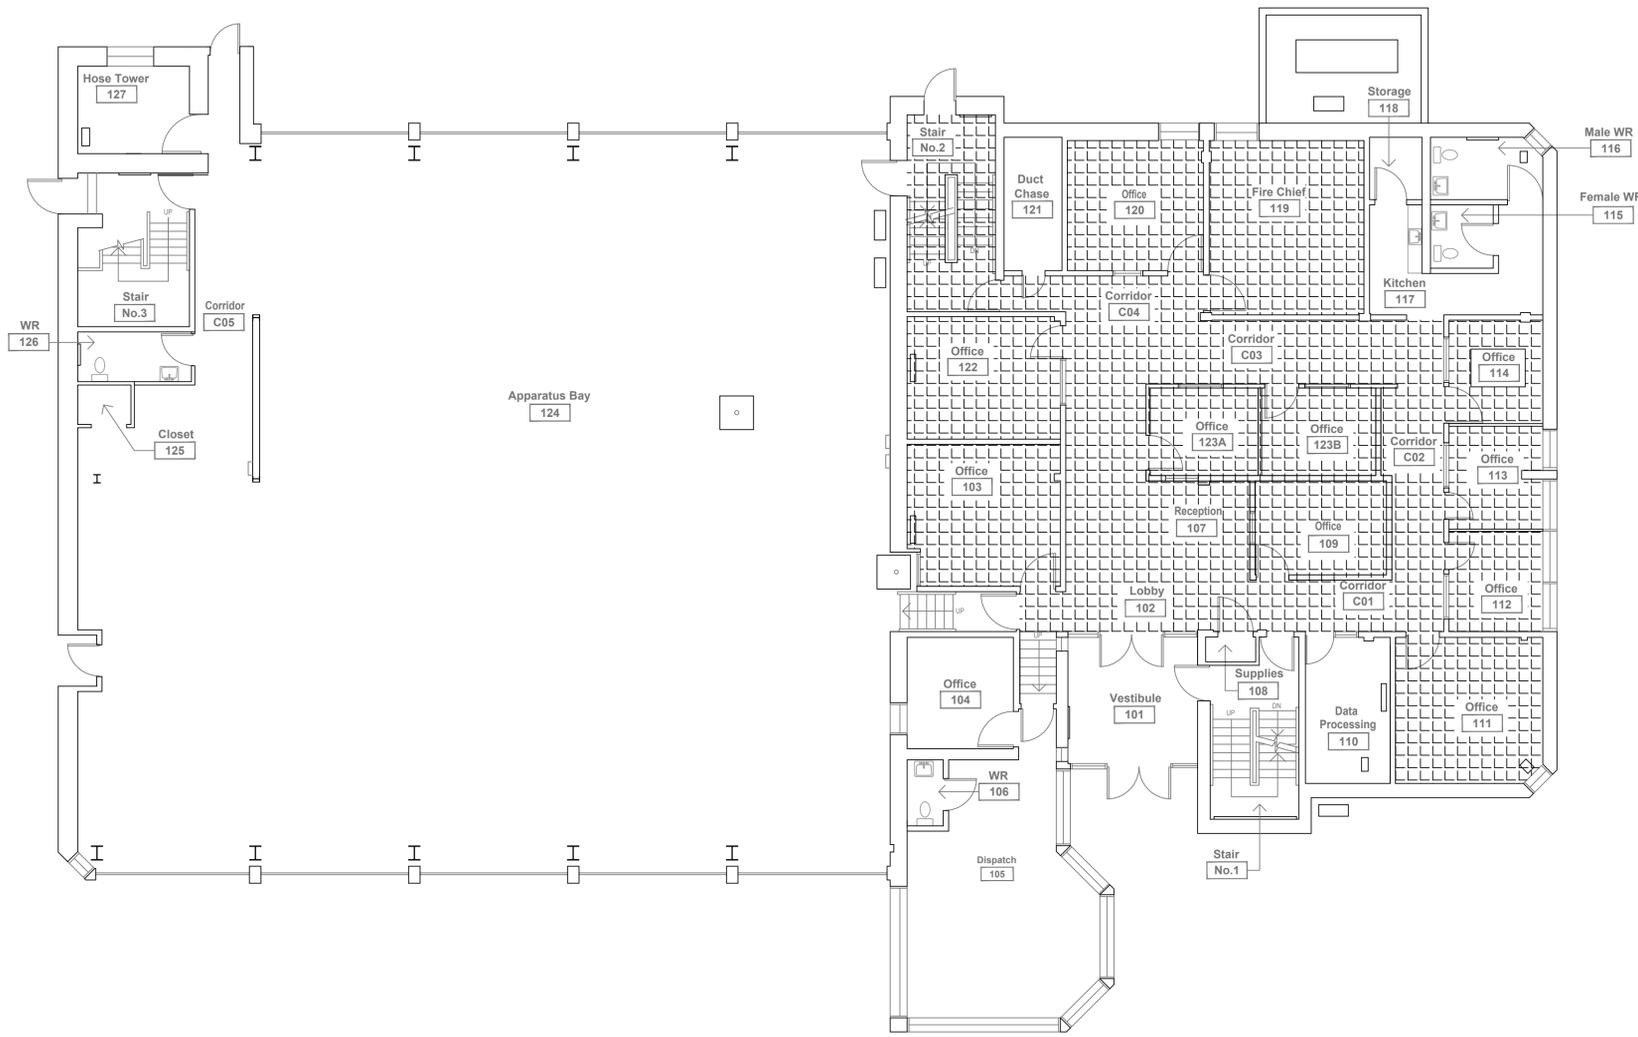

SCOPE NOTES


- INDICATES EXTENT OF EXISTING FLOORING REMOVALS (CARPETING IN OFFICES AND CORRIDORS, VINYL TILE IN STAIRWELLS).
- REMOVE EXISTING BROADLOOM CARPET AND ASSOCIATED UNDERPADDING WHERE APPLICABLE.
- REMOVE AND DISPOSE OF EXISTING VINYL TILE WHERE APPLICABLE.
- DETACH AND DISPOSE OF EXISTING TACK STRIPS (WHERE PRESENT)
- REMOVE EXISTING ADHESIVE RESIDUE WHERE PRESENT TO ACHIEVE A CLEAN, SMOOTH SUBSTRATE
- DISPOSE OF ALL DEBRIS ACCORDING TO PROVINCIAL AND LOCAL REGULATIONS.

GENERAL NOTES


- ALL WORK RELATED TO THE FACILITY UPGRADES MUST CONFORM TO APPLICABLE BUILDING CODES, FIRE CODES, AND OTHER RELEVANT REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING COMPLIANCE.
- THE LAYOUT DRAWINGS ARE DIAGRAMMATIC AND SHOW THE GENERAL DESIGN INTENT, ARRANGEMENT, AND EXTENT OF SYSTEMS. THEY SHOULD NOT BE SCALED OR USED AS SHOP DRAWINGS. ANY ALTERNATIVE ROUTING, OFFSETS, OR TRANSITIONS REQUIRED FOR FIELD COORDINATION SHOULD BE ADDRESSED BY THE CONTRACTOR WITHOUT ADDITIONAL COSTS.
- COORDINATION WITH OTHER TRADES: THE CONTRACTOR MUST CLOSELY COORDINATE NEW MECHANICAL WORK WITH EXISTING MECHANICAL, PLUMBING, ELECTRICAL, FIRE PROTECTION, ARCHITECTURAL, AND STRUCTURAL ELEMENTS. EXISTING SYSTEMS MAY NEED TO BE RELOCATED TO ACCOMMODATE NEW WORK.
- ALL EQUIPMENT SHOULD BE INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY DIRECTED OTHERWISE. CONTRACTORS ARE RESPONSIBLE FOR ENSURING COMPLETE INSTALLATIONS IN ACCORDANCE WITH EQUIPMENT MANUFACTURER'S WRITTEN INSTRUCTIONS.



Drawn By: TSE Checked By: MF



1
G-1
GROUND FLOOR DEMOLITION LAYOUT
1/8" = 1 ft

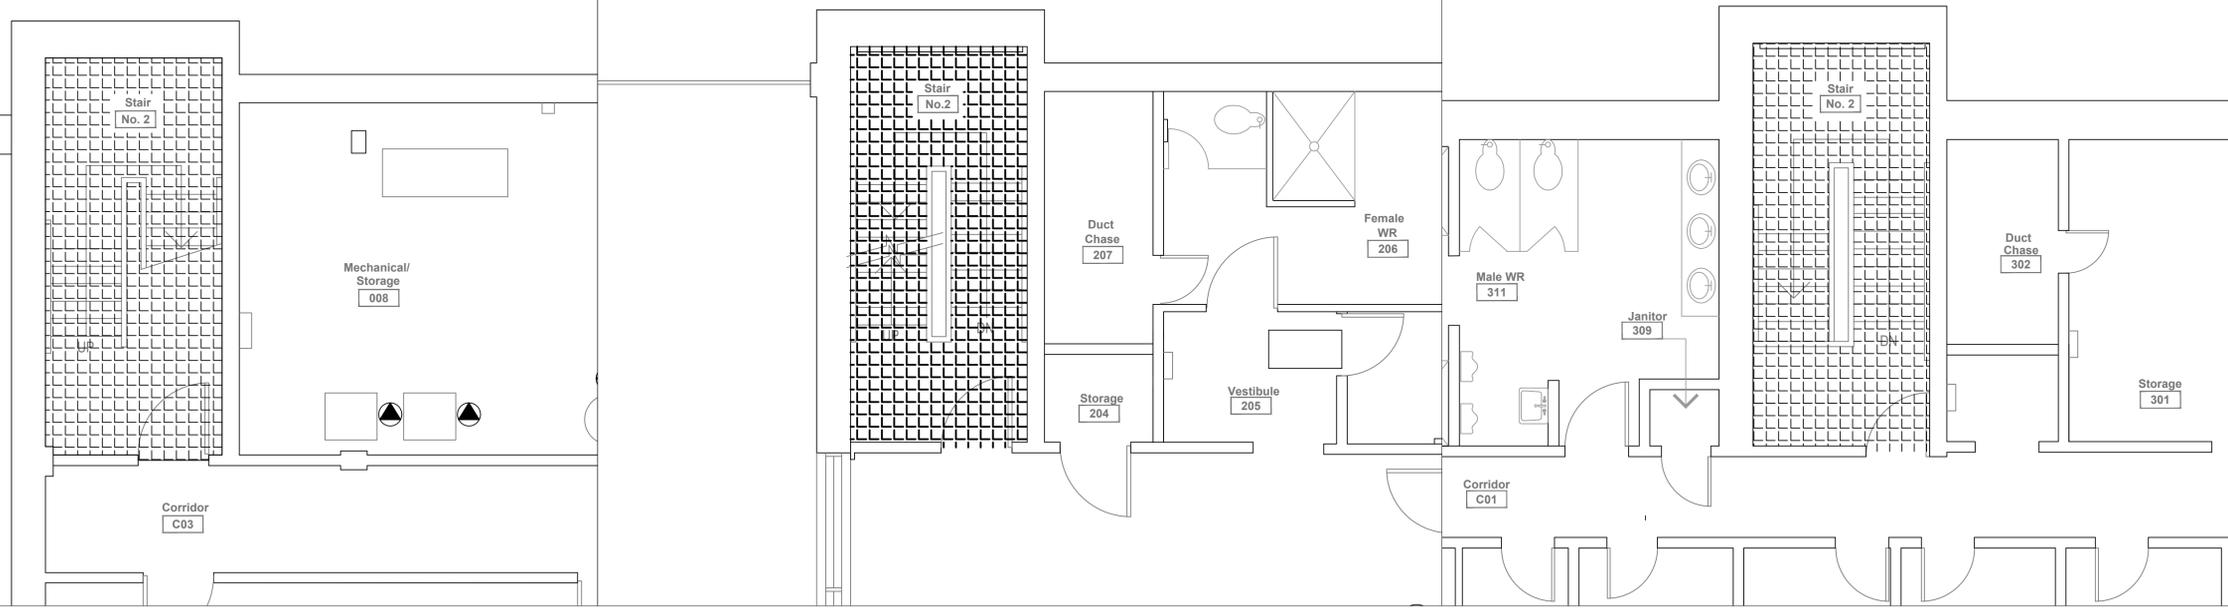

2
G-1
NORTHEAST STAIRWELL - BASEMENT DEMOLITION
1/4" = 1 ft

3
G-1
NORTHEAST STAIRWELL - SECOND FLOOR DEMOLITION
1/4" = 1 ft


4
G-1
NORTHEAST STAIRWELL - THIRD FLOOR DEMOLITION
1/4" = 1 ft

No.	Revision/Issue	Date
1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026

Project:
City of Peterborough
Fire Station #1, 2026 Renovations
210 Sherbrooke Street
Peterborough, ON, K9J 2N3

Drawing Title:
Flooring Demolition Layouts

Project Number: TS25-0291
Date: September 2025
Scale: AS SHOWN
Drawing Number: G-1

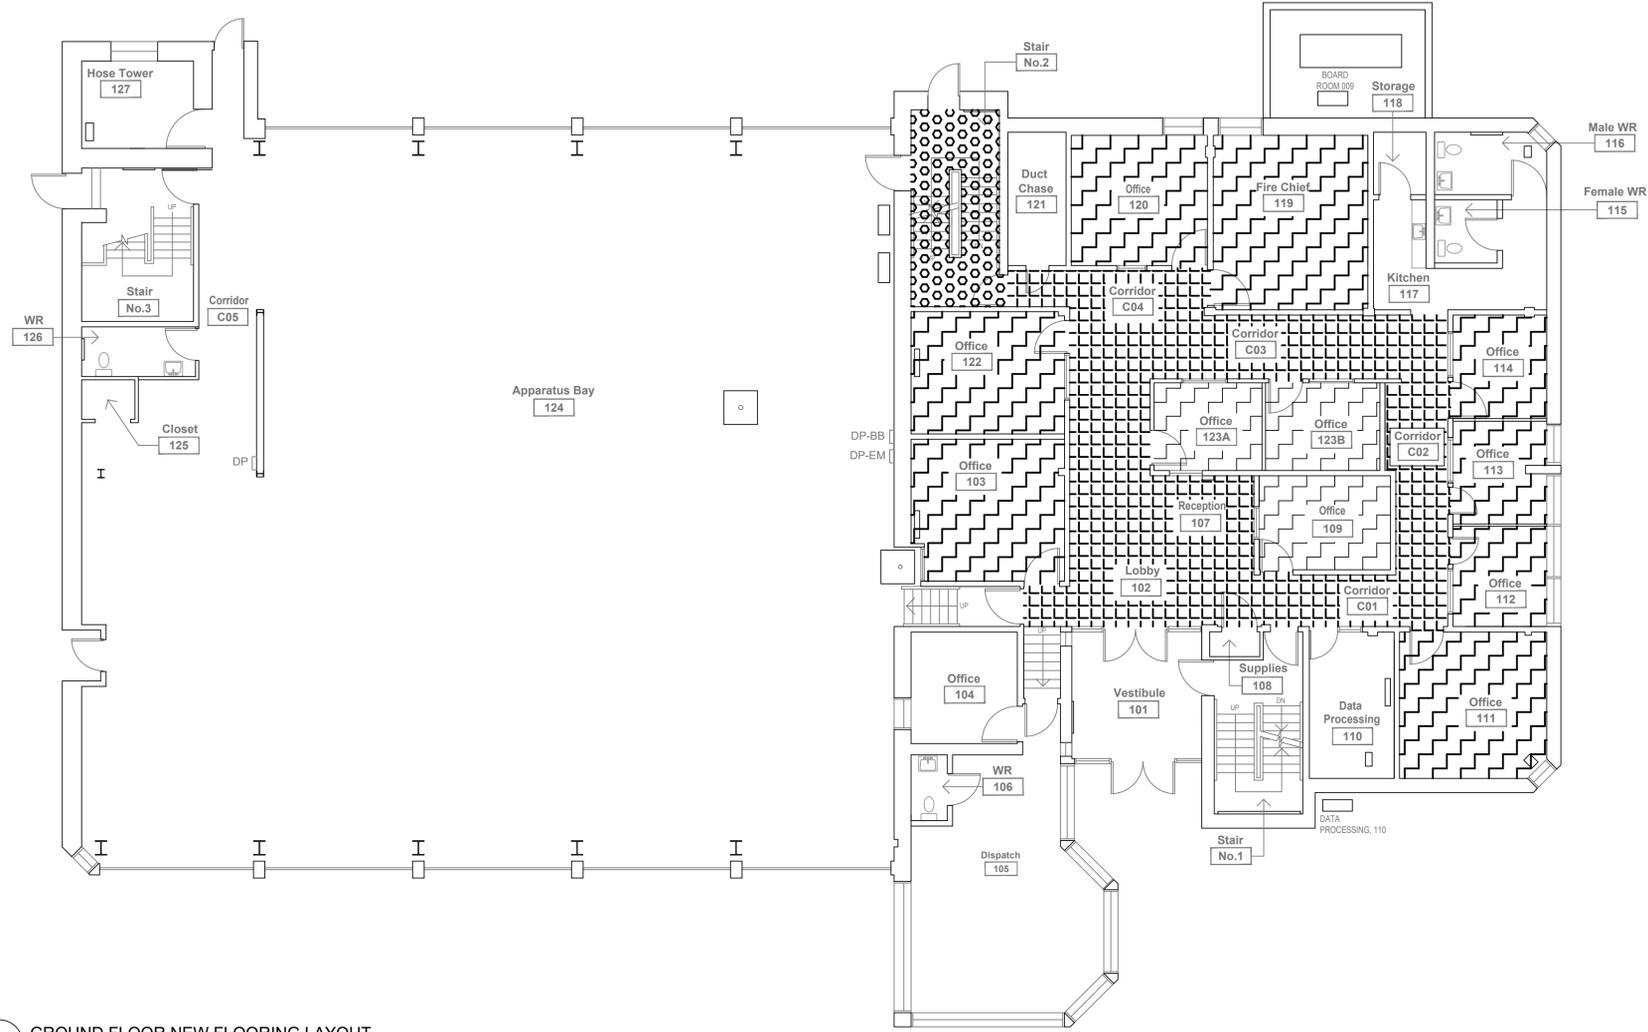

SCOPE NOTES


- 
 INDICATES EXTENT OF NEW VINYL PLANK FLOORING (FOR GROUND FLOOR CORRIDORS).
 - INSPECT SUBFLOOR FOR DAMAGE, MOISTURE CONCERNS, AND SURFACE IRREGULARITIES
 - PERFORM PATCHING, LEVELING, AND REPAIRS AS NEEDED TO MEET MANUFACTURER TOLERANCES
 - ENSURE SUBSTRATE IS CLEAN, DRY, AND SMOOTH PRIOR TO INSTALLATION
 - INSTALL COREtec PROPLUS XL VINYL PLANK FLOORING PER MANUFACTURER'S GUIDELINES AND APPROVED LAYOUT. COLOUR TO BE SELECTED BY FACILITY STAFF FROM THE STANDARD PRODUCT LINE CHOICES.
 - MAINTAIN REQUIRED EXPANSION GAPS AT WALLS, COLUMNS, AND FIXED ELEMENTS
 - ENSURE TIGHT SEAMS, PROPER ALIGNMENT, AND CONSISTENT PATTERN ORIENTATION
 - ROLL FLOORING AS REQUIRED TO ENSURE FULL ADHESIVE BOND WHERE REQUIRED.
 - INSTALL NEW TRANSITION STRIPS, REDUCERS, AND THRESHOLDS AS REQUIRED
 - CLEAN NEWLY INSTALLED FLOORING
- 
 INDICATES THE EXTENT OF NEW CARPET TILE (FOR GROUND FLOOR OFFICES)
 - LAY OUT CARPET TILE PATTERN ACCORDING TO APPROVED DESIGN
 - INSTALL PHILADELPHIA COMMERCIAL MYSTIFY 24" SQUARE CARPET TILES ACCORDING TO MANUFACTURER'S RECOMMENDATIONS
 - ENSURE TIGHT SEAMS, PROPER ALIGNMENT, AND CONSISTENT ORIENTATION
 - ROLL INSTALLED TILES TO ENSURE FULL ADHESIVE BOND
 - INSTALL NEW TRANSITION STRIPS, REDUCERS, OR BASE AS REQUIRED
 - PERFORM FINAL TRIMMING AND DETAIL WORK AROUND WALLS, COLUMNS, AND BUILT INS
 - VACUUM NEWLY INSTALLED CARPET TILE
- 
 INDICATES THE EXTENT OF NEW PAINTED CONCRETE FLOOR AND STAIRS.
 - CLEAN THOROUGHLY
 - REMOVE GREASE, DUST, ADHESIVE AND OLD PAINT
 - ETCH OR MECHANICALLY GRIND THE SURFACE WHERE REQUIRED
 - ENSURE THE CONCRETE IS FULLY DRY
 - COAT WITH EPOXY PRIMER AS RECOMMENDED BY MANUFACTURER
 - COAT WITH SHERWIN WILLIAMS RESUGRIP 175 TWO PART EPOXY PAINT OR APPROVED EQUIVALENT ACCORDING TO MANUFACTURER'S RECOMMENDATIONS. ADDITIONAL GRIT AS RECOMMENDED BY THE MANUFACTURER FOR STAIRWELL APPLICATION.

GENERAL NOTES


1. ALL WORK RELATED TO THE FACILITY UPGRADES MUST CONFORM TO APPLICABLE BUILDING CODES, FIRE CODES, AND OTHER RELEVANT REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING COMPLIANCE.
2. THE LAYOUT DRAWINGS ARE DIAGRAMMATIC AND SHOW THE GENERAL DESIGN INTENT, ARRANGEMENT, AND EXTENT OF SYSTEMS. THEY SHOULD NOT BE SCALED OR USED AS SHOP DRAWINGS. ANY ALTERNATIVE ROUTING, OFFSETS, OR TRANSITIONS REQUIRED FOR FIELD COORDINATION SHOULD BE ADDRESSED BY THE CONTRACTOR WITHOUT ADDITIONAL COSTS.
3. COORDINATION WITH OTHER TRADES: THE CONTRACTOR MUST CLOSELY COORDINATE NEW MECHANICAL WORK WITH EXISTING MECHANICAL, PLUMBING, ELECTRICAL, FIRE PROTECTION, ARCHITECTURAL, AND STRUCTURAL ELEMENTS. EXISTING SYSTEMS MAY NEED TO BE RELOCATED TO ACCOMMODATE NEW WORK.
4. ALL EQUIPMENT SHOULD BE INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY DIRECTED OTHERWISE. CONTRACTORS ARE RESPONSIBLE FOR ENSURING COMPLETE INSTALLATIONS IN ACCORDANCE WITH EQUIPMENT MANUFACTURER'S WRITTEN INSTRUCTIONS.



Drawn By: TSE Checked By: MF



1
G-2
GROUND FLOOR NEW FLOORING LAYOUT
1/8" = 1 ft

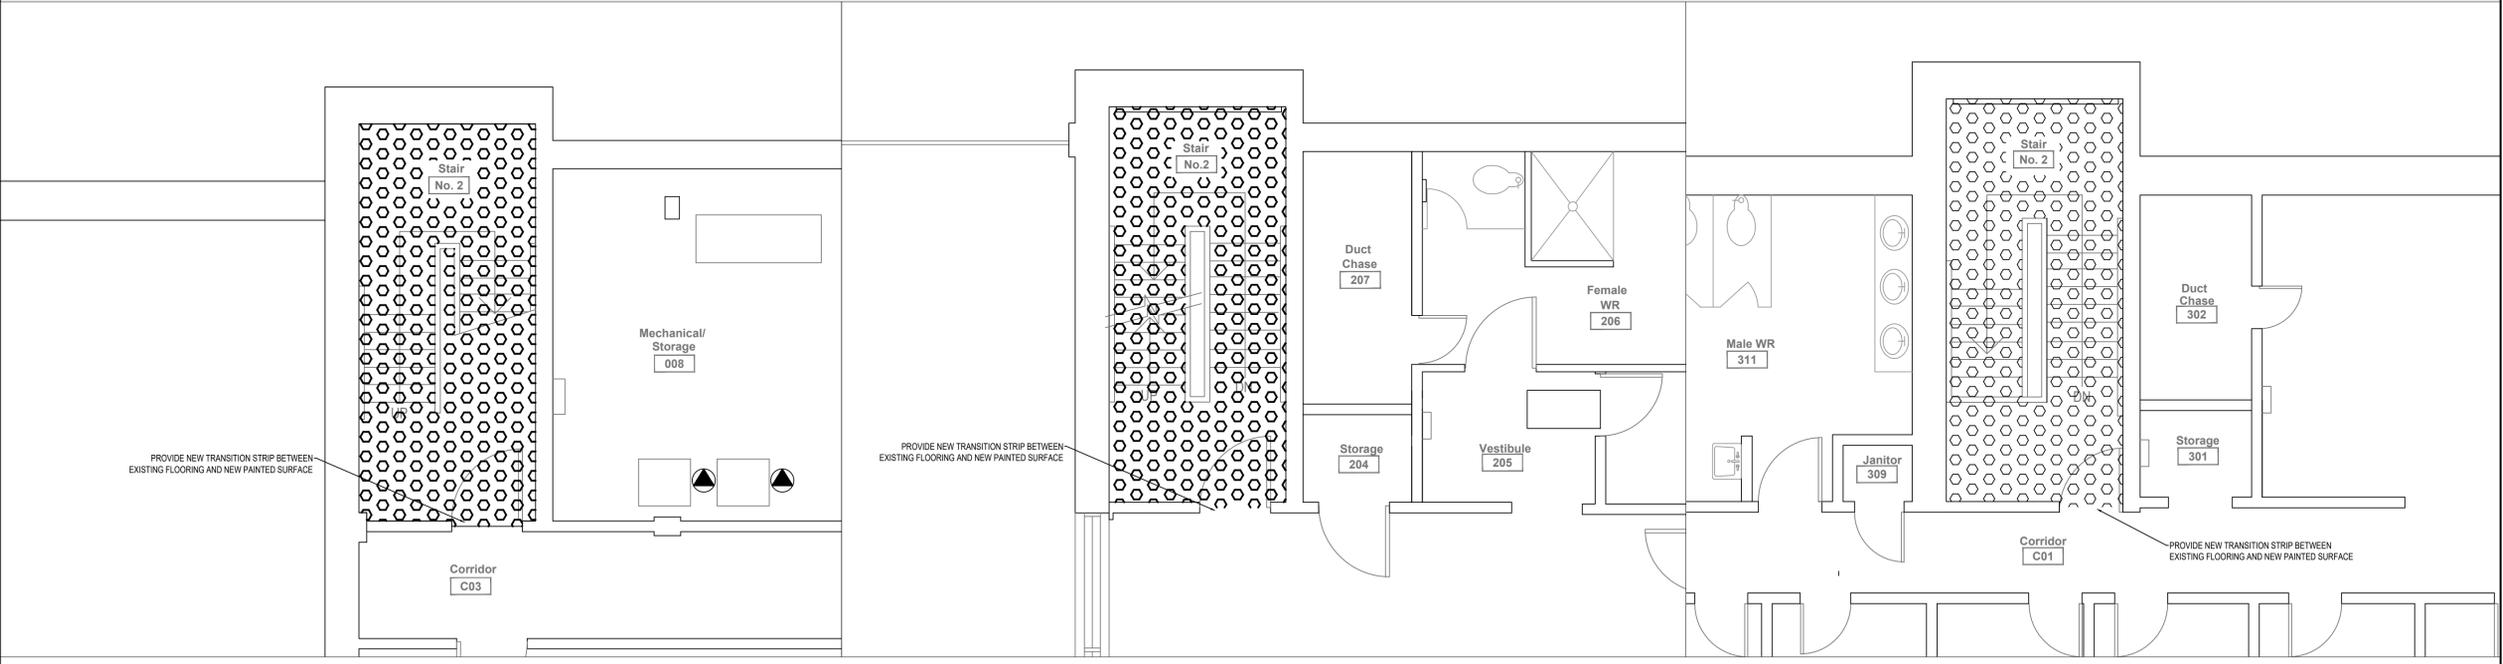

2
G-2
NORTHEAST STAIRWELL - NEW BASEMENT LAYOUT
1/4" = 1 ft

3
G-2
NORTHEAST STAIRWELL - NEW SECOND FLOOR LAYOUT
1/4" = 1 ft

4
G-2
NORTHEAST STAIRWELL - NEW THIRD FLOOR LAYOUT
1/4" = 1 ft

No.	Revision/Issue	Date
1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026

Project:
City of Peterborough
Fire Station #1, 2026 Renovations
 210 Sherbrooke Street
 Peterborough, ON, K9J 2N3

Drawing Title:
New Flooring Layouts

Project Number: TS25-0291
 Date: September 2025
 Scale: AS SHOWN
 Drawing Number: G-2



SCOPE LEGEND

- 1** NEW APPARATUS BAY CIRCULATION FANS
 - SUSPEND FANS FROM EXISTING STRUCTURE. PROVIDE ADDITIONAL SUPPORT STEEL AS REQUIRED AND INSTALL FANS ACCORDING TO MANUFACTURER'S RECOMMENDATIONS.
 - VERIFY FINAL MOUNTING LOCATION WITH FACILITY STAFF BEFORE PROCEEDING
 - FURNISH AND INSTALL MANUFACTURER'S SAFETY CAGE
 - UTILIZE 1/60/120V POWER PRESENTLY USED FOR HYDRONIC HEATERS TO POWER MANUFACTURER'S FAN CONTROLLER.
 - WALL MOUNT FAN CONTROLLER IN LOCATION APPROVED BY FACILITY STAFF AND CONNECT TO NEW CIRCULATION FANS.
- 2** RELOCATE EXISTING SERVICES
 - RELOCATE EXISTING ELECTRICAL CONDUITS AND EXISTING DRYING CABINET RECEPTACLE AS REQUIRED FOR NEW LOCATION OF CABINET AND VENT THROUGH THE WALL. COORDINATE WITH MECHANICAL CONTRACTOR.
- 3** NEW APPARATUS BAY GAS FIRED RADIANT HEATERS
 - RELOCATE EXISTING 1/60/120V FEEDS TO ACCOMMODATE NEW RADIANT HEATERS AS REQUIRED. COORDINATE WITH MECHANICAL CONTRACTOR.

CIRCULATION FAN SCHEDULE						
Tag	Make & Model	Size	Weight	Voltage	FLA	Accessories
CF-1,2	CaramDC Industrial CP48D or approved equivalent	48" diameter	18.6 lbs	1/60/120V	0.6 A	- 1" diameter downrod, coordinate length with facility staff - Wire safety cage - RREM-DCQ014-W controller shipped loose for installation on Apparatus Bay wall. One controller for both fans.

GENERAL NOTES

1. ALL WORK RELATED TO THE EQUIPMENT REPLACEMENTS MUST CONFORM TO APPLICABLE BUILDING CODES, FIRE CODES, AND OTHER RELEVANT REGULATIONS. THE CONTRACTOR IS RESPONSIBLE FOR ENSURING COMPLIANCE.
2. THE LAYOUT DRAWINGS ARE DIAGRAMMATIC AND SHOW THE GENERAL DESIGN INTENT, ARRANGEMENT, AND EXTENT OF SYSTEMS. THEY SHOULD NOT BE SCALED OR USED AS SHOP DRAWINGS. ANY ALTERNATIVE ROUTING, OFFSETS, OR TRANSITIONS REQUIRED FOR FIELD COORDINATION SHOULD BE ADDRESSED BY THE CONTRACTOR WITHOUT ADDITIONAL COSTS.
3. COORDINATION WITH OTHER TRADES: THE CONTRACTOR MUST CLOSELY COORDINATE NEW MECHANICAL WORK WITH EXISTING MECHANICAL, PLUMBING, ELECTRICAL, FIRE PROTECTION, ARCHITECTURAL, AND STRUCTURAL ELEMENTS. EXISTING SYSTEMS MAY NEED TO BE RELOCATED TO ACCOMMODATE NEW WORK.
4. ALL EQUIPMENT SHOULD BE INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY DIRECTED OTHERWISE. CONTRACTORS ARE RESPONSIBLE FOR ENSURING COMPLETE INSTALLATIONS IN ACCORDANCE WITH EQUIPMENT MANUFACTURER'S WRITTEN INSTRUCTIONS.



Drawn By: TSE Checked By: JL/MF

Stamp:



1	Issued for Tender	Jan. 20 2026
0	Issued for Review	Jan. 7 2026
No.	Revision/Issue	Date

Project:
 City of Peterborough
 Fire Station #1, 2026 Renovations
 210 Sherbrooke Street
 Peterborough, ON, K9J 2N3


Drawing Title:
**Mechanical Renovations
 New Ground Floor Electrical
 Layout**


Project Number: TS25-0291

Date: September 2025


Scale: 1/8" = 1 ft

Drawing Number: E-2




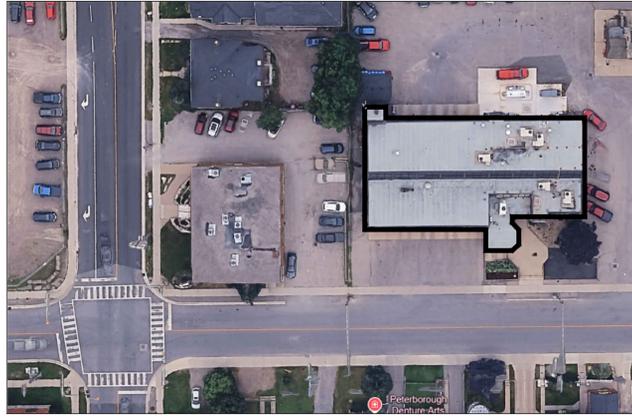

CONTEXT PLAN 6
N.T.S. A1

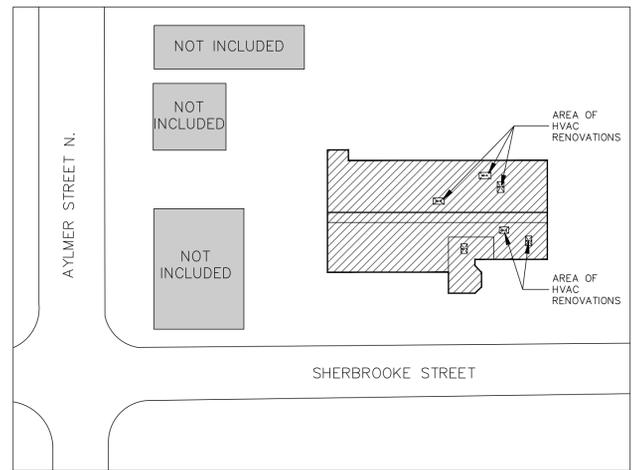

KEY PLAN 5
N.T.S. A1

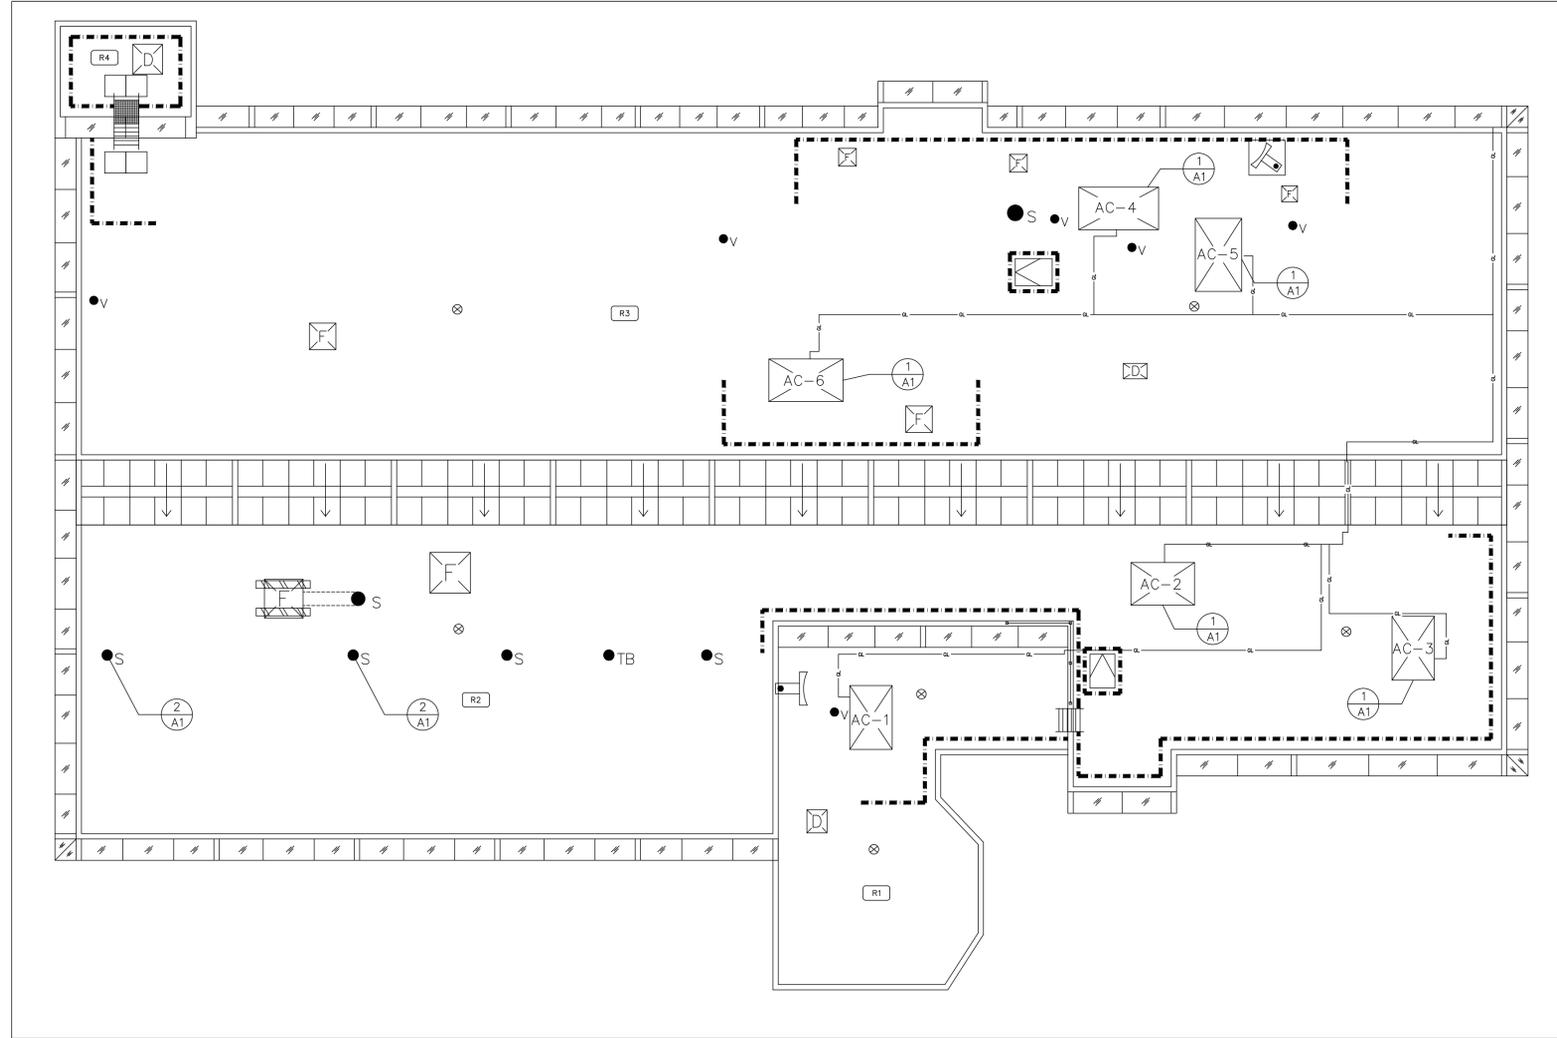


ROOF PLAN 4
N.T.S. A1




LEGEND


- R1 ROOF SECTION
- ⊗ ROOF DRAIN
- PLUMBING VENT STACK
- CHIMNEY STACK
- TB GUY-WIRE/TIE-BACK
- SLEEPER
- ANTENNA/SATELLITE
- DUCT CURB
- FAN CURB
- ROOF HATCH
- ROOFTOP UNIT
- LADDER
- GAS LINE
- ROOF GUARDRAIL

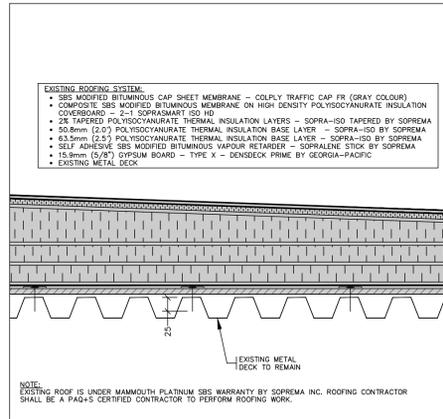

EXISTING ROOFING ASSEMBLY 3
N.T.S. A1

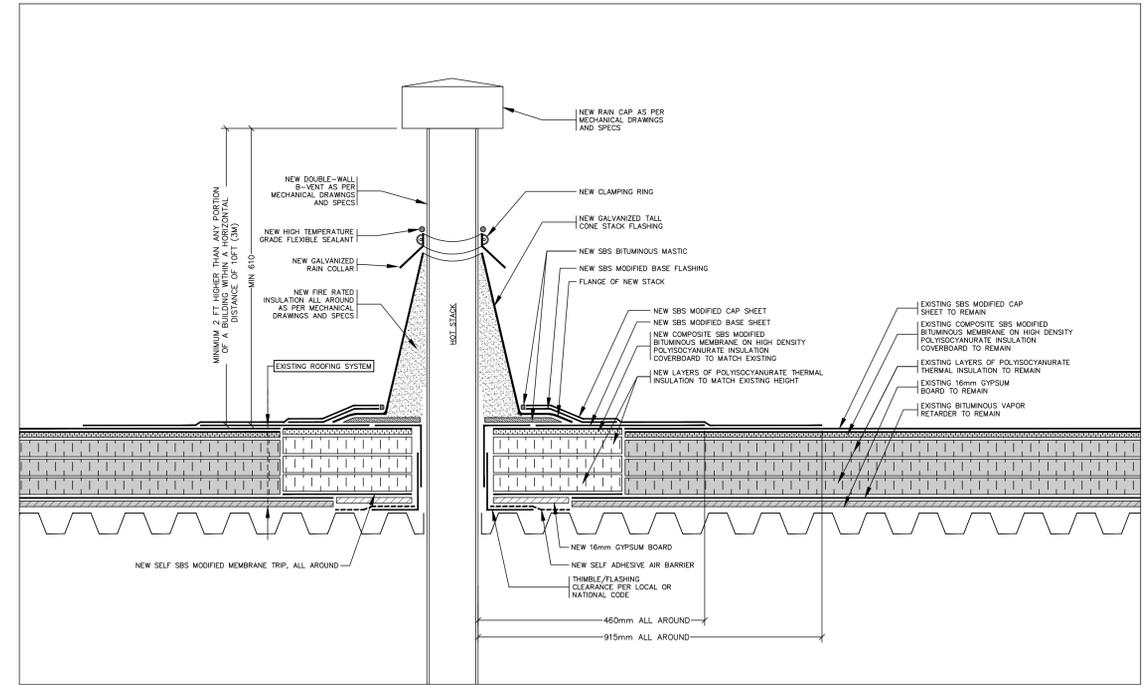

NEW HOT STACK FLASHING DETAIL 2
N.T.S. A1

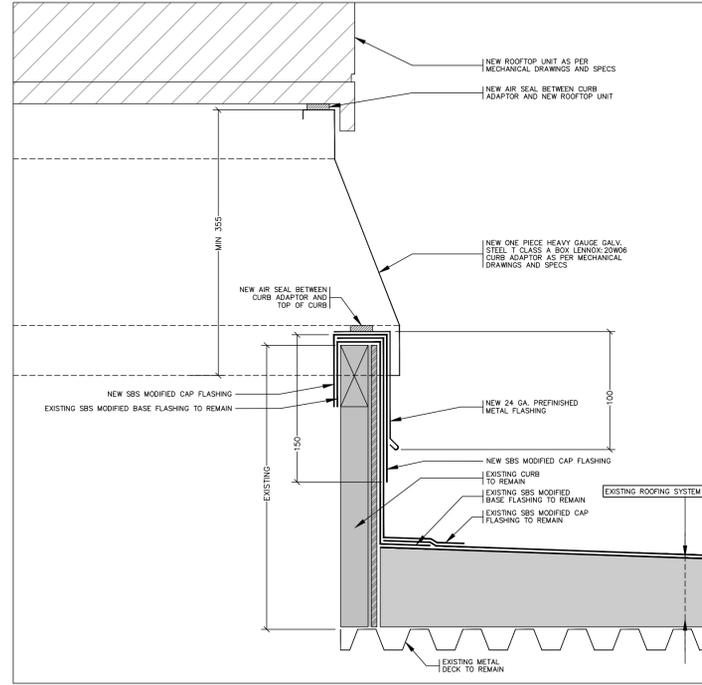

NEW CURB ADAPTOR FLASHING DETAIL 1
N.T.S. A1



NO.	REVISION	DATE
1	ISSUED FOR TENDER REVIEW	2024/01/24
2	ISSUED FOR TENDER	2024/01/29

ONLY USE LATEST APPROVED DRAWINGS FOR CONSTRUCTION

ALL DIMENSIONS, MEASUREMENTS & AREAS INDICATED ON ALL DRAWINGS ARE APPROXIMATE AND PROVIDED AS INFORMATION ONLY. THEY SHALL NOT BE USED FOR BIDDING, TENDERING AND/OR CONSTRUCTION. CONTRACTORS AND THEIR SUB-TRADES ARE RESPONSIBLE TO VERIFY AND OBTAIN ALL MEASUREMENTS ON SITE PRIOR TO BIDDING, PREPARATION OF SHOP DRAWINGS, APPROVAL OF SHOP DRAWINGS, ORDERING, DELIVERY AND INSTALLATION OF ANY MATERIAL AND/OR SYSTEM. THE CONSULTANT WILL NOT BE RESPONSIBLE FOR ANY VARIANCES IN DIMENSIONS, MEASUREMENTS & AREAS. CONTRACTOR MUST IMMEDIATELY NOTIFY THE CONSULTANT OF ANY FOUND VARIANCES.

CONSULTANT'S REVIEW OF SHOP DRAWINGS DOES NOT RELIEVE THE CONTRACTOR OF THE RESPONSIBILITY TO PERFORM THE WORK ACCURATELY AND IN COMPLIANCE WITH ALL CONTRACT DOCUMENTS. CONTRACTOR SHALL MAINTAIN A SET OF APPROVED DRAWINGS ON SITE AT ALL TIMES.

ABS
500 HOOD ROAD, SUITE 320
MARKHAM, ONTARIO L3R 9Z3
TEL: 905-474-9569 | www.absi.ca

CLIENT:

CITY OF PETERBOROUGH
GEORGE STREET NORTH,
PETERBOROUGH, ONTARIO K9H 3R9


BUILDING:
FIRE STATION #1,
210 SHERBROOKE STREET,
PETERBOROUGH, ON, K9J 2N3

DRAWN: G.M.
APPROVED: B. T. MARASHI, P. ENG., BSS

SCALE: AS NOTED
DATE: JANUARY 2026

PROJECT: HVAC RENOVATIONS
DRAWING: ROOF PLAN AND DETAILS

CSE ENGINEERED PROCEDURES

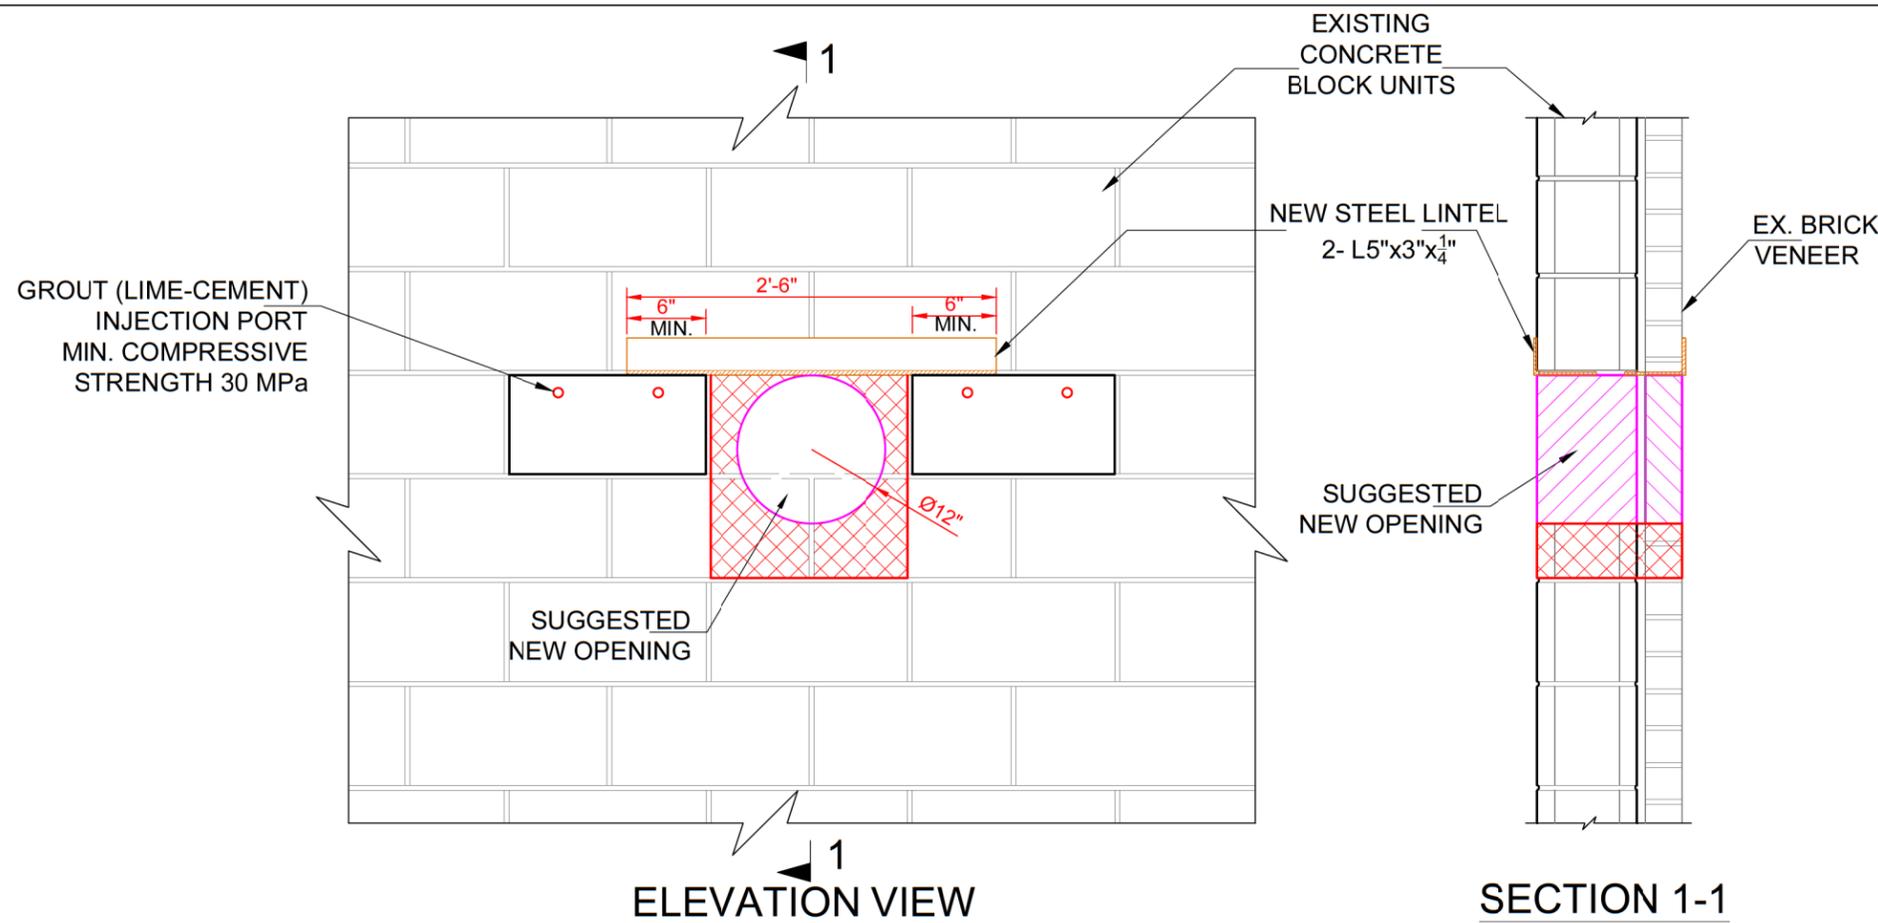

ISSUED FOR TENDER



5.0 SCOPE OF WORK

- .1 PERFORM ALL SITE MEASUREMENTS AND CONFIRM SIZES PRIOR TO INITIATING ANY STRUCTURAL WORK. DO NOT PROCEED ANY WORK WITHOUT APPROVED SHOP DRAWINGS.
- .2 DEMARCATHE THE LOCATION OF THE SUGGESTED OPENING ON THE MASONRY WALL. LAYOUT THE CENTER OF THE OPENING.
NOTE; ADJUST THE POSITION OF THE OPENING TO MINIMIZE DAMAGE TO ADJACENT BLOCKS.
- .3 USING A SUITABLE TOOL AND CREATE A CUT LINE HAVING A LENGTH EQUAL TO THE LINTEL FROM ONE SIDE ONLY.
- .4 INSTALL THE STEEL LINTEL AS REQUIRED AND FILL THE GAPS AROUND THE LINTEL WITH MORTAR AND CAULKING.
- .5 REPEAT THE SAME PROCEDURE AND INSTALL THE LINTEL AT THE SECOND SIDE.
- .6 DRILL/ CUT THE MASONRY WALL WITHIN THE SPECIFIED LAYOUT.
- .7 MAKE GOOD TO ANY DAMAGES CAUSED BY THIS CONSTRUCTION, TO THE OWNER'S SATISFACTION, WITH NO EXTRA COST TO THE CONTRACT.
- .8 ALLOW CSE TO CONDUCT A FINAL INSPECTION FOR SIGN-OFF.

6.0 STRUCTURAL STEEL

- .1 STRUCTURAL STEEL ANGLES TO CONFORM TO CAN/CSA-G40.20/G40.21 GRADE 300W.
- .3 FABRICATION, ERECTION AND WORKMANSHIP SHALL CONFORM TO CSA S16
- .4 ENSURE THAT THE SHOP PRIMER OF PAINT IS COMPATIBLE WITH SPRAY FIRE PROOFING AND /OR THE TOP COAT PAINT SYSTEM SPECIFIED, WHERE APPLICABLE.
 - a. SHOP PAINT: TO CISC/CPMA 1-37A OR SSPC PAINT 15.
 - b. SHOP PRIMER: TO CISC/CPMA STANDARD 2-75

7.0 GROUT MORTAR

- .1 MASONRY GROUT: CONFORM TO CSA A179, MIN. COMPRESSIVE STRENGTH 30 MPa AT 28 DAYS, MAXIMUM AGGREGATE SIZE 10 mm.

1.0 GENERAL

- .1 ALL DIMENSIONS ARE METRIC UNLESS OTHERWISE NOTED. DO NOT SCALE DRAWINGS. ALL DOCUMENTS REFERENCED SHALL BE THE LATEST EDITION.
- .2 THE DESIGNATED CONSTRUCTOR SHALL PERFORM ALL WORK IN ACCORDANCE WITH THE CONTRACT DRAWINGS & SPECIFICATIONS.
- .3 THESE DESIGN DRAWING AND GUIDELINE HEREIN ARE SITE SPECIFIC AND ARE NOT TO BE USED AT ANY OTHER LOCATIONS AND ARE PREPARED FOR THE EXCLUSIVE USE OF TS ENGINEERING INC. FOR CREATING AN OPENING OF 305mm DIAMETER WITHIN A MASONRY WALL OF THE BUILDING LOCATED AT 210 SHERBROOK ST. IN PETERBOROUGH, ONTARIO.

2.0 REFERENCE STANDARDS/CODES AND ACTS

- CONFORM WITH THE NATIONAL BUILDING CODE OF CANADA 2020 (NBC), THE ONTARIO BUILDING CODE 2024 (OBC), AND ANY APPLICABLE ACTS OF ANY AUTHORITY HAVING JURISDICTION, BUT NOT LIMITED TO THE FOLLOWINGS:
- a) OCCUPATIONAL HEALTH AND SAFETY ACT, (OHS) & ITS REGULATIONS FOR CONSTRUCTION PROJECTS.
 - b) CSA-S350 "CODE OF PRACTICE FOR SAFETY IN DEMOLITION OF STRUCTURES".

- c) DESIGN OF STEEL STRUCTURES CAN/CSA-S16
- d) MASONRY CONSTRUCTION FOR BUILDINGS CAN3-A371
- e) REINFORCING STEEL INSTITUTE OF CANADA (RSIC), MANUAL OF STANDARD PRACTICE

3.0 SPECIAL PRECAUTIONS

- .1 THE DESIGNATED CONSTRUCTOR SHALL ENSURE THAT ALL WORK IS PERFORMED IN ACCORDANCE WITH THE OHS AND ITS REGULATIONS.
- .2 THE CONTRACTOR IS RESPONSIBLE FOR ANY COORDINATION WITH STRUCTURAL, MECHANICAL, ELECTRICAL AND OTHER TRADES.
- .4 SHOULD ANY CONCERNS BE IDENTIFIED DURING THE WORK, STOP ALL WORK AND IMMEDIATELY REPORT TO ENGINEER.
- .5 NOMINAL DIMENSIONS ARE SHOWN ON DRAWINGS. ACTUAL SITE DIMENSION MAY VARY AND ARE TO BE SITE CONFIRMED.
- .6 EXTRA CAUTION NEEDS TO BE TAKEN WORKING AROUND LIVE MECHANICAL SERVICES, PIPES AND CONDUITS.
- .7 CSE RESERVES THE RIGHT TO UPDATE THE DESIGN BASED ON ANY NEW INFORMATION AS IT BECOMES AVAILABLE.

DRAWING 17" x 11"

	REVISION 00 ISSUED FOR TENDER	CLIENT TS ENGINEERING	CSE PROJECT NO. & DATE 2736.26 - 01/20/2026	DWG. NO.:
	Structural Forensic & Rehabilitation Services Barrie - 36 Macmillan Crescent, Barrie, (ON) L4N-7H1 Toronto - 701-1120 Finch Ave. W, Toronto (ON) M3J 3H7 Phone: 416-876-4357 Fax: 705-725-9949	CLIENT PROJECT 210 SHERBROOKE ST. PETERBOROUGH(ON)	DRAWN / CHECKED BY: JC / HH / GC	S1-01
		DWG TITLE WALL OPENING DETAILS & GENERAL NOTES	CARVAJAL STRUCTURAL ENGINEERS INC	