

GENERAL DEMOLITION NOTES


- SITE VERIFY ALL DIMENSIONS AND CONDITIONS.
- ALL WORK TO BE IN ACCORDANCE WITH THE ONTARIO BUILDING CODE AND THE OCCUPATIONAL HEALTH AND SAFETY ACT REGULATIONS FOR CONSTRUCTION PROJECTS.
- PROVIDE PROTECTION IN LOCATIONS APPROVED BY THE OWNER AND CONSULTANT SO AS NOT TO DAMAGE EXISTING STRUCTURE, LANDSCAPE OR PART THEREOF.
- COMPLETE ALL DEMOLITION WORK NECESSARY TO COMPLETE THE RENOVATIONS AS SHOWN AND AS REQUIRED. DEMOLITION OF BUILDING ELEMENTS INCLUDES COMPLETE REMOVAL OF ALL ASSOCIATED FIXTURES, FITTINGS, HARDWARE, FASTENERS, EQUIPMENT AND ACCESSORIES UNLESS NOTED OTHERWISE.
- ARCHITECTURAL, STRUCTURAL, MECHANICAL AND ELECTRICAL DEMOLITION DRAWINGS ARE COMPLEMENTARY AND SHALL BE READ TOGETHER.
- PROVIDE ALL SHORING AS REQUIRED. SHORING SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER.
- NOTIFY CONSULTANT OF LOAD BEARING MEMBERS OR ASSEMBLIES IDENTIFIED OR DISCOVERED DURING WORK AND NOT INDICATED ON DRAWINGS. DO NOT PROCEED WITH REMOVALS WITHOUT PRIOR REVIEW BY THE CONSULTANT.
- PROVIDE TEMPORARY SUPPORT OF PIPES, DUCTS AND ELECTRICAL CHASES AS REQUIRED FOR SAFE REMOVAL. EXISTING AND PROPOSED SUPPORTS ARE TO BE REVIEWED BY THE CONSULTANT PRIOR TO THE REMOVAL OF ANY COMPONENTS WHICH MAY FALL OR CAUSE OTHERS TO FALL.
- MAINTAIN WORK AREAS AND STORAGE AREAS CLEAN AND ORDERLY AT ALL TIMES.
- REMOVAL OF EXISTING FLOOR FINISHES IS TO INCLUDE COMPLETE REMOVAL OF BASE AND ALL MORTAR AND ADHESIVES AND PREPARATION OF EXISTING SUBSTRATES TO RECEIVE NEW FLOORING, SATISFACTORY TO THE MANUFACTURER OF NEW FLOOR FINISHES. ALLOW FOR EXCESSIVE LEVELING OF SLABS.
- DEMOLITION INCLUDES ALL ASSOCIATED MECHANICAL AND ELECTRICAL SERVICES, EQUIPMENT, FITTINGS, FIXTURES, HANGERS, BRACKETS, TRIM AND ACCESSORIES AS REQUIRED TO COMPLETE THE WORK.
- SAWCUT, BREAK OUT AND MAKE GOOD ALL EXISTING FLOOR SLABS WHERE REQUIRED TO INSTALL NEW UNDERGROUND PLUMBING AND OTHER BURIED SERVICES AS INDICATED ON MECHANICAL AND ELECTRICAL DRAWINGS.
- MAINTAIN EXISTING FIRE RATINGS.
- REMOVAL OF DOORS AND FRAMES IS TO INCLUDE REMOVAL OF ALL HARDWARE. ALL HARDWARE TO BE TURNED OVER TO THE OWNER.
- REMOVE ALL PROTRUSIONS IN FLOOR SLAB AND GRIND DOWN TO FLOOR LEVEL.
- CLEAN AND REPAIR ALL EXISTING SURFACES TO REMAIN, AS NECESSARY TO RECEIVE NEW FINISHES.
- DISCONNECT AND CAP OFF ALL SERVICES PRIOR TO DEMOLITION.
- DISPOSE OF MATERIALS OFF SITE.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ANY DAMAGE TO THE EXISTING STRUCTURE OR FINISHES SHOWN TO REMAIN AND REPAIR / REPLACE SAME TO THE SATISFACTION OF THE OWNER AND CONSULTANT.
- PATCH, REPAIR, MAKE GOOD AND PAINT WALL WHERE WALLS WHERE HEATERS HAVE BEEN REMOVED. COORDINATE WITH ELECTRICAL AND MECHANICAL.

DEMOLITION NOTES


- REMOVE AND DISPOSE OF EXISTING MILLWORK. PATCH AND MAKE GOOD ALL SURFACES.
- REMOVE AND DISPOSE OF EXISTING WALL TO EXTENT INDICATED IN PLAN. PATCH AND MAKE GOOD ALL SURFACES.
- REMOVE AND DISPOSE OF EXISTING FLOOR FINISHES INCLUDING BASE AND PREPARE SURFACE FOR NEW FINISH.
- REMOVE AND DISPOSE OF EXISTING CEILING INCLUDING LIGHTING AND DIFFUSER. BULKHEAD ALONG THE WINDOWS TO REMAIN. SEE ALSO MECH. & ELECT. DEMO. DRAWINGS.
- REMOVE BLACK BOARDS AND TACK BOARDS AS REQUIRED TO COMPLETE NEW WORK. PATCH, REPAIR AND MAKE GOOD ALL SURFACES.
- REMOVE EXISTING ROLLER SHADES AND STORE IN A SECURED STORAGE AND RE-INSTALL AFTER.
- REMOVE AND DISPOSE OF EXISTING STEEL STAIR, CONCRETE MID LANDING & RAILING IN IT'S ENTIRETY. PREPARE AREA FOR NEW STAIR. PATCH AND MAKE GOOD WALLS, FLOOR & CEILING.
- REMOVE AND DISPOSE EXISTING WALL HEATER. PATCH AND MAKE GOOD SURFACES. SEE ALSO MECH. DEMO. DRAWINGS.
- SHORE STRUCTURE, CUT NEW DOOR OPENING IN MASONRY WALL AND INSTALL NEW LINTEL.
- BREAKOUT TERRAZZO & FLOOR SLAB AS REQUIRED FOR NEW PLUMBING. RE-INSTALL FLOOR SLAB AFTER.
- REMOVE & DISPOSE OF EXISTING DOOR AND FRAME. PATCH, REPAIR AND MAKE GOOD ALL SURFACES.

DEMOLITION LEGEND


- EXISTING WALL, PARTITION OR COLUMN TO REMAIN
- DENOTES DEMOLITION OF BUILDING ELEMENT/PARTITIONS
- EXISTING DOOR, FRAME AND TRIM TO REMAIN
- EXISTING DOOR, FRAME AND TRIM TO BE CAREFULLY REMOVED AND DISPOSED.
- HATCH DENOTES APPROXIMATE EXTENT OF EX. FLOOR SLAB TO BE CUT FOR NEW PLUMBING

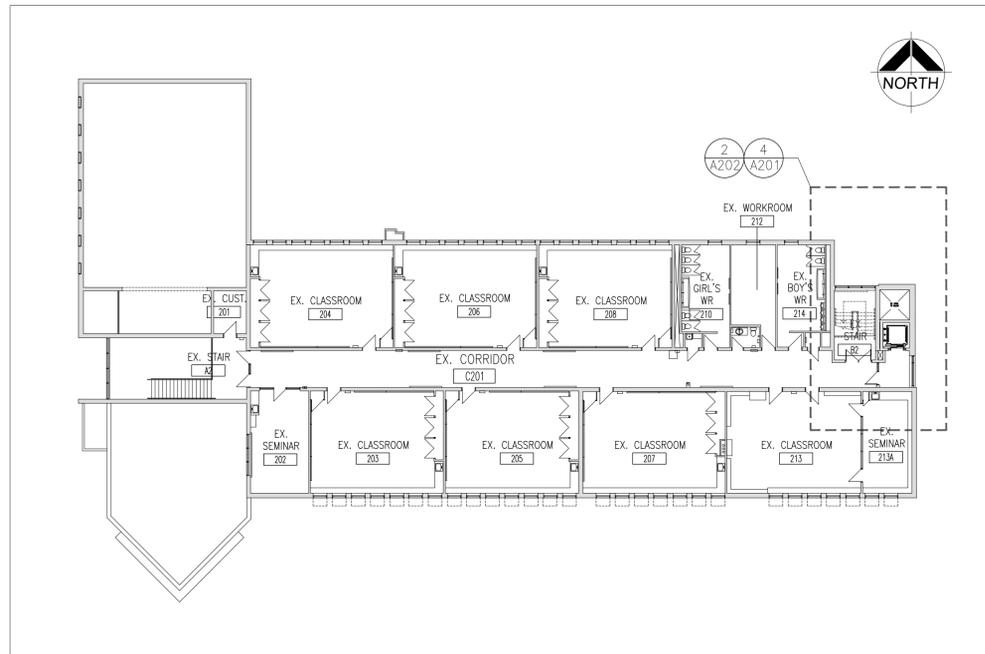


4 A202 EX. SECOND FLOOR KEY PLAN
1:250

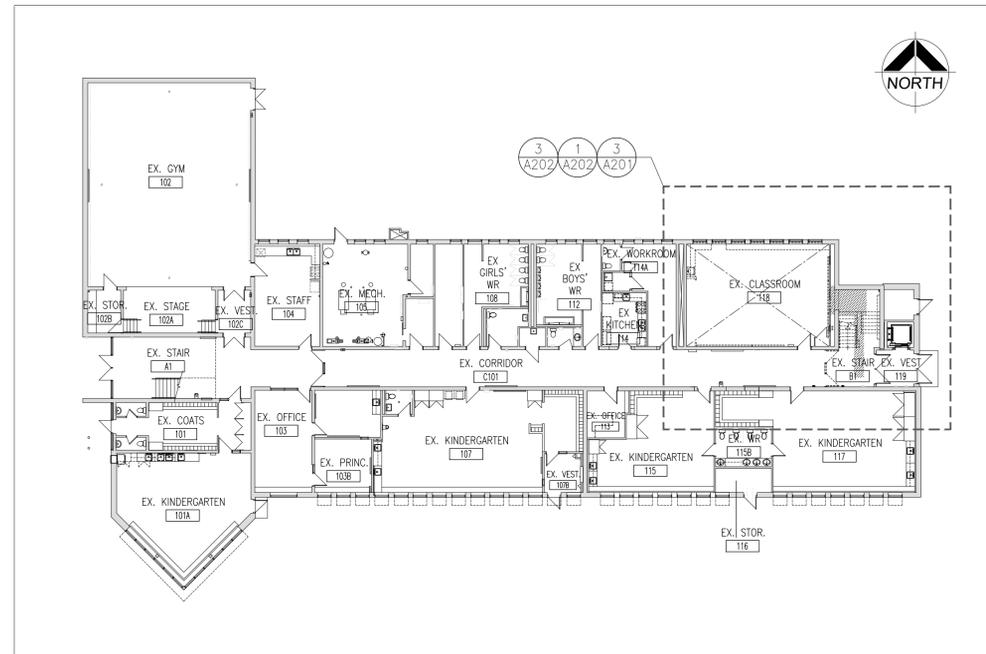

3 A202 EX. FIRST FLOOR KEY PLAN
1:250

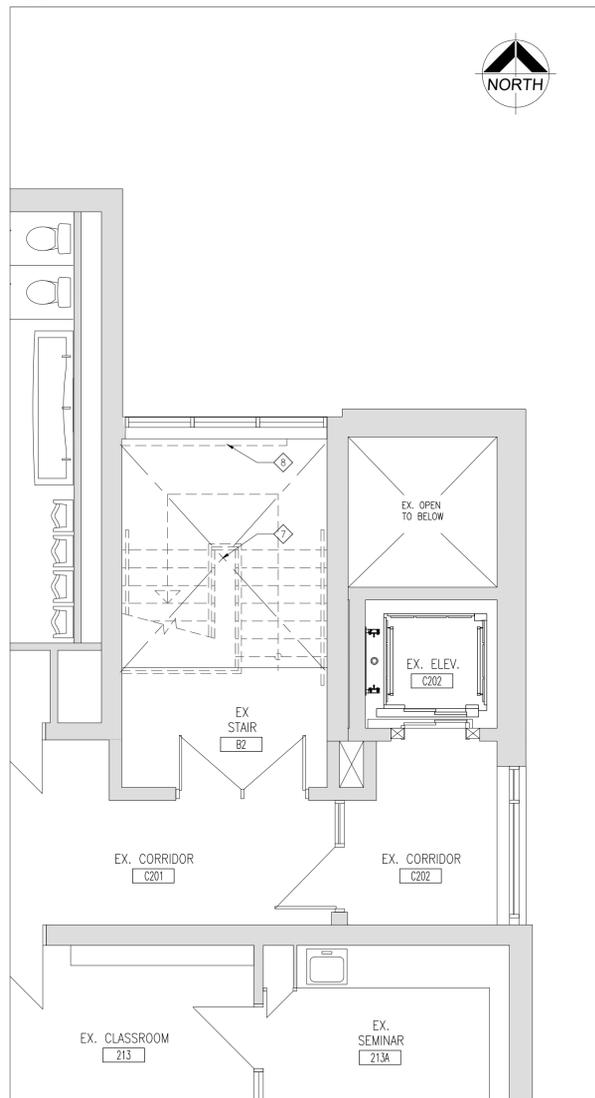

2 A201 EX. SECOND FLOOR DEMO. PLAN
1:50

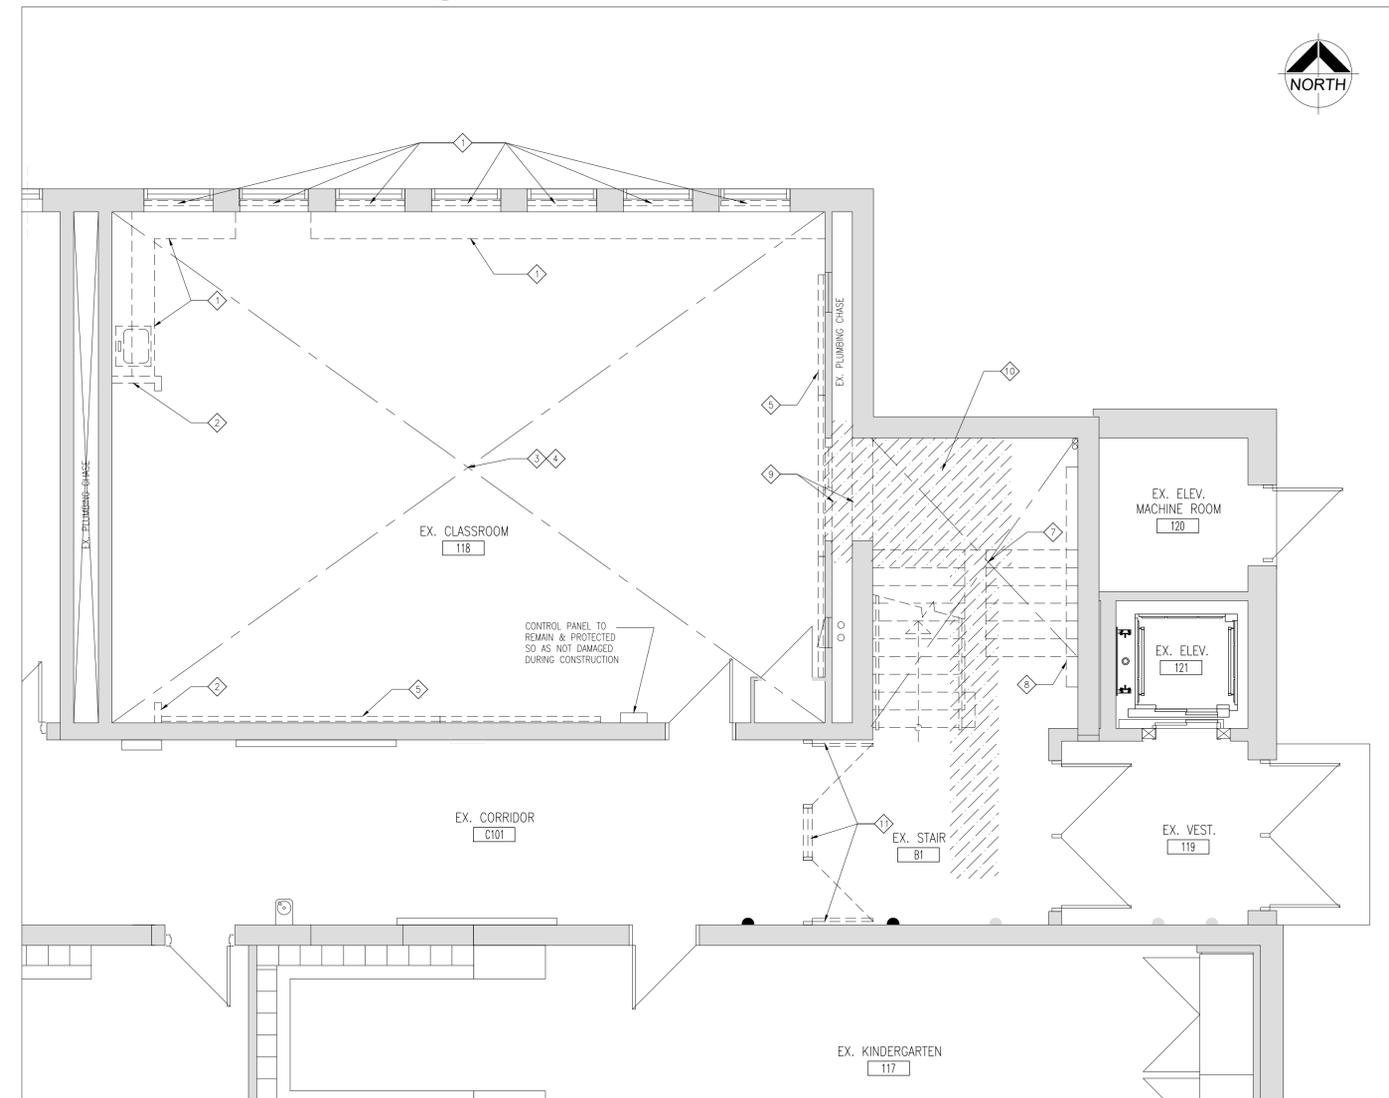

1 A201 EX. GROUND FLOOR DEMO. PLAN
1:50

DO NOT SCALE THE DRAWINGS. CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES/ REVISIONS	DATE	BY
1	ISSUED FOR CLIENT REVIEW	FEB. 27, 2026	BBA
2	ISSUED FOR PERMIT & TENDER	MAR. 6, 2026	BBA



PROJECT:
ECOLE ELEMENTAIRE
MICHELINE-SAINT-CYR
JK/SK RENOVATION

85 FORTY FIRST ST
ETOBICOKE, ONTARIO

DRAWING:
KEY PLANS & DEMOLITION
PLANS

DESIGN BY: W2
DRAWN BY: NV
CHECKED BY: -
DATE: DEC. 2025
SCALE: AS NOTED
PROJECT NO: 25205
DRAWING NO: A201



25205 A201

PARTITION TYPES SCHEDULE

- (P1) 140mm CONCRETE BLOCK TO U/S OF STRUCTURE
- (P2) 16mm TYPE 'X' GYPSUM BOARD 92mm METAL STUD @ 400 O.C. 90mm ACOUSTIC BATT INSULATION BET. 16mm TYPE 'X' GYPSUM BOARD
1 HOUR FIRE RESISTANT RATING BASED ON ULC DESIGN W407
PROVIDE CONT. FIRE STOP SEALANT TOP & BOT. EACH SIDE.
- (F1) 50mm RIGID INSULATION & 16mm MOISTURE/MOLD RESISTANT GYPSUM BOARD GLUED ONTO EXISTING MASONRY WALL

FLOOR PLAN NOTATION LEGEND

- CORRIDOR**
- CA ROOM NAME & NUMBER
 - EXX INTERIOR PARTITION OR FURRING TYPE
 - 101 DOOR NUMBER
 - DOOR WITH DOOR OPERATOR
 - ML1 MILLWORK NUMBER
 - 1 A200 WALL SECTION REFERENCE
 - PB BARRIER FREE DOOR OPERATOR PUSH BUTTON
- NEW DOOR**
- EXISTING DOOR**
- ROLLER SHADE**
- CONTROL PANEL**
- INTERIOR ELEVATION REFERENCE NUMBER**

CEILING NOTATION LEGEND


- CE1 CEILING TYPE (REFER TO CEILING TYPE SCHEDULE AND ROOM FINISH SCHEDULE)
- CE2 CEILING LEVEL ABOVE FINISHED FLOOR (SEE ALSO ROOM FINISH SCHEDULE)
- EXP EXPOSED STRUCTURE WITH PAINT FINISH
- SA SUPPLY AIR DIFFUSER (REFER TO MECHANICAL DRAWINGS)
- RA RETURN AIR GRILLE. SIZES VARY (REFER TO MECHANICAL DRAWINGS)
- EX EXHAUST FAN (REFER TO MECHANICAL DRAWINGS)
- LF LIGHT FIXTURES (REFER TO ELECTRICAL DRAWINGS)
- CEILING OR WALL MOUNTED EXT LIGHT (REFER TO ELECTRICAL DRAWINGS)

CEILING TYPES


- CE1 1220mmx610mm ACOUSTIC CEILING PANELS IN SUSPENDED T-BAR GRID
- CE2 13mm GYPSUM BOARD (PAINTED) ON METAL STUD FRAMING
- CE3 SHAFTWALL CEILING (1HR): 25mm TYPE 'X' GYPSUM BOARD LINER 64mm SHAFT STUDS 39mm GLASS FIBRE INSULATION 16mm TYPE 'X' GYPSUM BOARD F.R.R. REF. ULC#W452 SYSTEM 'A' PROVIDE CONT. FIRE STOP SEALANT AT ENDS

PARTITION & FURRING NOTES


1. UNLESS OTHERWISE NOTED, ALL PARTITIONS TERMINATE AT UNDERSIDE OF FLOOR OR ROOF STRUCTURE, U.N.O.
2. ALL GYPSUM BOARD BULKHEADS AND PARTITIONS ABOVE MASONRY WALLS OR GLAZING TO BE BRACED AS REQUIRED (TYP.).
3. ALL OUTSIDE CORNERS OF EXPOSED INTERIOR BLOCK WALLS TO BE BULLNOSED BLOCKS. GROUNDING CORNERS ON A JIG WILL BE REJECTED.
4. ALL FULL HEIGHT MASONRY PARTITIONS SHALL BE CONNECTED TO THE U/S OF ROOF DECK U.N.O.
5. ALL ENDS OF TERMINATED EXPOSED MASONRY BLOCK WALLS MUST BE GROUTED SOLID INCLUDING DOORS/ OPENINGS.
6. PROVIDE FIRE STOPPING/ SMOKE SEAL AT TOPS OF ALL RATED PARTITIONS/ FURRING TYPES AT UNDERSIDE OF ROOF DECK C/W INFILL OF FLUTES.
7. ALL PENETRATIONS THROUGH RATED PARTITIONS/ FIREWALL ARE TO BE FIRESTOPPED WITH LISTED FIRESTOPPING SYSTEM.

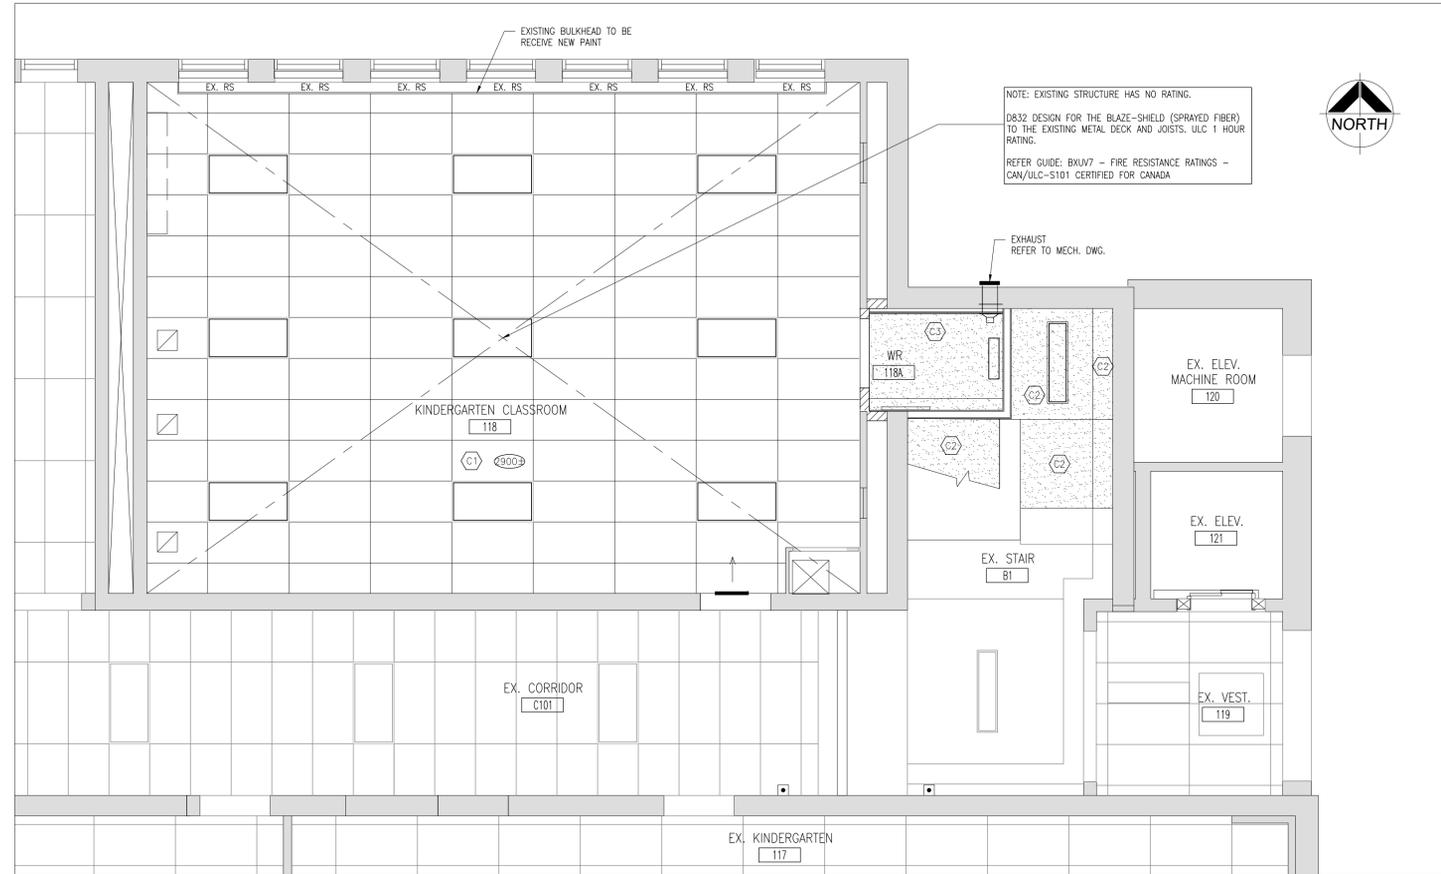

3 PART GROUND REFLECTED CEILING PLAN
1:50

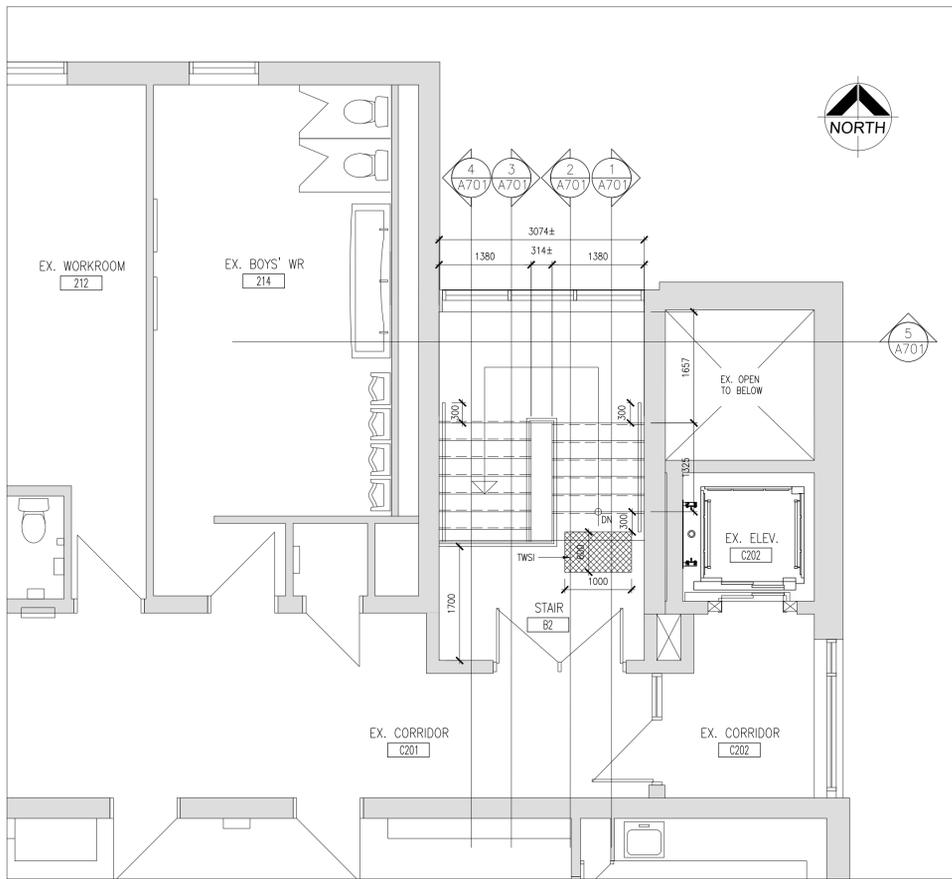

2 PART SECOND FLOOR PLAN
1:50

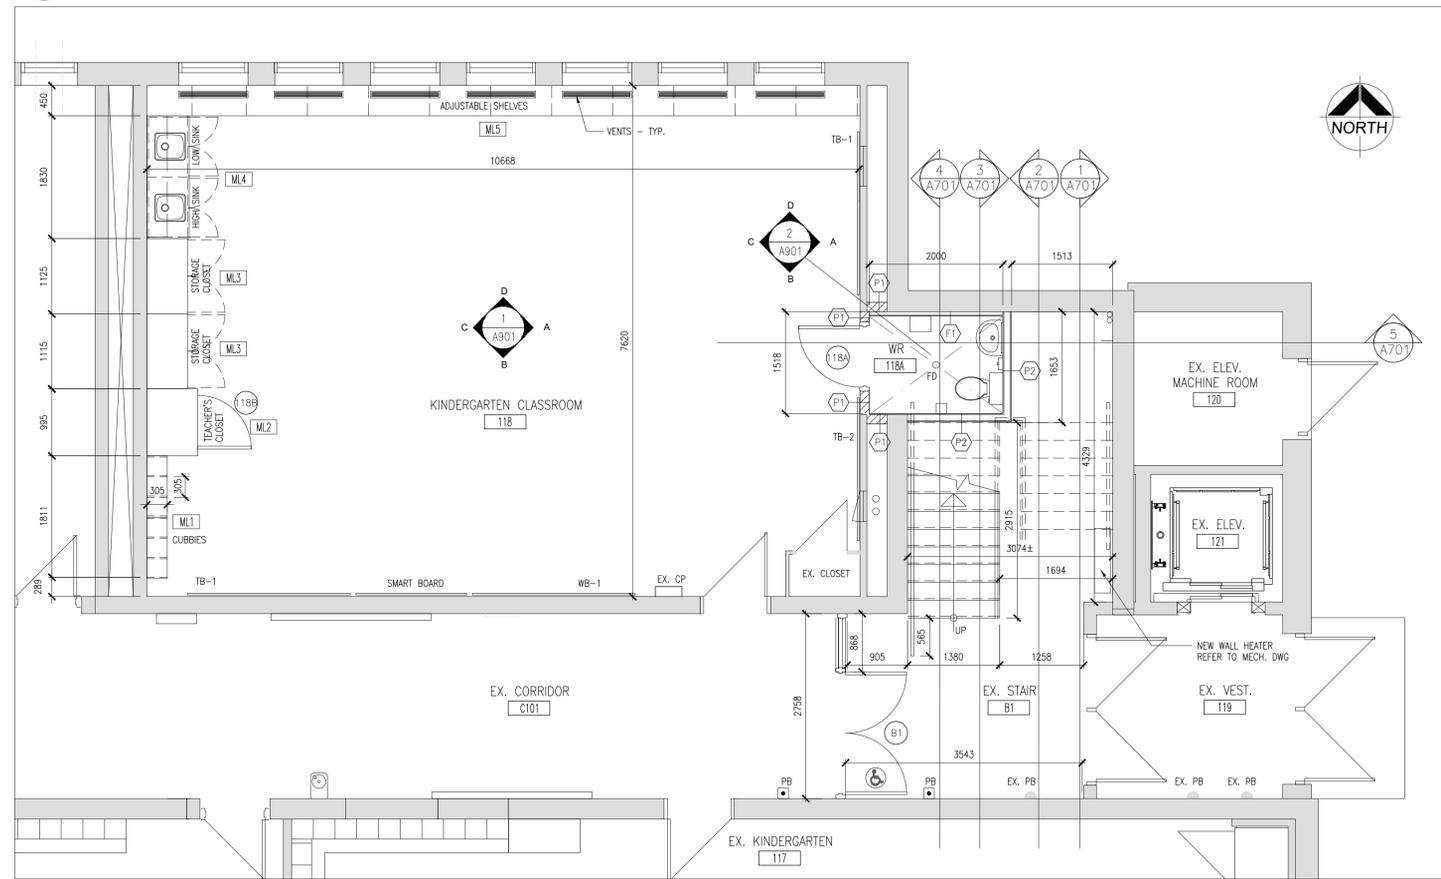

1 PART GROUND FLOOR PLAN
1:50

DO NOT SCALE THE DRAWINGS. CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES/ REVISIONS	DATE	BY
1	ISSUED FOR CLIENT REVIEW	FEB. 27, 2026	BBA
2	ISSUED FOR PERMIT & TENDER	MAR. 6, 2026	BBA



PROJECT:
ECOLE ELEMENTAIRE MICHELINE-SAINT-CYR JK/SK RENOVATION

85 FORTY FIRST ST
ETOBICOKE, ONTARIO

DRAWING:
FLOOR PLANS

DESIGN BY: W2
DRAWN BY: NV
CHECKED BY:
DATE: DEC. 2025
SCALE: AS NOTED
PROJECT NO:
DRAWING NO:



25205 A202


DO NOT SCALE THE DRAWINGS.
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.

ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE
COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED
UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE
WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.


DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED
AND SEALED BY THE CONSULTANT.




NO.	ISSUES/ REVISIONS	DATE	BY
1	ISSUED FOR CLIENT REVIEW	FEB. 27, 2026	BBA
2	ISSUED FOR PERMIT & TENDER	MAR. 6, 2026	BBA

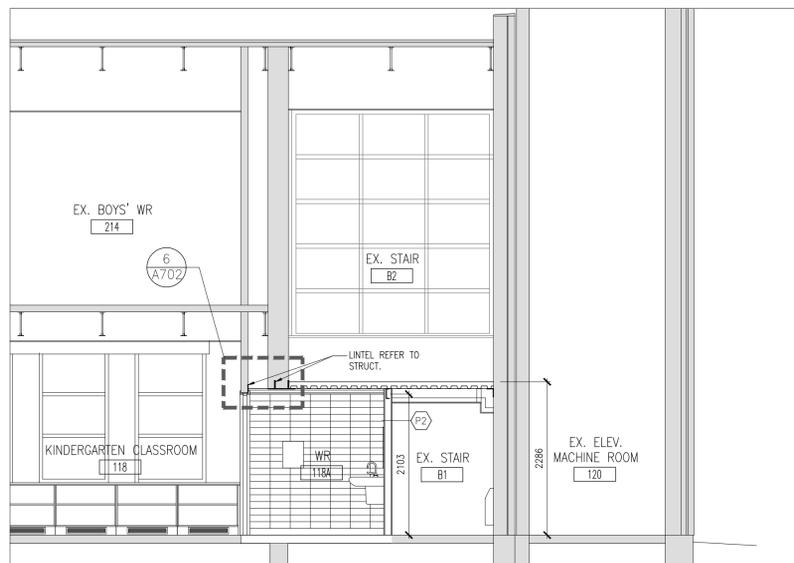


5 STAIR SECTION
A701 1:50

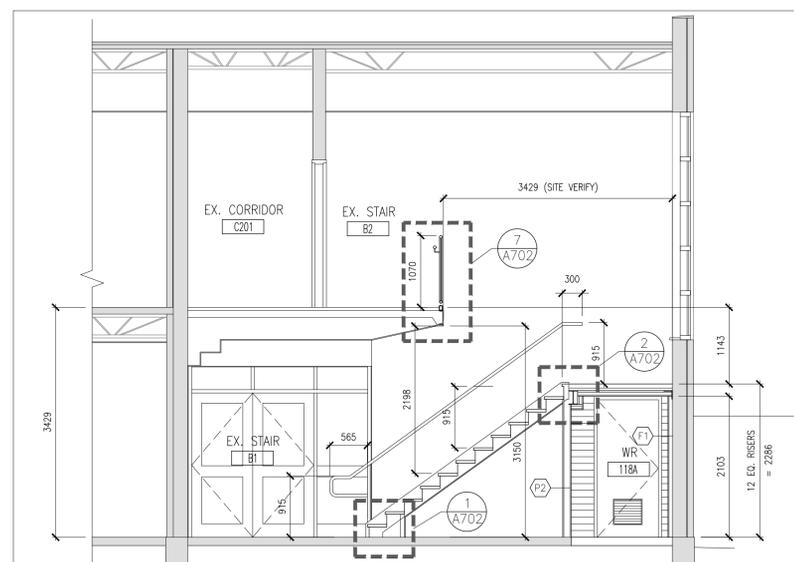


4 STAIR SECTION
A701 1:50

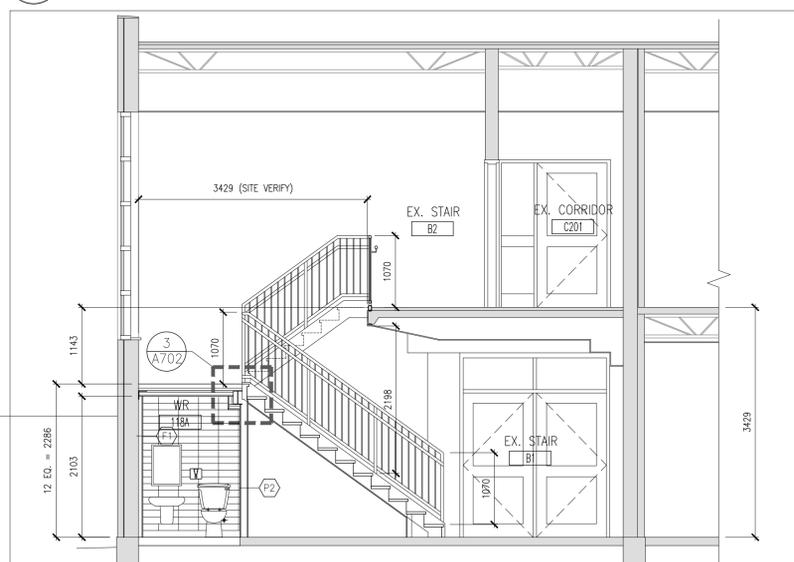

3 STAIR SECTION
A701 1:50

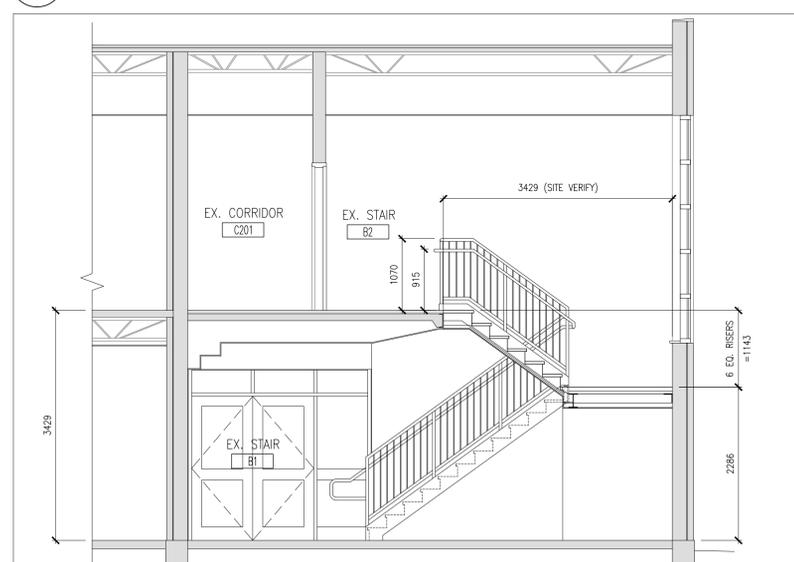

2 STAIR SECTION
A701 1:50

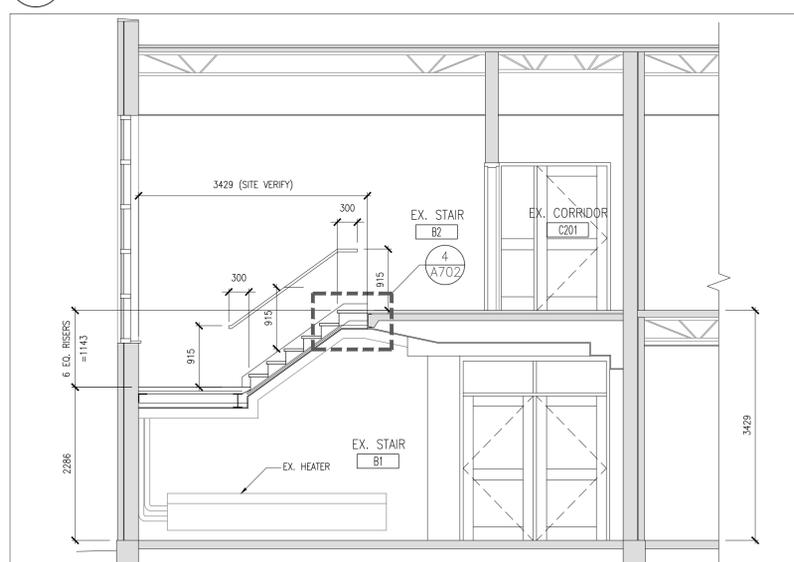

1 STAIR SECTION
A701 1:50



PROJECT:
ECOLE ELEMENTAIRE
MICHELINE-SAINT-CYR
JK/SK RENOVATION

85 FORTY FIRST ST
ETOBICOKE, ONTARIO

DRAWING:
STAIR SECTIONS & DETAILS

DESIGN BY: W2
DRAWN BY: NV
CHECKED BY:
DATE: DEC. 2025
SCALE: AS NOTED




PROJECT NO: 25205
DRAWING NO: A701


DO NOT SCALE THE DRAWINGS.
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE
COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED
UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE
WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED
AND SEALED BY THE CONSULTANT.




NO.	ISSUES/ REVISIONS	DATE	BY
1	ISSUED FOR CLIENT REVIEW	FEB. 27, 2026	BBA
2	ISSUED FOR PERMIT & TENDER	MAR. 6, 2026	BBA

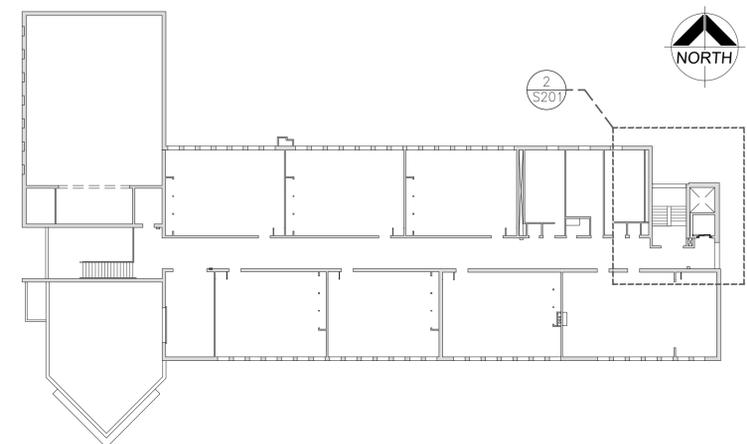


4 SECOND FLOOR KEY PLAN
1:300

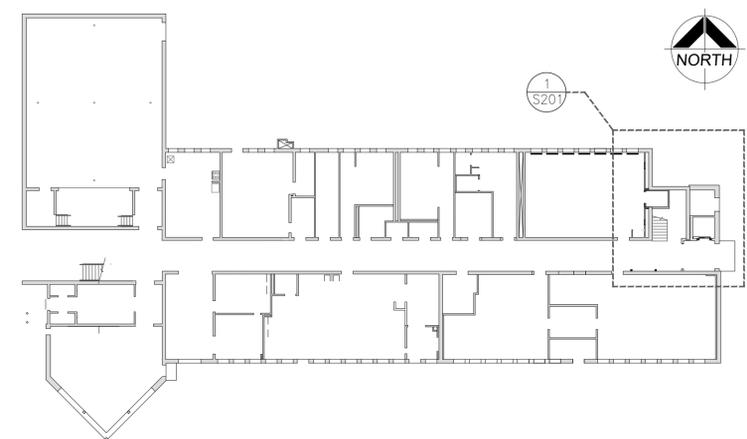


3 GROUND FLOOR KEY PLAN
1:300

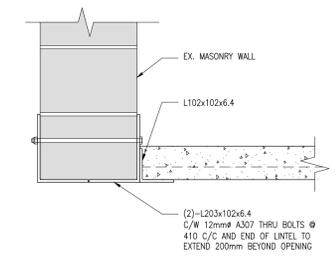


8 DETAIL
S201 1:10

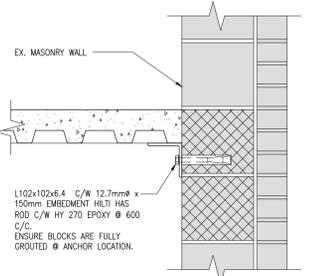

6 DETAIL
S201 1:10

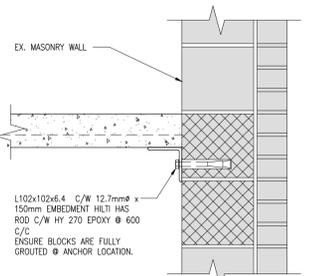

5 DETAIL
S201 1:10

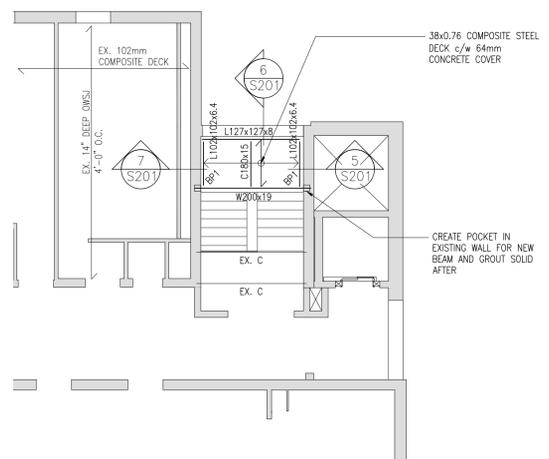


2 PART SECOND FLOOR FRAMING PLAN
1:100

DESIGN LOADS:

STAIR LANDING:	
DEAD LOAD	= 1.90 kPa
102 COMPOSITE DECK	= 0.10 kPa
FLOOR FINISHES	= 0.20 kPa
M/E	= 0.15 kPa
MISCELLANEOUS FIREPROOFING	= 0.05 kPa
TOTAL	= 2.40 kPa

2ND FLOOR:	
DEAD LOAD	= 1.90 kPa
102 COMPOSITE DECK	= 0.10 kPa
FLOOR FINISHES	= 0.25 kPa
M/E	= 0.20 kPa
CEILING	= 0.25 kPa
MISCELLANEOUS FIREPROOFING	= 0.05 kPa
TOTAL	= 2.75 kPa

LIVE LOAD = 4.8 kPa

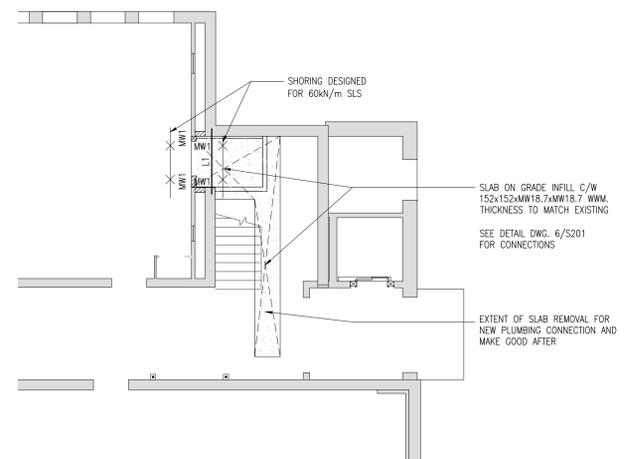

1 PART FOUNDATION PLAN
1:100



PROJECT:
ECOLE ELEMENTAIRE
MICHELINE-SAINT-CYR
JK/SK RENOVATION

85 FORTY FIRST ST
ETOBICOKE, ONTARIO

DRAWING:
KEY PLANS, PART PLANS,
& DETAILS

DESIGN BY: HM
DRAWN BY: NV
CHECKED BY: DM
DATE: DEC. 2025
SCALE: AS NOTED



PROJECT NO: 25205
DRAWING NO: S201

LEGEND (NOT ALL SYMBOLS SHOWN ON THIS LEGEND ARE NECESSARILY USED ON THIS PROJECT)

EXISTING/DEMOLISHED PIPING:

---[TYPE]---	EXISTING PIPEWORK TO BE DEMOLISHED
---[TYPE]---	EXISTING PIPEWORK TO REMAIN
---DCW---	EXISTING DOMESTIC COLD WATER
---DHW---	EXISTING DOMESTIC HOT WATER
---DHWRC---	EXISTING DOMESTIC HOT WATER RECIRC.

PLUMBING:

---DCW---	DOMESTIC COLD WATER
---DHW---	DOMESTIC HOT WATER
---DHWRC---	DOMESTIC HOT WATER RECIRC.
---SW---	SOFTENED DOMESTIC WATER
---TW---	DOMESTIC TEMPERED WATER
---NPW---	NON-POTABLE WATER PIPE
---SAN---	SANITARY DRAINAGE
---SAN---	SANITARY DRAINAGE (BELOW)
---V---	SANITARY VENT
---STW---	STORM WATER DRAINAGE
---STW---	STORM WATER DRAINAGE (BELOW)

FUEL PIPING:

---G---	NATURAL GAS
---------	-------------

HEATING/COOLING PIPING:

---HWS---	HEATING WATER SUPPLY
---HWR---	HEATING WATER RETURN
---DTWS---	DUAL TEMPERATURE WATER SUPPLY
---DTWR---	DUAL TEMPERATURE WATER RETURN
---CWS---	CHILLED WATER SUPPLY
---CWR---	CHILLED WATER RETURN
---RL---	REFRIGERANT LIQUID SUPPLY
---RV---	REFRIGERANT VAPOUR RETURN

SPRINKLER AND FIRE PROTECTION PIPING

---	FIRE PROTECTION ZONE
---	FIRE PROTECTION RATING
---F---	XXXG FIRE PROTECTION PIPE
---SP---	XXXG SPRINKLER MAIN
---	XXXG SPRINKLER BRANCH PIPING
---DSP---	XXXG DRY SPRINKLER PIPING
---PA---	XXXG PRE-ACTION SPRINKLER PIPING

VALVES

EXISTING	DEMO	NEW	
---	---	---	GATE VALVE
---	---	---	BALL VALVE
---	---	---	GLOBE VALVE (TOP / SIDE)
---	---	---	CIRCUIT BALANCING VALVE
---	---	---	TWO-WAY CONTROL VALVE
---	---	---	SOLENOID OPERATED VALVE
---	---	---	PLUG VALVE
---	---	---	BACK FLOW PREVENTER
---	---	---	SWING CHECK VALVE
---	---	---	SPRING TYPE CHECK VALVE
---	---	---	REDUCED PRESSURE BACKFLOW PREVENTER
---	---	---	DOUBLE CHECK VALVE ASSEMBLY
---	---	---	GAS PRV
---	---	---	SAFETY OR RELIEF VALVE
---	---	---	HOSE BIBB VALVE

VENTILATION:

---	TERMINAL BOX / WITH ATTENUATOR / AND REHEAT COIL
---	EXISTING DUCT TO REMAIN (TYPE INDICATED)
---	EXISTING DUCT TO BE DEMOLISHED
---	SUPPLY AIR DUCT
---	RETURN AIR DUCT
---	TRANSFER AIR DUCT
---	OUTDOOR AIR DUCT
---	GENERAL EXHAUST DUCT
---	WASHROOM EXHAUST DUCT
---	KITCHEN EXHAUST DUCT
---	FUME HOOD EXHAUST DUCT
---	RECTANGULAR DUCTS UP (SUPPLY / RETURN / EXHAUST)
---	RECTANGULAR DUCTS DOWN (SUPPLY / RETURN / EXHAUST)
---	MOTORIZED DAMPER / BALANCING DAMPER
---	FIRE DAMPER / SMOKE DAMPER / COMBINATION FIRE-SMOKE DAMPER
---	ROUND ELBOWS - 45°: R1.0 / R1.5 / R2.0
---	ROUND ELBOWS - 90°: R1.0 / R1.5 / R2.0
---	RECTANGULAR ELBOWS - 45°: R1.0 / R1.5
---	RECTANGULAR ELBOWS - 90°: R1.0 / R1.5
---	RECTANGULAR ELBOWS WITH TURNING VANES (90° R1.0 / 45° R1.0 / 90° SQUARE)
---	ACOUSTICALLY LINED DUCT
---	GRILLES AND DIFFUSERS: SUPPLY / RETURN / EXHAUST
---	SUPPLY DIFFUSERS: SQUARE / ROUND PLAQUE OR CONE
---	HORIZONTAL OR WALL GRILLES / DIFFUSER: SUPPLY / RETURN OR EXHAUST.

PLUMBING & DRAINAGE

---	FUNNEL FLOOR DRAIN / FLOOR DRAIN / FLOOR DRAIN WITH TRAP
---	HUB DRAIN / WITH TRAP
---	CLEAN OUT PLUG / FLOOR
---	P-TRAP / SINK TRAP / P-TRAP BELOW GRADE
---	HOT / DRAIN / COLD CONNECTIONS

CONTROLS

---	CONTROL WIRE
---	THERMOSTAT / SPACE TEMPERATURE SENSOR
---	THERMOSTAT WITH GUARD
---	HUMIDISTAT / HUMIDITY SENSOR
---	CO2 SENSOR
---	SWITCH
---	PUSH BUTTON

FIRE PROTECTION

NOTE: DEMOLISHED ITEMS WITH "R" DENOTES "SAVE FOR REINSTALLATION IN NEW LOCATION"

●	PENDANT
⊙	PENDANT (EXISTING TO REMAIN)
⊙	PENDANT (DEMOLISHED)
⊙	PENDANT (REMOVE AND REINSTALL IN NEW LOCATION)
⊙	RECESSED
○	UPRIGHT
⊖	CONCEALED
⊖	DRY PENDANT
⊖	DRY PENDANT (EXISTING)
⊗	PRE-ACTION
⊗	CONCEALED SIDEWALL
⊗	RECESSED SIDEWALL
⊗	FIRE EXTINGUISHER
⊗	FIRE EXTINGUISHER (EXISTING)
⊗	SURFACE MOUNTED F.E. CABINET
⊗	SEMI-RECESSED F.E. CABINET
⊗	FULLY RECESSED F.E. CABINET
⊗	FIRE DEPARTMENT CONNECTION
⊗	FIRE DEPARTMENT TEST CONNECTION

PIPE ANNOTATION

---	UP FROM BELOW / UP TO ABOVE
---	DOWN TO BELOW / DOWN FROM ABOVE
---	VENT UP FROM BELOW / UP TO ABOVE
---	VENT UP FROM BELOW / UP TO VENT CAP
---	PIPEWORK SHORTENED FOR CLARITY
---	PIPEWORK CONTINUED ELSEWHERE
---	PIPEWORK SHORTENED FOR CLARITY (ALTERNATE SYMBOL)
---	PIPE FLOW ARROW (SMALL)
---	PIPE FLOW ARROW (LARGE)

EQUIPMENT:

---	PUMP
---	RADIANT PANEL
---	UNIT HEATER (HORIZONTAL)
---	UNIT HEATER (VERTICAL)

TAGS:

---	SCHEMATIC INLET/OUTLET
---	PLUMBING FIXTURE TYPE TAG
---	GRILLE / DIFFUSER TAG
---	FIN TUBE RADIATION TAG
---	RADIANT PANEL TAG
---	EQUIPMENT IDENTIFICATION TAG
---	TIE-IN POINT

GENERAL NOTES:

NOTE:	DESCRIPTION:
1.	THIS DRAWING SET SHALL BE READ IN CONJUNCTION WITH ARCHITECTURAL DRAWINGS.
2.	THIS DRAWING SET SHALL BE READ IN CONJUNCTION WITH THE MECHANICAL SPECIFICATIONS PROVIDED.
3.	THESE DRAWINGS DO NOT REPRESENT A FULLY COORDINATED INFORMATION PACKAGE FOR THE PURPOSES OF CONSTRUCTION, AND DO NOT RELIEVE THE CONTRACTOR OF THE REQUIREMENT TO COORDINATE THE WORK IN ALL RESPECTS.
4.	IT IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE THE WORK OF ALL TRADES AND SUPPLIERS TO ACHIEVE COMPLETE AND OPERATIONAL BUILDING SYSTEMS.
5.	DO NOT SCALE DRAWINGS. LOCATIONS OF ITEMS ARE APPROXIMATE AND ARE INTENDED TO BE USED FOR COORDINATION. EXACT LOCATIONS ARE DEPENDANT UPON SITE CONDITIONS. REVIEW ANY REVISIONS WITH CONSULTANT.
6.	ALL EXISTING EQUIPMENT TO REMAIN SHALL BE INSPECTED AND TESTED FOR PROPER OPERATIONS. REPORT RESULTS OF INSPECTION AND TESTING TO CONSULTANT.

DRAWING LIST:

DRAWING:	DESCRIPTION:	SCALE:
M-01	MECHANICAL DRAWING LIST, LEGEND, EQUIPMENT SCHEDULES AND GENERAL NOTES	N.T.S.
M-02	MECHANICAL SPECIFICATIONS	N.T.S.
M-03	MECHANICAL CONSTRUCTION PLANS	1:50
M-04	MECHANICAL DEMOLITION PLANS	1:50
M-05	RESERVED	N.T.S.

EXHAUST FAN SCHEDULE

* ALTERNATIVE MANUFACTURER: JENCO, COOK

REFERENCE	AIR FLOW L/S (CFM)	E.S.P. in. WC.	MOTOR HP (WATT / AMP)	RPM	MANUF.	MODEL	ELECTRICAL			REMARK
							VOLT	PHASE	HZ	
EF-1	38 (80)	0.12	1/10 HP (1.5 A)	988	GREENHECK	SE1-8-440-VG	115	1	60	CONTROL: INTERLOCK WITH LIGHT

PLUMBING FIXTURE SCHEDULE

FIXTURE SYMBOL	DESCRIPTION	MANUFACTURER	MODEL	CONNECTION SIZES-MM				REMARKS
				C.W.	H.W.	DRAIN	VENT	
WC-1	TANK TYPE TOILET	AMERICAN STANDARD	CADET PRO ROUND FRONT TOILET 3517D 101 BOWL, 4188A 004 TANK	12	-	75	1 1/4"	CENTOCO 300CC-001 SEAT, OPEN FRONT. COMPLETE FLOOR FLANGE.
L-1	WALL HUNG LAVATORY	AMERICAN STANDARD	MURRO UNIVERSAL DESIGN 0955.001 WALL HUNG, CENTER HOLE	12	12	32	32	AMERICAN STANDARD COLONY PRO 7075.104 SINGLE CONTROL FAUCET LAWLER MODEL TMM-1070, MIXING VALVE WITH THERMOSTATIC LIMIT STOP FLOOR MOUNTED LAV CARRIER WITH CONCEALED ARMS SIMILAR TO Z1231EZ OR EQUIVALENT. COMPLETE WITH ZURN Z8746-PC OFFSET STRAINER, Z8700-8-PC P-TRAP, WATER SUPPLY STOPS.
S-1	SINK UNDERMOUNT	KINDRED	LBS6808P-1 SINGLE SINK	12	12	40	32	AMERICAN STANDARD MONTERREY TWO HANDLE 8409.170 TOP MOUNT KITCHEN FAUCET LAWLER MODEL TMM-1070, MIXING VALVE WITH THERMOSTATIC LIMIT STOP COMPLETE WITH ZURN Z8702-9-PC P-TRAP, WATER SUPPLY STOPS.
FD-1	FLOOR DRAIN	WATTS	FD-100-CAS-1 (FINISHED FLOOR)	-	-	75	-	EPOXY COATED, CAST IRON BODY, VANDAL PROOF WITH PRIMER CONNECTION WITH PLUG.

REGISTERS, GRILLES AND DIFFUSERS SCHEDULE

REFERENCE	FUNCTION	CONFIGURATION	MODEL NUMBER	CEILING / MOUNTING TYPE	REMARKS:
A	SUPPLY PERIMETER HEATER	LINEAR BAR GRILLE	150 (6") LBP-CORE 15A	SURFACE MOUNT	1/4" BLADE SPACING, ZERO DEFLECTION, TOTAL LENGTH 7 METER, C.W BLANK-OFF SECTION FOR NON-ACTIVE GRILLE (ACTIVE SECTION - WINDOW WIDTH)
B	RETURN	EGG CRATE	300X300/80/B12	T-BAR	CW 300X300 RETURN PLENUM
C	SUPPLY	SUPPLY GRILLE	530/F/A/B12	DUCT MOUNT	CW VOLUME DAMPER. REFER TO PLANS FOR SIZE

SYMBOL CLARIFICATION: C-800480-800 C-DIFFUSER/GRILLE TYPE 800MM GRILLE SIZE 800 AIR QUANTITY L/S
SELECTION BASED ON: EN PRICE

ENTRANCE AND UNIT HEATER SCHEDULE

REFERENCE	HEATING CAPACITY OUTPUT (MBH) AT 150F EWT	WATER FLOW (GPM)	AIR FLOW (CFM)	MANUFACTURER	MODEL	FAN MOTOR (HP)	MOTOR (AMPS)	POWER SUPPLY	
								VOLTS	PHASE
EH-1	30.5	3.07	370	ENGA	CUH-4	1/20	1.2	120	1

WALL FIN SCHEDULE

REF.	BTU/LINEAR FOOT	ROWS	ELEMENT	MANUFACTURER	DESCRIPTION
H	1060	1	4"x4" FIN, 50FIN/FT	ENGA	BARE FIN

LENGTH OF ELEMENTS (FT)
REF. TYPE
HEAT OUTPUT (MBH)
AVERAGE WATER TEMPERATURE 170 ° F

DO NOT SCALE THE DRAWINGS. CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES/ REVISIONS	DATE	BY
1	60% PROGRESS REVIEW	02-13-2026	ET/TL
2	ISSUED FOR PERMIT AND TENDER	03-06-2026	ET/TL

MCW Consultants Ltd.
 Vancouver | Calgary
 Edmonton | Guelph
 Winnipeg | Toronto
 Thunder Bay
 Ottawa | Montreal
 Saint John | Toronto
 Halifax
 25104-05
 Queen's Quay Terminal
 207 Queen's Quay West, Suite 615
 Toronto, Ontario, M5J 1A7
 Tel: 416-598-2820
 Fax: 416-598-8204
 www.mcw.com

BBA
 BARRY BRYAN ASSOCIATES

PROJECT:
 ECOLE ELEMENTAIRE
 MICHELINE-SAINT-CYR
 JK/SK RENOVATION


85 FORTY FIRST ST
 ETOBICOKE, ONTARIO

DRAWING:
 MECHANICAL DRAWING LIST,
 LEGEND, EQUIPMENT
 SCHEDULE AND
 GENERAL NOTES

DESIGN BY: ET
 SEAL:
 DRAWN BY: ET
 CHECKED BY: PT
 DATE: DEC. 2025
 SCALE: AS NOTED
 PROJECT NO: DRAWING NO:




25104-05 M-01

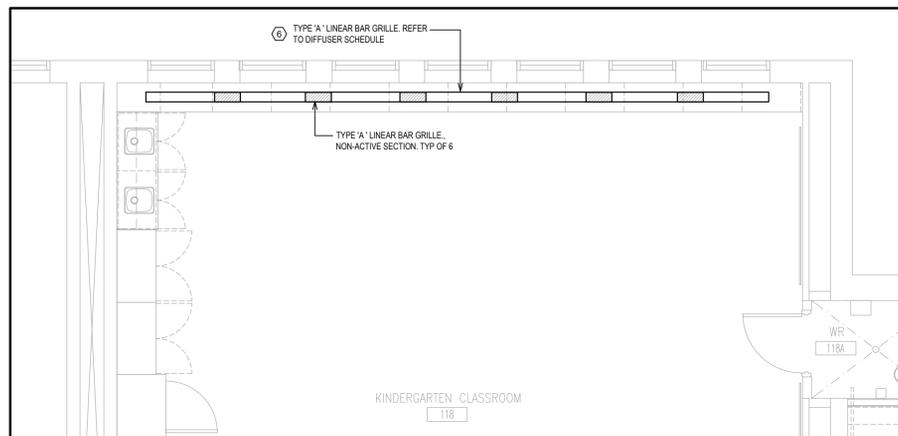


3 PERIMETER HEATING SUPPLY GRILLE
M-03 1:50

KEYNOTE:	DESCRIPTION:
1	EXISTING DUCTWORK TO REMAIN. REPLACE SUPPLY GRILLE WITH NEW TYPE C GRILLE. BALANCE AIR QUANTITY AS SHOWN. REPLACE EXISTING RETURN AIR GRILLE WITH TYPE B GRILLE. PROTECT ALL DUCT OPENINGS FROM DUST DURING CONSTRUCTION.
2	PROVIDE SIDEWALL EXHAUST FAN EF-1. FAN TO BE INSTALLED AS HIGH AS POSSIBLE.
3	PROVIDE NEW FAN FORCE ENTRANCE HEATER. 30.5 MBH (8.9 KW). CONNECT SUPPLY AND RETURN HEATING WATER PIPE TO CAPPED CONNECTION. BALANCE HEATING WATER FLOW.
4	PROVIDE NEW SECTION OF WALL FIN. CONNECT SUPPLY AND RETURN HEATING WATER PIPE TO CAPPED CONNECTION. BALANCE HEATING WATER FLOW.
5	ELECTRIC BASEBOARD HEATER BY ELECTRICAL TRADE.
6	PROVIDE CONTINUOUS 150 MM BAR GRILLE ON TOP OF ENCLOSURE / MILLWORK.
7	PROVIDE NEW SINK. CONNECT DOMESTIC HOT AND COLD WATER, SANITARY, AND PLUMBING VENT TO EXISTING CAPPED CONNECTIONS.
8	CONNECT NEW 1000 SANITARY TO EXISTING SANITARY MAN AT CORRIDOR.
9	VENT ALL PLUMBING FIXTURES IN COMPLIANCE WITH BUILDING CODE.
10	RELOCATE EXISTING WALL CAVITY VENT.
11	UNDERCUT DOOR FOR WASHROOM EXHAUST MAKE-UP AIR.

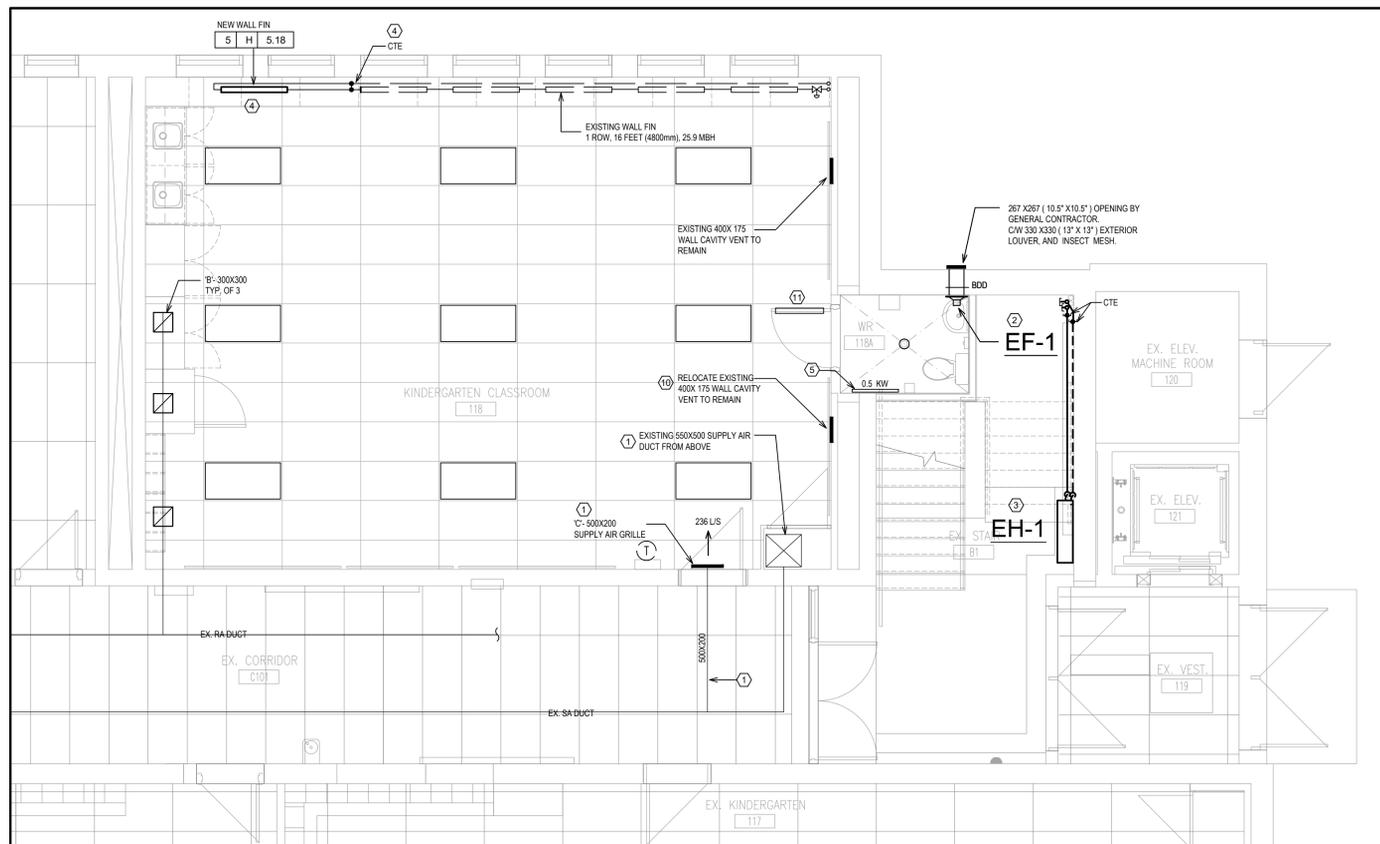

2 PART GROUND FLOOR - HVAC CONSTRUCTION PLAN
M-03 1:50

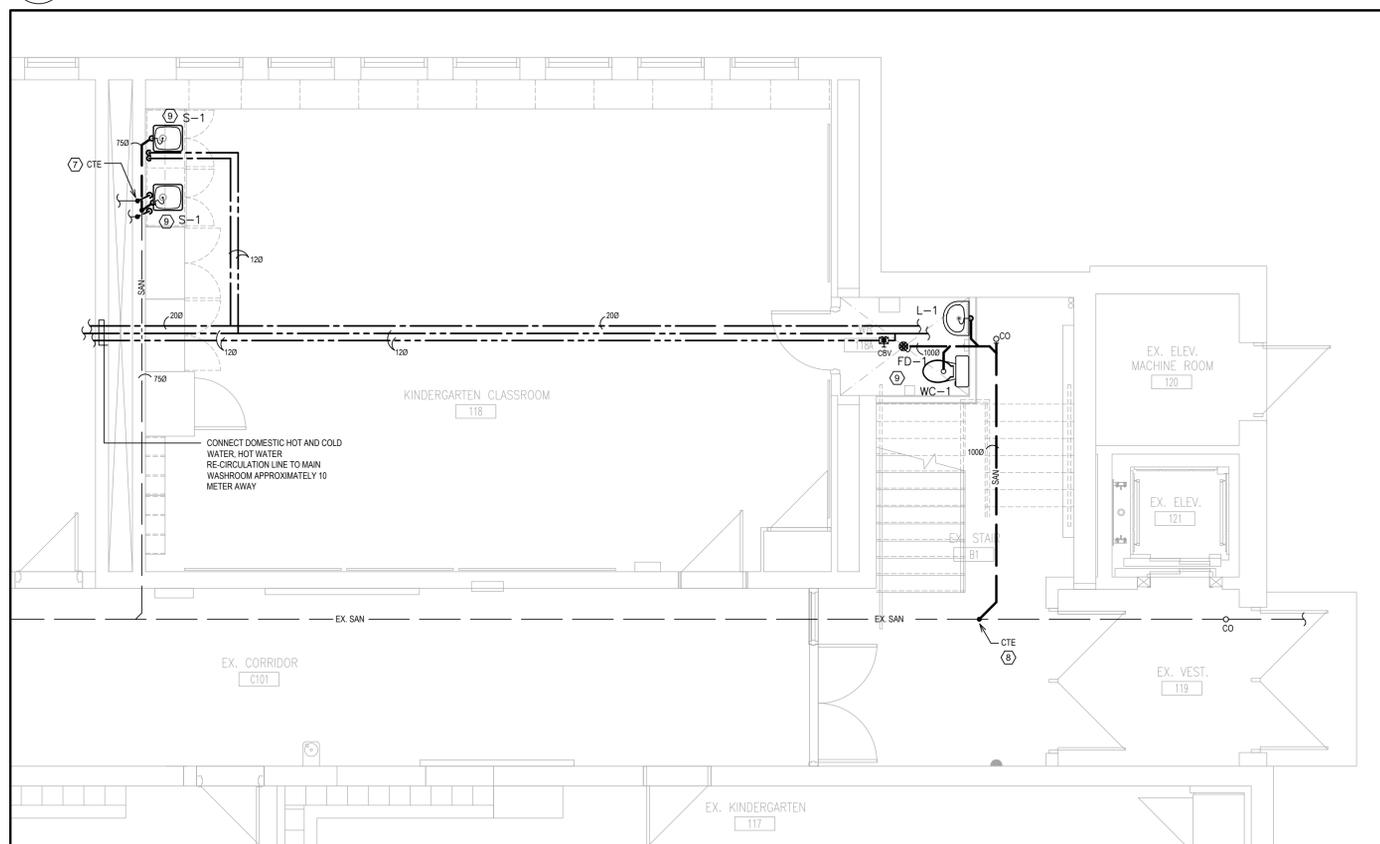

1 PART GROUND FLOOR - PLUMBING AND FIRE PROTECTION CONSTRUCTION PLAN
M-03 1:50

DO NOT SCALE THE DRAWINGS.
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES/ REVISIONS	DATE	BY
1	60% PROGRESS REVIEW	02-13-2026	ET/TL
2	ISSUED FOR PERMIT AND TENDER	03-06-2026	ET/TL

MCW MCW Consultants Ltd.
 Vancouver | Calgary | Queen's Quay Terminal
 Edmonton | Dauphin | 207 Queen's Quay West, Suite 615
 Winnipeg | Toronto | Toronto, Ontario, M5J 1A7
 Thunder Bay | Tel: 416-598-2820
 Ottawa | Montreal | Fax: 416-598-8204
 Saint John's | Toronto | www.mcw.com
 Halifax


BBA
 BARRY BRYAN ASSOCIATES

PROJECT:
 ECOLE ELEMENTAIRE
 MICHELINE-SAINT-CYR
 JK/SK RENOVATION


85 FORTY FIRST ST
 ETOBICOKE, ONTARIO

DRAWING:
 MECHANICAL
 CONSTRUCTION
 PLANS


DESIGN BY: ET
 DRAWN BY: ET
 CHECKED BY: PT
 DATE: DEC. 2025
 SCALE: AS NOTED



PROJECT NO: DRAWING NO:
25104-05 M-03

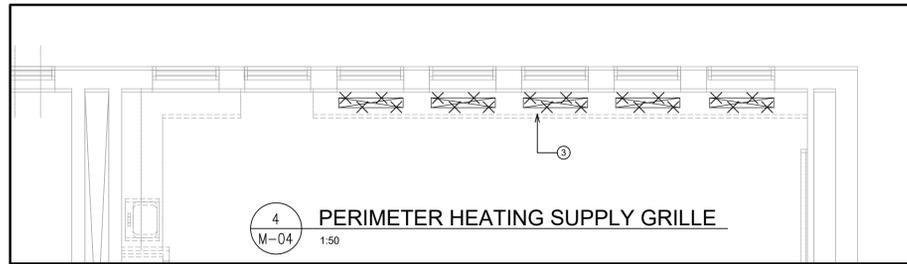


4 PERIMETER HEATING SUPPLY GRILLE
M-04 1:50

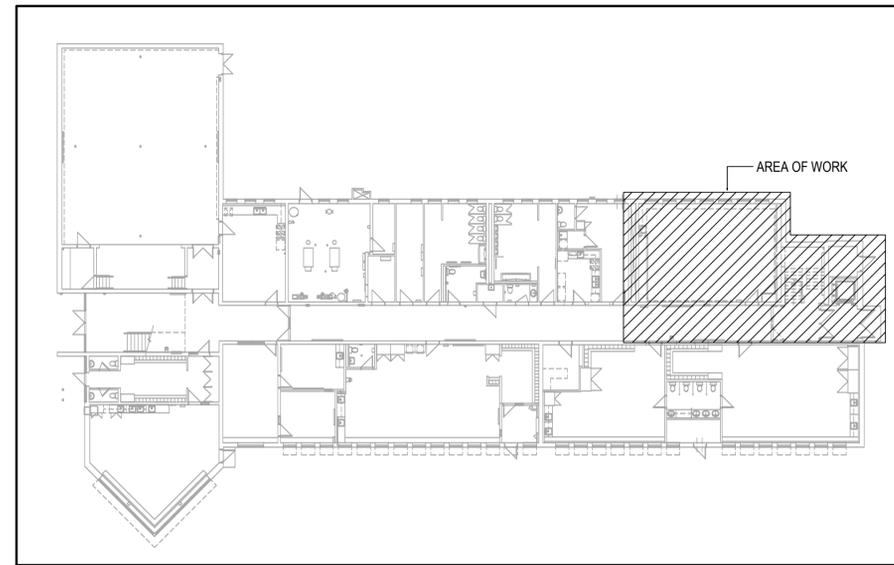


3 EXISTING FIRST FLOOR KEY PLAN
M-04 1:50

KEYNOTE	DESCRIPTION
1	EXISTING SUPPLY AND RETURN AIR DUCT TO REMAIN. CONTRACTOR TO RE-BALANCE SUPPLY AIR QUANTITY AND REPORT TO OWNER AND CONSULTANT BEFORE CONSTRUCTION WORK. TYPICAL REPLACE EXISTING SUPPLY AND RETURN GRILLE WITH NEW.
2	EXISTING HEATING BARE WALL FIN IN ENCLOSURE TO REMAIN. REFER TO DRAWING M-03 FOR MODIFICATION.
3	REMOVE EXISTING PERIMETER HEATING GRILLE. TYPICAL OF 6.
4	REMOVE EXISTING HEATING WALL FIN AND ENCLOSURE AT STAIR LANDING. CAP HEATING PIPE FOR FUTURE MODIFICATIONS.
5	REMOVE EXISTING HEATING WALL FIN AND ENCLOSURE AT GROUND FLOOR UNDER STAIR. CAP HEATING PIPE FOR FUTURE MODIFICATIONS.
6	REMOVE EXISTING SINK, CAP DOMESTIC HOT & COLD WATER, SANITARY PIPE, VENT PIPE FOR NEW MODIFICATIONS.

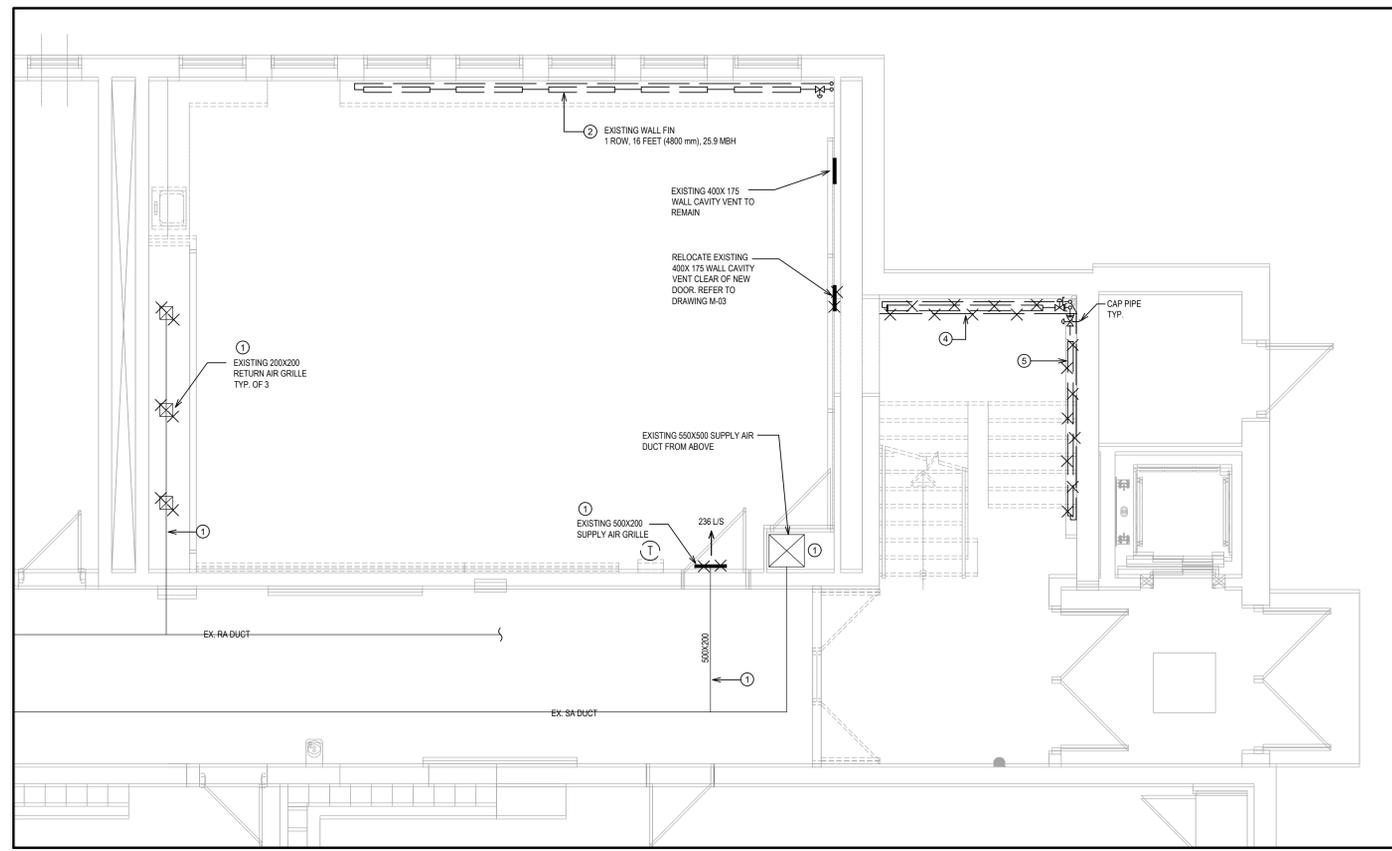

2 PART GROUND FLOOR - HVAC DEMOLITION PLAN
M-04 1:50

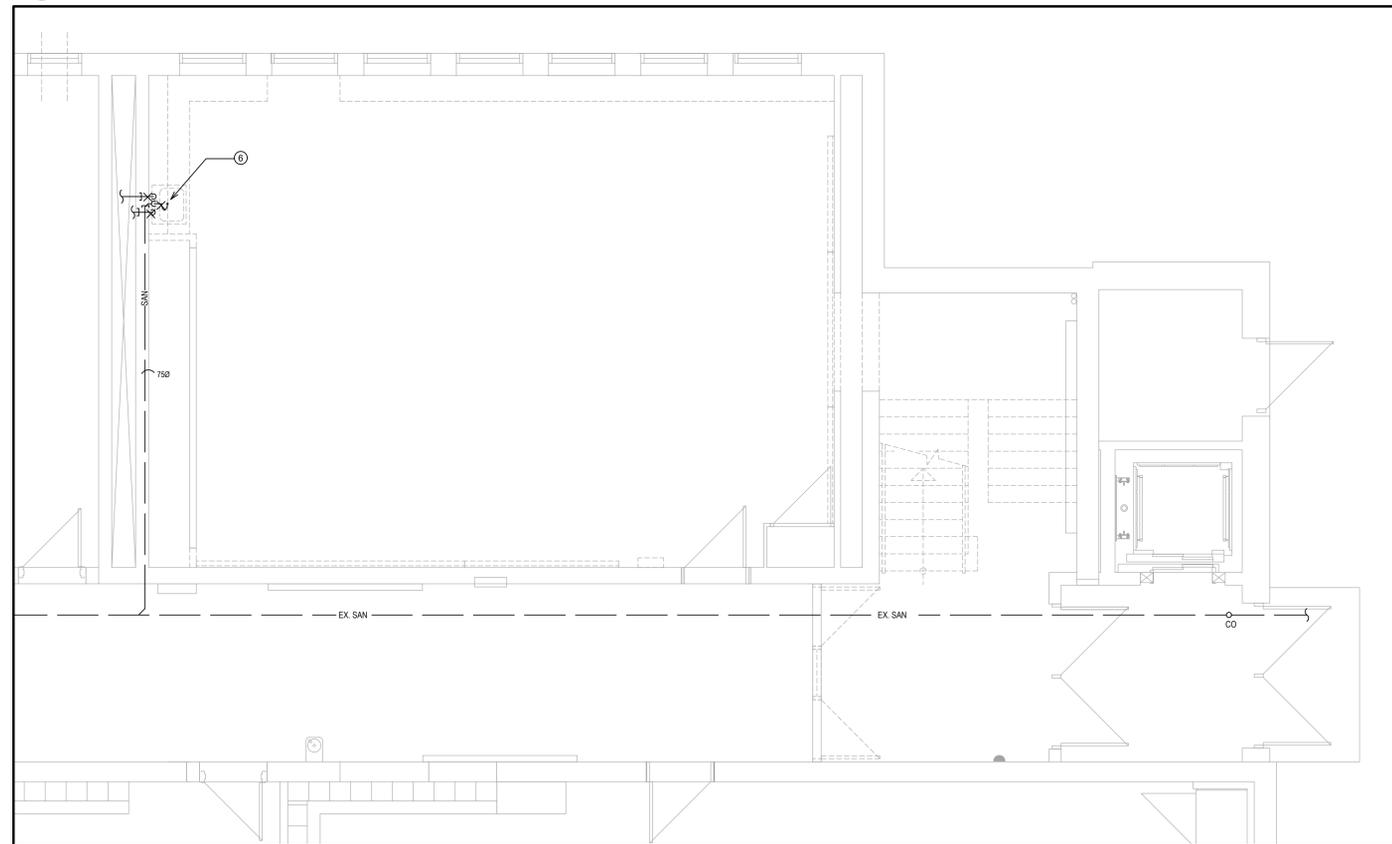

1 PART GROUND FLOOR - PLUMBING AND FIRE PROTECTION DEMOLITION PLAN
M-04 1:50

DO NOT SCALE THE DRAWINGS.
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES/ REVISIONS	DATE	BY
1	60% PROGRESS REVIEW	02-13-2026	ET/TL
2	ISSUED FOR PERMIT AND TENDER	03-06-2026	ET/TL

MCW *MCW Consultants Ltd.*
 Vancouver | Calgary | Queen's Quay Terminal
 Edmonton | Dauphin | 207 Queen's Quay West, Suite 615
 Winnipeg | Toronto | Toronto, Ontario, M5J 1A7
 Thunder Bay | Tel: 416-598-2820
 Ottawa | Moncton | Fax: 416-598-8204
 Saskatoon | Truro | www.mcw.com
 Halifax

BBA
 BARRY BRYAN ASSOCIATES

PROJECT:
 ECOLE ELEMENTAIRE
 MICHELINE-SAINT-CYR
 JK/SK RENOVATION
 85 FORTY FIRST ST
 ETOBICOKE, ONTARIO

DRAWING:
 MECHANICAL DEMOLITION
 PLANS

DESIGN BY: ET
 DRAWN BY: ET
 CHECKED BY: PT
 DATE: DEC. 2025
 SCALE: AS NOTED
 PROJECT NO: DRAWING NO:



25104-05 M-04

DO NOT SCALE THE DRAWINGS.
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.
ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE
COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED
UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE
WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.
DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED
AND SEALED BY THE CONSULTANT.



ELECTRICAL SYMBOL LEGEND		ELECTRICAL DRAWING LIST														
<p>LIGHTING</p> <p>LINEAR FLUORESCENT LUMINAIRE, TYPE 'A' AS SPECIFIED. HATCHING DENOTES CONNECTED TO EMERGENCY/NIGHT LIGHTING CIRCUIT</p> <p>CEILING MOUNTED LUMINAIRE, TYPE 'A' AS SPECIFIED</p> <p>WALL MOUNTED LUMINAIRE, TYPE 'A' AS SPECIFIED</p> <p>POLE MOUNTED LUMINAIRE, TYPE 'H' AS SPECIFIED</p> <p>DOUBLE SURFACE MOUNTED EMERGENCY LIGHTING REMOTE HEADS, TYPE 'BU-1' INDICATES BATTERY BANK FED FROM</p> <p>CEILING MOUNTED EMERGENCY LIGHTING REMOTE HEAD</p> <p>EMERGENCY LIGHTING BATTERY UNIT C/W DUPLEX RECEPTACLE AND DOUBLE REMOTE HEADS, TYPE 'BU-1' AS SPECIFIED.</p> <p>WALL MOUNTED DOUBLE FACED EXIT LIGHT AND DIRECTIONAL ARROWS AS INDICATED. SHADED AREAS DENOTE DIRECTION OF FACE OF EXIT SIGN. 'BU-1' INDICATES BATTERY UNIT FED FROM.</p> <p>WALL MOUNTED SINGLE FACED EXIT LIGHT AND DIRECTIONAL ARROWS AS INDICATED. SHADED AREAS DENOTE DIRECTION OF FACE OF EXIT SIGN.</p> <p>CEILING MOUNTED DOUBLE FACED EXIT LIGHT AND DIRECTIONAL ARROWS AS INDICATED. SHADED AREAS DENOTE DIRECTION OF FACE OF EXIT SIGN.</p> <p>CEILING MOUNTED SINGLE FACED EXIT LIGHT AND DIRECTIONAL ARROWS AS INDICATED. SHADED AREAS DENOTE DIRECTION OF FACE OF EXIT SIGN.</p> <p>SECURITY AND ACCESS SYSTEMS</p> <p>SECURITY SYSTEM CONTROL PANEL</p> <p>KEY PAD</p> <p>CARD READER</p> <p>INFRA RED READER</p> <p>REQUEST TO EXIT MOTION DETECTOR</p> <p>EGRESS MOTION DETECTOR</p> <p>DOOR CONTACT</p> <p>ELECTRIC STRIKE</p> <p>AUDIBLE ALARM</p> <p>MOTION DETECTOR</p> <p>MOTION SENSOR RELEASE</p> <p>SECURITY SYSTEM MONITOR</p> <p>MAGLOCK DEVICE</p> <p>MAGLOCK RESET SWITCH</p> <p>KEY SWITCH</p> <p>CODE BLUE SPEAKER PHONE</p> <p>CODE BLUE INTEGRATED UNIT C/W ACCESSORIES, POLE OR PEDESTAL MOUNTED</p> <p>CLOSED CIRCUIT CAMERA</p> <p>PUSH ASSISTANCE</p> <p>AUTOMATIC DOOR OPENER</p> <p>WAVE TO DEPN</p> <p>WAVE TO LOCK</p> <p>AUDIBLE AND VISUAL SIGNAL DEVICE</p>	<p>EQUIPMENT CONNECTIONS AND CONTROLS</p> <p>DIRECT CONNECTION - 120 OR 208V AS SPECIFIED</p> <p>DIRECT CONNECTION - 374 OR 600V AS SPECIFIED</p> <p>DIRECT CONNECTION - 120 OR 208V C/W UNFUSED DISCONNECT SWITCH AS SPECIFIED</p> <p>DIRECT CONNECTION - 347 OR 600V C/W UNFUSED DISCONNECT SWITCH AS SPECIFIED</p> <p>DIRECT CONNECTION - 120 OR 208V C/W FUSED DISCONNECT SWITCH AS SPECIFIED</p> <p>DIRECT CONNECTION - 347 OR 600V C/W FUSED DISCONNECT SWITCH AS SPECIFIED</p> <p>MODULAR FURNITURE WHP CONNECTION. PROVIDE HARD-WIRE CONNECTION AND CONDUIT SIZE AS PER COMMUNICATION DRAWINGS C - DENOTES FOR COMMUNICATION P - DENOTES FOR POWER</p> <p>AS ABOVE FOR POLE MOUNTED. POLE IS PART OF SYSTEM FURNITURE</p> <p>POWER AND COMMUNICATION HARDWARE CONNECTIONS ON FLOOR, CORE DRILL OR TRENCHING CONCRETE FLOOR AS REQUIRED</p> <p>MOTOR CONNECTION C/W UNFUSED DISCONNECT SWITCH</p> <p>MOTOR CONNECTION C/W FUSED DISCONNECT SWITCH</p> <p>MOTOR CONNECTION C/W LOOSE STARTER</p> <p>MOTOR STARTER AS SPECIFIED</p> <p>UNFUSED DISCONNECT SWITCH</p> <p>FUSED DISCONNECT SWITCH</p> <p>HAND DRYER</p> <p>THERMOSTAT PROVIDED BY DIV. 15 AND WIRED BY DIV. 16</p> <p>GENERAL POWER</p> <p>20A, TWISTLOCK L5-20R, U-GROUND SINGLE RECEPTACLE</p> <p>15A, U-GROUND DUPLEX RECEPTACLE</p> <p>USB CHARGER/15A, U-GROUND DUPLEX RECEPTACLE, HUBBELL CAT# USB15ASW</p> <p>15A, U-GROUND QUAD RECEPTACLE</p> <p>20A, (5-20R) T-SLOT U-GROUND DUPLEX RECEPTACLE</p> <p>15A, U-GROUND SINGLE OR DUPLEX RECEPTACLE - MOUNTED ABOVE COUNTER</p> <p>15A, U-GROUND SINGLE INSULATED/ISOLATED GROUND RECEPTACLE - STANDARD MOUNTING HEIGHT OR MOUNTED ABOVE COUNTER</p> <p>15A, U-GROUND DUPLEX INSULATED/ISOLATED GROUND RECEPTACLE - STANDARD MOUNTING HEIGHT OR MOUNTED ABOVE COUNTER</p> <p>(5-20R) T-SLOT U-GROUND DUPLEX INSULATED/ISOLATED GROUND RECEPTACLE - STANDARD MOUNTING HEIGHT OR MOUNTED ABOVE COUNTER</p> <p>120/208V/1000 AMP DRYER OUTLET</p> <p>120/208V/1040 AMP RANGE OUTLET</p> <p>SINGLE SPECIAL RECEPTACLE - AMPACITY AS INDICATED, TYPE 'A' AS SPECIFIED</p> <p>15A, U-GROUND SPLIT WIRED DUPLEX RECEPTACLE - STANDARD MOUNTING HEIGHT OR MOUNTED ABOVE COUNTER</p> <p>15A, U-GROUND HALF SWITCHED DUPLEX RECEPTACLE - STANDARD MOUNTING HEIGHT OR MOUNTED ABOVE COUNTER (CONTROLLED BY SWITCH)</p> <p>15A, U-GROUND DUPLEX RECEPTACLE C/W GROUND FAULT CIRCUIT INTERRUPTER - STANDARD MOUNTING HEIGHT OR MOUNTED ABOVE COUNTER</p> <p>(5-20R) T-SLOT U-GROUND DUPLEX RECEPTACLE C/W GROUND FAULT CIRCUIT INTERRUPTER</p> <p>15A, U-GROUND SINGLE RECEPTACLE - FLUSH FLOOR MOUNTED UNLESS NOTED OTHERWISE</p> <p>15A, U-GROUND DUPLEX RECEPTACLE - FLUSH FLOOR MOUNTED UNLESS NOTED OTHERWISE</p> <p>15A, U-GROUND DUPLEX RECEPTACLE - FLUSH CEILING MOUNTED UNLESS NOTED OTHERWISE</p> <p>(5-20R) T-SLOT U-GROUND DUPLEX RECEPTACLE - FLUSH CEILING MOUNTED UNLESS NOTED OTHERWISE</p>	<p>FIRE ALARM SYSTEM</p> <p>PULL STATION</p> <p>CEILING FLUSH VERTICAL MOUNTED BELL C/W FLUSH MTD. BOX</p> <p>FLUSH MOUNTED HORN</p> <p>DOUBLE HORN - CEILING OR WALL MOUNTED</p> <p>SUITE ISOLATOR MODULE</p> <p>STROBE - WALL OR CEILING MOUNTED</p> <p>FLUSH MOUNTED SPEAKER - WALL OR CEILING MOUNTED</p> <p>SURFACE MOUNTED SPEAKER - WALL OR CEILING MOUNTED</p> <p>FIREMEN HANDSET</p> <p>FIRE ALARM SYSTEM SPEAKER</p> <p>AUTOMATIC COMBINATION FIXED TEMPERATURE/RATE OF RISE HEAT DETECTOR - WALL OR CEILING MOUNTED</p> <p>AUTOMATIC FIXED TEMPERATURE HEAT DETECTOR - WALL OR CEILING MOUNTED</p> <p>SMOKE DETECTOR - WALL OR CEILING MOUNTED</p> <p>DUCT TYPE SMOKE DETECTOR WITH REMOTE ANNUNCIATION</p> <p>SINGLE STATION TYPE SMOKE DETECTOR C/W RED INDICATION LIGHT - WALL OR CEILING MOUNTED</p> <p>SINGLE STATION TYPE SMOKE/CARBON MONOXIDE DETECTOR C/W RED INDICATION LIGHT - WALL OR CEILING MOUNTED</p> <p>CARBON MONOXIDE DETECTOR - WALL OR CEILING MOUNTED</p> <p>DOOR HOLDER</p> <p>LIGHTING CONTROL</p> <p>ONE, TWO, THREE AND FOUR GANG SINGLE POLE TOGGLE SWITCHES</p> <p>3-WAY SWITCH</p> <p>4-WAY SWITCH</p> <p>KEY OPERATED LIGHT SWITCH</p> <p>DLM WIRED STANDARD SWITCH, MANUAL ON AUTO OFF LEGRAND, CAT# LMSW-210-WH</p> <p>DUAL TECHNOLOGY WALL SWITCH OCCUPANCY SENSOR LEGRAND, CAT# DSM-301-WH</p> <p>DLM WIRED STANDARD SWITCH, DIMMING LEGRAND, CAT# LMSW-211-WH</p> <p>FAN CONTROL SWITCH</p> <p>LUTRON VARIABLE SPEED FAN CONTROL SWITCH NTF SERIES</p> <p>MANUAL TIMER SWITCH</p> <p>PROGRAMMABLE TIME CLOCK, TYPE 'A' AS SPECIFIED</p> <p>DLM DUAL TECH CEILING MOUNTED OCCUPANCY SENSOR LEGRAND, CAT# LMDC-100-WH C/W ROOM CONTROLLER LMR-101</p> <p>PHOTO ELECTRIC CONTROL</p> <p>MISCELLANEOUS</p> <p>INDICATES EXISTING DEVICE TO REMAIN</p> <p>INDICATES EXISTING DEVICE TO BE MOVED</p> <p>INDICATES EXISTING DEVICE IN RELOCATED POSITION</p> <p>INDICATES EXISTING DEVICE TO BE DEMOLISHED</p> <p>INDICATES CONDUIT</p> <p>ELECTRICAL DRAWING NOTES</p>	<p>COMMUNICATIONS</p> <p>WALL MOUNTED COMBINATION MULTI-FUNCTION HDMI AND VGA OUTLETS, 1 1/2" TO ACCESSIBLE T-BAR CEILING SPACE BY DIV. 16.</p> <p>2 GANG MUDRING</p> <p>WALL MOUNTED TELEVISION OUTLET PWR FOR SATELLITE (R66 PLENUM RATED CABLE), TO TERMINATE TO THE SERVER ROOM, 3/4" TO ACCESSIBLE T-BAR CEILING SPACE BY DIV. 16.</p> <p>FLUSH CEILING MOUNTED TELEVISION OUTLET PWR FOR SATELLITE (R66 PLENUM RATED CABLE), TO TERMINATE TO THE SERVER ROOM.</p> <p>VOIP TELEPHONE OUTLET - WALL MOUNTED OR MOUNTED ABOVE COUNTER. PROVIDE 3/4" CONDUIT FROM OUTLET TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>VOIP TELEPHONE OUTLET - FLUSH CEILING MOUNTED UNLESS NOTED OTHERWISE. PROVIDE 3/4" TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>TELEPHONE OUTLET - FLUSH FLOOR MOUNTED PROVIDE 3/4" TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>VOIP DATA OUTLET - WALL MOUNTED OR MOUNTED ABOVE COUNTER. PROVIDE 3/4" CONDUIT TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>VOIP DATA OUTLET - FLUSH CEILING MOUNTED UNLESS NOTED OTHERWISE. PROVIDE 3/4" CONDUIT TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>VOIP DATA OUTLET - FLUSH FLOOR MOUNTED. PROVIDE 3/4" CONDUIT TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>COMBINATION DATA & COAXIAL OUTLET - WALL MOUNTED OR MOUNTED ABOVE COUNTER. PROVIDE 1" CONDUIT TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>VOIP DATA OUTLET - FLUSH CEILING MOUNTED UNLESS NOTED OTHERWISE. PROVIDE 3/4" CONDUITS TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>VOIP DATA OUTLET - FLUSH FLOOR MOUNTED TYPE TO MATCH EXISTING. PROVIDE 3/4" CONDUIT TO ACCESSIBLE T-BAR CEILING SPACE</p> <p>SIGNAL PUSHBUTTON</p> <p>SIGNAL BELL C/W TRANSFORMER</p> <p>INTERCOM MASTER STATION</p> <p>INTERCOM STATION</p> <p>FLUSH MOUNTED AUXILIARY SOUND SYSTEM SPEAKER - WALL MOUNTED OR CEILING MOUNTED</p> <p>SURFACE MOUNTED AUXILIARY SOUND SYSTEM SPEAKER - WALL MOUNTED OR CEILING MOUNTED</p> <p>MICROPHONE JACK</p> <p>PUBLIC ADDRESS SPEAKER, TYPE 'A' AS SPECIFIED</p> <p>VOLUME CONTROL SWITCH</p> <p>PROJECTION SOUND JACK</p> <p>SOUND BRIDGING JACK</p> <p>AMPLIFIER</p> <p>CONSOLE OR RACK C/W TERMINAL BOX</p> <p>POWER DISTRIBUTION</p> <p>POWER TRANSFORMER</p> <p>POWER TRANSFORMER C/W ELECTROSTATIC SHIELD</p> <p>CURRENT CONTROL TRANSFORMER</p> <p>INCOMING POWER INTERRUPTER SWITCH</p> <p>DISCONNECT SWITCH</p> <p>MOLDED CASE CIRCUIT BREAKER</p> <p>DRAW OUT AIR CIRCUIT BREAKER</p> <p>FIXED AIR CIRCUIT BREAKER</p> <p>ELECTRIC HEATING</p> <p>SURFACE WALL MOUNTED ELECTRIC BASEBOARD HEATER</p> <p>BRANCH CIRCUITING LEGEND</p> <p>2EP1-3 - DENOTES CIRCUIT NUMBER PT - DENOTES LOCATION OF PANEL (P1 LEVEL) E - DENOTES EMERGENCY PANEL Z - DENOTES 120/208V OR W - DENOTES 347/600V</p>	<table border="1"> <tr> <td>E-01</td> <td>ELECTRICAL LEGEND, GENERAL NOTES AND DRAWING LIST</td> <td>N.T.S.</td> </tr> <tr> <td>E-02</td> <td>ELECTRICAL SPECIFICATIONS</td> <td>N.T.S.</td> </tr> <tr> <td>E-03</td> <td>ELECTRICAL CONSTRUCTION PLANS</td> <td>1:50</td> </tr> <tr> <td>E-04</td> <td>ELECTRICAL DEMOLITION PLANS</td> <td>1:50</td> </tr> </table> <p>DEMOLITION NOTES:</p> <ol style="list-style-type: none"> REMOVE AND DISPOSE OF ALL ELECTRICAL DEVICES AND EQUIPMENT SUCH AS LIGHT FIXTURES, RECEPTACLES, SYSTEMS OUTLETS, (e.g. SECURITY, TELEPHONE & DATA) etc. UNLESS OTHERWISE NOTED. DISCONNECT DEVICES AND/OR EQUIPMENT AT SOURCE AND REMOVE ALL ASSOCIATED CONDUITS AND WIRING AND MAKE GOOD. ALL FIRE ALARM AND LIFE SAFETY DEVICES SUCH AS PULL STATIONS, HORNS, DETECTORS, EXIT LIGHTS etc. SHALL REMAIN UNLESS OTHERWISE NOTED. WHERE MOUNTED ON CEILING BEING REMOVED OR ON WALLS BEING REMOVED, SUSPEND DEVICES SECURELY FROM STRUCTURE AND RE-CONNECT. CONNECTIONS FOR MECHANICAL EQUIPMENT BEING REMOVED SHALL BE DISCONNECTED AND REMOVED. REMOVE ALL ASSOCIATED WIRING AND CONDUITS, DISCONNECT AT SOURCE AND MAKE GOOD. EXACT EXTENT OF REMOVALS TO BE CONFIRMED ON SITE. IT IS THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO VERIFY EXACT EXTENT OF DEMOLITION/REMOVALS/RELOCATIONS ON SITE PRIOR TO PRICING THE WORK. ALL DRAWINGS TO BE READ IN CONJUNCTION WITH ARCHITECT'S DEMOLITION DRAWINGS. <p>GENERAL NOTES:</p> <ol style="list-style-type: none"> THE ELECTRICAL DRAWINGS ARE GENERALLY DIAGRAMMATIC. THE ELECTRICAL INSTALLATION SHALL BE COORDINATED WITH OTHER TRADES SO THAT INTERFERENCES BETWEEN THE ELECTRICAL INSTALLATION AND ARCHITECTURAL, STRUCTURE, MECHANICAL, PLUMBING, FIRE PROTECTION AND EQUIPMENT INSTALLATION WILL BE AVOIDED. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS, ROOM AND AREA FINISHED, CEILING PLANS, DOOR SWINGS, FIRE RELATED PARTITIONS, CABINET AND CASE WORK AND BUILT-IN DETAILS. ALL WIRING TO BE SIZE #12 AWG UNLESS NOTED OTHERWISE. CIRCUIT NUMBERS SHOWN ARE GROUPING ONLY. REFER ON JOB-SITE FOR EXACT CIRCUIT USED. ALL THE FINAL CONNECTIONS SHOWN ON THE DRAWINGS ARE ACTUAL REQUIREMENTS OF THE EQUIPMENT AND ARE SHOWN IN THEIR APPROXIMATE LOCATION. CO-ORDINATE WITH MECHANICAL AND ARCHITECTURAL DRAWINGS FOR EXACT LOCATION. ELECTRICAL SYSTEM EQUIPMENTS AND COMPONENTS SHALL BE CSA OR UL LISTED AND BE IN COMPLIANCE WITH THE REGULATIONS ON ONTARIO BUILDING CODE. 	E-01	ELECTRICAL LEGEND, GENERAL NOTES AND DRAWING LIST	N.T.S.	E-02	ELECTRICAL SPECIFICATIONS	N.T.S.	E-03	ELECTRICAL CONSTRUCTION PLANS	1:50	E-04	ELECTRICAL DEMOLITION PLANS	1:50
E-01	ELECTRICAL LEGEND, GENERAL NOTES AND DRAWING LIST	N.T.S.														
E-02	ELECTRICAL SPECIFICATIONS	N.T.S.														
E-03	ELECTRICAL CONSTRUCTION PLANS	1:50														
E-04	ELECTRICAL DEMOLITION PLANS	1:50														

NO.	ISSUES/ REVISIONS	DATE	BY
1	60% PROGRESS REVIEW	02-13-2026	ET/TL
2	ISSUED FOR PERMIT AND TENDER	03-06-2026	ET/TL

Vancouver | Calgary
 Edmonton | Dauphin
 Winnipeg | Toronto
 Thunder Bay
 Ottawa | Moncton
 Saint John | Trois
 Halifax
 25104-05

MCW Consultants Ltd.
 Queen's Quay Terminal
 207 Queen's Quay West, Suite 615
 Toronto, Ontario, M5J 1A7
 Tel: 416-598-2920
 Fax: 416-598-5204
 www.mcw.com



PROJECT:
 ECOLE ELEMENTAIRE
 MICHELINE-SAINT-CYR
 JK/SK RENOVATION

85 FORTY FIRST ST
 ETOBICOKE, ONTARIO

DRAWING:
ELECTRICAL LEGEND,
NOTES AND DRAWINGS LIST

DESIGN BY:	TL	SEAL:	
DRAWN BY:	TL		
CHECKED BY:	RL		
DATE:	DEC. 2025		
SCALE:	AS NOTED		
PROJECT NO:		DRAWING NO:	



25104-05 E-01


DO NOT SCALE THE DRAWINGS.
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.

ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.


DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES/ REVISIONS	DATE	BY
1	60% PROGRESS REVIEW	02-13-2026	ET/TL
2	ISSUED FOR PERMIT AND TENDER	03-06-2026	ET/TL

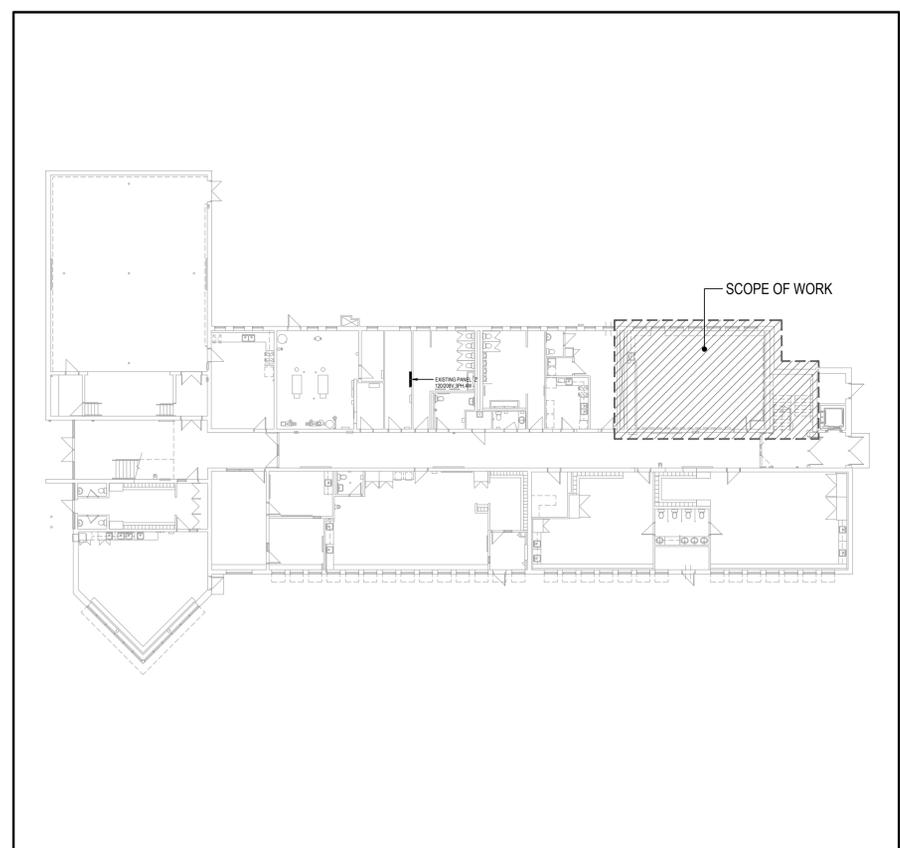

3
E-03
EXISTING FIRST FLOOR KEY PLAN
1:50

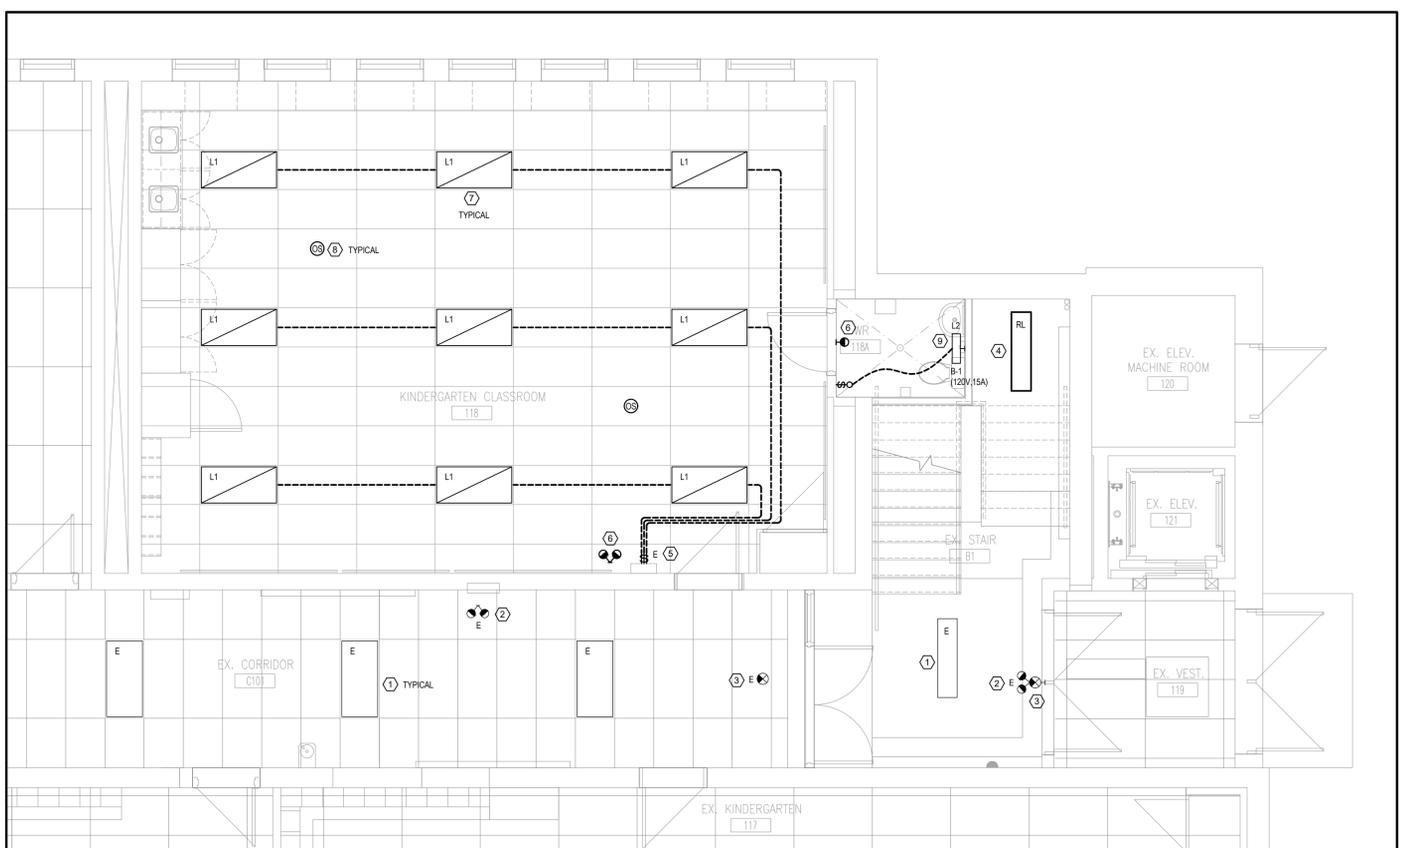

2
E-03
PART GROUND FLOOR - LIGHTING CONSTRUCTION PLAN
1:50


LIGHTING CONSTRUCTION KEYNOTES:

KEYNOTE:	DESCRIPTION:
1	EXISTING CORRIDOR LIGHTING TO REMAIN
2	EXISTING CORRIDOR EMERGENCY REMOTE HEAD TO REMAIN
3	EXISTING CORRIDOR EXIT SIGN TO REMAIN
4	RELOCATED CEILING SURFACE MOUNTED 1'x4' LIGHTING FIXTURE. EXTEND WIRING & CONDUIT TO SUIT CW NEW LAMPS
5	EXISTING LIGHTING SWITCHES ON CONTROL PANEL TO REMAIN
6	NEW EMERGENCY REMOTE HEADS. CONNECT TO EXISTING REMOTE HEAD CIRCUIT. TYPE TO MATCH EXISTING
7	NEW CEILING RECESSED 2'x4' LED SELECTABLE BACKLIT PANEL. DAY-NITE OFF BY SIGNIFY. CAT.#28P415L8C54-UVV-DIM-120V. CONNECT TO EXISTING LIGHTING CIRCUIT WITHIN THE ROOM
8	NEW CEILING MOUNTED OCCUPANCY SENSOR FOR CONTROLLING ALL LIGHTING FIXTURE WITHIN THE ROOM
9	WALL MOUNTED LED LINEAR VANITY LIGHT. ELITE LIGHTING. CAT.#0VLS-LED-18-1300L-120V-3000K-90-CH (CHROME)

POWER/COMM. CONST. KEYNOTES:

KEYNOTE:	DESCRIPTION:
1	EXISTING FIRE ALARM HORN TO REMAIN
2	EXISTING FIRE ALARM PULL STATION TO REMAIN
3	EXISTING PA SOUND SPEAKER TO REMAIN
4	EXISTING FIRE ALARM HEAT DETECTOR TO REMAIN
5	EXISTING GFI POWER OUTLET TO REMAIN
6	EXISTING CLASSROOM CONTROL PANEL TO REMAIN
7	RELOCATED FIRE ALARM HEAT DETECTOR. EXTEND WIRING AND CONDUIT TO SUIT
8	NEW 450W WALL MOUNTED AT 2 SIN FROM CEILING. RADIANCE COVE HEATER. STELPRO. CAT.#SCR045W-120V-WH CW BUILT-IN THERMOSTAT
9	REPLACE EXISTING AUTOMATIC DOOR PUSH BUTTON WITH NEW AUTOMATIC DOOR PUSH BUTTON
10	CONNECT NEW DOOR OPENER TO EXISTING DOOR OPENER POWER CIRCUIT.

- ELECTRICAL NOTES:**
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH MECHANICAL AND ARCHITECTURAL DRAWINGS.
 - REFER TO ARCHITECTURE DRAWINGS FOR DIMENSIONS.
 - ELECTRICAL OUTLETS MUST BE IDENTIFIED WITH PANEL AND CIRCUIT BREAKER NUMBER.
 - ALL COMMUNICATION CONDUIT WITH A DIAMETER OF 2" OR LESS SHALL HAVE A BEND RADIUS OF SIX TIMES THE CONDUIT DIAMETER.
 - COMMUNICATION CONDUIT RUNS SHALL HAVE NO CONTINUOUS SECTIONS BETWEEN PULL BOXES LONGER THAN 30M.
 - THE MAXIMUM NUMBER OF BENDS BETWEEN COMMUNICATION PULL BOXES SHALL NOT EXCEED TWO 90° BENDS.
 - CIRCUIT NUMBERS SHOWN ARE GROUPING ONLY. REFER ON JOB-SITE FOR EXACT CIRCUIT USED.

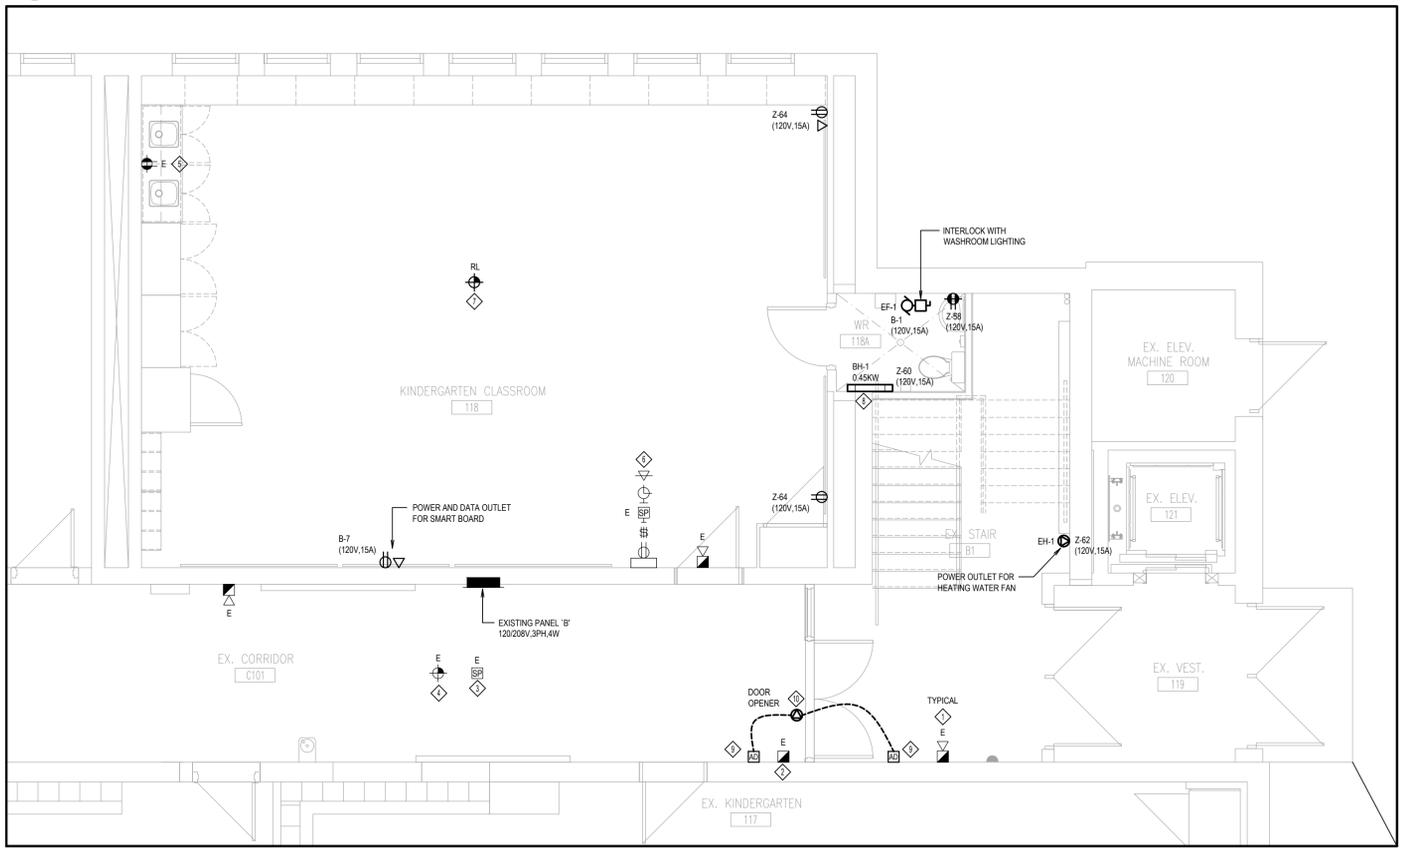

1
E-03
PART GROUND FLOOR - POWER & COMM. CONSTRUCTION PLAN
1:50

MCW
McW Consultants Ltd.

Vancouver Calgary
Edmonton Toronto
Winnipeg Toronto
Thunder Bay
Ottawa Moncton
Saint John's Truro
Halifax

Queen's Quay Terminal
207 Queen's Quay West, Suite 615
Toronto, Ontario, M5J 1A7
Tel: 416-598-2820
Fax: 416-598-8204
www.mcw.com

25104-05

BBA
BARRY BRYAN ASSOCIATES

PROJECT:
ECOLE ELEMENTAIRE
MICHELINE-SAINT-CYR
JK/SK RENOVATION

85 FORTY FIRST ST
ETOBICOKE, ONTARIO

DRAWING:
ELECTRICAL
CONSTRUCTION PLANS

DESIGN BY: TL
DRAWN BY: TL
CHECKED BY: RL
DATE: DEC. 2025
SCALE: AS NOTED

PROJECT NO: DRAWING NO:



25104-05 E-03


DO NOT SCALE THE DRAWINGS.
CHECK AND VERIFY ALL DIMENSIONS AT THE SITE.

ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE CONSULTANT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS IN PART OR WHOLE WITHOUT THE PERMISSION OF THE CONSULTANT IS FORBIDDEN.


DRAWINGS ARE NOT TO BE USED FOR CONSTRUCTION UNTIL SIGNED AND SEALED BY THE CONSULTANT.



NO.	ISSUES/ REVISIONS	DATE	BY
1	60% PROGRESS REVIEW	02-13-2026	ET/TL
2	ISSUED FOR PERMIT AND TENDER	03-06-2026	ET/TL

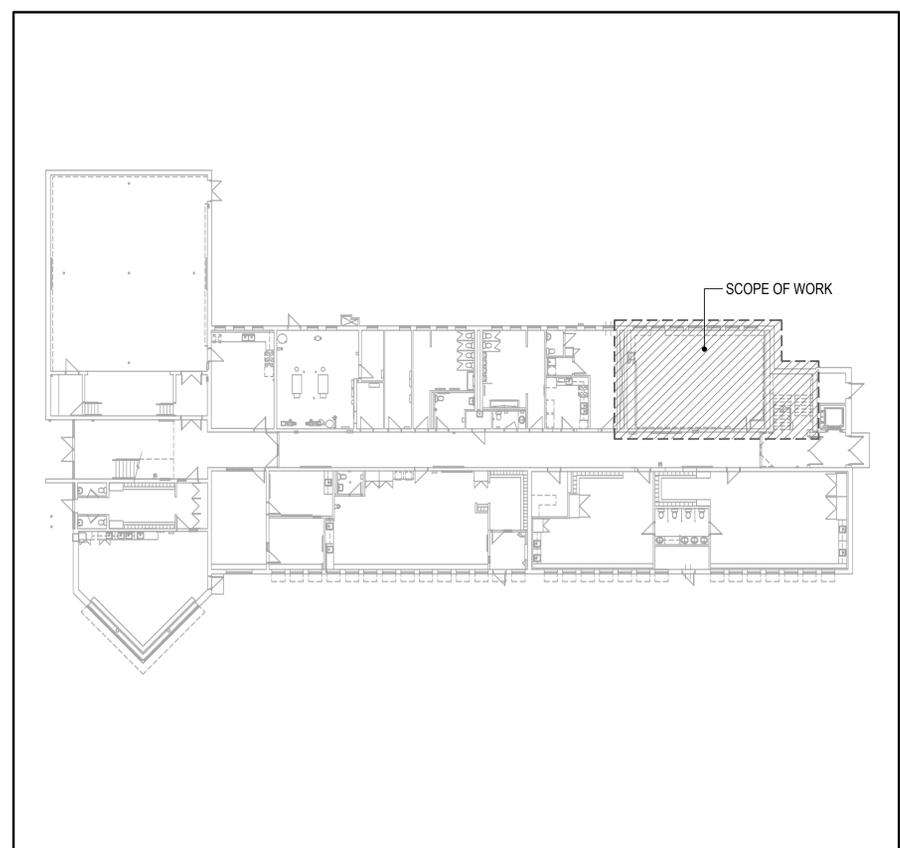

3
E-04
1:50
EXISTING FIRST FLOOR KEY PLAN

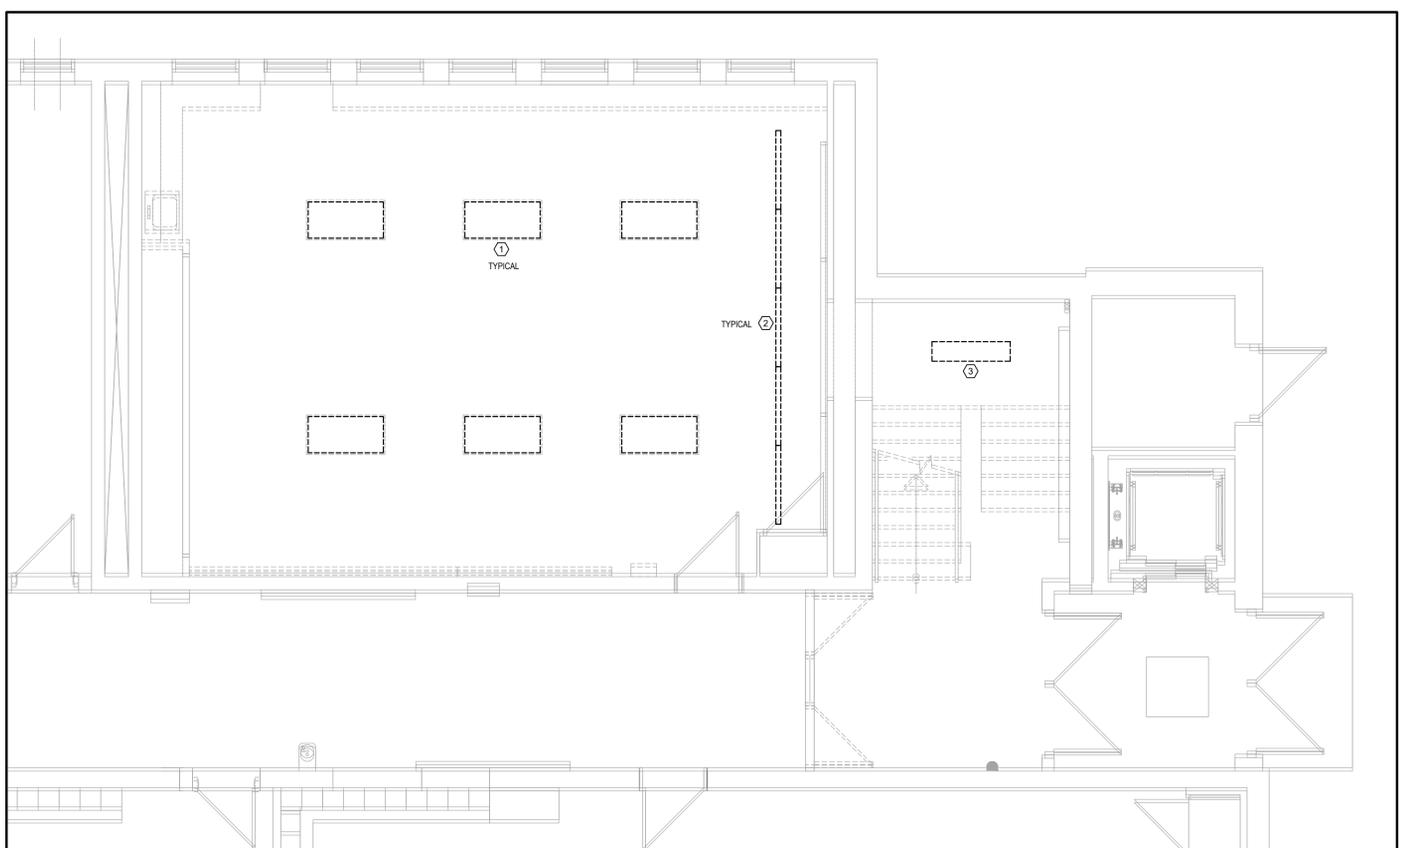

2
E-04
1:50
PART GROUND FLOOR - LIGHTING DEMOLITION PLAN

LIGHTING DEMOLITION KEYNOTES:


KEYNOTE:	DESCRIPTION:
①	EXISTING CEILING SURFACE MOUNTED 2'x4' FLUORESCENT LIGHTING FIXTURE TO BE DISCONNECTED AND DEMOLISHED
②	EXISTING CEILING SURFACE MOUNTED FLUORESCENT STRIP LIGHT TO BE DISCONNECTED AND DEMOLISHED
③	EXISTING CEILING SURFACE MOUNTED 1'x4' FLUORESCENT LIGHTING FIXTURE TO BE DISCONNECTED AND RELOCATED

POWER/COMM. DEMOLITION KEYNOTES:

KEYNOTE:	DESCRIPTION:
◇	EXISTING WIREMOLD RACEWAY TO BE DISCONNECTED AND DEMOLISHED
◇	EXISTING POWER AND DATA OUTLETS ON WIREMOLD RACEWAY DISCONNECTED AND DEMOLISHED
◇	EXISTING FIRE ALARM HEAT DETECTOR TO BE RELOCATED
◇	EXISTING AUTOMATIC DOOR PUSH BUTTON TO BE DISCONNECTED AND DEMOLISHED
◇	EXISTING DOOR OPENER TO BE DISCONNECTED AND DEMOLISHED

ELECTRICAL DEMOLITION NOTES:

- REMOVE AND DISPOSE OF ALL ELECTRICAL DEVICES AND EQUIPMENT SUCH AS LIGHT FIXTURES, RECEPTACLES, SYSTEMS OUTLETS, (e.g. SECURITY, TELEPHONE & DATA) etc. UNLESS OTHERWISE NOTED.
- DISCONNECT DEVICES AND/OR EQUIPMENT AT SOURCE AND REMOVE ALL ASSOCIATED CONDUITS AND WIRING AND MAKE GOOD.
- ALL FIRE ALARM AND LIFE SAFETY DEVICES SUCH AS PULL STATIONS, BELLS, DETECTORS, EXIT LIGHTS etc. SHALL REMAIN UNLESS OTHERWISE NOTED. WHERE MOUNTED ON CEILING BEING REMOVED OR ON WALLS BEING REMOVED, SUSPEND DEVICES SECURELY FROM STRUCTURE AND RE-CONNECT.
- ALL FLOOR MOUNTED OUTLETS SHALL BE CAPPED, REMOVE ALL ASSOCIATED WIRING AND CONDUITS, DISCONNECT AT SOURCE AND MAKE GOOD.
- CONNECTIONS FOR MECHANICAL EQUIPMENT BEING REMOVED SHALL BE DISCONNECTED AND REMOVED. REMOVE ALL ASSOCIATED WIRING AND CONDUITS, DISCONNECT AT SOURCE AND MAKE GOOD. EXACT EXTENT OF REMOVALS TO BE CONFIRMED ON SITE.
- IT IS THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR TO VERIFY EXACT EXTENT OF DEMOLITION/REMOVALS/RELOCATIONS ON SITE PRIOR TO PRICING THE WORK. ALL DRAWING TO BE READ IN CONJUNCTION WITH ARCHITECT'S DEMOLITION DRAWINGS.

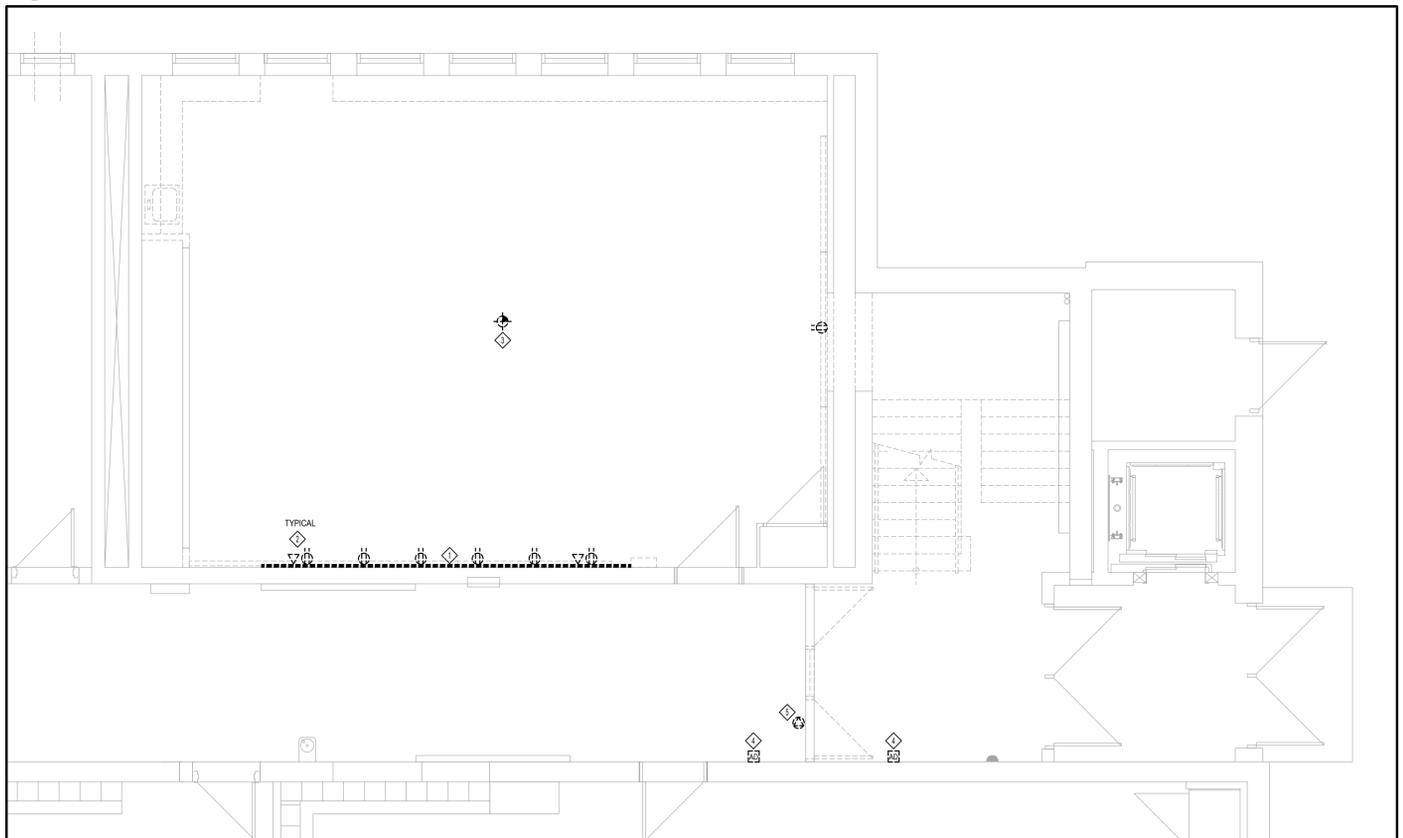

1
E-04
1:50
PART GROUND FLOOR - POWER & COMM. DEMOLITION PLAN

MCW
MCW Consultants Ltd.

Vancouver, Calgary, Edmonton, Regina, Winnipeg, Toronto, Thunder Bay, Ottawa, Montreal, Saint John, Toronto, Halifax

Queen's Quay Terminal
207 Queen's Quay West, Suite 615
Toronto, Ontario, M5J 1A7
Tel: 416-598-2820
Fax: 416-598-5304
www.mcw.com

25104-05

BBA
BARRY BRYAN ASSOCIATES

PROJECT:
ECOLE ELEMENTAIRE
MICHELINE-SAINT-CYR
JK/SK RENOVATION

85 FORTY FIRST ST
ETOBICOKE, ONTARIO

DRAWING:
ELECTRICAL
DEMOLITION PLANS

DESIGN BY: TL
DRAWN BY: TL
CHECKED BY: RL
DATE: DEC. 2025
SCALE: AS NOTED

PROJECT NO: DRAWING NO:



25104-05 E-04